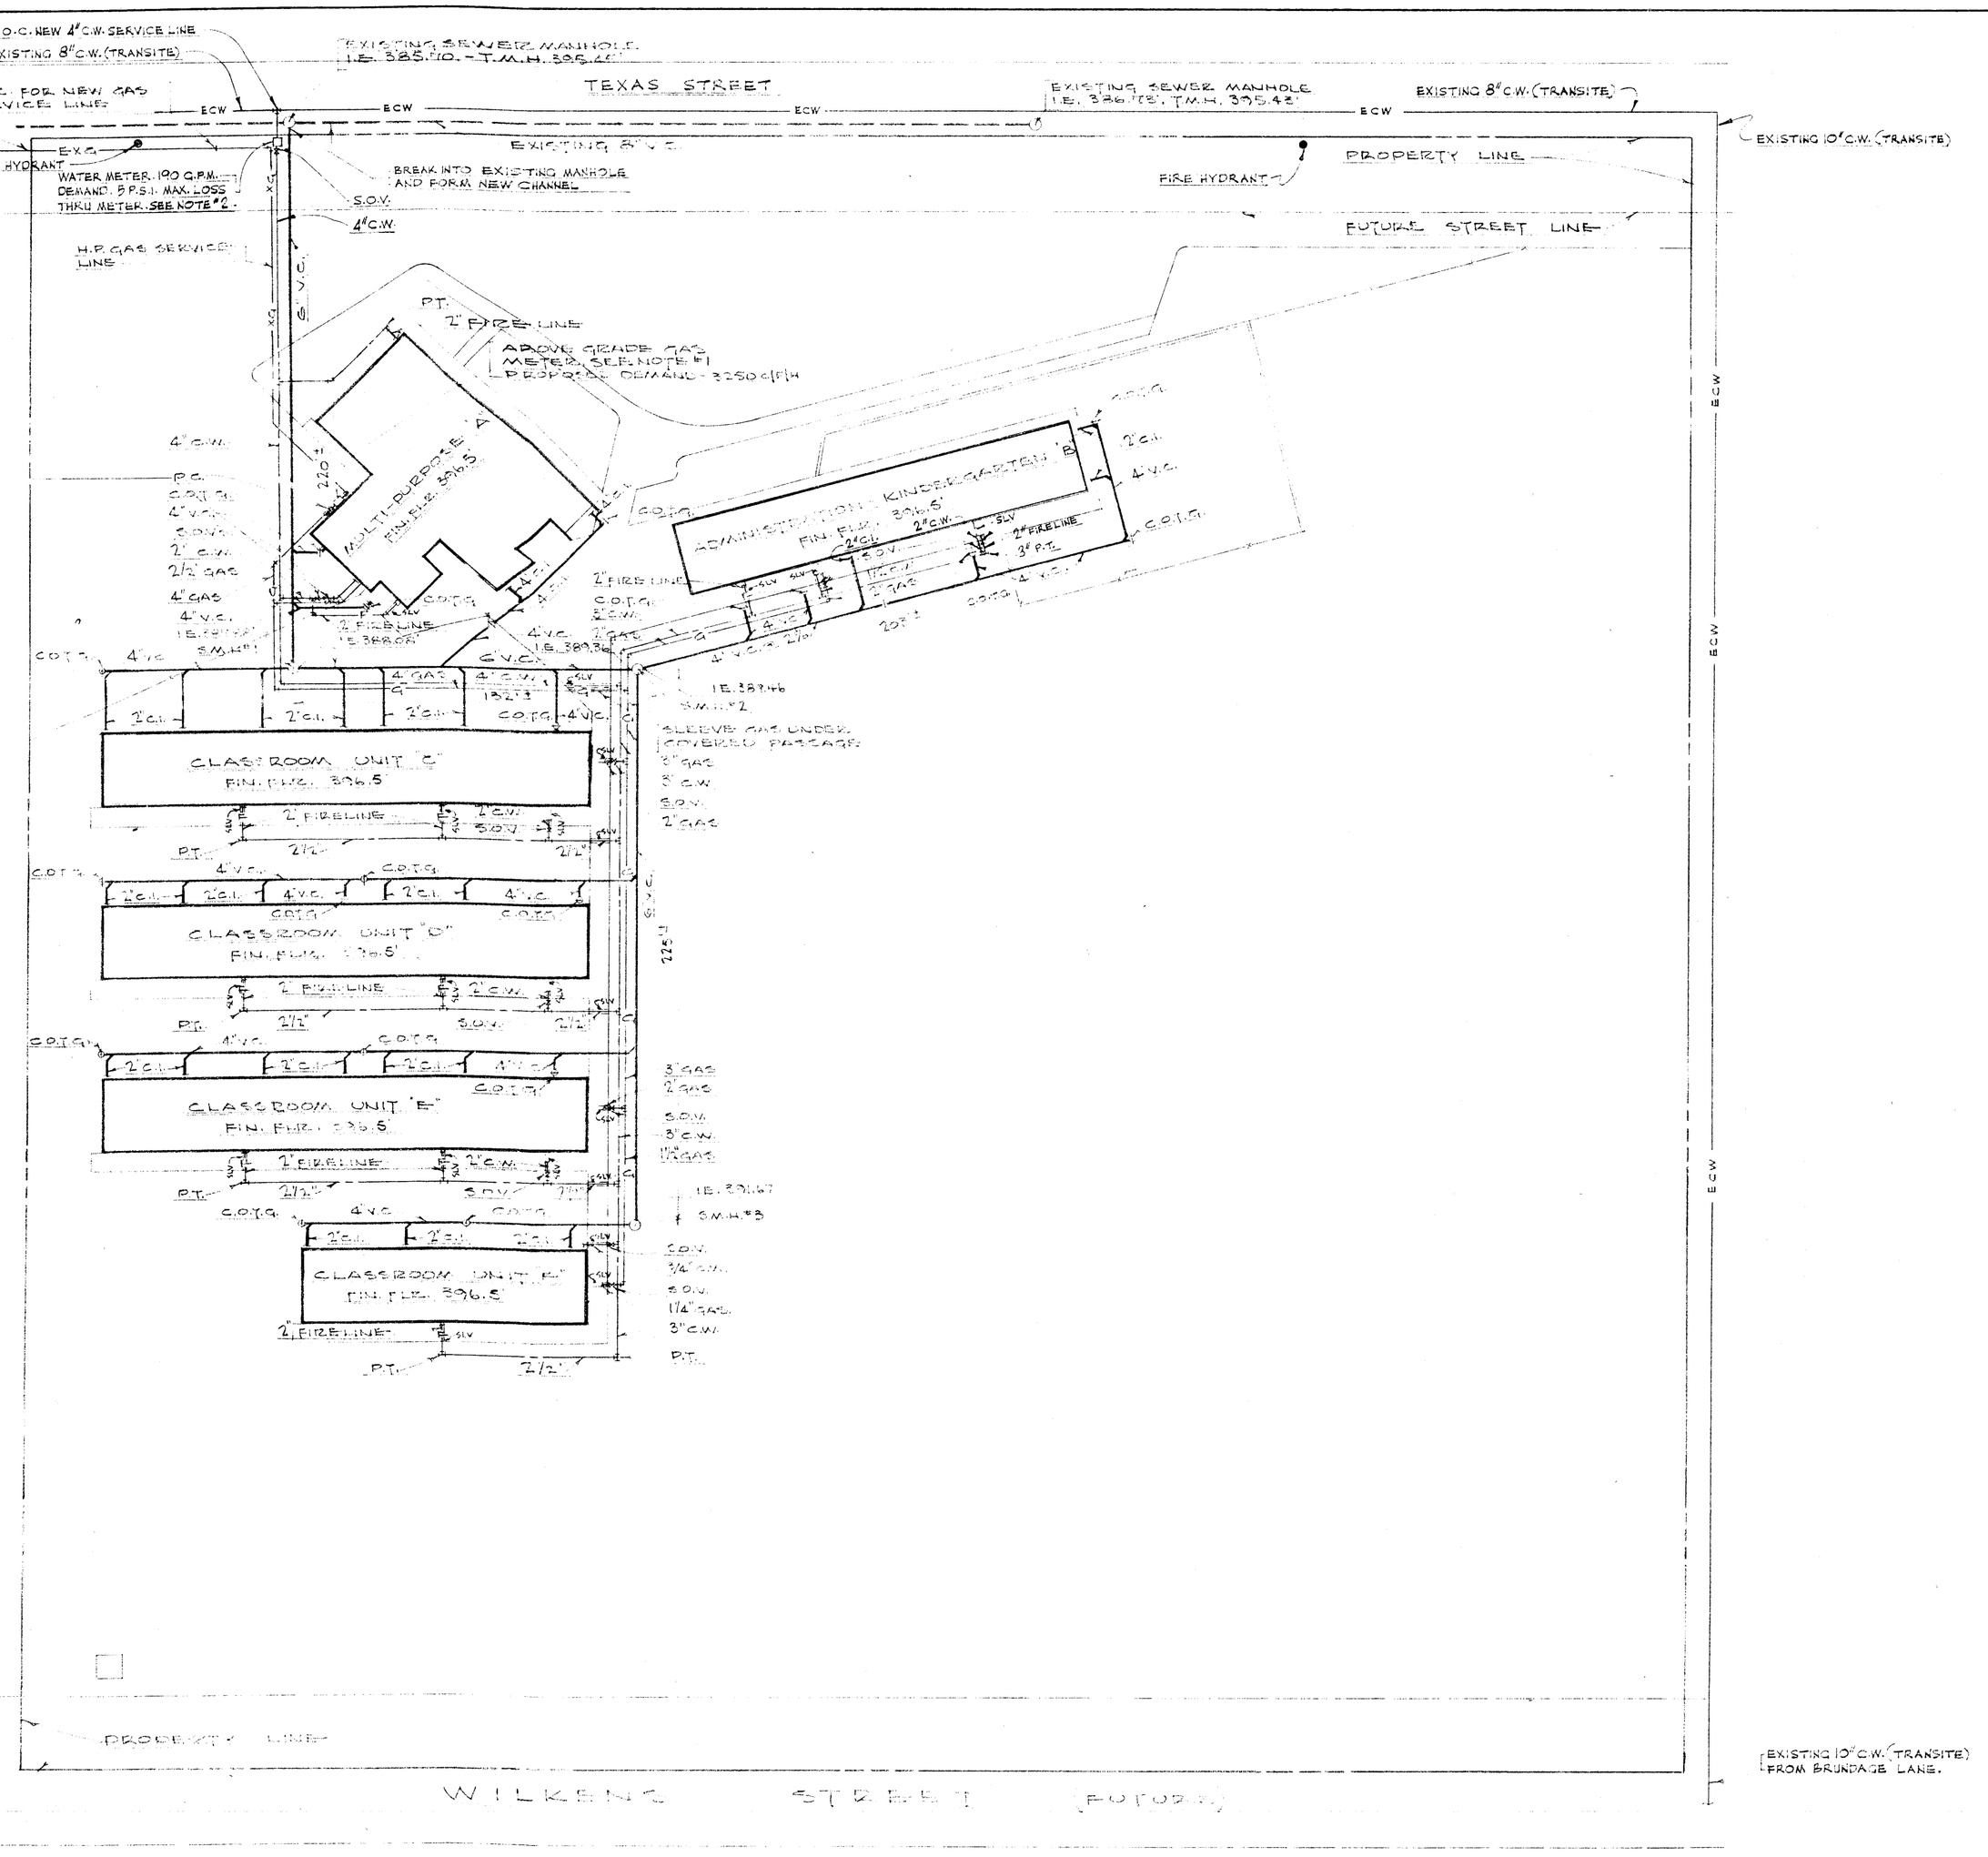

PLUMBING PLOT PLAN

SCALE 1" = 40'

N

PLUMBING SYMBOLS & ABBREVIATIONS

	SOIL WASTE, DEPT. & SEWER
	EXISTING SOIL WASTE, DOMN. & SEWER
W	INDIRECT WASTE
D	STORM DRAIN
	SANITARY VENT
	COLD WATER
	HOT WATER
	HOT WATER RETURN
T	TEMPERED WATER
I	HIGH TEMPERATURE WATER
FL	FIRE LINE
SL	SOIL LINE
SD	SOAP DISPENSER
G	FUEL GAS (LOW PRESSURE)
CO	CLEANOUT
WCO	WALL CLEANOUT
HB or SC	HOSE BIB OR SILLCOCK
SOV	SHUT OFF VALVE
CV	CHECK VALVE
GV	GATE VALVE
GLV	GLOBE VALVE
DC	PLUG COCK
PRV	PRESSURE REDUCING VALVE
SRV	PRESSURE RELIEF VALVE
	RISER
	ROOF
V	VENT
VO	VENT OFFSET
VTR	VENT THRU ROOF
ST	STUBBED TEE
SY	STUBBED WYE
FH	FIRE HYDRANT
FHC	FIRE HOSE CABINET
FHR	FIRE HOSE RACK
HTR	HEATER
DS	DOWNSPOUT
MH	MANHOLE
CB	CATCH BASIN
CI	CAST IRON
VC	VITRIFIED CLAY
S	SOIL
W	WASTE
HDR	HEADER
FIN. FLR.	FINISHED FLOOR
CLG.	CEILING
INV. EL.	INVERT ELEVATION
ABV.	ABOVE
BEL.	BELOW
LKS.	LOOSE KEY STOP
POC	POINT OF CONNECTION
COTG.	CLEANOUT TO GRADE
FE.	FIRE EXTINGUISHER
F.G.	FINISHED GRADE
N.I.C.	NOT IN CONTRACT
U.O.S.	UNDER, OTHER SECTIONS
HP	HIGH PRESSURE GAS
SLV	SLEEVE

PLUMBING FIXTURE SCHEDULE

FIXTURE	SPEC NO	T	W	V	CW	HW	SETTING, HEIGHT
WATER CLOSET	WC 1A	IN*	4"	2"	1½		15"
	WC 1B	IN*	4"	2"	1½		15"
	WC 1C	IN*	4"	2"	1½		15"
URINAL	U 2A	2"	2"	1½	1"		
LAVATORY	L 3A	1½	2"	1½	½	½	31"
	L 3A1	1½	2"	1½	½	½	31"
	L 3B	1½	2"	1½	½		31"
	L 3C	1½	2"	1½	½		27"
	L 3F1	1½	2"	1½	½	½	18" BUILT-IN
	L 3J	1½	2"	1½	½		26"
SINK	S 4A	1½	2"	1½	½		BUILT-IN
	S 4C	1½	2"	1½	½		30
	S 4D	1½	2"	1½	½	½	30
	S 4B	2"	2"	1½	¾	¾	28"
	S 4E1	2"	2"	1½	¾		28"
	S 4F	1½	2"	1½	½	½	BUILT-IN
DRINKING FOUNTAIN	DF 5A	1½	2"	1½	½		36" TO TOP OF BUBBLER
	DF 5C	1½	2"	1½	½		30
DOUCHE	D 7A	2"	2"	1½			
	D 7A1	2"	2"	1½			
	D 7H	2"	2"	1½			
SHOWER	SH 7A	2"	2"	1½	½	½	

NOTES:

1. GAS METER ASSEMBLY AND SERVICE LINE FURNISHED AND INSTALLED BY P.G.&E. CO. ALL CHARGES FOR OBTAINING THIS SERVICE SHALL BE PAID BY THE CONTRACTOR.
2. WATER METER AND SERVICE LINE FURNISHED AND INSTALLED BY THE CALIF. WATER SERVICE CO. ALL CHARGES INCIDENT TO THIS SERVICE SHALL BE PAID BY THE CONTRACTOR.
3. GAS & WATER SHUTOFF VALVES OUTSIDE THE BUILDING SHALL BE IN CONCRETE BOXES WITH THE WORD OF THE SERVICE CAST IN THE COVER.
4. CLEANOUTS SHALL BE BROUGHT TO WITHIN 12" OF FINISH GRADE, UNLESS IN PAVED AREAS OR OTHERWISE NOTED.
5. HOSE BIBBS SHALL BE INSTALLED 18" ABV. GRADE.
6. PROVIDE SLEEVES FOR ALL GAS & WATER LINES PASSING UNDER (THRU) CONCRETE SLABS & FOOTINGS, EXCEPT AS NOTED.

USE PER PLANS
CONSTRUCTION IN ACCORDANCE WITH ALL APPLICABLE REQUIREMENTS OF THE 1973 EDITION OF THE UNIFORM BUILDING CODE AND LOS ANGELES COUNTY BUILDING CODE
DATE 10-3-75
DEPUTY

STATE DIVISION OF ARCHITECTURE
APPLICATION NO. 19-73-55
DATE 10-3-75

KERN COUNTY SUPT. OF SCHOOLS APPROVED:
DATE

BAKERSFIELD CITY SCHOOL DISTRICT BOARD OF EDUCATION APPROVED:
DATE

DATE OF PLANS
DATE
DATE
AS NOTED

JOHN C. FREMONT SCHOOL
NEW 288
BAKERSFIELD CITY SCHOOL DISTRICT
TEXAS STREET BAKERSFIELD, KERN COUNTY, CALIFORNIA