SITE LIGHTING NOTES

1. 1"C. W/2#8,1#10 GND
2. 1"C. W/3#8,1#10 GND
3. COORDINATE FIXTURE INSTALLATION WITH SIGN INSTALLER

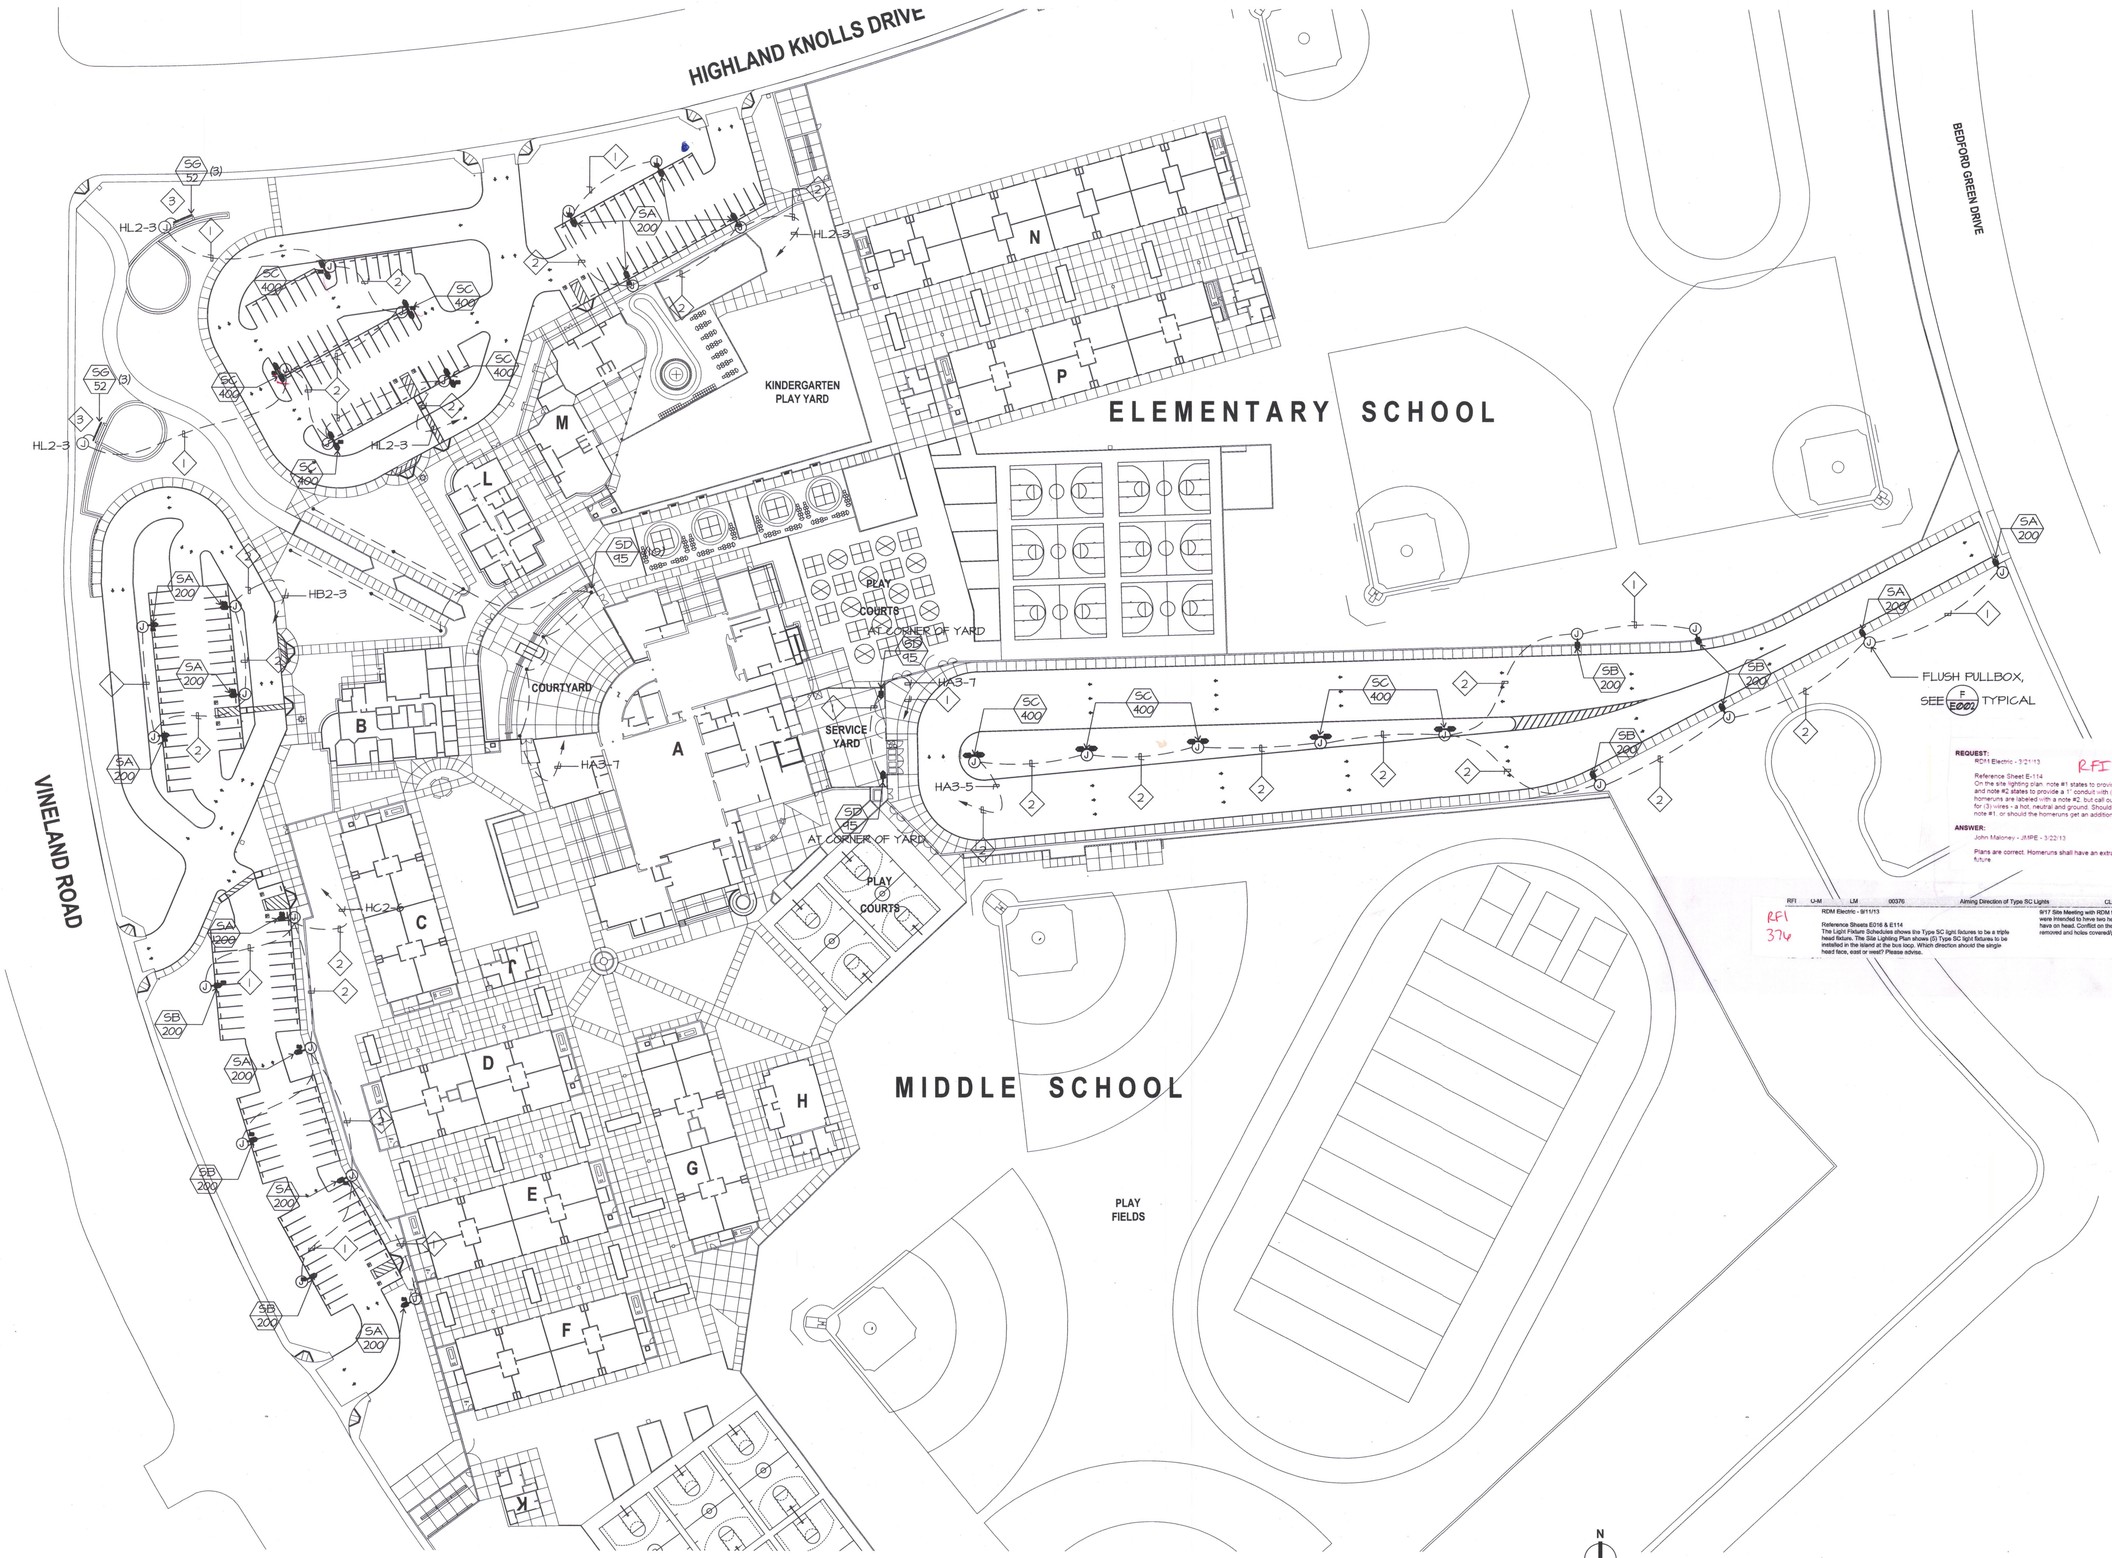

LIGHTING SITE PLAN

SCALE: 1" = 50'-0"

REQUEST:
RDM Electric - 3/21/13 RFI 289

Reference Sheet E-114
On the site lighting plan, note #1 states to provide a 1" conduit with (2) #8 and (1) #10 ground and note #2 states to provide a 1" conduit with (3) #8 and (1) #10 ground. However, the homeruns are labeled with a note #2, but call out for only one circuit. One circuit only allows for (3) wires - a hot, neutral and ground. Should all the runs, including the homeruns, have a note #1, or should the homeruns get an additional circuit? Please advise.

ANSWER:
John Maloney - JMPE - 3/22/13

Plans are correct. Homeruns shall have an extra conductor for an extra circuit if desired in the future.

RFI	U-M	LM	00376	Aiming Direction of Type SC Lights	CLO	5/11/2013	9/18/2013
RFI 376	RDM Electric - 5/11/13 Reference Sheets E016 & E114 The Light Fixture Schedules shows the Type SC light fixtures to be a triple head fixture. The Site Lighting Plan shows (5) Type SC light fixtures to be installed in the island at the bus loop. Which direction should the single head face, east or west? Please advise.						9/18 Site Meeting with RDM to determine fix for site lights. 3 headed fixtures were intended to have two heads, double headed fixtures were intended to have on head. Conflict on the fixture schedule. Additional fixtures will be removed and holes covered/patched on a T&M basis.

ORDIZ MELBY
ARCHITECTS, INC.

5500 MING AVENUE SUITE 280
BAKERSFIELD, CALIFORNIA 93309
TELEPHONE (661) 832-5258
FACSIMILE (661) 832-4291

LICENSED ARCHITECT
DANNY ESPINOZA ORDIZ
No. C-14728
MAY 31, 2013
RENEWAL DATE
STATE OF CALIFORNIA

DANNY E. ORDIZ, AIA
ARCHITECT C-14,728

WILLIAM J. MELBY, AIA
ARCHITECT C-16,835

CONSULTANT

IDENTIFICATION STAMP
DIVISION OF STATE ARCHITECT
OFFICE OF REGULATION SERVICES
APPL. # : 02-112027
FILE # : 15-6
AC ___ FC ___ SS ___
DATE ___

NEW ELEMENTARY SCHOOL
9801 HIGHLAND KNOLLS DR
BAKERSFIELD
CALIFORNIA
93306

NEW MIDDLE SCHOOL
4115 VINELAND ROAD
BAKERSFIELD
CALIFORNIA
93306

FOR:

BAKERSFIELD CITY SCHOOL DISTRICT
1300 BAKER STREET
BAKERSFIELD
CALIFORNIA
93305

JMPE
ELECTRICAL ENGINEERING
LIGHTING DESIGN
CA REGISTRATION NO E13083
10244
5500 MING AVENUE, SUITE 250
BAKERSFIELD, CA 93309
(661) 831-7051
FAX (661) 831-7813
email - maloney@jmpe.net
www.jmpe.net

MAY 31, 2013
RENEWAL DATE
STATE OF CALIFORNIA

MARK	DATE	DESCRIPTION
△		
△		
△		
△		
△		

JOB NUMBER:
20101244
CAD DRAWING FILE:

DRAWN BY:
AC
CHECKED BY:
PH

CHECK AND VERIFY ALL DIMENSIONS BEFORE PROCEEDING WITH THE WORK.
REPORT DESCREPANCIES TO THE ARCHITECT.

THE DRAWINGS, IDEAS, AND DESIGNS REPRESENTED ON THIS SHEET ARE THE PROPERTY OF THE ARCHITECT.

COPYRIGHT
ORDIZ-MELBY ARCHITECTS, INC. 2010

SHEET TITLE
LIGHTING SITE PLAN

SHEET IDENTIFICATION NUMBER
E-114
SHEET OF

JMPE/JOB#:10244/DATE:12-06-11 AC