

JOB# 4736

BCSD - Cesar Chavez
STKP# 76
S/N's: 48734-001/002

MODULAR CLASSROOM BUILDING

FOR WILLIAMS SCOTSMAN

BUILDING SIZE: 24'x40' (50 UNITS)


STOCKPILE

CLASS LEASING INC
STOCKPILE 76- A# 04-105455 CERTIFIED 3/25/2005

SERIAL NUMBERS


- 47944-001/002
- 47945-001/002
- 47946-001/002
- 47947-001/002
- 47948-001/002
- 47949-001/002
- 47962-001/002
- 47963-001/002
- 47980-001/002
- 47981-001/002
- 48721-001/002
- 48722-001/002
- 48724-001/002
- 48725-001/002
- 48726-001/002
- 48728-001/002
- 48733-001/002
- 48734-001/002

PC-04-104796

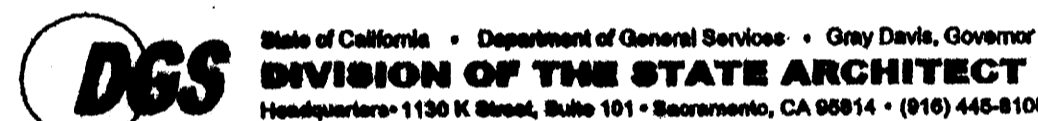

STRUCTURAL TESTS AND INSPECTIONS

Form for structural tests and inspections, including sections for Concrete, Grout, Mortar, and Steel. Includes checkboxes for various tests like compressive strength, split tensile, and rebar lap tests.

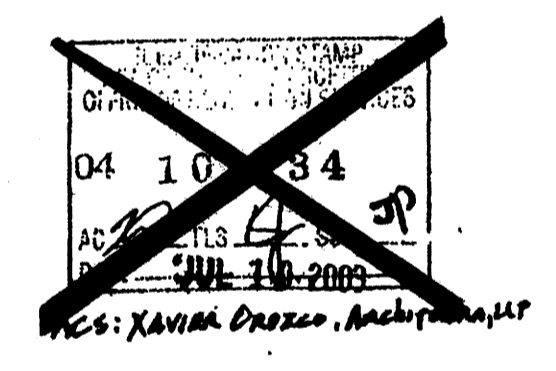

PC
CBC 2001

NOTES
SECTION 2113A.4.1 OF THE 2001 CBC
ALL WELDS IN PRIMARY MEMBERS AND CONNECTIONS IN THE LATERAL FORCE-RESISTING SYSTEM SHALL BE MADE WITH A FILLER METAL THAT HAS A MINIMUM CHARPY V-NOTCH TOUGHNESS OF 20 FT-LBS AT MINUS 20 DEGREES F.

BUILDING DATA

STRUCTURAL DESIGN: ORDINARY MOMENT RESISTANT FRAME
 TYPE OF CONSTRUCTION: V-H
 WIND LOAD (EXP C): 80 MPH
 SEISMIC ZONE 4, SEISMIC SOURCE TYPE A, DISTANCE <1.25 MILES
 Z = .4 I = 1.0 Cv = 1.28 Nv = 2.0
 R = 4.5 Ca = 0.66 Na = 1.5 SOIL TYPE = S_D
 FLOOR LIVE LOAD: 50 PSF
 ROOF LIVE LOAD: 20 PSF
 OCCUPANCY: 24'x40' CLASSROOM: E-2
 BUILDING AREA: 24'x40' BUILDING - 960 SF
 -COMPLIES WITH CLIMATE ZONES 1-15
 THIS PC IS DESIGNED STRUCTURALLY TO SUPPORT THE WEIGHT OF A FIRE SPRINKLER SYSTEM.

APPLICABLE CODES

- 2001 CALIFORNIA BUILDING CODE (CBC), VOLUMES 1, 2, AND 3 (PART 2, TITLE 24, CCR) (1997 EDITION UNIFORM BUILDING CODE WITH 2001 CALIFORNIA AMENDMENTS)
- 2001 CALIFORNIA ELECTRICAL CODE (CEC), (PART 3, TITLE 24, CCR) (1999 EDITION NATIONAL ELECTRICAL CODE WITH 2001 CALIFORNIA AMENDMENTS)
- 2001 CALIFORNIA MECHANICAL CODE (CMC), (PART 4, TITLE 24, CCR) (2000 EDITION IAPMO UNIFORM MECHANICAL CODE WITH 2001 CALIFORNIA AMENDMENTS)
- 2001 CALIFORNIA PLUMBING CODE (CPC), (PART 5, TITLE 24, CCR) (2000 EDITION IAPMO UNIFORM PLUMBING CODE WITH 2001 CALIFORNIA AMENDMENTS)
- 2001 CALIFORNIA FIRE CODE (PART 9, TITLE 24, CCR)
- 2001 CALIFORNIA BUILDING STANDARDS ADMINISTRATIVE CODE (PART 1, TITLE 24, CCR)
- 2001 CALIFORNIA ENERGY CODE (PART 6, TITLE 24, CCR)
- 2001 CALIFORNIA REFERENCED STANDARDS CODE (PART 12, TITLE 24, CCR)
- TITLE 19, CCR, PUBLIC SAFETY, STATE FIRE MARSHAL REGULATIONS.

LEGEND

SYMBOL	DESCRIPTION
⊖	DETAIL (1) ON SAME SHEET AS SYMBOL
⊕	DETAIL (1) ON SHEET (2)
1	KEY NOTE (1) ON SAME SHEET AS SYMBOL
△	SECTION "A" ON SHEET (2)
1	REVISION/CHANGE IN DRAWING. (1) IS FIRST REVISION
CLOUD	HIGHLIGHTS CHANGED AREA
1	DOOR REFERENCE
△	WINDOW REFERENCE
EL	ELECTRICAL ITEM(S) SEE ELECTRICAL DRAWINGS
HV	HEATING/VENTILATING & AIR CONDITIONING ITEM(S) SEE MECHANICAL DRAWINGS
PLG	PLUMBING ITEM(S) SEE MECHANICAL DRAWINGS
STR	STRUCTURAL ITEM(S) SEE STRUCTURAL DRAWINGS
FIN	FINISH ITEM(S) SEE FINISH SCHEDULE
RAMP	RAMP - SEE RAMP DRAWINGS

ABBREVIATIONS

- AGC = ABOVE GRADE CONCRETE
- BGC = BELOW GRADE CONCRETE
- DIA = DIAMETER
- CLR = CLEAR
- GA = GAUGE
- MAX = MAXIMUM
- MIN = MINIMUM
- NIC = NOT IN CONTRACT
- NTS = NOT TO SCALE
- OC = ON CENTER
- OD = OUTSIDE DIAMETER
- OSB = ORIENTED STRAND BOARD
- ROH = ROOF OVERHANG
- SIM = SIMILAR
- STS = SELF TAPPING SCREW
- STMS = SELF TAPPING SHEET METAL SCREW
- TYP = TYPICAL
- UON = UNLESS OTHERWISE NOTED

WITH THE SIGNING OF THESE DRAWINGS, WE ACKNOWLEDGE THAT WE HAVE REVIEWED THESE PLANS AND SPECIFICATIONS AND HAVE FOUND THEM TO BE IN GENERAL COMPLIANCE WITH THE BID DRAWINGS, SPECIFICATIONS AND ASSOCIATED ADDENDA. WHEN THESE PLANS AND SPECIFICATIONS HAVE BEEN APPROVED BY THE DIVISION OF THE STATE ARCHITECT, THEY SHALL PRESEIDE OVER CONFLICTING AREAS IN THE BID DRAWINGS AND SPECIFICATIONS, AND ANY ADDENDA THERETO.

CONFIDENTIAL - THIS DOCUMENT AND THE INFORMATION CONTAINED HEREIN ARE THE PROPERTY OF MODTECH, INC. UNAUTHORIZED COPYING, DISCLOSURE OR OTHER UNAUTHORIZED USES ARE PROHIBITED.

SHEET INDEX

A.O	TITLE SHEET
A1.0	FLOOR PLAN
A1.1	FLOOR PLAN
A2.01	REFLECTED CEILING PLAN (8 LIGHTS)
A2.02	REFLECTED CEILING PLAN (10 LIGHTS)
A2.03	REFLECTED CEILING PLAN (12 LIGHTS)
A2.04	REFLECTED CEILING PLAN (12 LIGHTS)
A2.06	REFLECTED CEILING DETAILS
A3.01	ROOF PLAN 22 GA.
A3.02	ROOF PLAN 22 GA.
A3.03	ROOF DETAILS
A4.01	EXTERIOR ELEVATIONS (DUAL PITCH) W/ FASCIA
A4.02	EXTERIOR ELEVATIONS (DUAL PITCH) W/O FASCIA
A4.03	ARCHITECTURAL DETAILS (WOOD STUDS)
A4.03M	ARCHITECTURAL DETAILS (METAL STUDS)
A4.04	ARCHITECTURAL DETAILS (WOOD STUDS)
A4.04M	ARCHITECTURAL DETAILS (METAL STUDS)

A.O	INTERIOR ELEVATIONS
A5.02	INTERIOR ELEVATIONS
A6.01	DOOR, WINDOW, FINISH, HARDWARE SCHEDULES
A6.02	DOOR, WINDOW, FINISH, HARDWARE SCHEDULES
A8.0	SPECIFICATIONS
A8.1	SPECIFICATIONS
A8.2	SPECIFICATIONS

A.O	STRUCTURAL
F1.0	FOUNDATION PLAN - 50 PSF LL (WOOD)
F1.01	FOUNDATION PLAN 50 PSF LL (WOOD)
F2.0	FOUNDATION DETAILS (WOOD) W/ 3 PLATES
F2.01	FOUNDATION DETAILS (WOOD) W/ 3 PLATES
S1.0	FLOOR FRAMING PLAN 50 PSF LL
S1.2	FLOOR FRAMING DETAILS (TYPICAL)
S2.0	ROOF FRAMING PLAN (DUAL PITCH) W/ FASCIA
S2.01	ROOF FRAMING PLAN (DUAL PITCH) W/O FASCIA
S2.1	ROOF FRAMING DETAILS (W/ FASCIA)
S2.2	ROOF FRAMING DETAILS (W/O FASCIA)
S3.0	SHED ROOF FRAMING PLAN (DUAL PITCH) W/ FASCIA
S3.01	SHED ROOF FRAMING PLAN (DUAL PITCH) W/O FASCIA
S3.1	SHED ROOF FRAMING DETAILS (DUAL PITCH) W/ FASCIA
S3.11	SHED ROOF FRAMING DETAILS (DUAL PITCH) W/O FASCIA
S4.0	WALL FRAMING (WOOD)
S4.1	WALL FRAMING (WOOD)
S4.2	WALL FRAMING (WOOD)
S4.3	WALL FRAMING (WOOD)
S4.4	WALL FRAMING (WOOD)
S4.5	WALL FRAMING (WOOD)
S4.6	WALL FRAMING (WOOD)
S4.7	WALL FRAMING (WOOD)
S4.8	WALL FRAMING (WOOD)
S4.9	WALL FRAMING (WOOD)
S4.10	WALL FRAMING (WOOD)
S4.11	WALL FRAMING (WOOD)
S4.12	WALL FRAMING (WOOD)
S4.13	WALL FRAMING (WOOD)
S4.14	WALL FRAMING (WOOD)
S4.15	WALL FRAMING (WOOD)
S4.16	WALL FRAMING (WOOD)
S4.17	WALL FRAMING (WOOD)
S4.18	WALL FRAMING (WOOD)
S4.19	WALL FRAMING (WOOD)
S4.20	WALL FRAMING (WOOD)

A.O	MECHANICAL
M1.0	MECHANICAL (HVAC) PLAN - 4 TON
M1.01	MECHANICAL (HVAC) PLAN - 4 TON
M1.02	MECHANICAL (HVAC) PLAN - 4 TON

A.O	ELECTRICAL
E1.01	ELECTRICAL PLAN
E1.02	ELECTRICAL PLAN
E1.03	ELECTRICAL PLAN
E1.04	ELECTRICAL PLAN

A.O	RAMP
R1.01	1 FOOT RAMP/STAIRS PLAN
R1.02	RAMP/STAIRS DETAILS
R2.01	STREET RAMP/STAIRS PLAN
R2.02	STREET RAMP/STAIRS DETAILS
R3.01	FULL LENGTH RAMP/STAIRS PLAN
R3.02	CONCRETE RAMP/STAIRS DETAILS
R5.01	5 FOOT RAMP/LANDING PLAN, 11' STAIRS
R5.02	5 FOOT RAMP/LANDING PLAN, 11' STAIRS

REVISIONS	Electrical Engineer's Seal	Mechanical Engineer's Seal	PC Professional of Record Seal	Architect's Seal
1				
2				
3				
4				


Professional seals for Electrical, Mechanical, PC Professional of Record, and Architect. Includes the Modtech logo and project information.

MODTECH, INC. 2830 BARRETT AVENUE PERRIS, CALIF. 92572 FAX (909) 943-4014 (909) 940-0427

PROJECT NUMBER: 4736
WILLIAM SCOTSMAN
COVER SHEET


MODTECH, INC. 2002 ALL RIGHTS RESERVED
DRAWN BY: CL
DATE: 07/07/03
CHECKED BY: STKP-76
MODTECH Job No. A.0

PROJECT NO. 4736

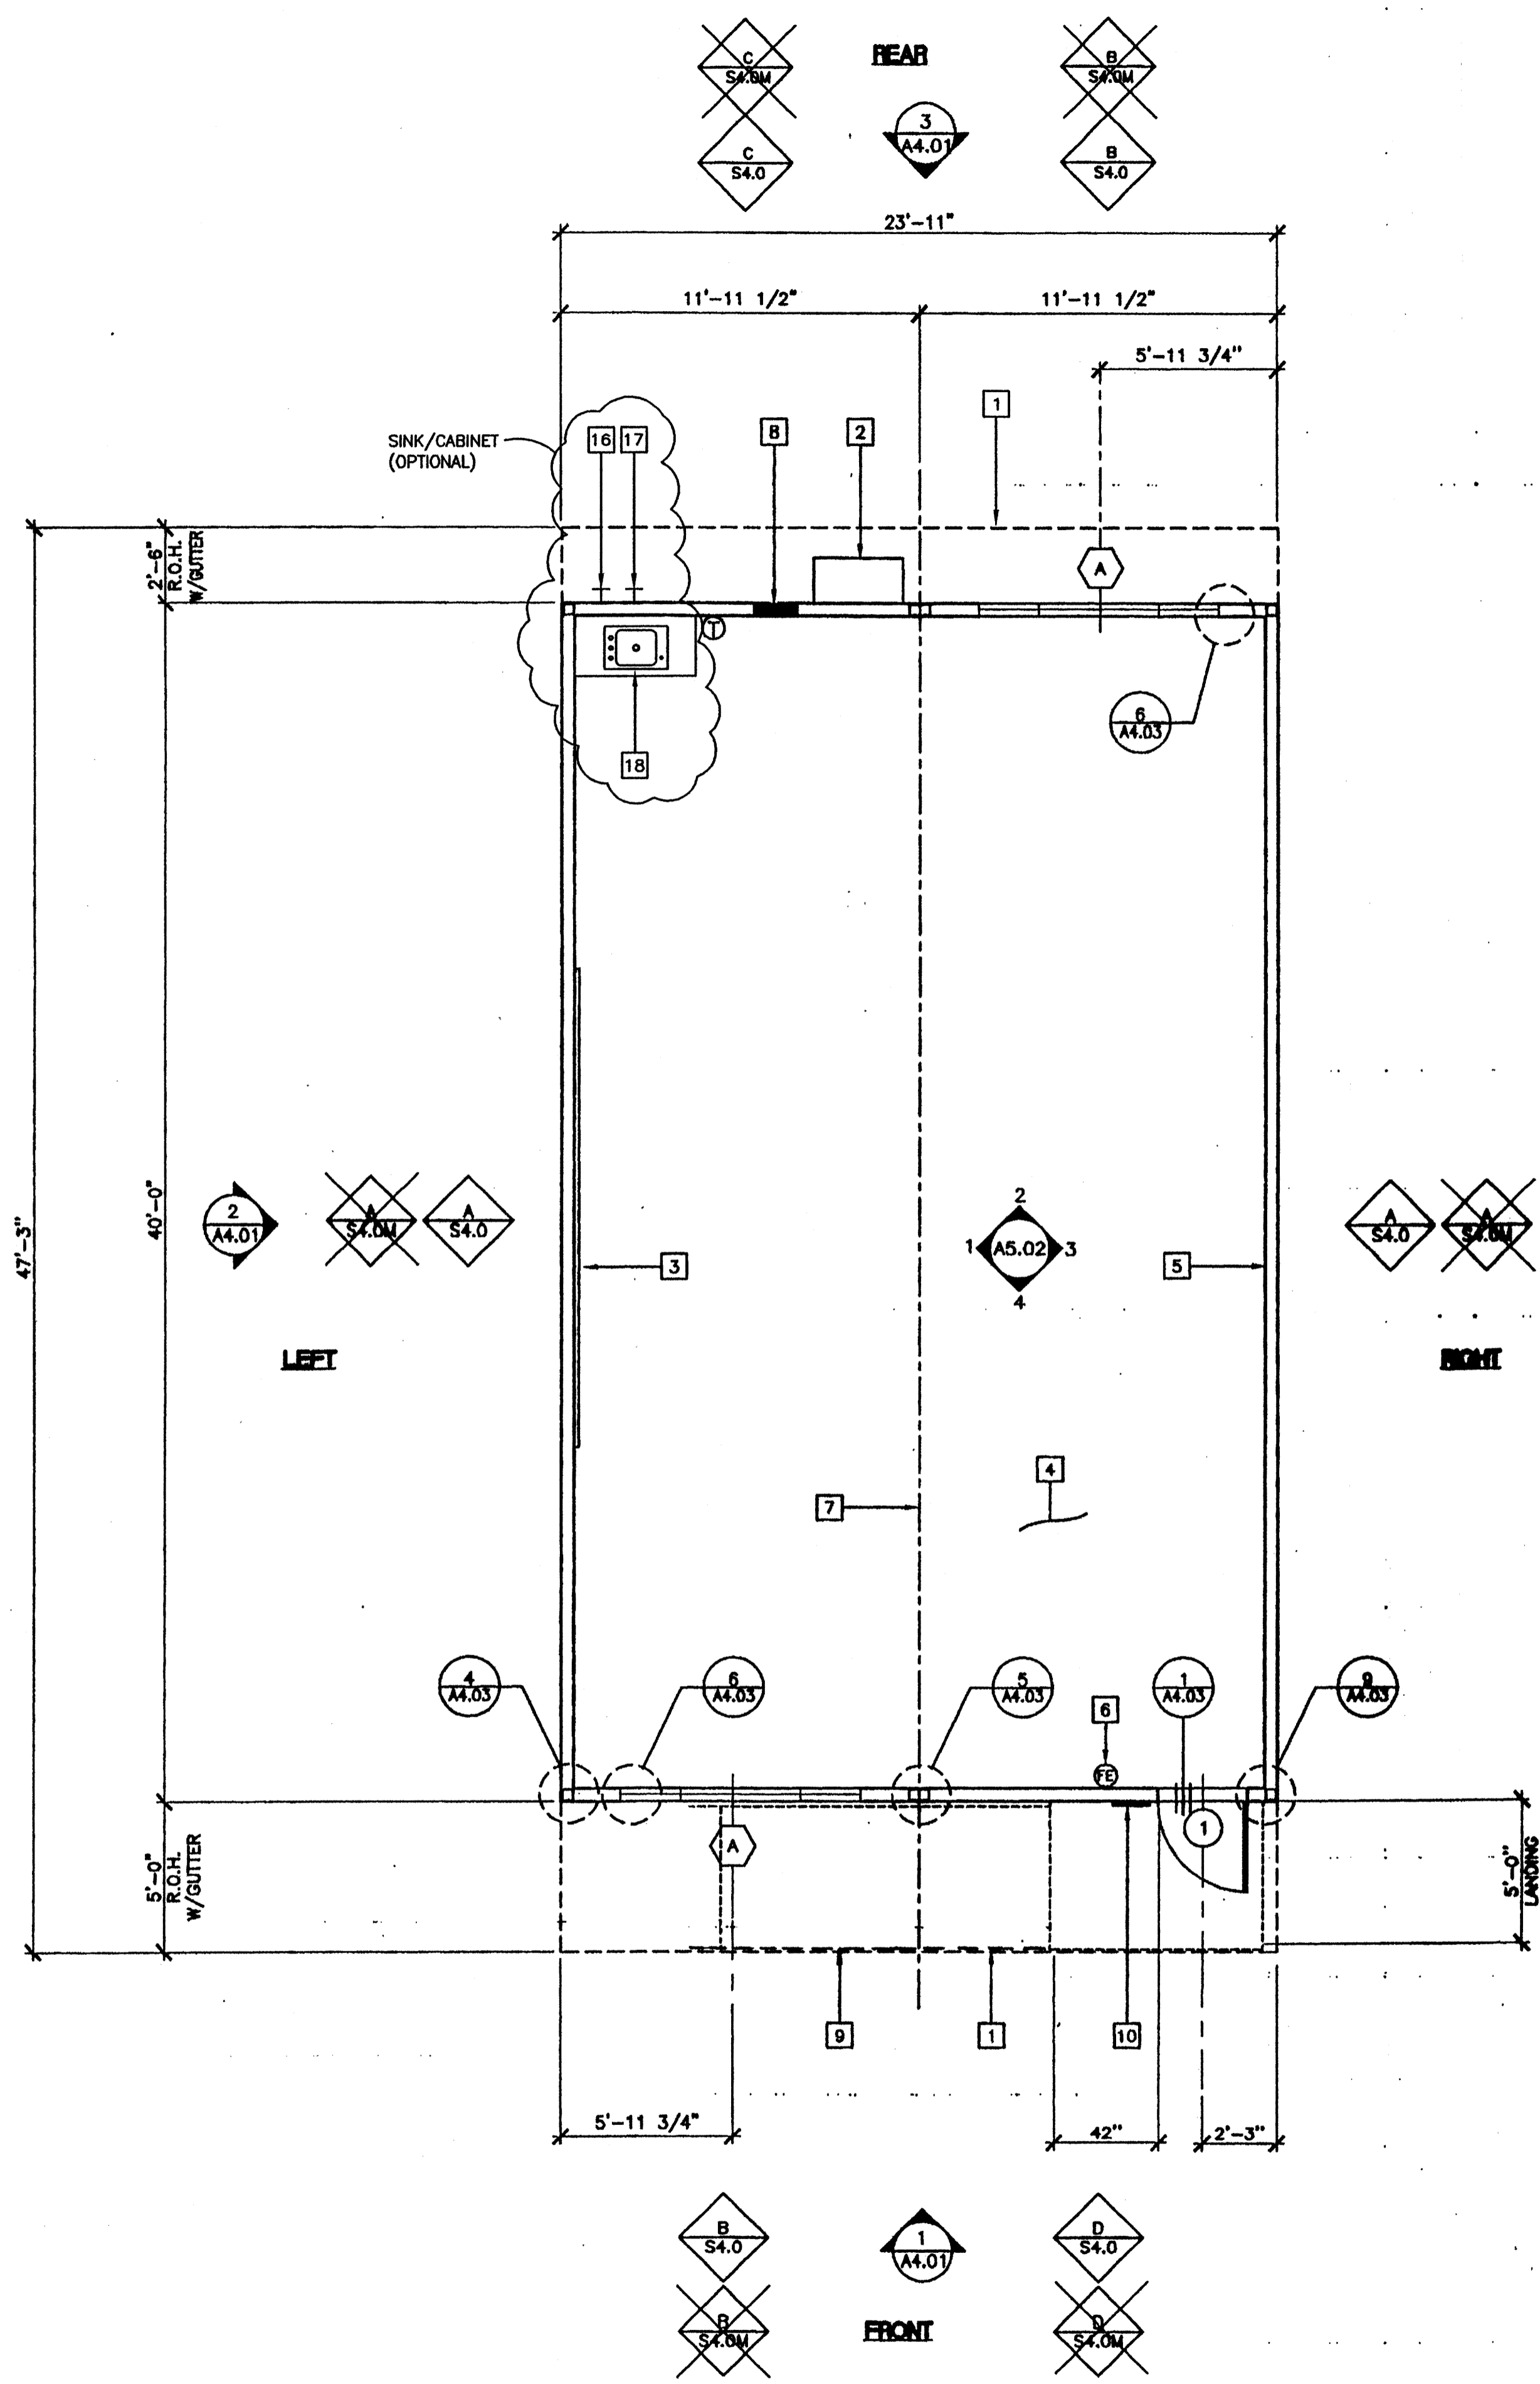


FLOOR PLAN
OPP-HAND

24x40
SCALE: 1/4" = 1'-0"

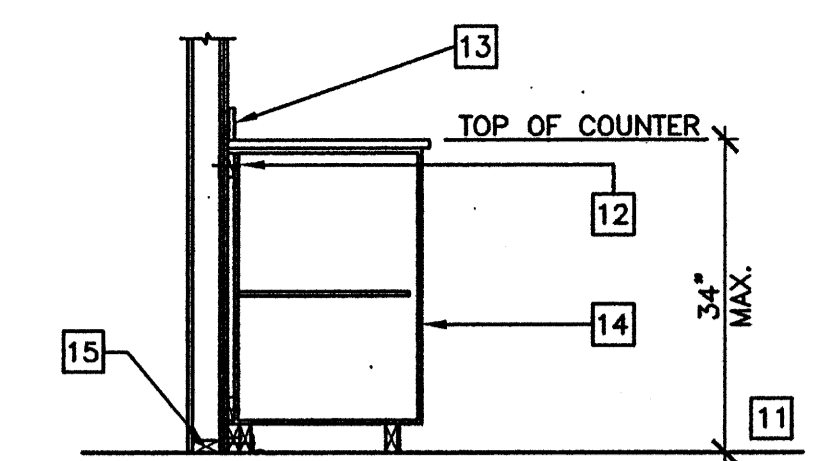


NOTES:
1. SEE PLANS AND ELEVATIONS FOR EACH SPECIFIC DESIGN.
2. REMOVE TOE KICK AND BASE FOR ACCESSIBLE CONDITION
3. PROVIDE U SHAPED WIRE PULLS AT ALL ACCESSIBLE CASEWORK OR EQUAL.

SCALE: NTS (OPTIONAL)
BASE CABINET ANCHORAGE 1

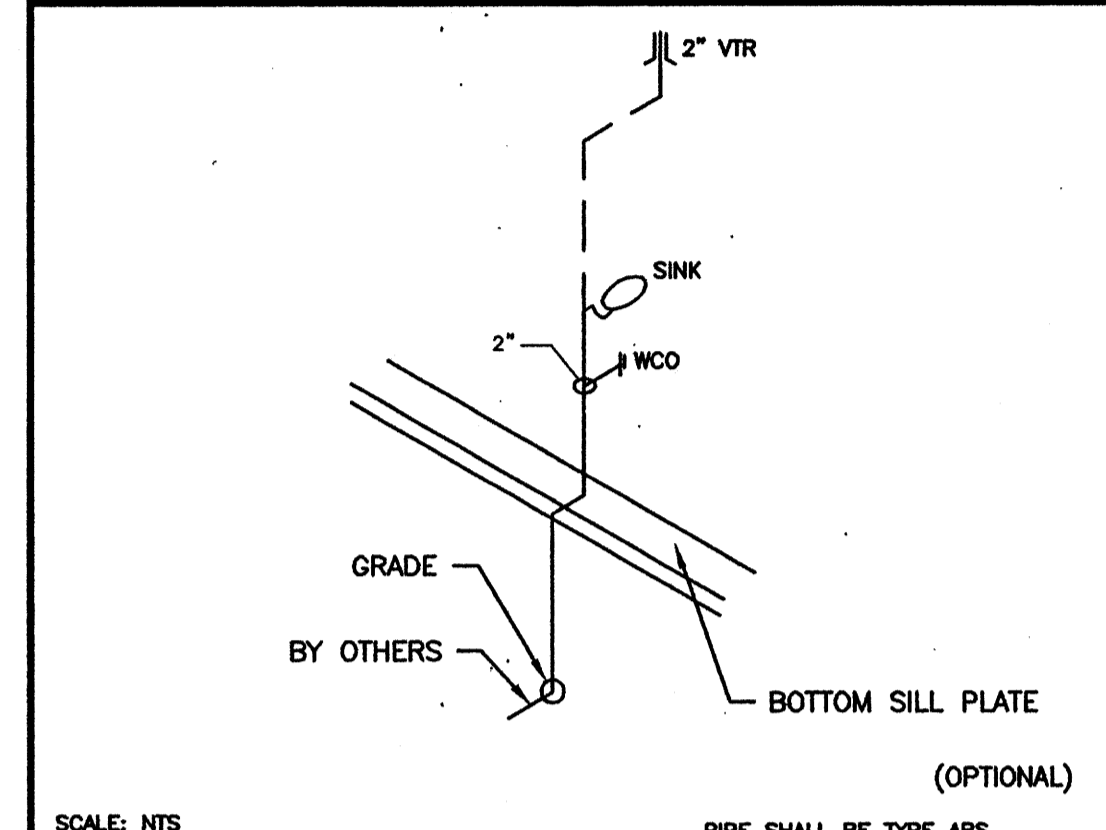

SCALE: NTS PIPE SHALL BE TYPE ABS
SINK CABINET WASTE 2

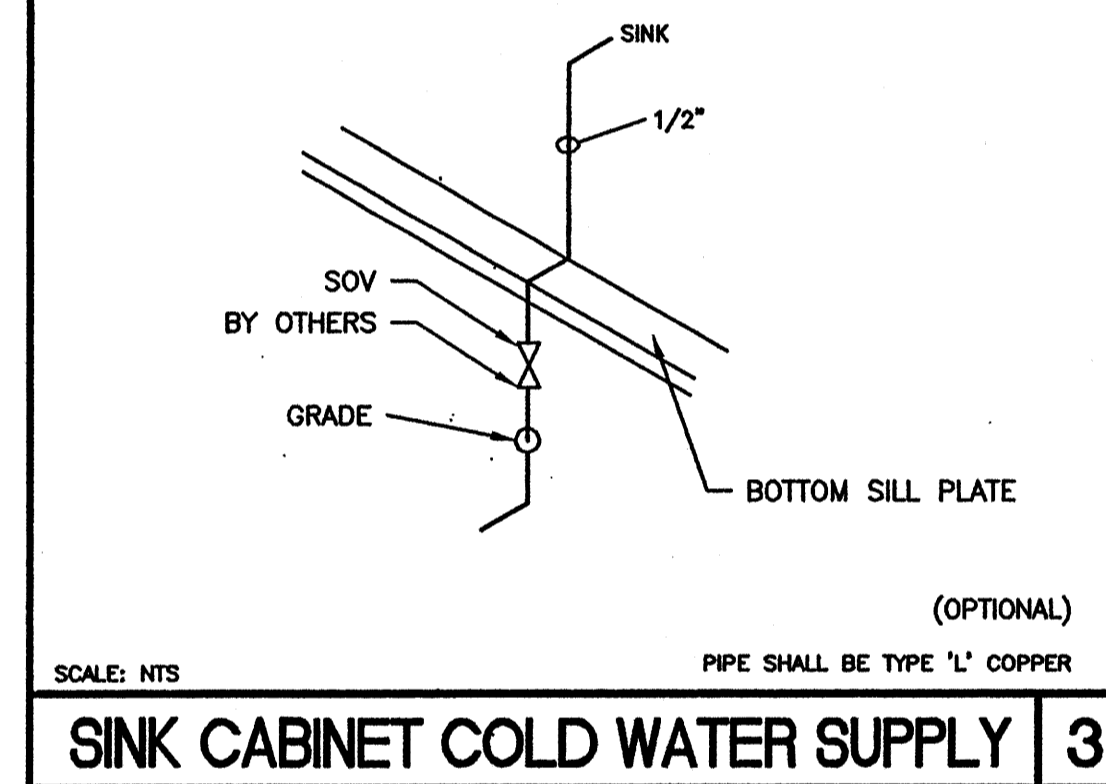

SCALE: NTS PIPE SHALL BE TYPE 'L' COPPER
SINK CABINET COLD WATER SUPPLY 3

- KEY NOTES**
- 1 ROOF OVERHANG
 - 2 HVAC UNIT (HV)
 - 3 2 - 8'x4' PORCELAIN STEEL MARKER BOARDS (SEE SPEC'S FOR TYPE)
 - 4 FINISH FLOORING (FIN)
 - 5 INTERIOR FINISH (FIN)
 - 6 FIRE EXTINGUISHER - 5 LBS DRY CHEMICAL WITH 2A-10BC UL RATING WALL MOUNTED BRACKET, HANDLE AT 48" AFF
 - 7 MODLINE (M)
 - 8 ELECTRICAL PANEL
 - 9 RAMP/LANDING (RMP) SEE RAMP DRAWINGS
 - 10 SIGNAGE PROVIDED AND INSTALLED BY DISTRICT PRIOR TO OCCUPANCY, SEE A5.02
 - 11 FINISH FLOOR
 - 12 4"x22 GA CONTINUOUS METAL STRAPS WITH #14 STMS AT 24" OC
 - 13 BACK SPLASH
 - 14 BASE CABINET
 - 15 BOTTOM PLATE
 - 16 COLD WATER P.O.C. SEE DETAIL# 3
 - 17 WASTE P.O.C. SEE DETAIL# 2
 - 18 CLASSROOM SINK, TYP. SEE A5.02 SINK: CRAC-ADA-1725-A-GR FAUCET: CHICAGO 350. BUBBLER: JSB 10 (OPTIONAL)

- NOTES**
1. METAL TAG ON ALL MODULES. MECHANICALLY ATTACHED TO REAR EXTERIOR OF BUILDING SHOW D.S.A. APPLICATION NUMBER, MANUFACTURER'S NAME AND SERIAL NUMBER.
 2. METAL TAG MIN. 3 1/2"x1 1/2" STAMPED METAL I.D. W/
1. OPSC BUILDING NUMBER
2. DESIGN WIND LOAD
3. DESIGN ROOF LOAD
 3. PROVIDE MIN. 3 1/2"x1 1/2" METAL TAG INSTALLED INSIDE THE ELECTRICAL PANEL SHOWING OPSC NUMBER AND DSA NUMBER.
 3. BLDG. MANUFACTURER TO VERIFY W/ CUSTOMER IF SINK AND CABINET OPTION APPLIES.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
04 105455
DATE JUL 17 2003

~~IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
04 105455
DATE JUL 17 2003~~

REVISIONS

1		
2		
3		
4		

Electrical Engineer's Seal
Mechanical Engineer's Seal
PC Professional of Record Seal
Architects Seal

PC
CBC 2001
IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
PC-04
104796
DATE 7/2/03


MODTECH™
2830 BARRETT AVENUE FAX (909) 943-4014
PERRIS, CALIF. 92572 FAX (909) 940-0427

PROJECT NUMBER: 4736
WILLIAM SCOTTSMAN
© MODTECH, INC. 2002
ALL RIGHTS RESERVED

DRAWN BY: GL
DATE: 07/07/03
CHECKED BY:
DATE:
MODTECH Index No.
A1.1

FLOOR PLAN

FILE PATH: PROJECT NO. 4736 PC-04-104796

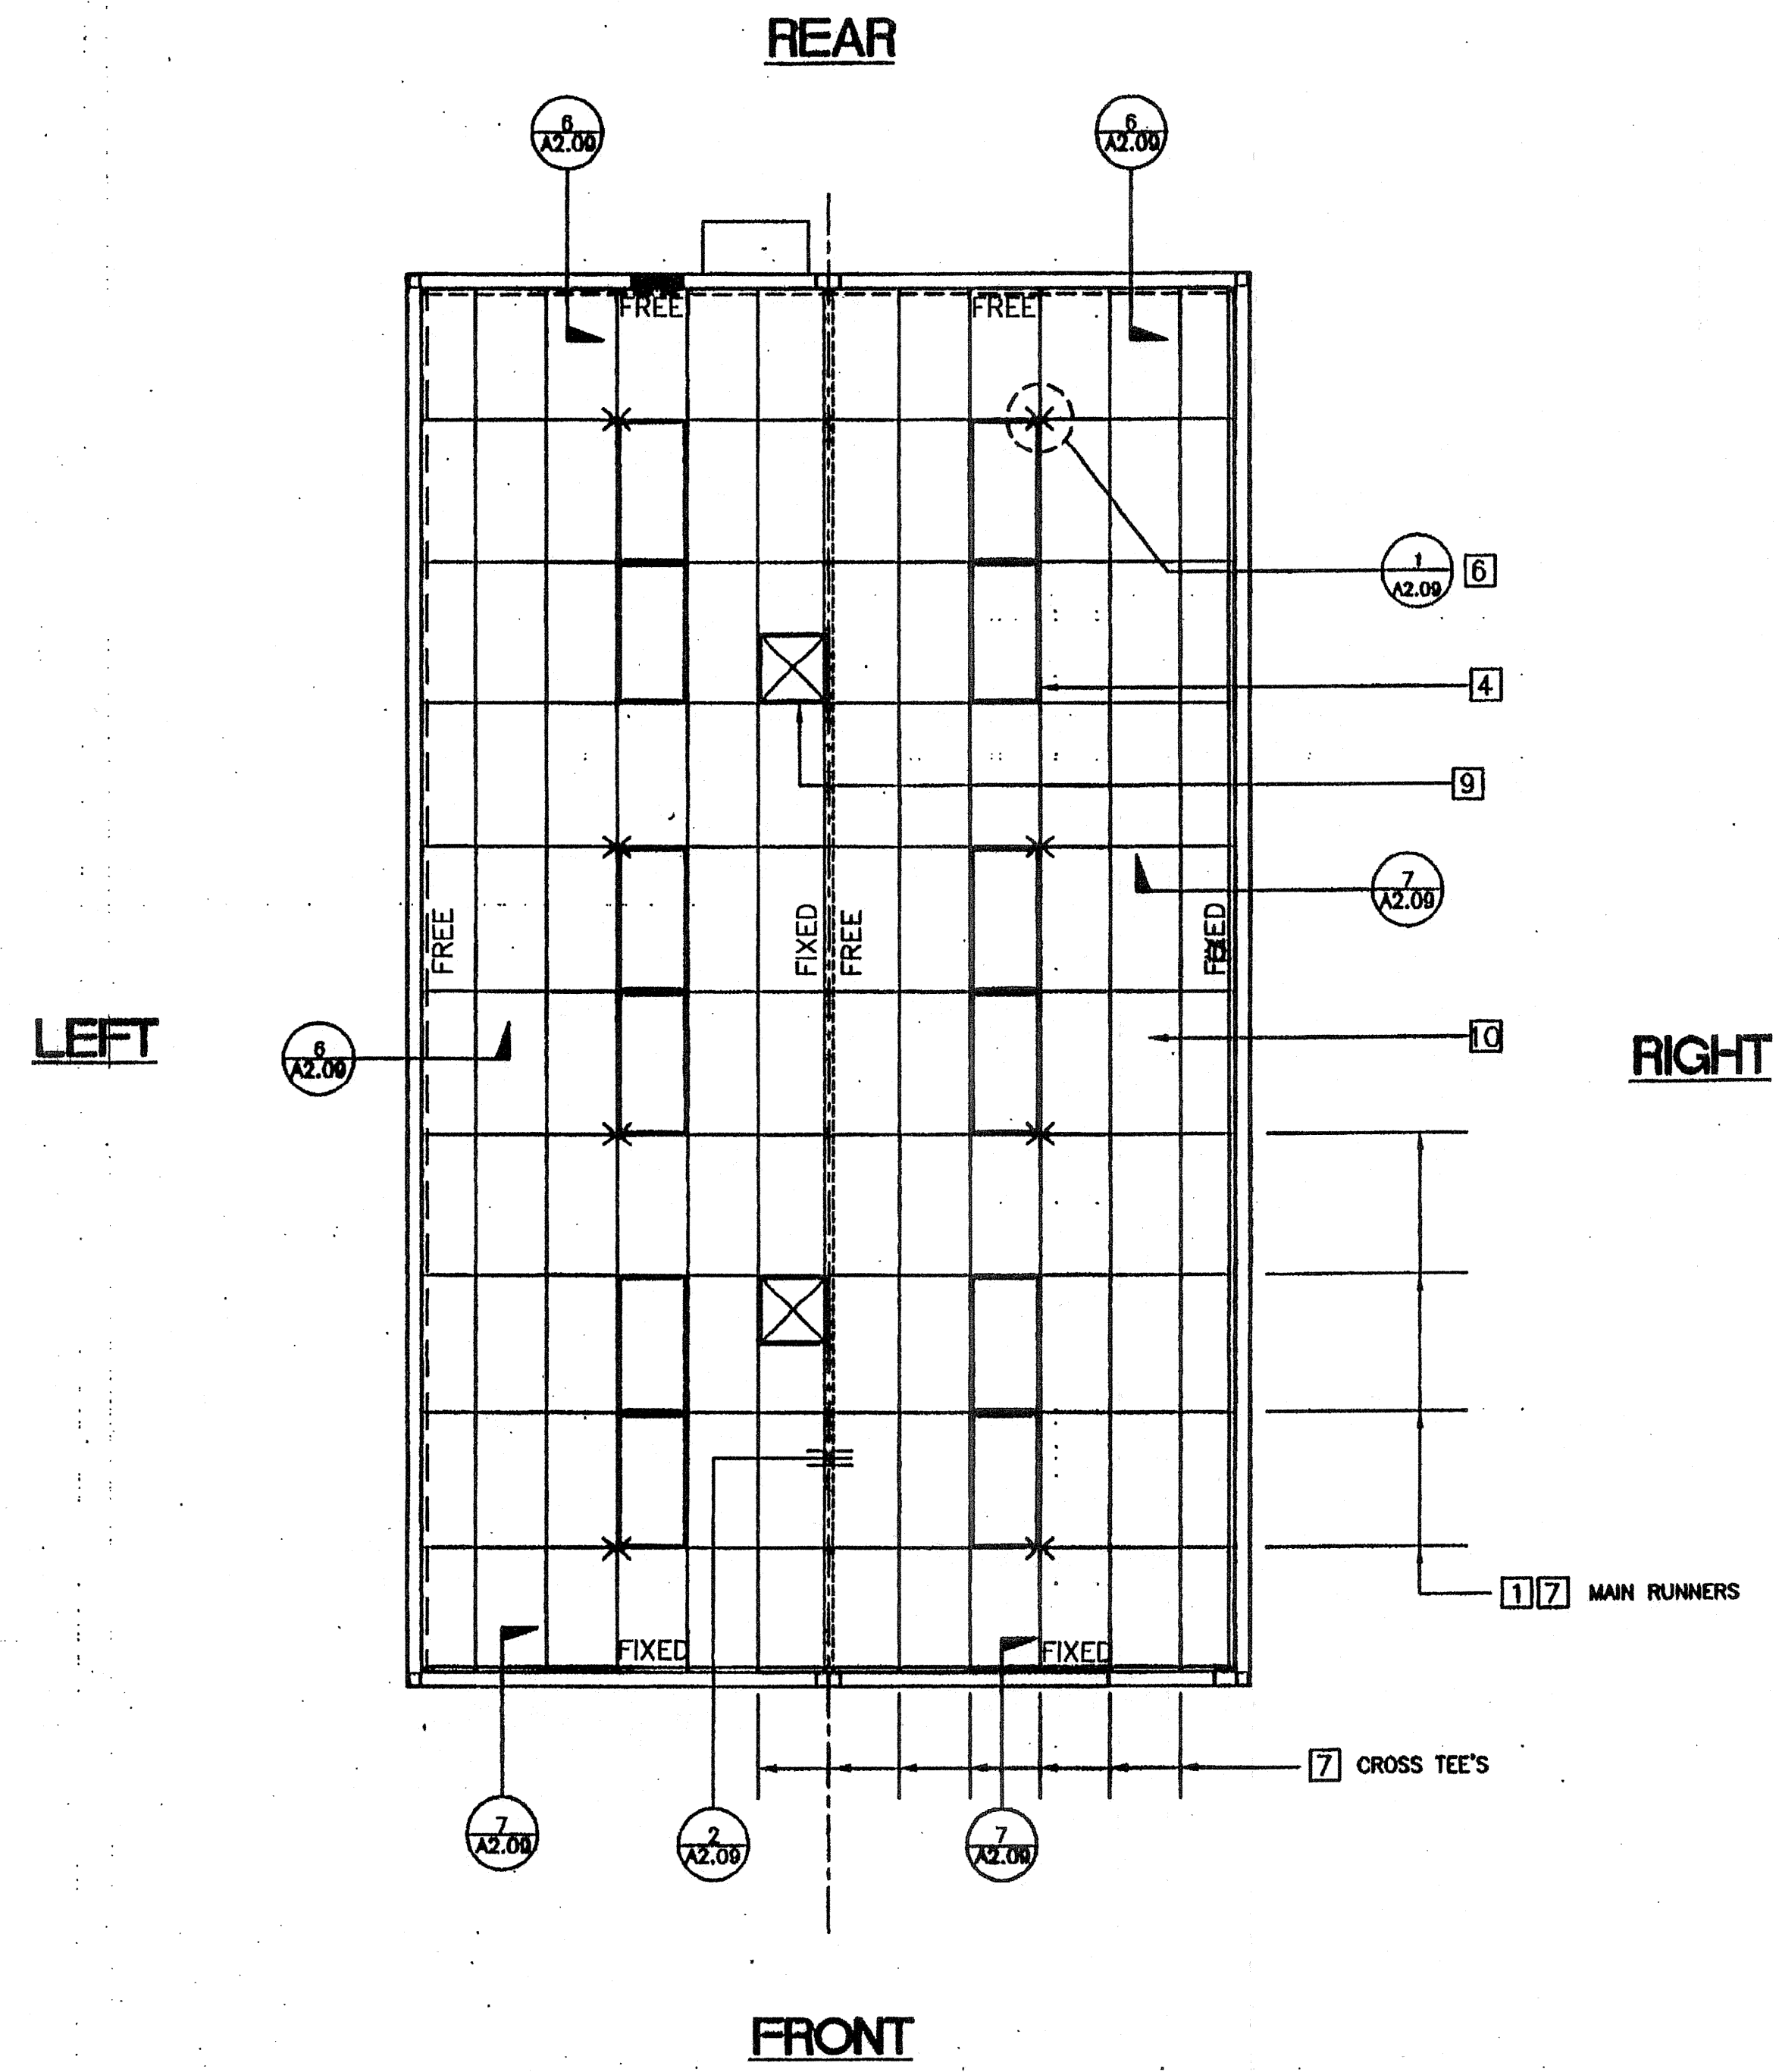

KEY NOTES

- 1 MAIN RUNNERS @ 4'-0" W/12GA. HANGER WIRES @ END OF EACH RUNNER.
- 2 AT THE END OF ROWS OF RUNNERS A 12GA. HANGER WIRE SHALL BE ATTACHED WITHIN 8" OF WALL OR SOFFIT.
- 3 VERTICAL WIRES MORE THAN 1-IN-6 OUT OF PLUMB SHALL HAVE COUNTERBRACING WIRES.
- 4 PROVIDE 2-12GA. SLACK WIRES TO HOUSING OF ALL LIGHT FIXTURES AT DIAGONAL CORNERS. WIRES SHALL BE ATTACHED TO STRUCTURE OF LIGHT FIXTURES: 2 X 4 RECESSED, ATTACH FIXTURE TO GRID W/1-#8 SHEET METAL SCREW AT EACH CORNER.
- 5 RUNNERS MAY BE ATTACHED TO WALLS OR MOLD AT 2-ADJACENT WALLS. OTHER WALLS NO ATTACHMENT. CLEARANCE OF 1/2" BETWEEN END OF RUNNERS AND FACE OF WALL.
- 6 CEILING AREAS SHALL HAVE 2/4-WAY SPLAYS PER DETAIL 1 ON SHEET A2.09 IN LOCATIONS INDICATED ON DRAWINGS. WIRES TAUT BUT NOT TO DISTORT GRID.

T-BAR PART NUMBERS

	ARMSTRONG FA-041		
RUNNER MAIN	7301D		
4' CROSS TEE	7343		
2' CROSS TEE	7328		
WALL ANGLE	7800D		

- 8 DUCTWORK SHALL BE RIGIDLY ATTACHED TO BUILDING AND SHALL NOT BE CLOSER THAN 6" TO HANGER WIRES.
- 9 REGISTERS SHALL BE POSITIVELY ATTACHED W/4-10GA. SHEET METAL SCREWS. (TYP. 1- @ EA. CORNER)
- 10 CEILING PANELS: 2910

LEGEND

- T & T BAR CEILING
- 2'X 4' ELEC. FIXTURE RECESSED
- SUPPLY AIR DIFFUSER
- RETURN AIR DIFFUSER
- SPLAY WIRE 4 WAY
- INDICATES FIXED SIDE (SEE DETAIL 7/A2.09)
- INDICATES FREE SIDE (SEE DETAIL 6/A2.09)

REVISIONS

NO.	CL.	ADDED & MODIFIED REFLECTED CLG.	DATE
1			7/9/03
2			
3			
4			

Electrical Engineer's Seal
Mechanical Engineer's Seal
PC Professional of Record Seal
Architect's Seal

PC
CBC 2001
IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
PC-04
104796
AC [Signature] FILE [Signature] DATE 5/2/07

MODTECH™
2830 BARRETT AVENUE FAX (909) 943-4014
PERRIS, CALIF. 92572 FAX (909) 940-0427


PROJECT NUMBER: 4736
WILLIAM SCOTTSMAN

© MODTECH, INC. 2002
ALL RIGHTS RESERVED

DRAWN BY: GL
DATE: 07/07/03
CHECKED BY:
DATE:
MODTECH Index No.
A2.04

REFLECTED CEILING PLAN 12 LIGHTS


PROJECT NO. 4736

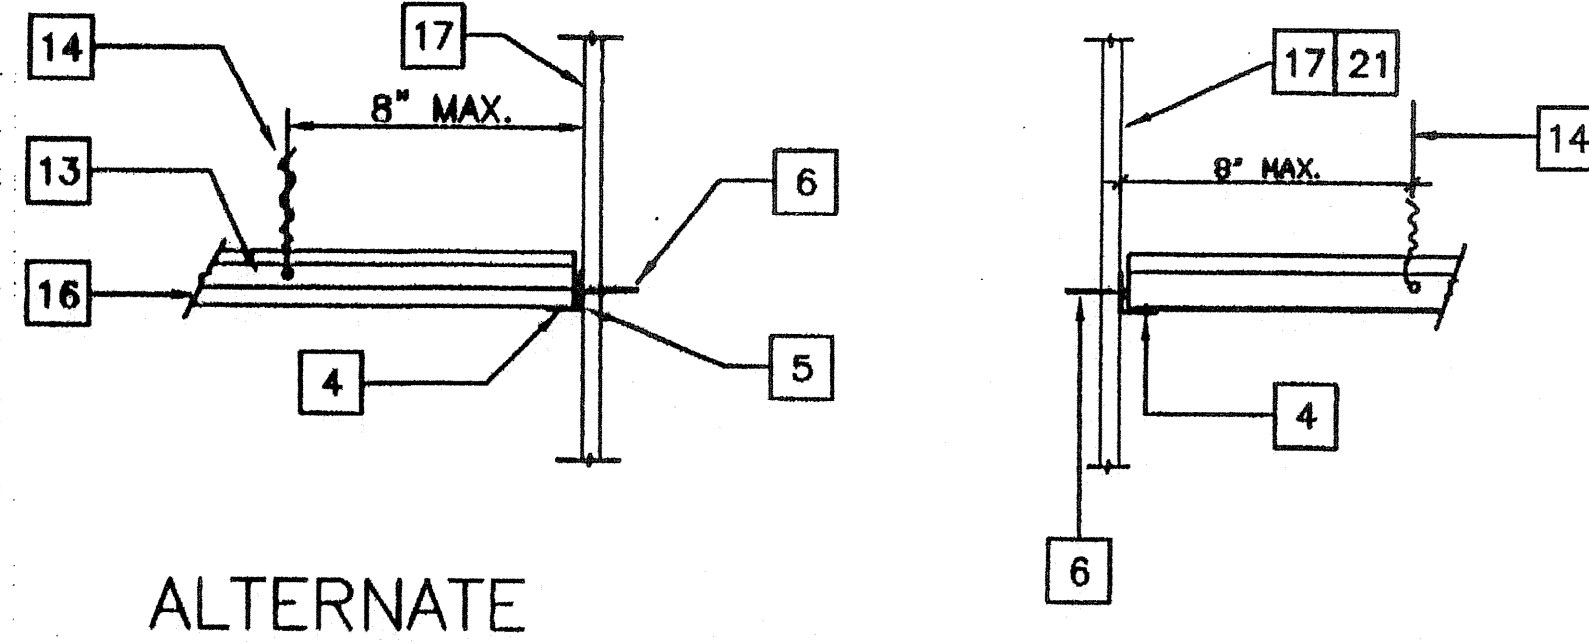

ALTERNATE

TYPICAL FIXED SIDE


7

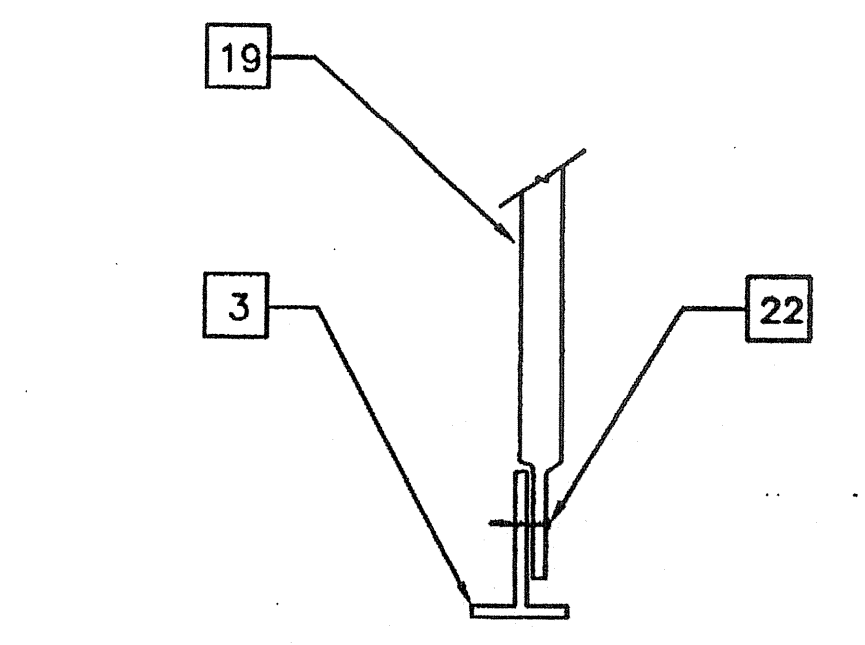

NOTE: CONDUIT MAY BE CRIMPED ON EITHER SIDE OF T-BAR, DEPENDING UPON CONDITION & LOCATION


ALT. CONN. AT BOTTOM

4

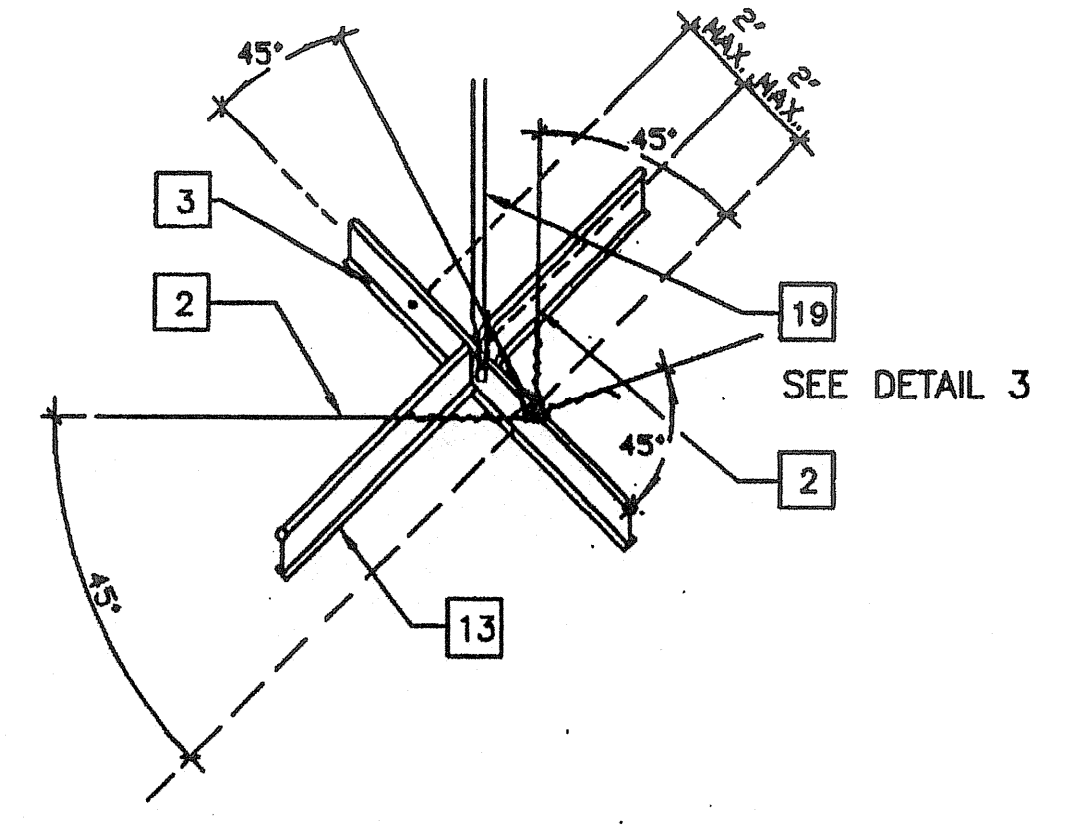


SISMIC SPLAY - 4 WAY

1

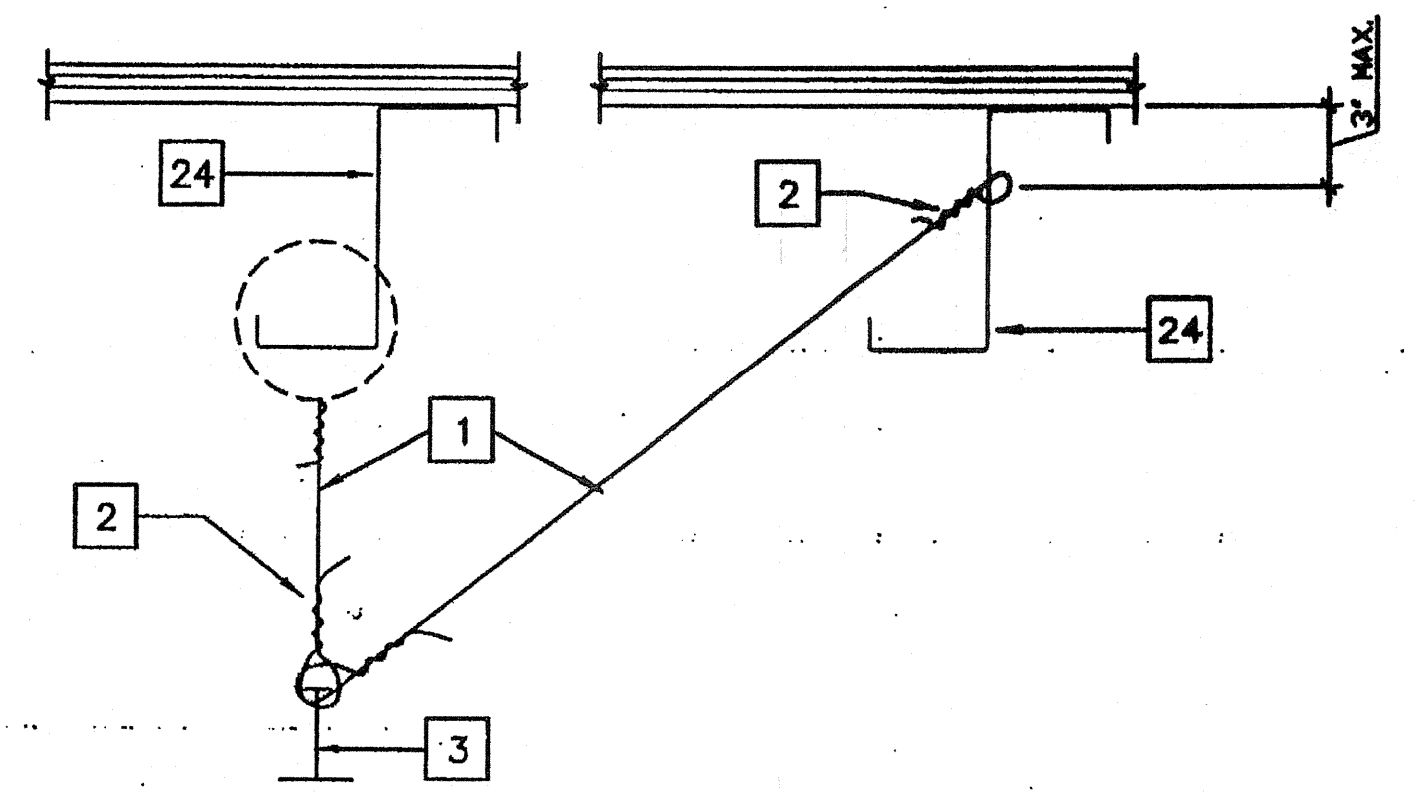


5

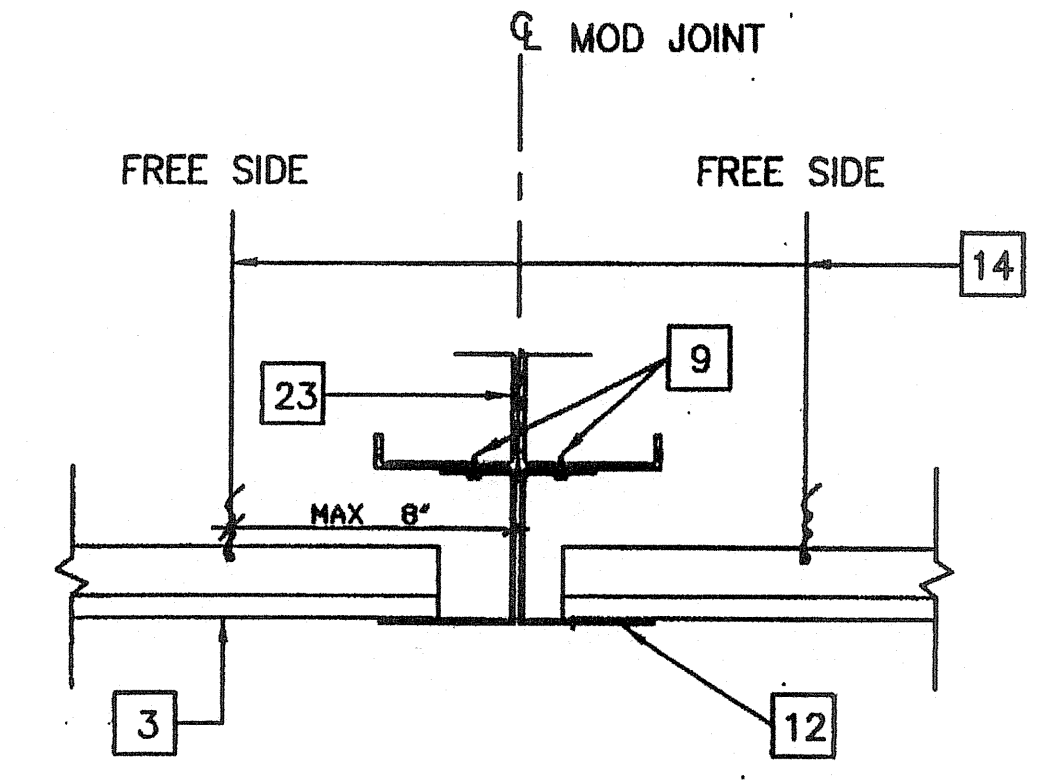

GRID AT MOD LINE


2

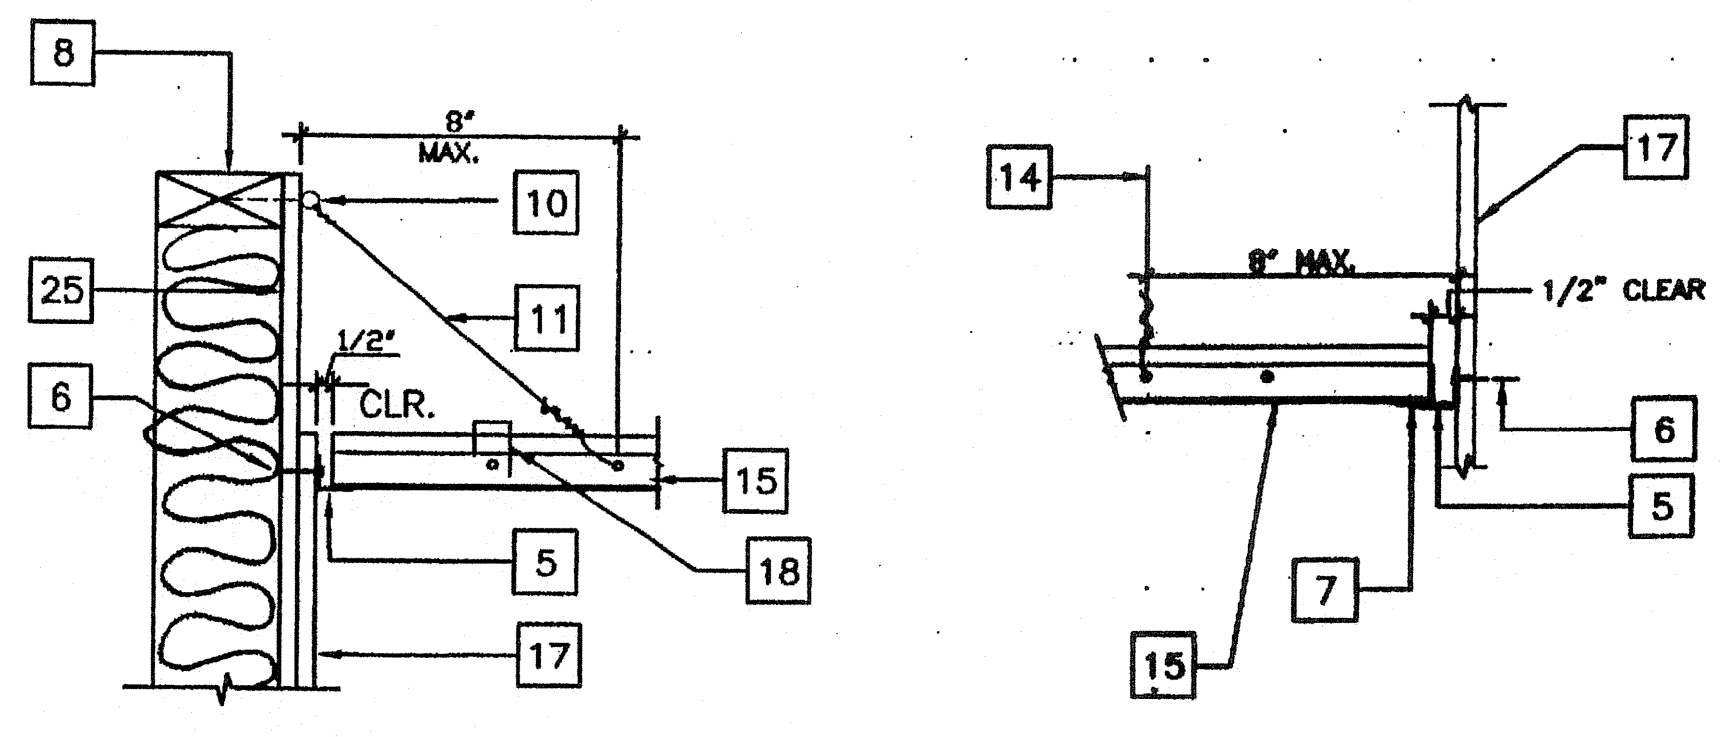

ALTERNATE

TYPICAL FREE SIDE

6

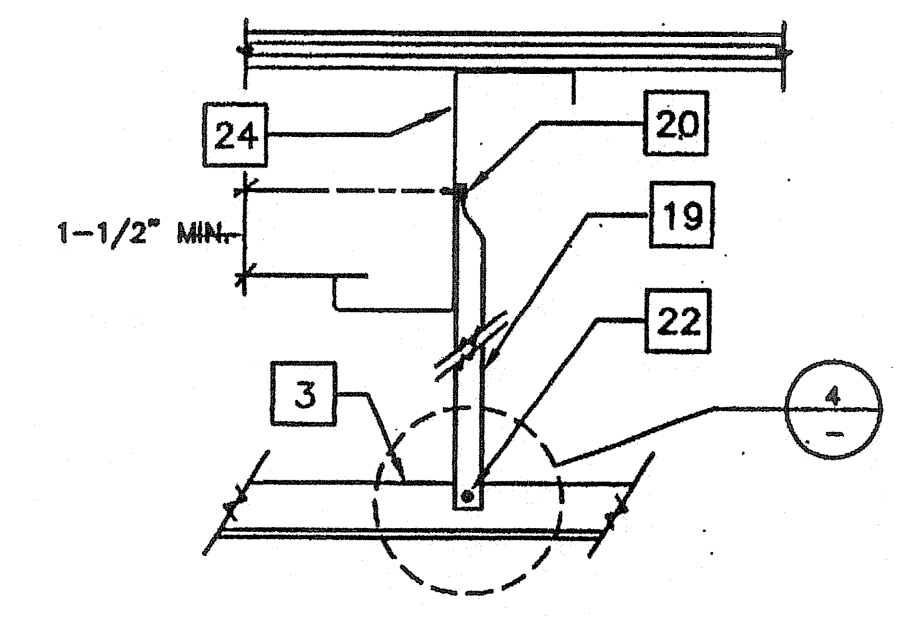

NOTE: CONDUIT MAY BE CRIMPED ON EITHER SIDE OF T-BAR DEPENDING UPON CONDITION & LOCATION

3

KEY NOTES

- 1 12GA. HANGER OR DIAGONAL SPLAY WIRE IN PUNCHED OR DRILLED HOLE
- 2 12GA. WIRE WITH 4 WRAPS IN 1 1/2" (TYP.) WIRE TO RUN PERPENDICULAR TO MAIN TEE
- 3 MAIN RUNNER
- 4 1/8" POP RIVET TO EACH T-BAR
- 5 WALL ANGLE
- 6 6d 16" FRAMING TO WALL STUD #8 S.T.S.M.S. WHEN METAL STUDS ARE USED
- 7 ANGLE WITH 1/8" POP RIVET TO EACH T-BAR NO CONNECTION TO WALL ANGLE
- 8 TOP PLATE
- 9 #10 S.T.S.M.S. @ 4' O.C.
- 10 3" X 1/4" EYED SCREW. 1/8" X 2" JIF-E SCREW WHEN METAL STUDS ARE USED
- 11 HANGER TO WALL WHERE NO RAFTER ABOVE MAX SLOPE 1" IN 6"
- 12 28 GA. JETCOAT
- 13 CROSS TEE
- 14 12GA. HANGER WIRE AT THE END ON EACH RUNNER MIN. 4 WRAPS IN MAX 1 1/2" - SEE DETAIL #5 FOR WIRE TO PURLIN ATTACHMENT
- 15 MAIN RUNNERS OR CROSS TEES
- 16 ACOUSTICAL BOARD
- 17 FINISH WALL
- 18 HORIZONTAL STRUTS SHALL RUN CONTINUOUS AT ALL PERIMETERS, NOT POP RIVETED TO THE WALL ANGLE ARMSTRONG #7425 OR #7445 WITH SPRING STEEL SNAP TO RUNNER PER IR-M-3
- 19 3/4" EMT CONDUIT - MAX 5'-2" (COMPRESSION STRUT)
- 20 CRIMP CONDUIT AND ATTACH TO RAFTER WITH (T) #8 TEK SCREW
- 21 PROVIDE SPACE AT ALL MEMBERS AT OPPOSITE WALL
- 22 CRIMP CONDUIT AND ATTACH TO T-BAR GRID WITH (T) #8 TEK SCREW
- 23 ROOF BEAM SEE (STR)
- 24 ROOF PURLIN SEE (STR)
- 25 ~~ROOF PLANKS PLANKS, INSULATION, POP RIVETS~~

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES

04 105455
FLS [Signature] SS [Signature]
DATE JUL 17 2003

JUL 10 2003

Notes:
1. FIRE BLOCKING TO BE PROVIDED AT CEILING LEVEL OF ALL WALLS. FIRE BLOCKING MAY BE WOOD, GYPSUM BOARD, GOMBENT FIRE BOARD OR Batts OR BLANKETS OF MINERAL OR GLASS FIBER INSULATION PER CBC SECTION 708.2.2.

NO.	REVISIONS
1	
2	
3	
4	
5	

Electrical Engineer's Seal
Mechanical Engineer's Seal
PC Professional of Record Seal
Architects Seal

PC
CBC 2001
IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
PC-04
104796
DATE 8/2/03

MODTECH™
2830 BARRETT AVENUE FAX (909) 943-4014
PERRIS, CALIF. 92572 FAX (909) 940-0427

PROJECT NUMBER: 4736
WILLIAM SCOTTSMAN

© MODTECH, INC. 2002
ALL RIGHTS RESERVED

DRAWN BY: GL
DATE: 07/07/03
CHECKED BY:
DATE:

MODTECH Index No.
A2.09

REFLECTED CEILING DETAILS


PROJECT NO. 4736

KEY NOTES

- 1 DOWNSPOUT (TYPICAL 3" X 2" X 26GA)
- 2 CONTINUOUS GUTTER 26GA.
- 3 22GA. MIN. INTERLOCKING ROOF PANELS (TYP)
- 4 MODLINE
- 5 RIDGELINE

NOTES

- 1. BUILDING HOUSING GROUP E OCCUPANCIES SHALL HAVE ROOF COVERINGS AS SPECIFIED IN TABLE 15A. C.B.C. CLASS A

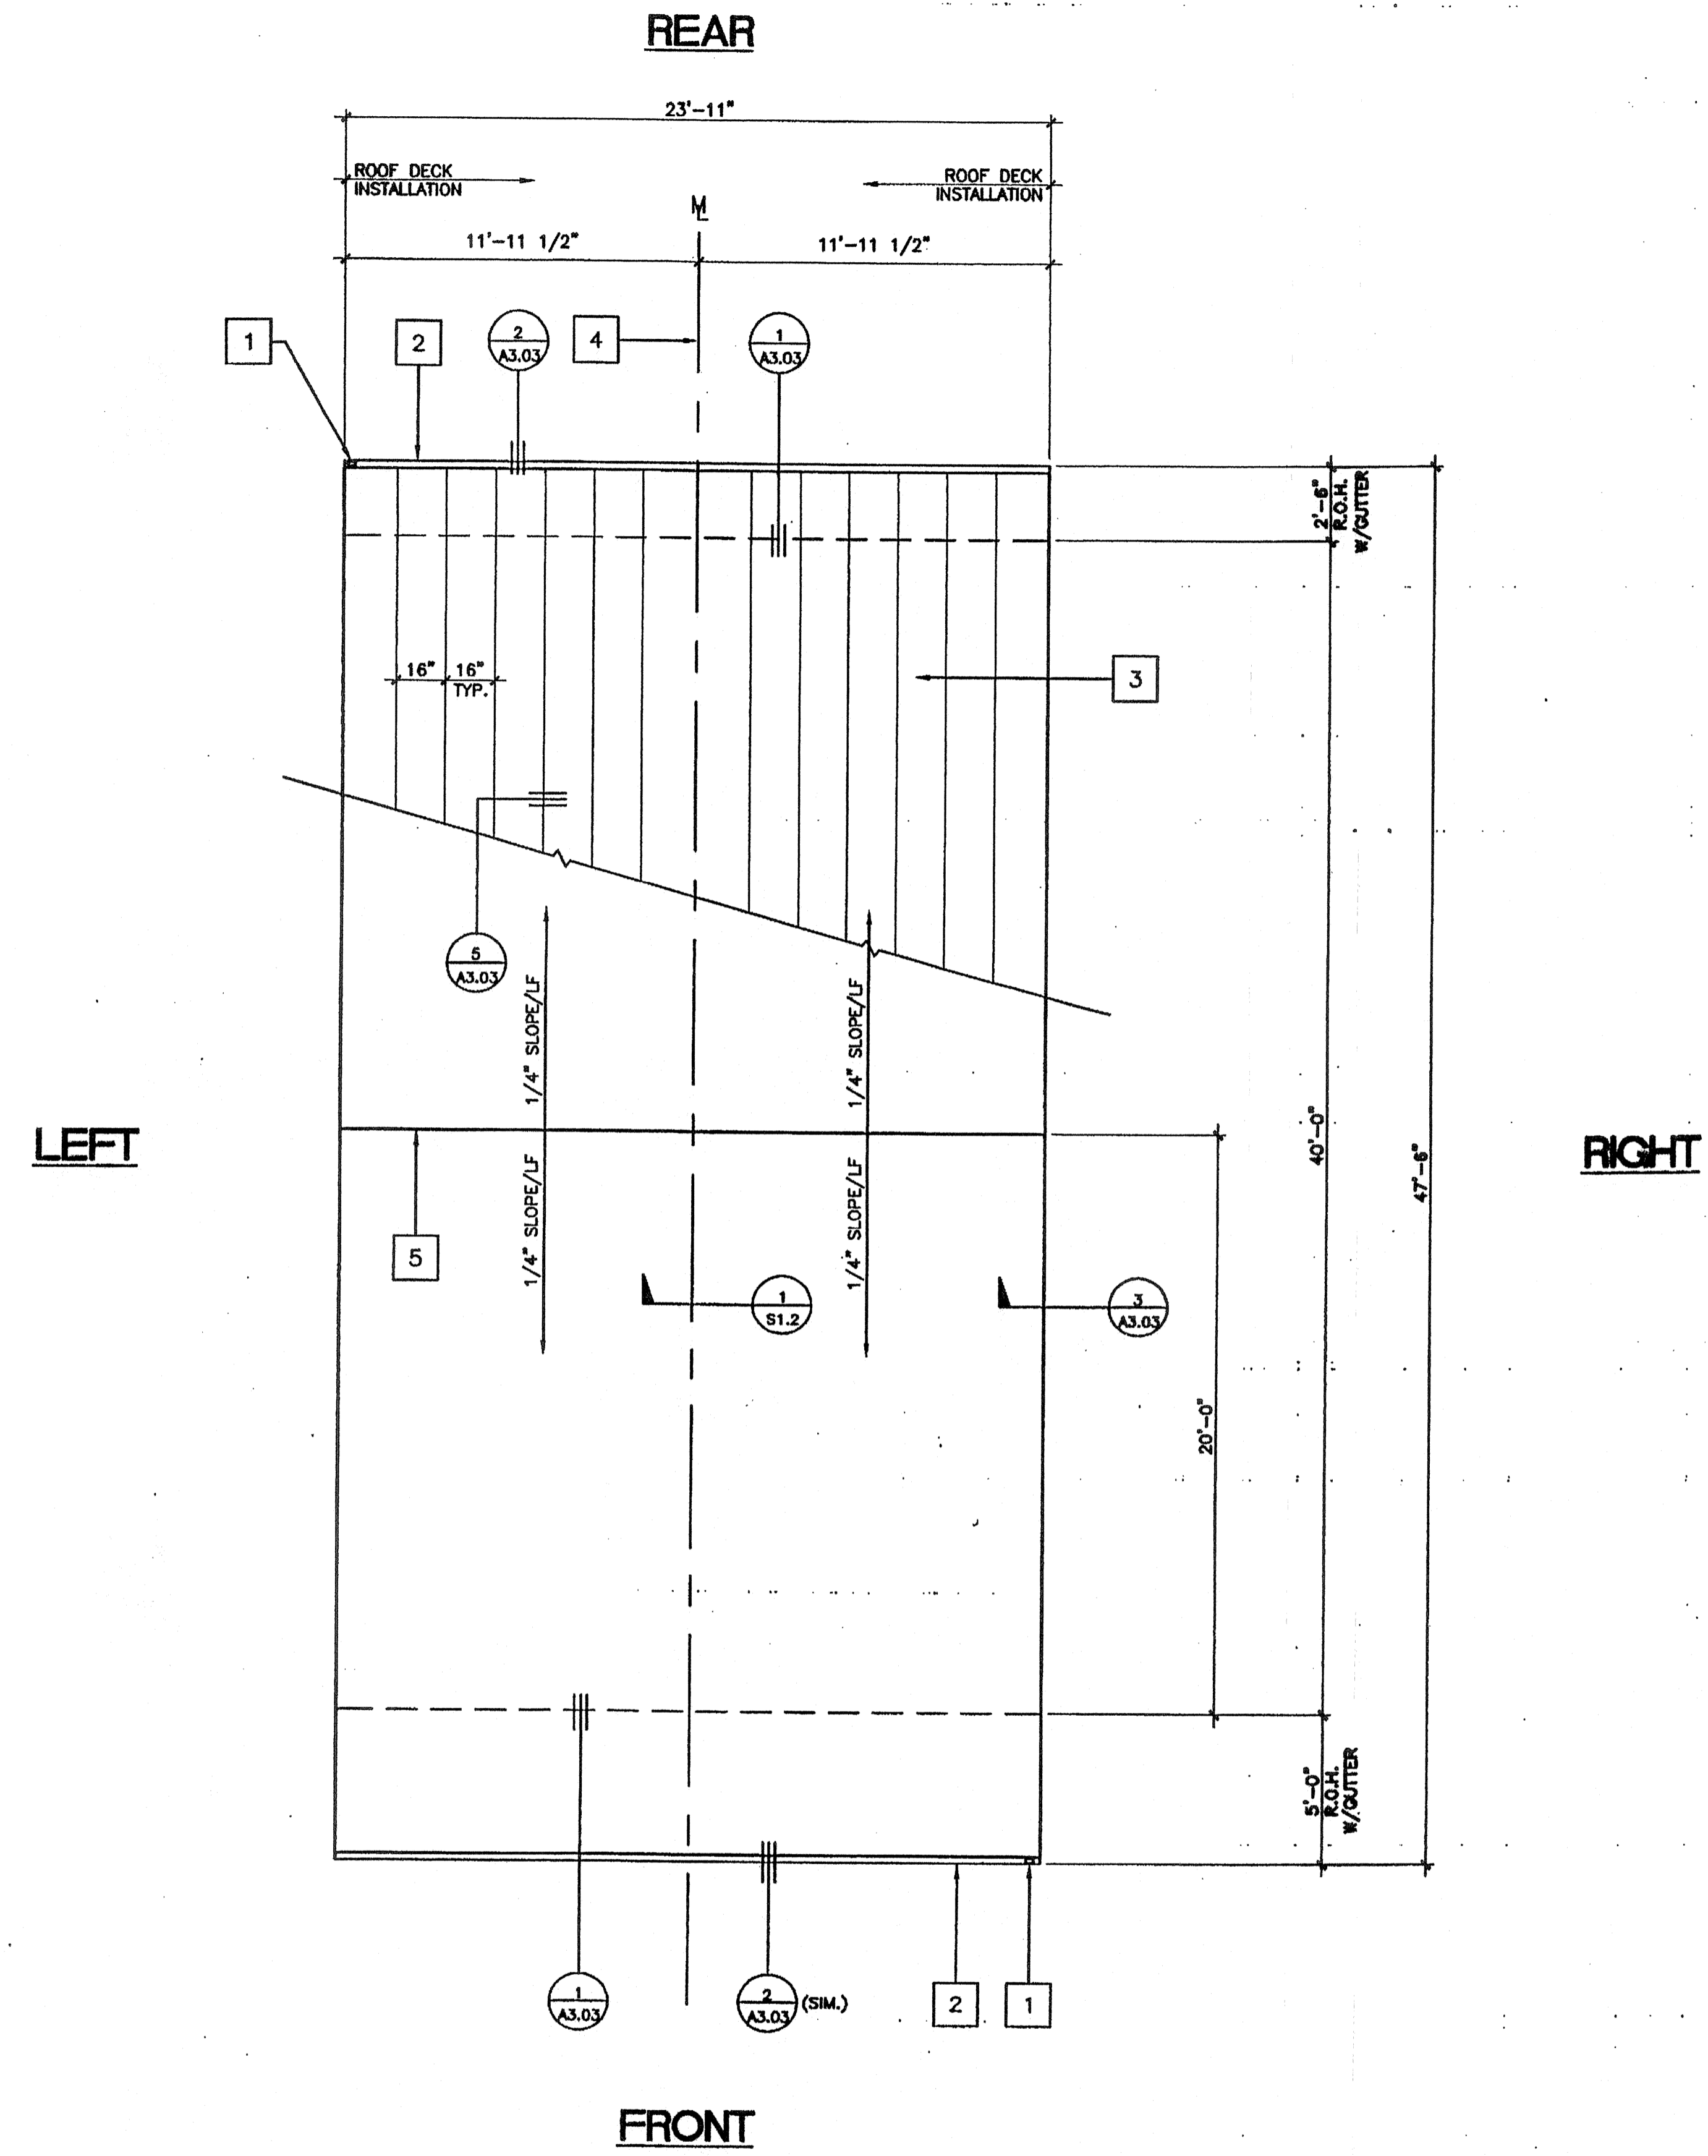

ROOF PLAN (DUAL SLOPE) (24'X40')

SCALE: 1/4" = 1'-0"

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 04 105455
 AC PLS SS W/S
 DATE JUL 17 2003

~~IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 04 105455
 AC PLS SS W/S
 DATE JUL 17 2003~~

REVISIONS	DESCRIPTION	DATE
1		
2		
3		
4		
5		

Electrical Engineer's Seal	Mechanical Engineer's Seal	PC Professional of Record Seal 	Architect's Seal
----------------------------	----------------------------	------------------------------------	----------------------

PC
CBC 2001
 IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 PC-04
 104796
 AC PLS SS W/S
 DATE 7/2/03

MODTECH™
 2830 BARRETT AVENUE FAX (909) 943-4014
 PERRIS, CALIF. 92572 FAX (909) 940-0427

PROJECT NUMBER: 4736
 WILLIAM SCOTTSMAN

© MODTECH, INC. 2002
 ALL RIGHTS RESERVED



ROOF PLAN

DRAWN BY: GL
 DATE: 07/07/03



CHECKED BY:
 DATE:

MODTECH Order No.
A3.01

PROJECT NO. 4736
 PC-04-104796

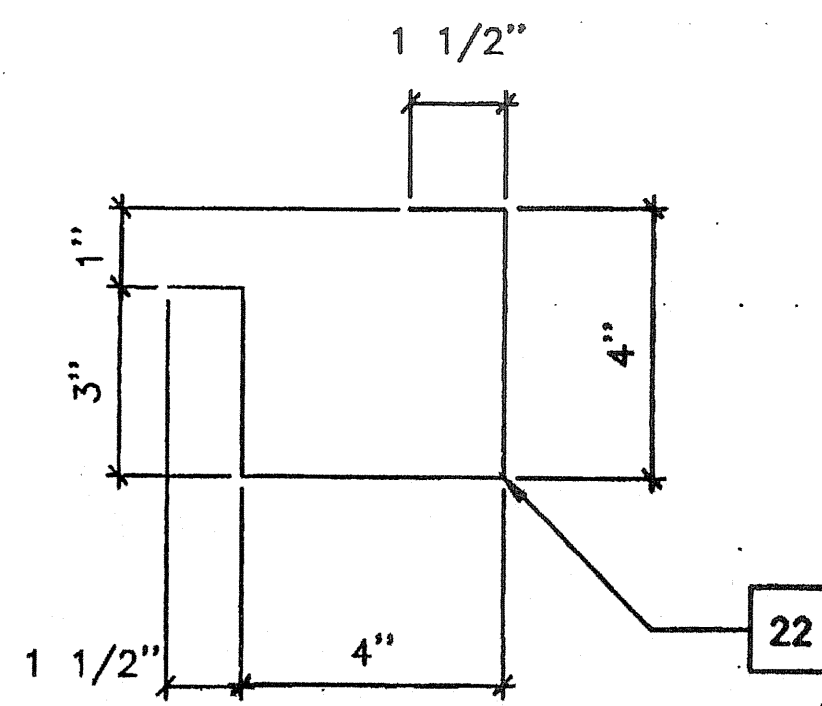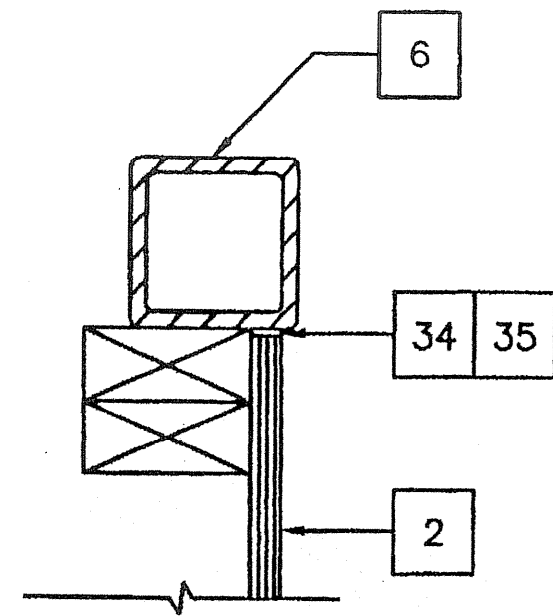

SCALE: 3"=1' CONT. GUTTER 26GA. AT FRONT

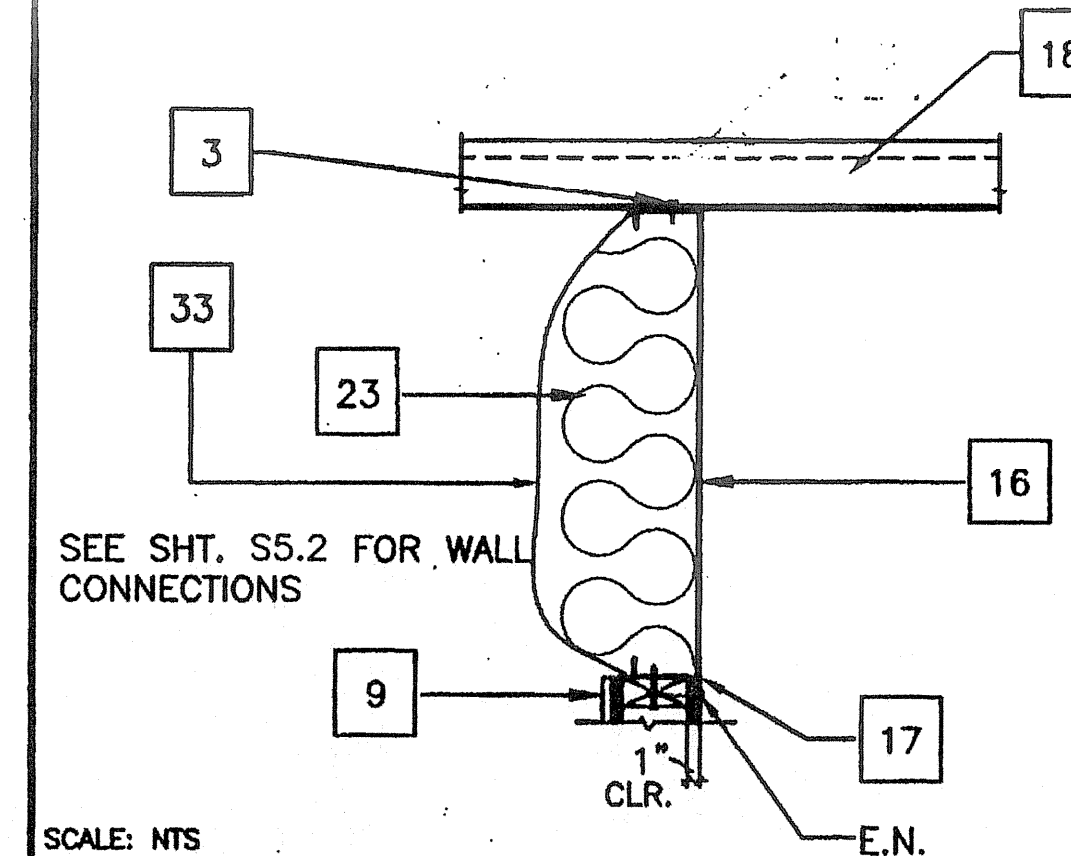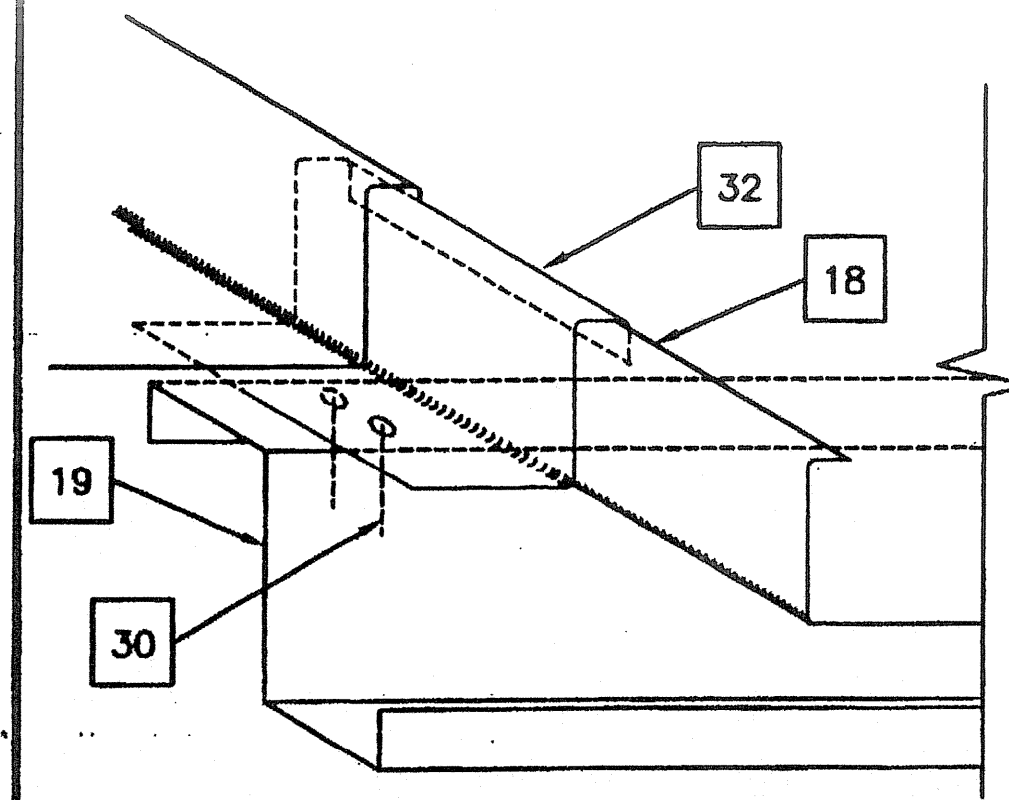

SCALE: NTS


KEY NOTES

- 1 TYP. INTERIOR FINISH
- 2 TYP. EXTERIOR FINISH
- 3 #14STSMS X 3/4" W/NEO WASHER 3 PER PAN MAX 6" O.C. AT HEADER FRONT AND REAR
- 4 2X4 STUD TYP. 16" O.C.
- 5 1 1/2"X1 1/2" X 22GA ∠ CLIP AT 32" O.C.
- 6 TUBE STEEL SEE [STR]
- 7 NOT USED
- 8 SEALANT TYP. (SEE SPECIFICATIONS)
- 9 EXTERIOR WALL (SEE S5.0 FOR CONNECTIONS)
- 10 #14 STSMS AT EA STANDING RIB (16" OC)
- 11 DOWNSPOUT
- 12 #8 STSMS 1 AT EA SIDE OF DOWNSPOUT TO BRACKET
- 13 ~~NOT USED~~
- 14 ATTACHMENT BRACKET (TYP 3 PLACES: TOP, BOTTOM & MIDSPAN W/ 2 #10 STSMS. BRACKET TO STUD) SEE NOTE AT DETAIL 8
- 15 2 X 4 SILL PLATE PER 4/66.1
- 16 ROOF HEADER SEE [STR]
- 17 1/4" GAP w/ 3/8" DIA BACKER ROD 1/4" CAULKING/COLOR CAULK, MATCH PAINT
- 18 STANDING SEAM ROOF (SEE A3.01 FOR GA.)
- 19 ROOF PURLIN SEE [STR]
- 20 FLOOR BEAM SEE [STR]
- 21 22GA GALV. FLASHING (AT BELOW GRADE CONG. FOUNDATION ONLY)
- 22 CONTINUOUS 26GA. GUTTER (SEE DETAIL #9)
- 23 INSULATION (SEE SPECS FOR TYPE AND SIZE)
- 24 #14 STSMS AT EACH CLIP (32" O.C.)
- 25 22 GA STARTER/END ROOF CLIP-DETAIL #3
- 26 1/4" CONTINUOUS BEAD OF SEALANT AROUND ENTIRE PERIMETER OF FRAME
- 27 #10 STSMS WITH NEOPRENE WASHER FOR FLASHING INTO ROOF BEAM @ 24" O.C.
- 28 26 GA GALVANIZED IRON FLASHING AT SIDE WALL
- 29 C 14x12 GA HEADER
- 30 (2) BZH #4.075 KNURLED DRIVING PING ROOF CLIP TO EACH PURLIN TO ROOF BEAM AND TO HEADER (PURLINS @ 16" O.C.)
- 31 ~~22-GA STANDING SEAM ROOF PAN~~
- 32 22 GA ROOF CLIP (AT EA. PURLIN)
- 33 PROVIDE VAPOR BARRIER OVER INSULATION AT ROOF BEAMS AND CEILING
- 34 1/4" GAP w/ 3/8" BACKER ROD
- 35 1/4" CAULKING/COLOR CAULK, MATCH PAINT


17 EXT. FINISH TO COLUMN

13 CONT. GUTTER AND CLOSURE 9 ROOF STANDING SEAM


5 END WALL AT ROOF 1

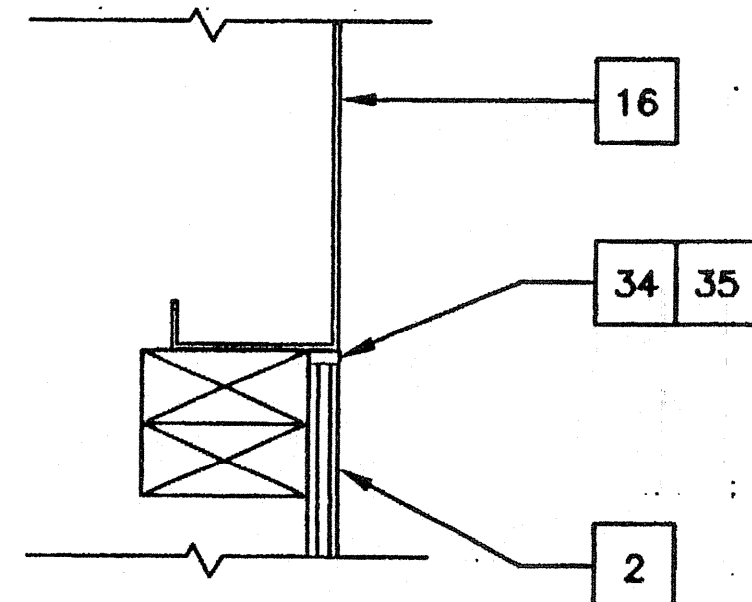


14 EXT. FINISH TO BEAM/HEADER 10

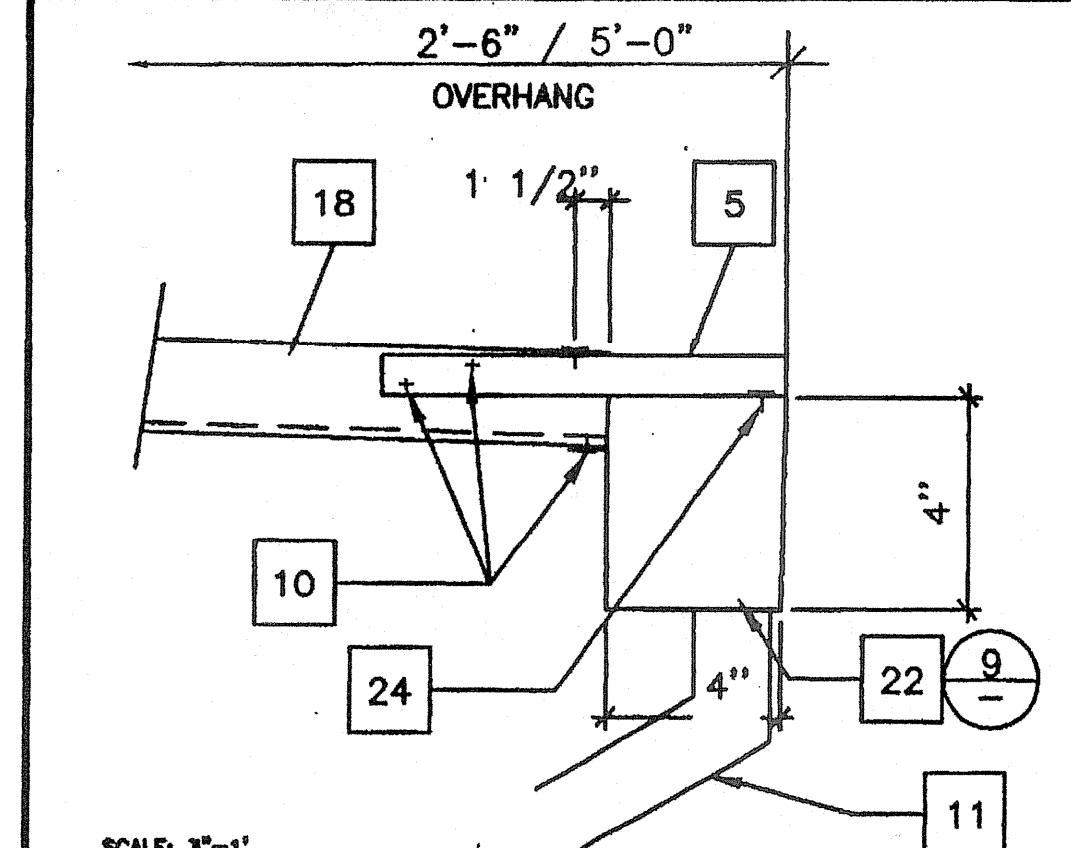

2 GUTTER • ROOF HEADER

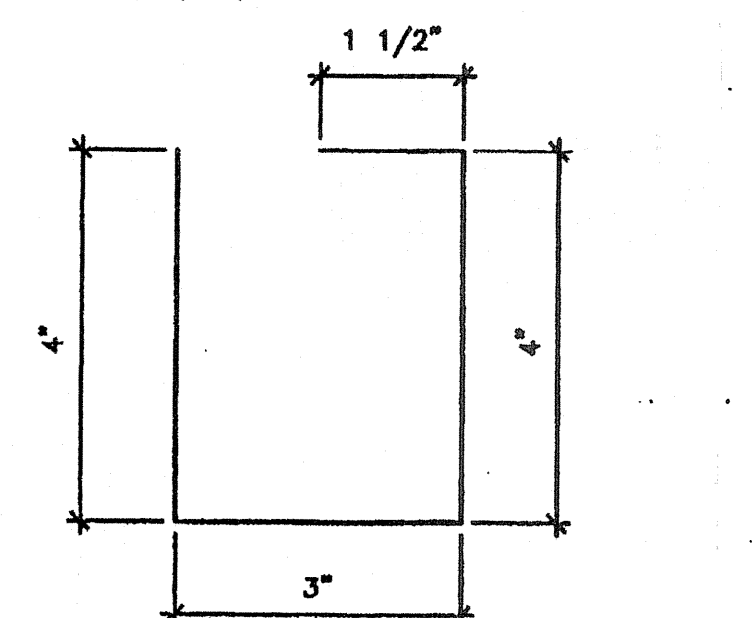



SCALE: NTS CONT. GUTTER 26GA. AT REAR

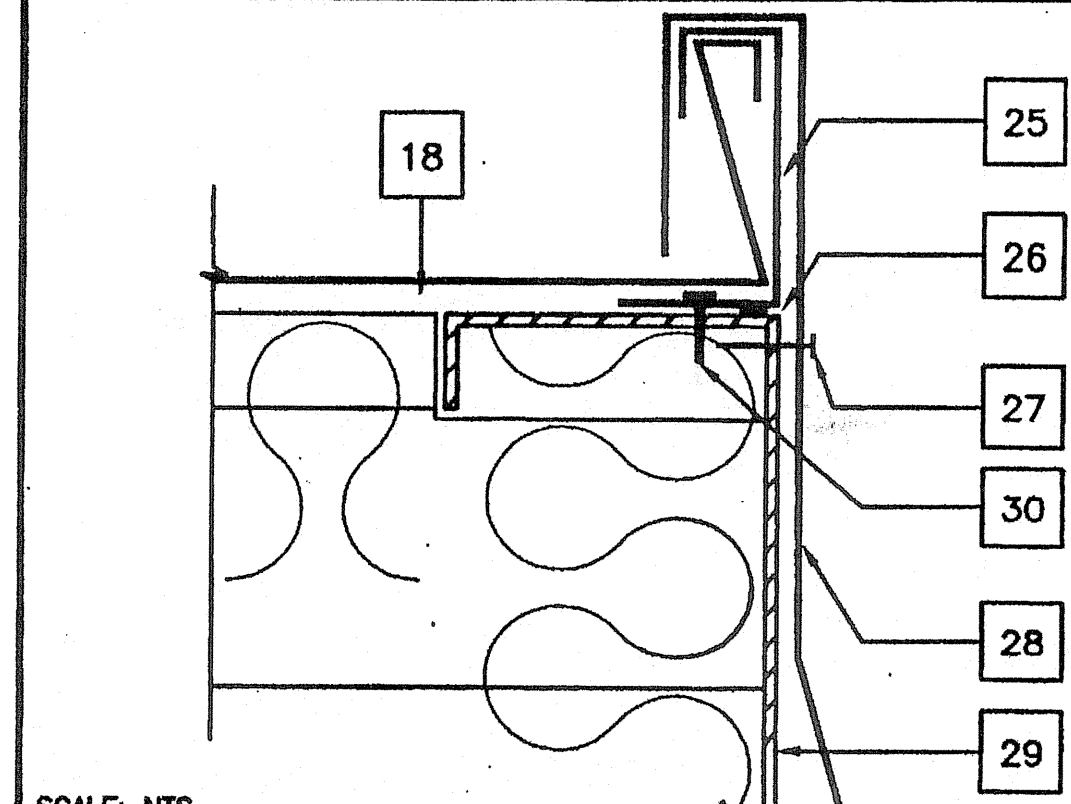

6 ROOF FLASHING AT SIDE WALL 3


15 CONT. GUTTER AND CLOSURE 11

3

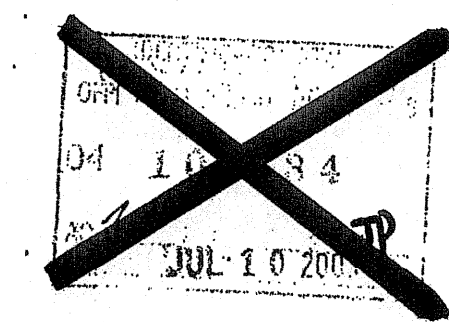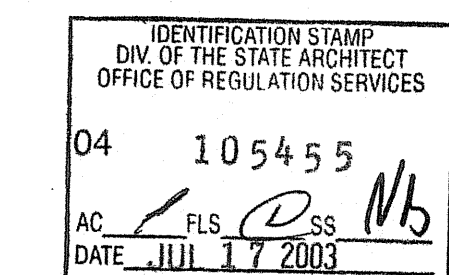

REVISIONS

Electrical Engineer's Seal
Mechanical Engineer's Seal
PC Professional of Record Seal
Architect's Seal

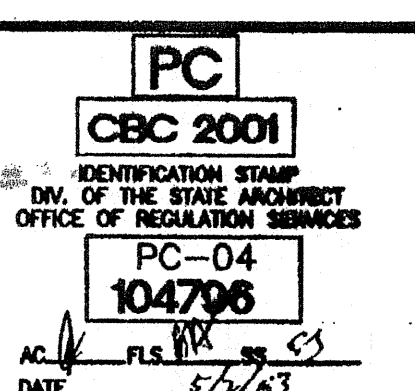


MODTECHTM
2830 BARRETT AVENUE FAX (909) 943-4014
PERRIS, CALIF. 92572 FAX (909) 940-0427

PROJECT NUMBER: 4736
WILLIAM SCOTTSMAN
© MODTECH, INC. 2002 ALL RIGHTS RESERVED
DRAWN BY: GL DATE: 07/07/03
CHECKED BY: DATE:
MODTECH Index No. **A3.03**

ROOF DETAILS


FILE PATH:

PROJECT NO. 4736

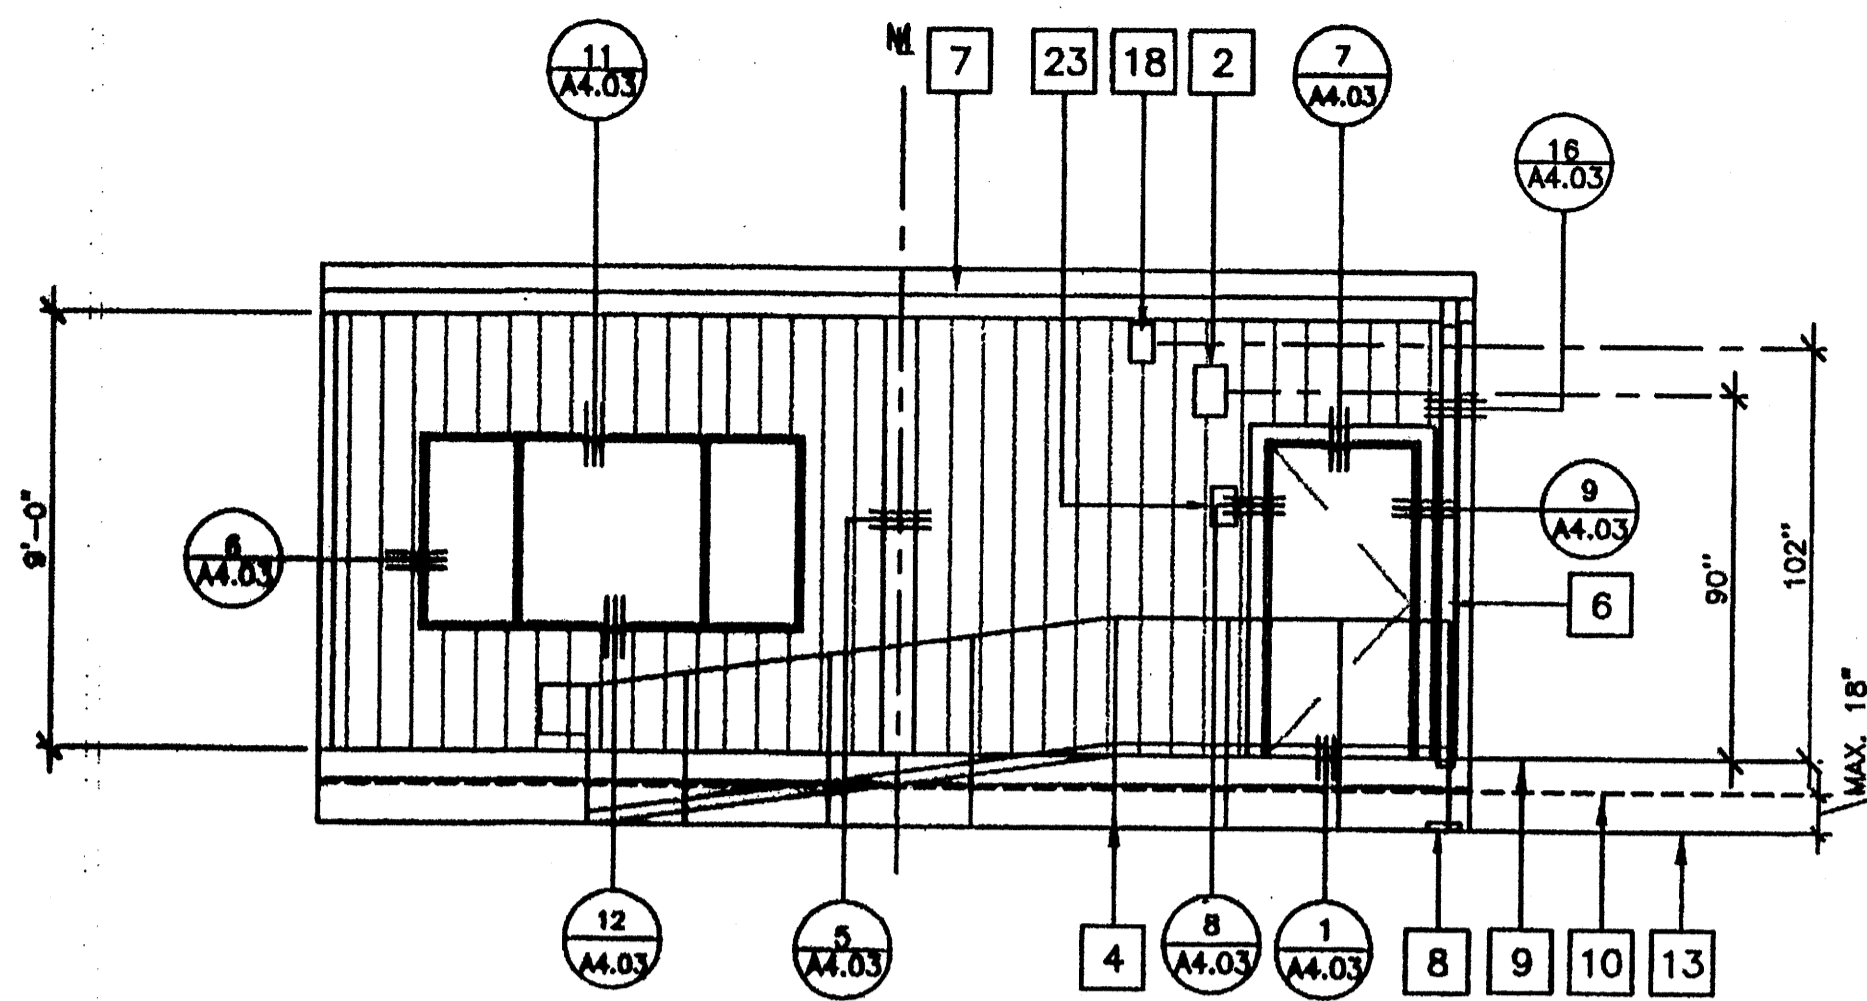


1 FRONT ELEVATION
OPP-HAND

1/4" = 1'-0"

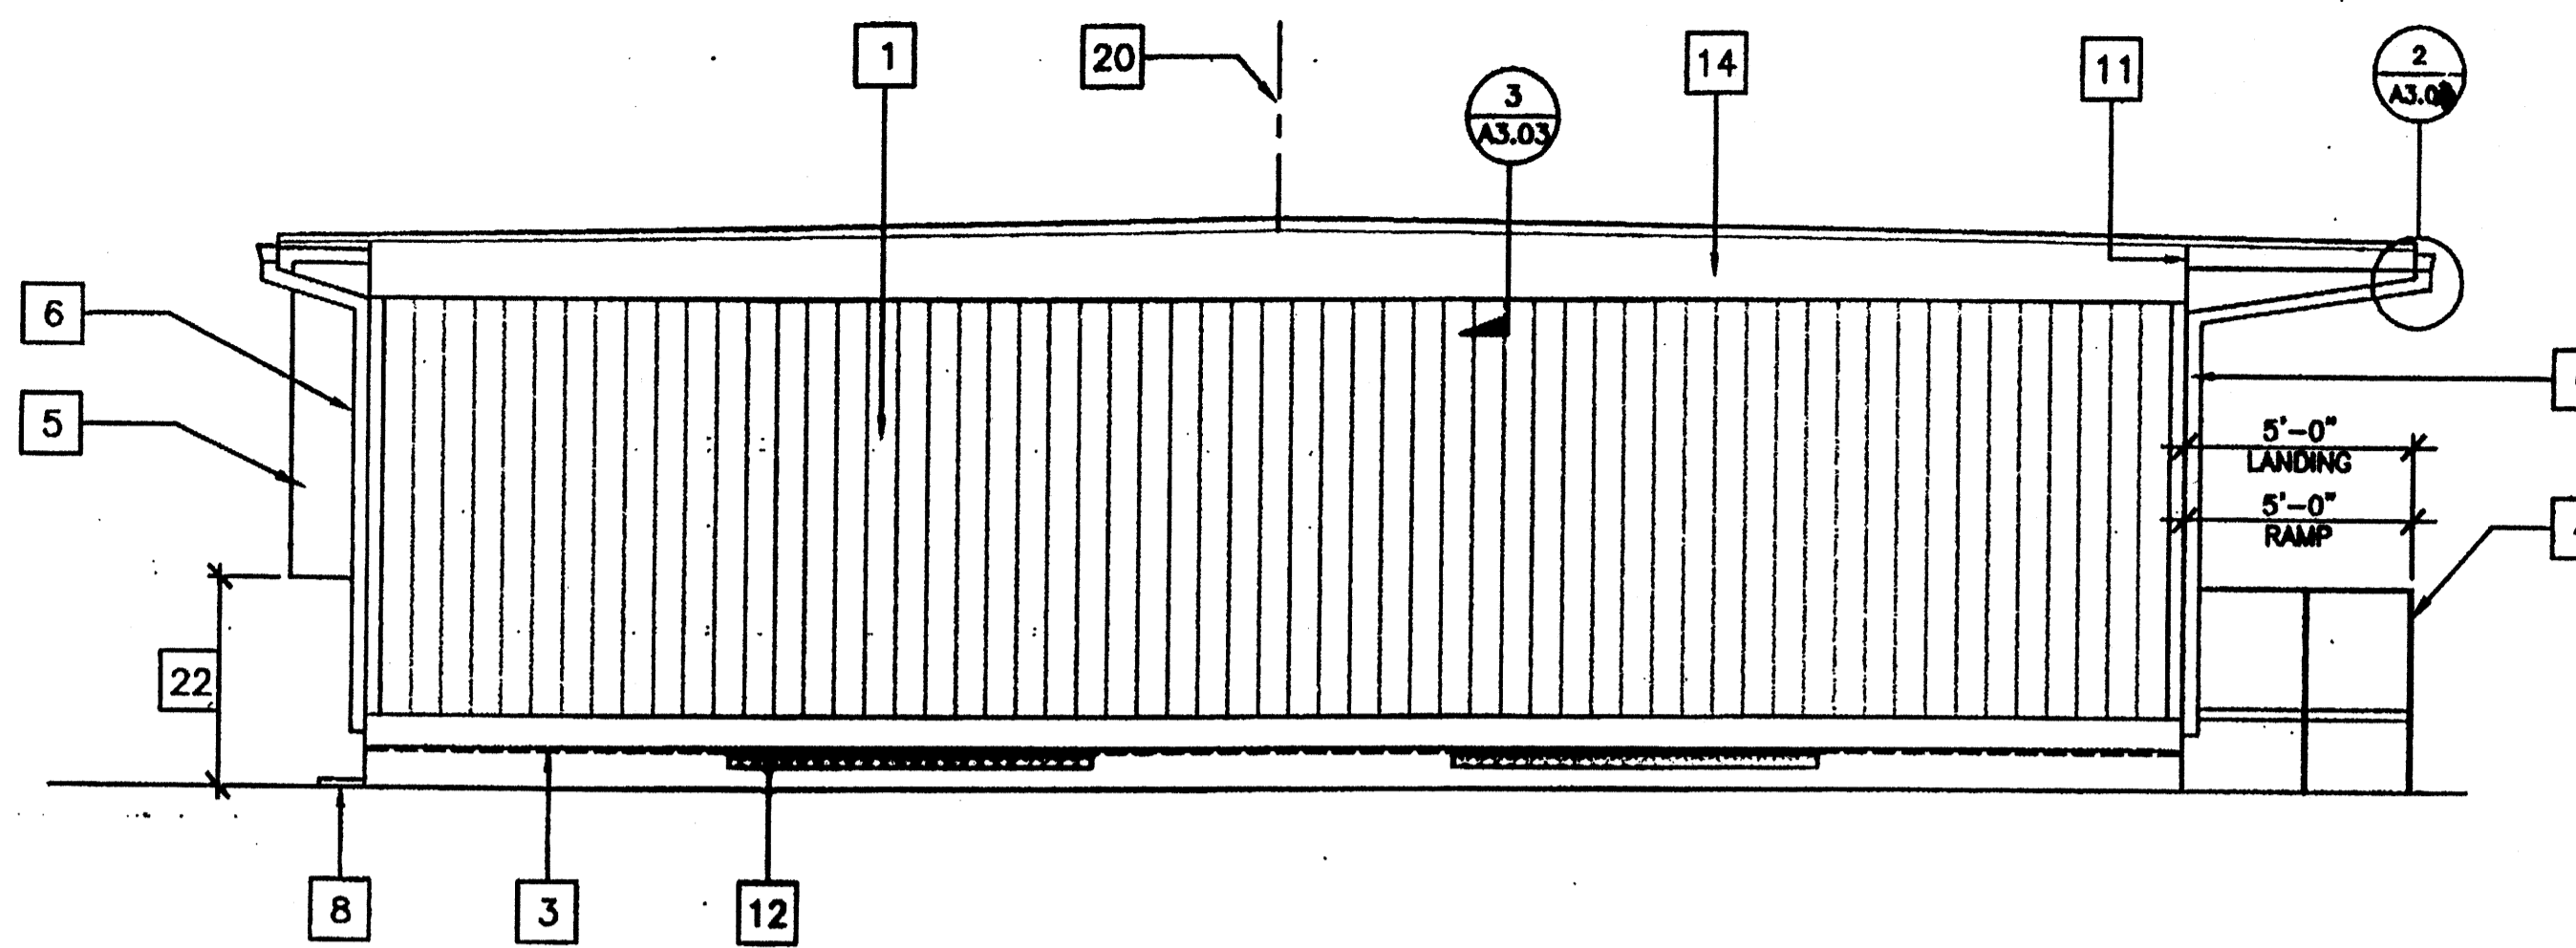


2 LEFT ELEVATION

1/4" = 1'-0"

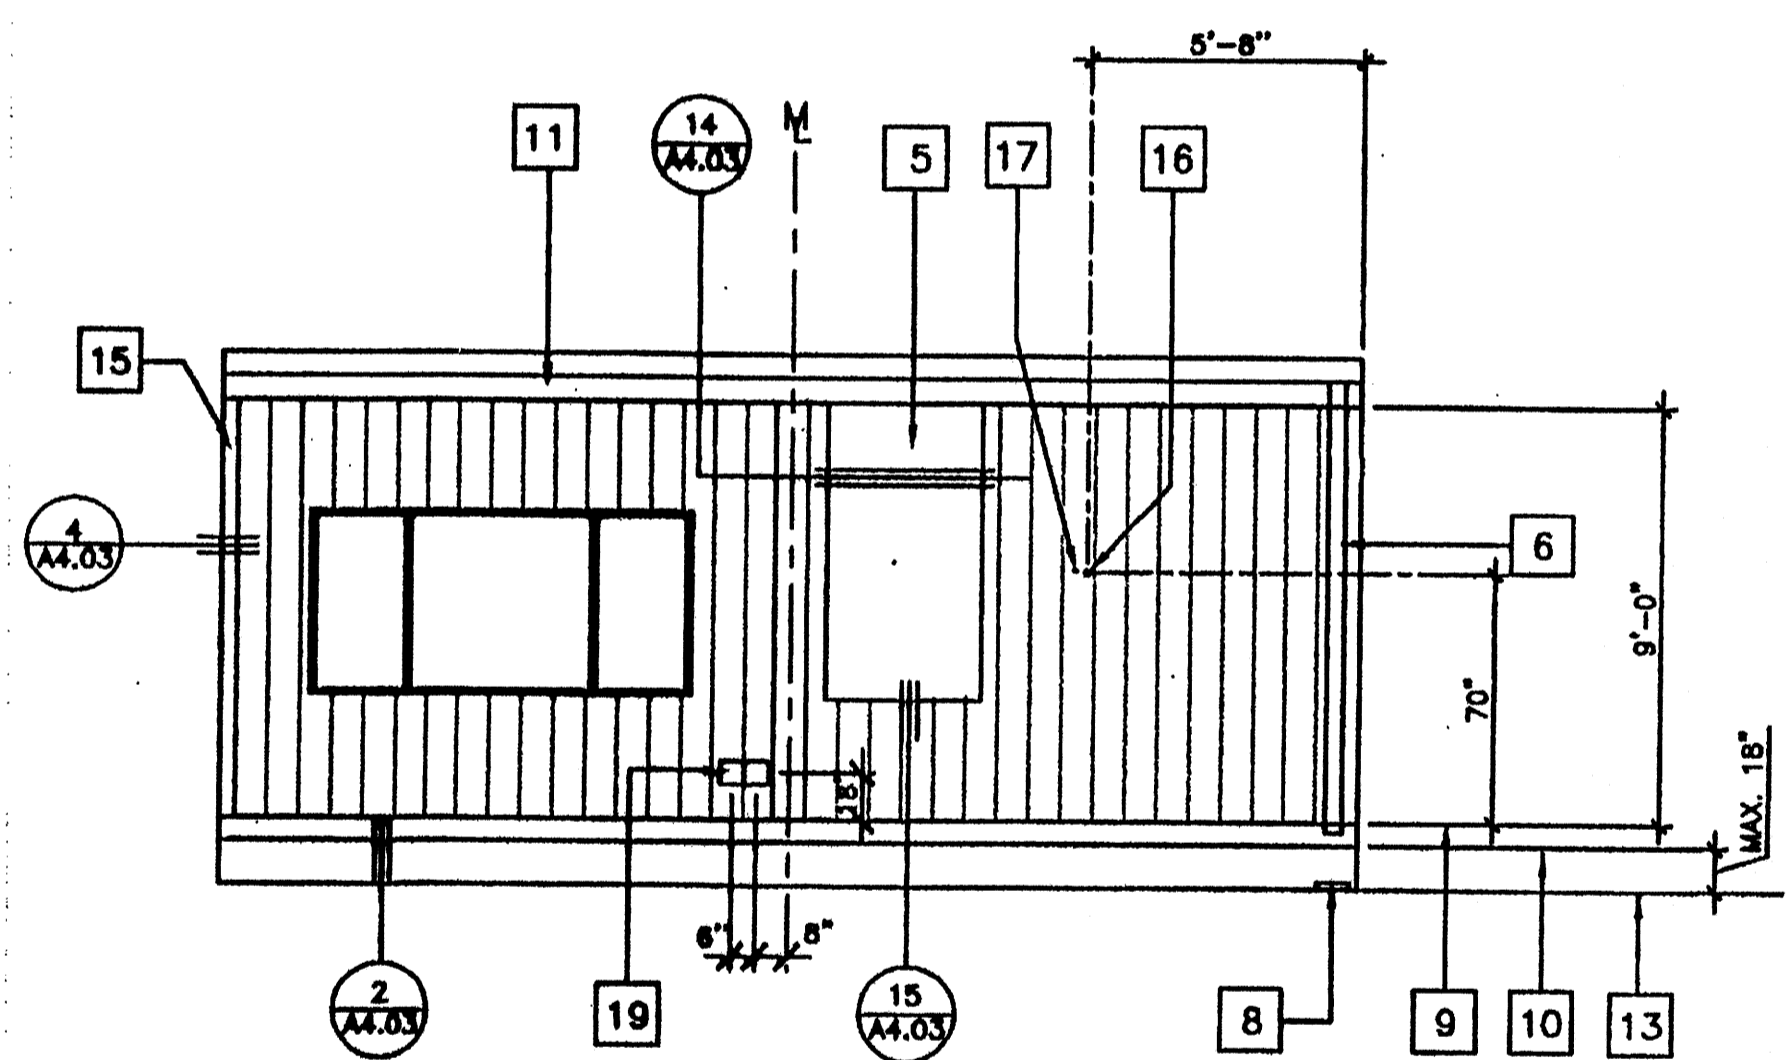

3 REAR ELEVATION
OPP-HAND

1/4" = 1'-0"

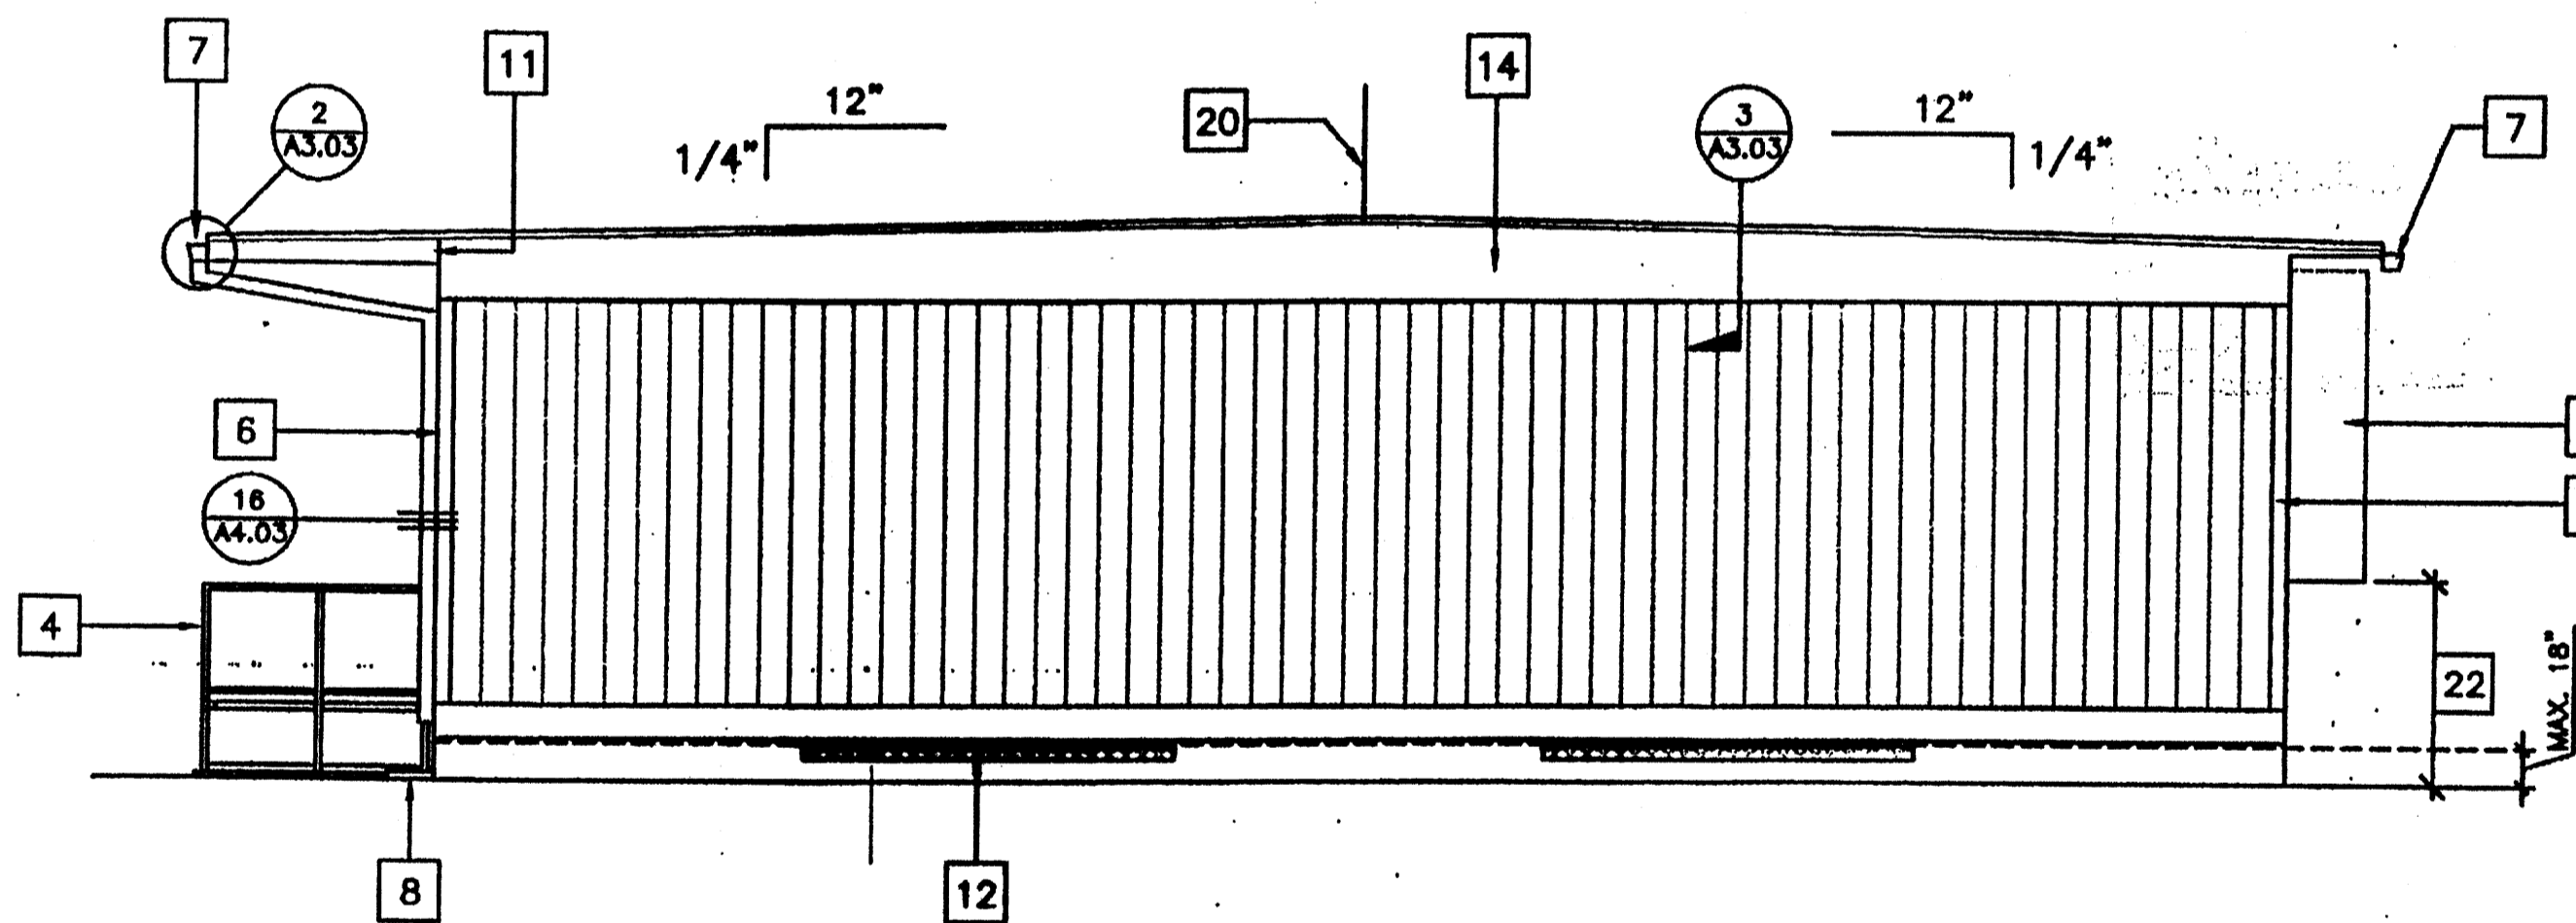

4 RIGHT ELEVATION



1/4" = 1'-0"

KEY NOTES

- 1 TYPICAL EXTERIOR SIDING (SEE A6.02)
- 2 EXTERIOR LIGHT FIXTURE (SEE SPEC'S)
- 3 TOP OF SKIRTING
- 4 RAMP AND LANDING **RAMP** SEE RAMP DRAWINGS
- 5 HVAC UNIT. SEE **HV**
- 6 DOWNSPOUT (TYP.) FOR (2). FASTEN TO BLD'G. TYP 3 PLACES (SEE 16/A4.03)
- 7 CONTINUOUS GUTTER WITH DOWNSPOUT (LOCATION OF DOWNSPOUT SHOWN ON ROOF PLAN) SEE A3.01
- 8 SPLASH BLOCK (BY OTHERS)
- 9 FINISH FLOOR LINE
- 10 BOTTOM FLANGE OF FLOOR BEAM
- 11 ROOF HEADER
- 12 VENT. SEE FOUNDATION PLAN
- 13 FINISH GRADE
- 14 ROOF BEAM SEE **STR**
- 15 COLUMN SEE **STR**
- 16 ELECTRICAL STUB-OUT SEE **EL**
- 17 GROUND STUB-OUT SEE **EL**
- 18 J BOX FOR EXT. FA HORN SEE **EL**
- 19 NEMA 6" X 6" GUTTER BOX SEE **EL**
- 20 RIDGE
- 21 NOT USED
- 22 IF HVAC UNIT IS LOCATED IN ANY PATH OF TRAVEL OR CIRCULATION AREA AND HEIGHT FROM GRADE TO BOTTOM OF UNIT EXCEEDS 27" THEN PROTECTION MUST BE PROVIDED BY DISTRICT PRIOR TO OCCUPANCY
- 23 SIGNAGE PROVIDED AND INSTALLED BY DISTRICT PRIOR TO OCCUPANCY. SEE SHEET A6.02

NOTES

- 1. SEE FOUNDATION PLAN FOR SIZE AND LOCATION OF UNDER FLOOR VENTS.

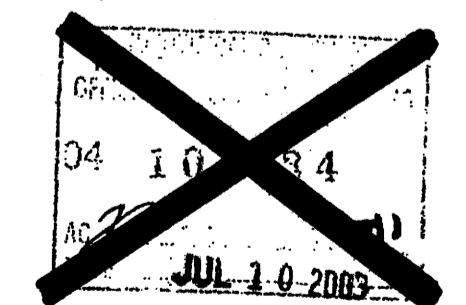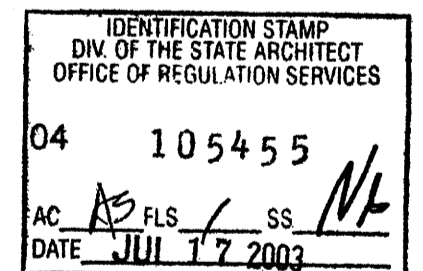

REVISIONS	DESCRIPTION

Electrical Engineer's Seal
Mechanical Engineer's Seal
PC Professional of Record Seal

Architects Seal

PC
CBC 2001
IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
PC-04
104796
DATE: 7/17/03


MODTECHTM
2830 BARRETT AVENUE FAX (909) 943-4014
PERRIS, CALIF. 92572 FAX (909) 940-0427

PROJECT NUMBER: 4736
WILLIAM SCOTTSMAN
© MODTECH, INC. 2002
ALL RIGHTS RESERVED


DRAWN BY: GL
DATE: 07/07/03
CHECKED BY:
DATE:
MODTECH Index No.
A4.01

EXTERIOR ELEVATIONS W/ FASCIA


PROJECT NO. 4736

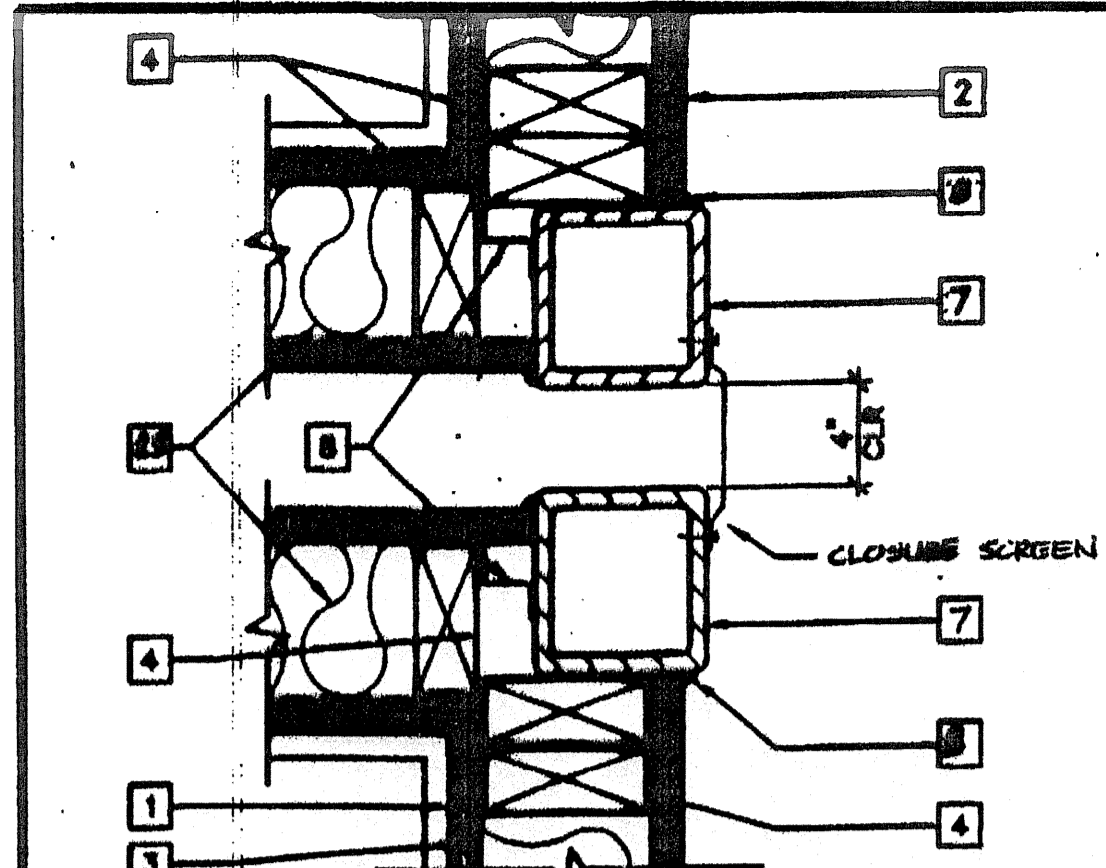


17 CLOSURE BETWEEN BLDG'S

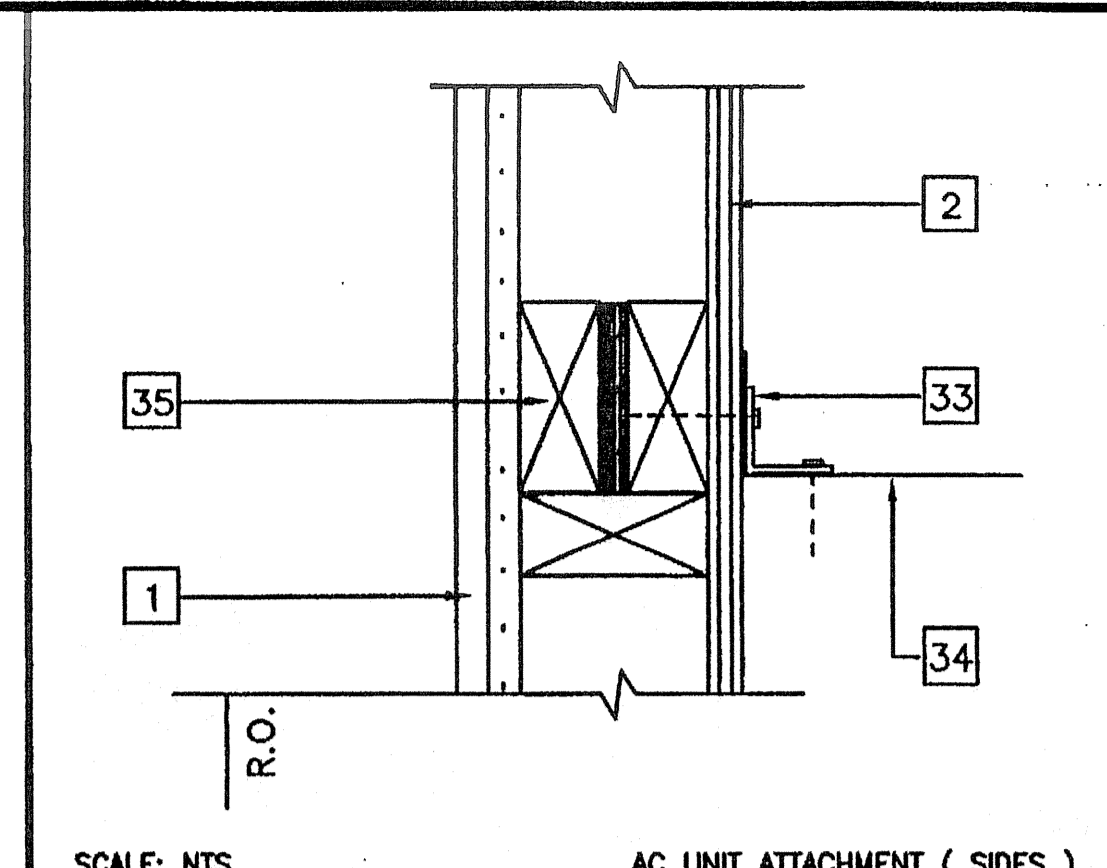


18 UNIT ATTACHMENT

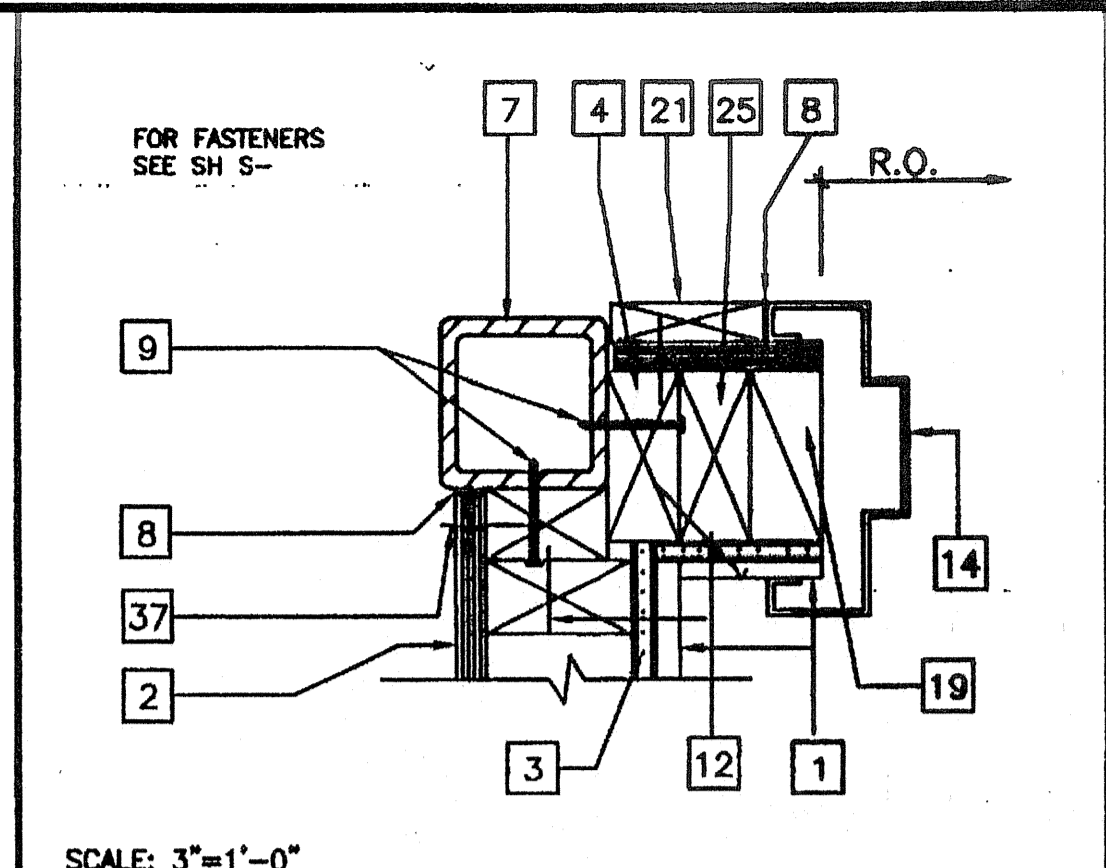

9 DOOR JAMB

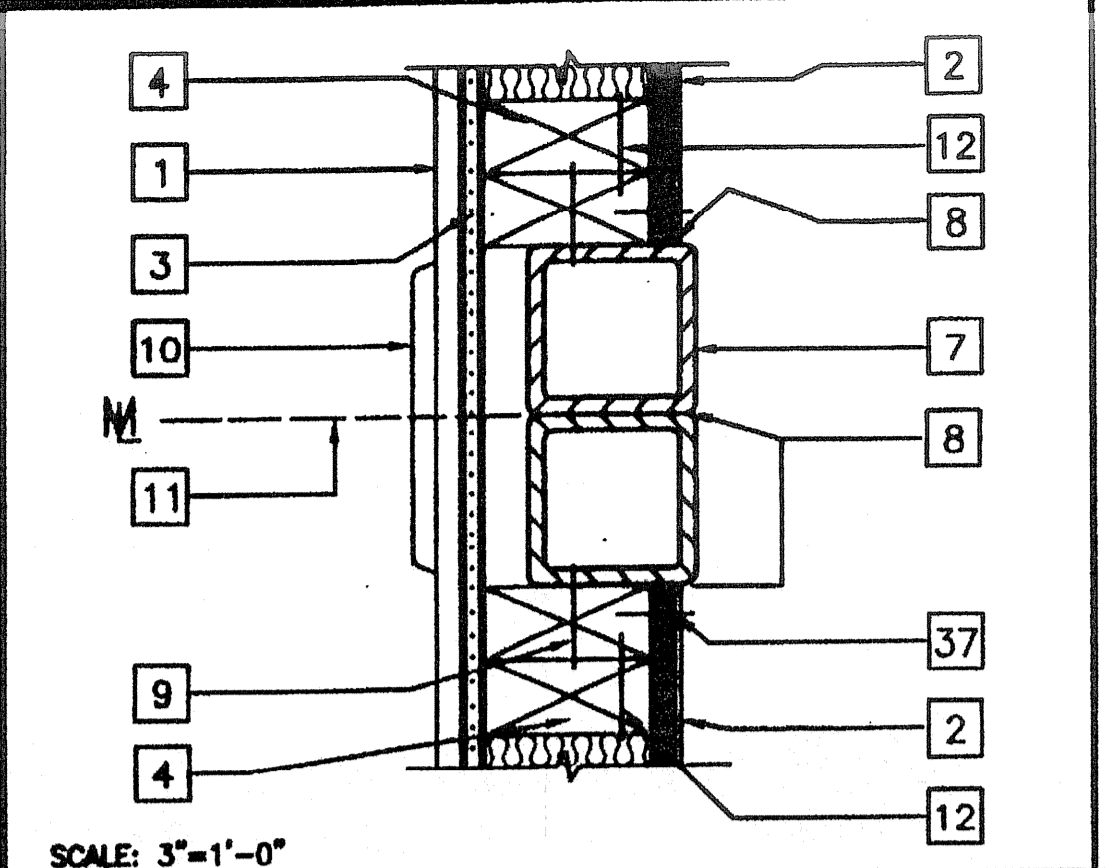


5 COLUMN • MODLINE

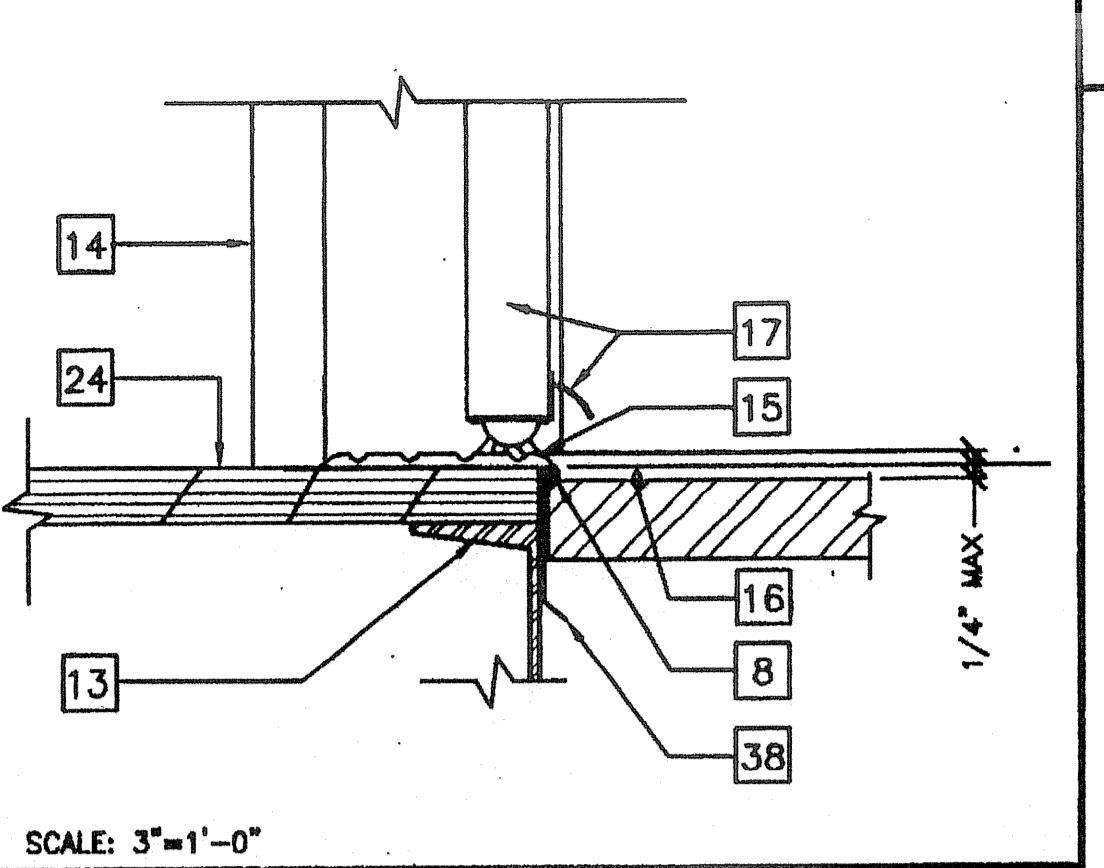


1 THRESHOLD

KEY NOTES


- 1 TYP. INTERIOR FINISH (SEE FINISH SCHEDULE)
- 2 TYPICAL EXTERIOR FINISH
- 3 1/2" GYPSUM BOARD BACKING W/ 7d COOLER NAILS AT MAX 7" O.C. TYP. AT EA. STUD
- 4 2X4 STUD TYP. AT 16" O.C. MAX.
- 5 CORNER MOLD
- 6 DOWNSPOUT
- 7 TUBE STEEL COLUMN SEE (STR)
- 8 CAULKING
- 9 #10 S.T.S.M.S. AT MAX. 24" O.C. (ALT. HILTI 0.145 SHOT PIN) 2X FILLER TO COLUMN
- 10 VINYL CLOSURE
- 11 MODULE JOINT
- 12 16d AT 24" O.C. FACE NAIL OR 16d AT 12" O.C. TOE NAIL (SEE SHEET S5.2)
- 13 FLOOR BEAM SEE (STR)
- 14 PRESSED STEEL FRAME (K.D. TYPE SEE A6.02)
- 15 ALUMINUM THRESHOLD (SEE HARDWARE SCHEDULE)
- 16 FINISH LANDING SEE FLOOR PLAN AND FOUNDATION FOR TYPE AND FINISH
- 17 DOOR AND DOOR BOTTOM (SEE HARDWARE SCHEDULE)
- 18 (2) 2X4 KING STUD (SEE SHEET S5.0)
- 19 2X4 TRIMMER (SEE SHEET S5.0)
- 20 "Z" MOLD 28GA
- 21 4" ABTCCO TRIM
- 22 (2) 2X4 SILL PLATE W/ 16d AT 16" O.C.
- 23 INSULATION (SEE SPECS. FOR SIZE AND TYPE)
- 24 FINISH FLOORING (SEE FINISH SCHEDULE SHEET A6.02)
- 25 2X4 JAMB STUDS (SEE SHEET S5.0) DETAILS FOR NUMBER OF STUDS REQUIRED AND NAILING SCHEDULE FOR NAILING
- 26 WINDOW GLAZING (SEE WINDOW SCHEDULE SHEET A6.02)
- 27 2X6 LET IN (SEE WALL FRAMING SHEET C/S4.0)
- 28 ALUMINUM WINDOW FRAME WITH NAIL-ON FINISH. INSTALL W/ MIN. 3" BLDG. PAPER BETWEEN FINISH AND FRAMING. INSTALL WITH 8d AT MAX. 24" O.C.
- 29 16d BOX STAGGERED AT MAX 24" O.C.
- 30 HEADER 12/S5.0
- 31 26 GA DRIP FLASH
- 32 6-3/8" X 2" GALVANIZED LAG SCREWS
- 33 L 1-1/2"x1-1/2"x1/8"x18" LONG (BY HVAC MFR.) ATTACHED TO A/C W/ 4-#10 SELF TAPPING SHEET METAL SCREWS AND ATTACH TO WALL W/ 3" X 2" GALVANIZED LAG SCREWS
- 34 SIDE OF HVAC UNIT SEE (STR)
- 35 (3) 2X4 W/ PLYWOOD SPACER- BUILT- UP POST. 8d AT O.C. STAGGERED SPACER TO FIRST 2X4 16d AT 12" O.C. SECOND 2X4 12d AT 12" O.C. STAGGERED THIRD 2X4 ALTERNATE USE 4X4 POST
- 36 11GA. X24" STEEL SUPPORT BRACKET
- 37 EN - 8d BOX ELECTRO GALV. AT 6" O.C.
FN - 8d BOX ELECTRO GALV. AT 12" O.C.
- 38 26 GA GALVANIZED FLASH AT DOOR SILL
- 39 22 GA. GALV. FLASHING (AT BELOW GRADE CONC. FOUNDATION ONLY)
- 40 #8 STMS - 1 AT EA SIDE OF DOWNSPOUT- TO BRACKET
- 41 ATTACHMENT BRACKET (TYP 3 PLACES: TOP, BOTTOM & MIDSPAN W/ 2-#10 STMS, BRACKET TO STUD) SEE NOTE AT DETAIL B

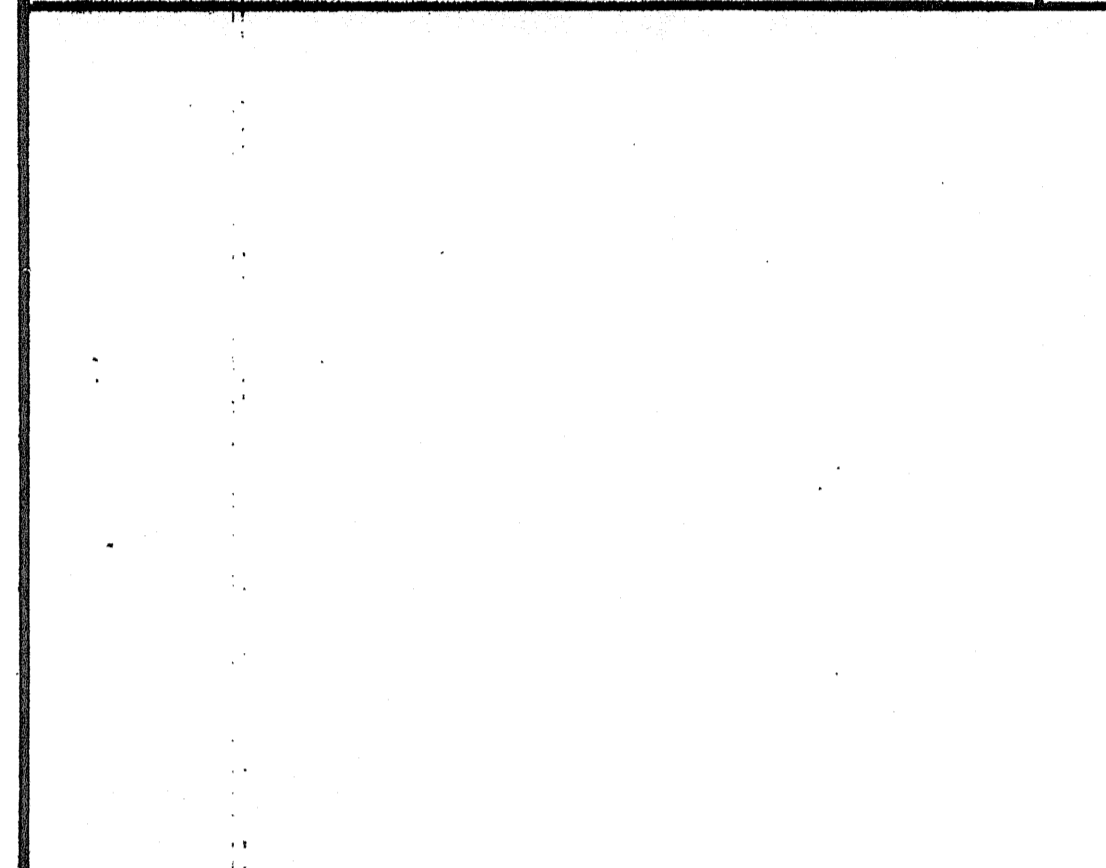


18 A.C. UNIT (PLAN)

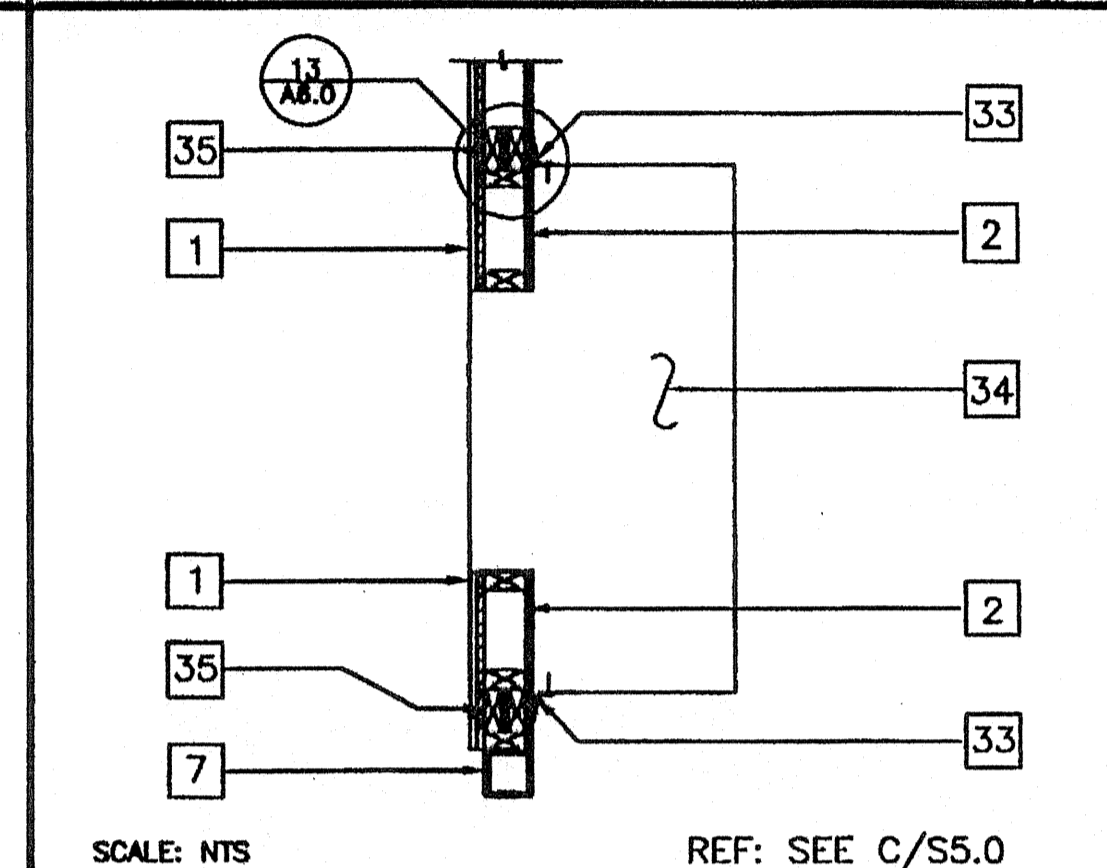


14 WINDOWS SECTION • JAMBS

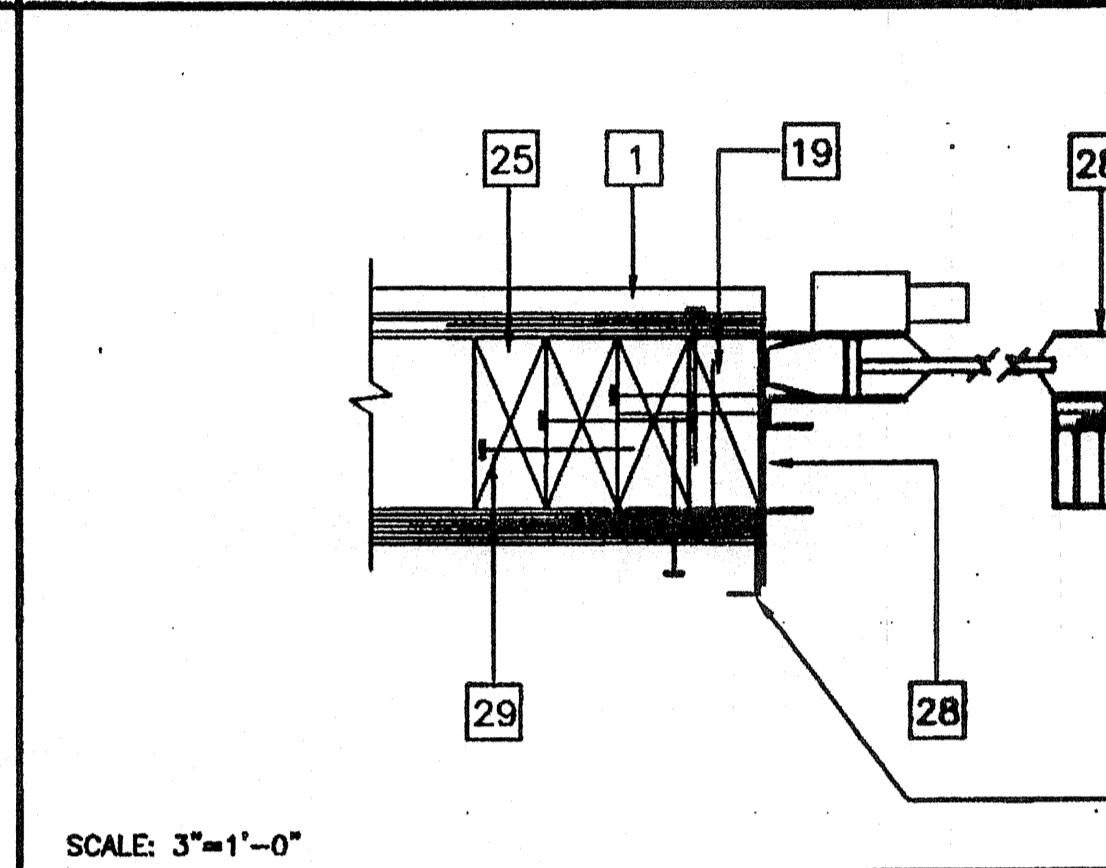


11 WINDOW HEADER

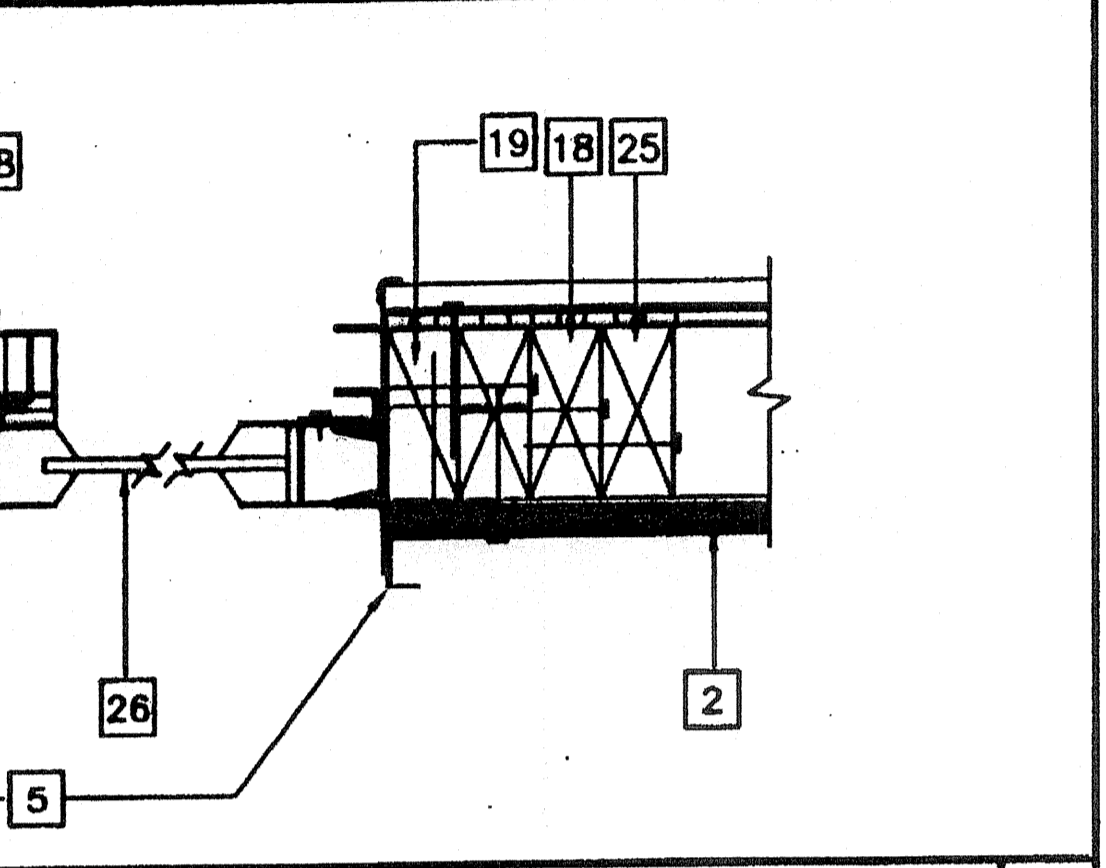


7 DOOR HEADER

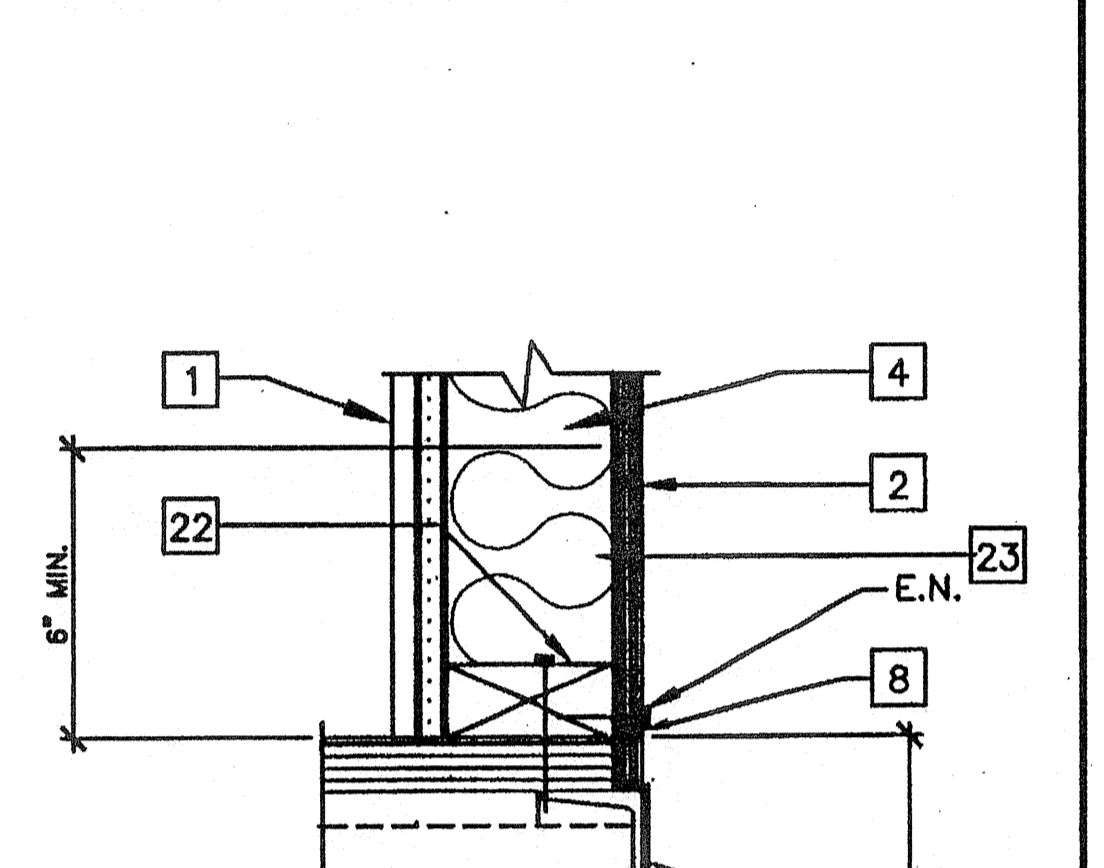


2 TYPICAL SILL • FLOOR

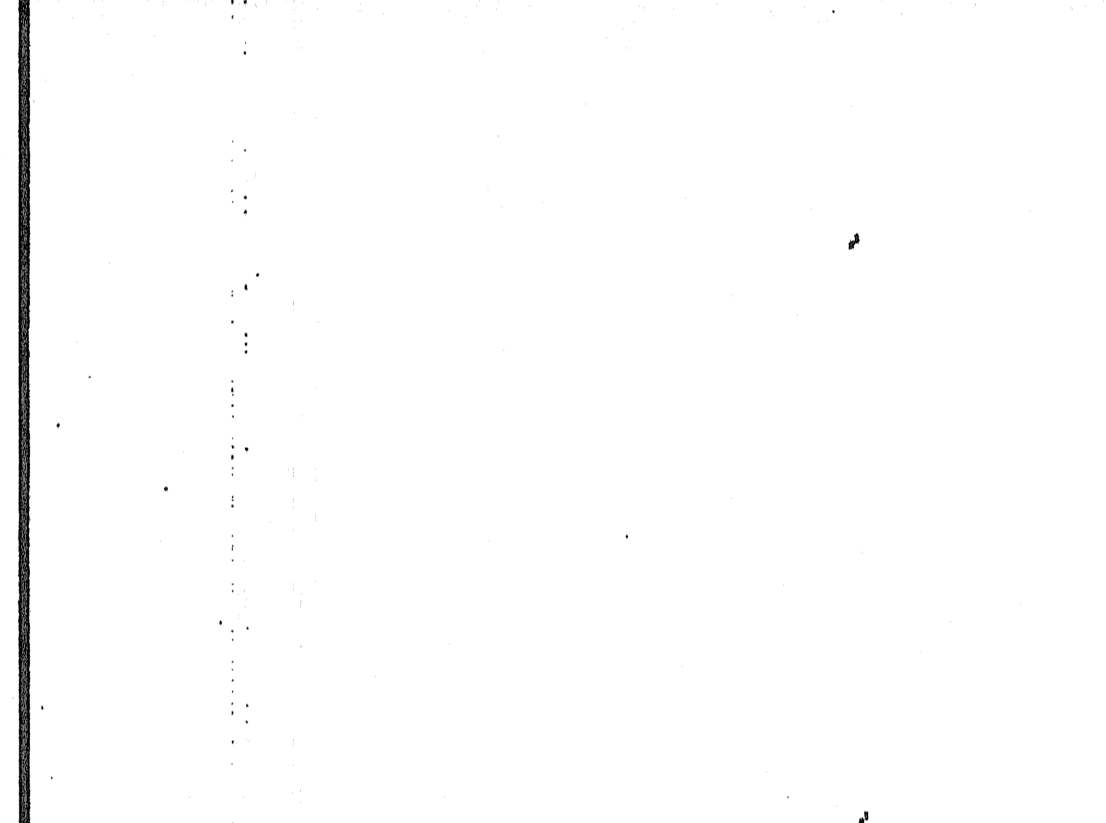


19 A.C. UNIT (BOTTOM)

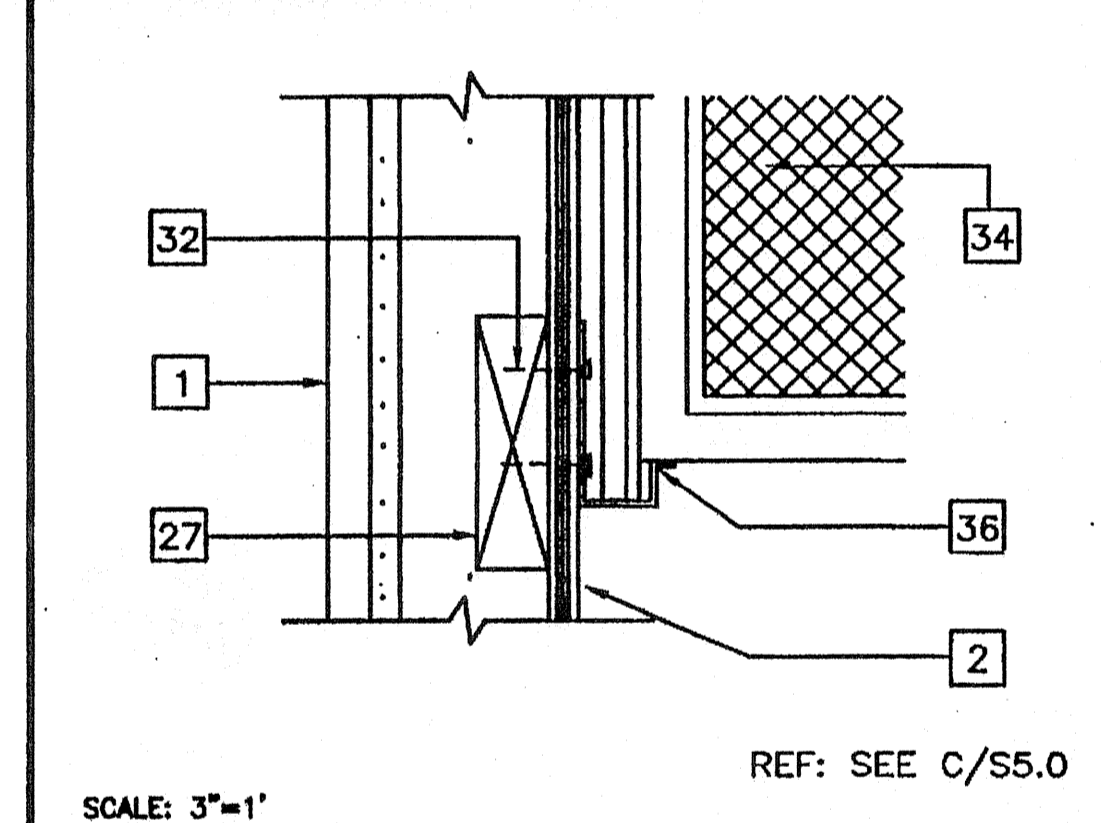


15 WINDOW SILL PLATE

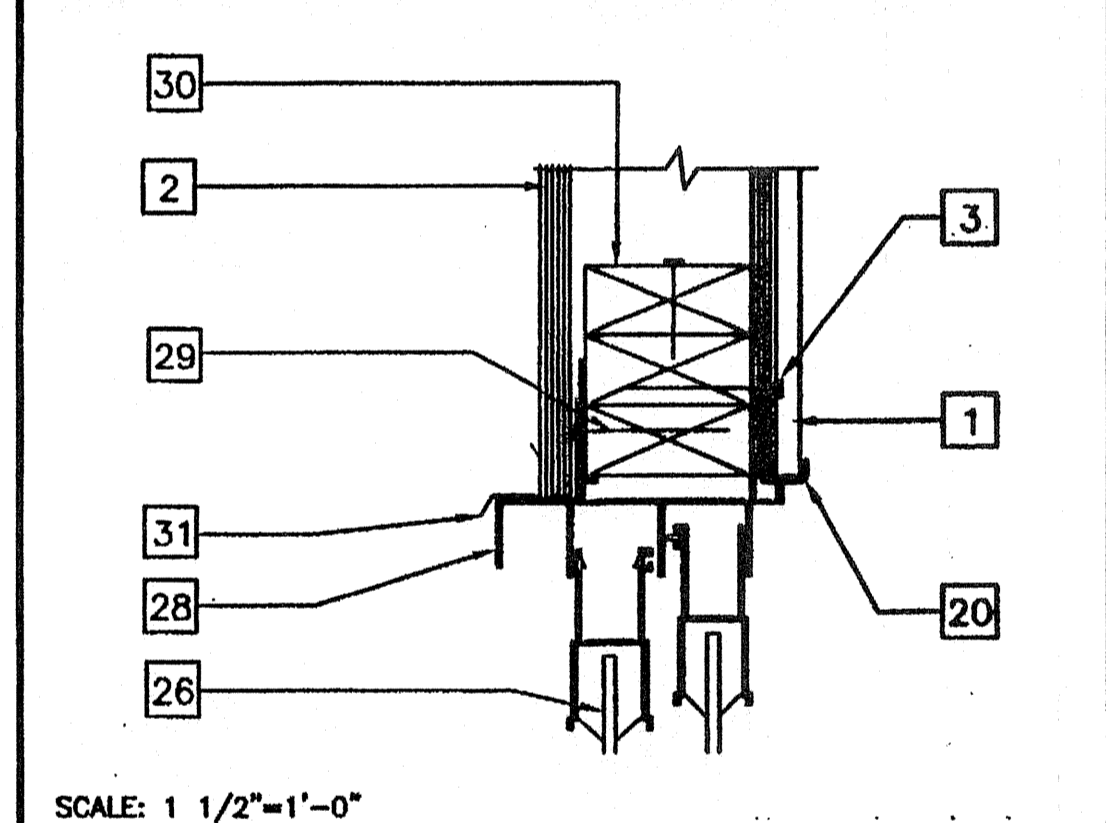


12 DOOR JAMB

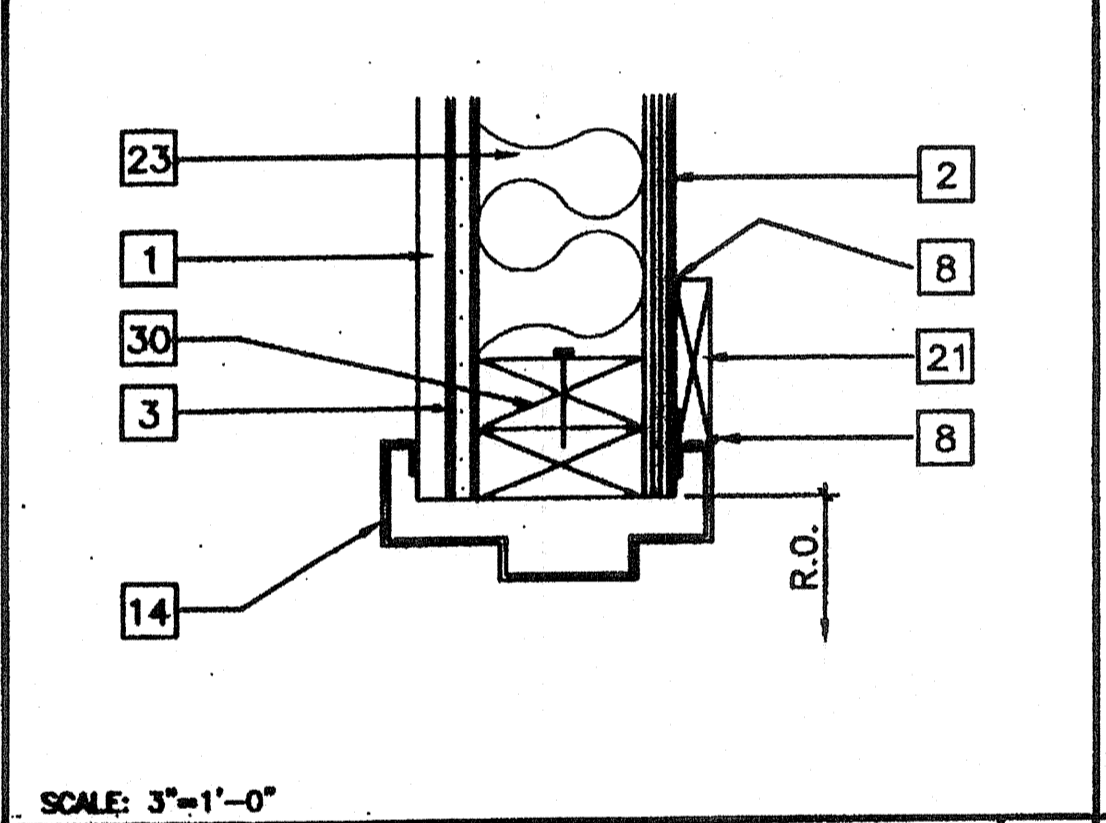


8 CORNER COLUMN

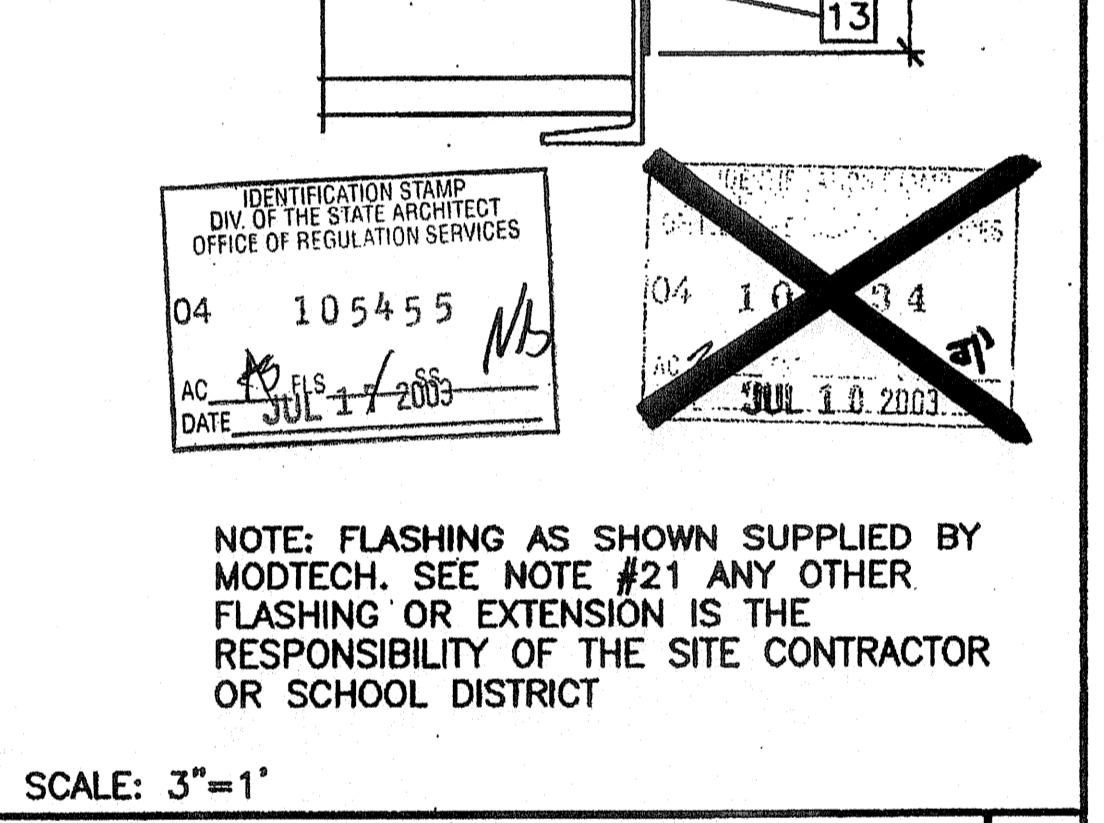


20 DOWNSPOUT ATTACHMENT

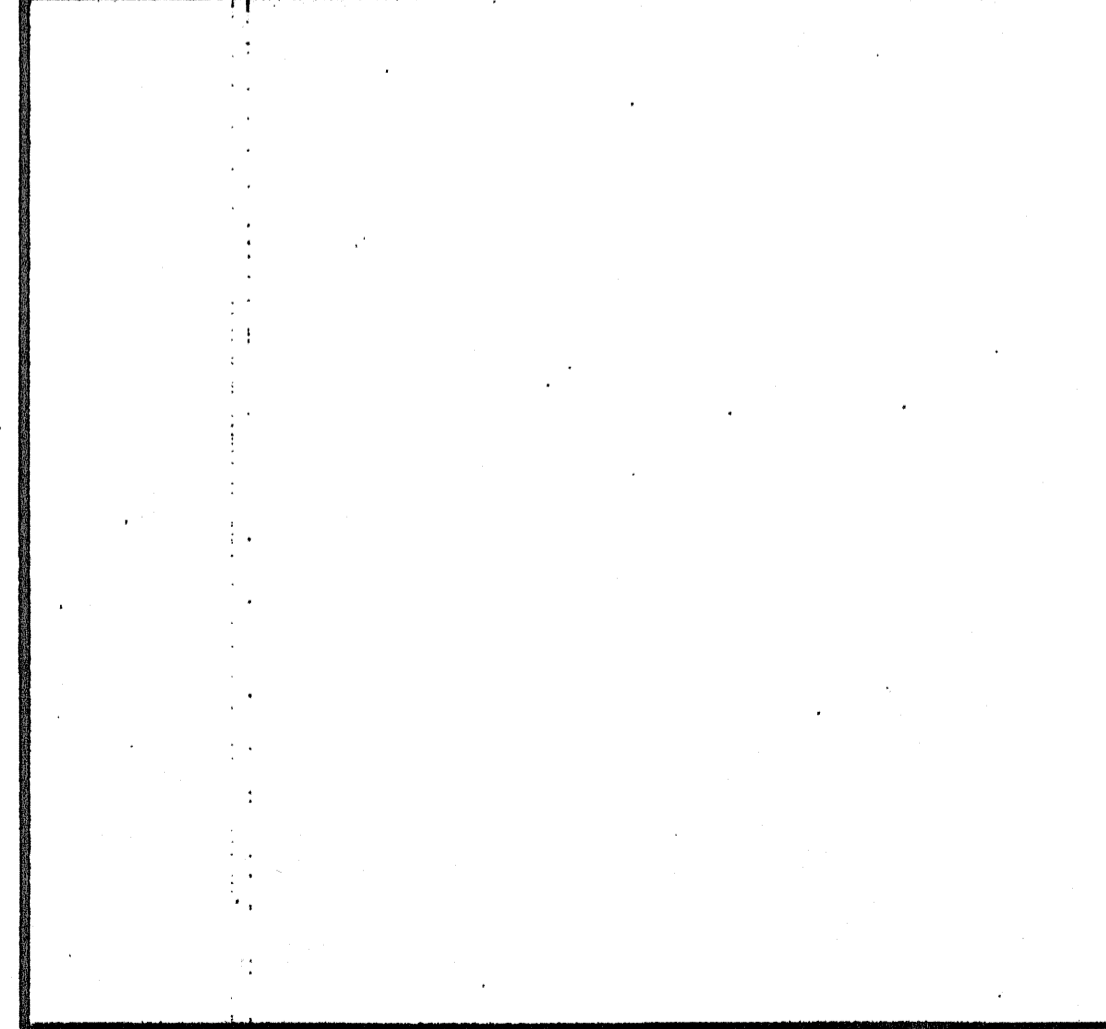


15 WINDOW SILL PLATE

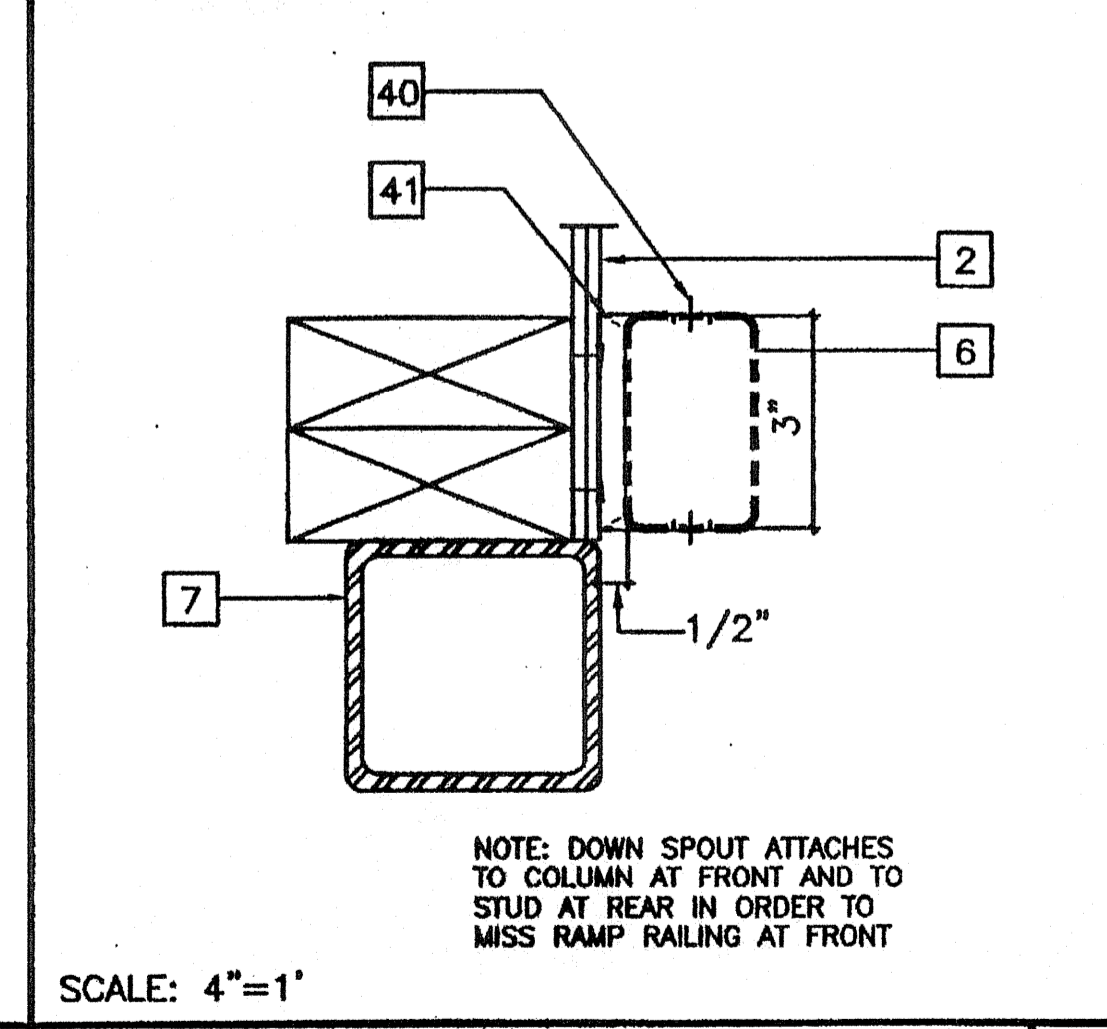


12 DOOR JAMB

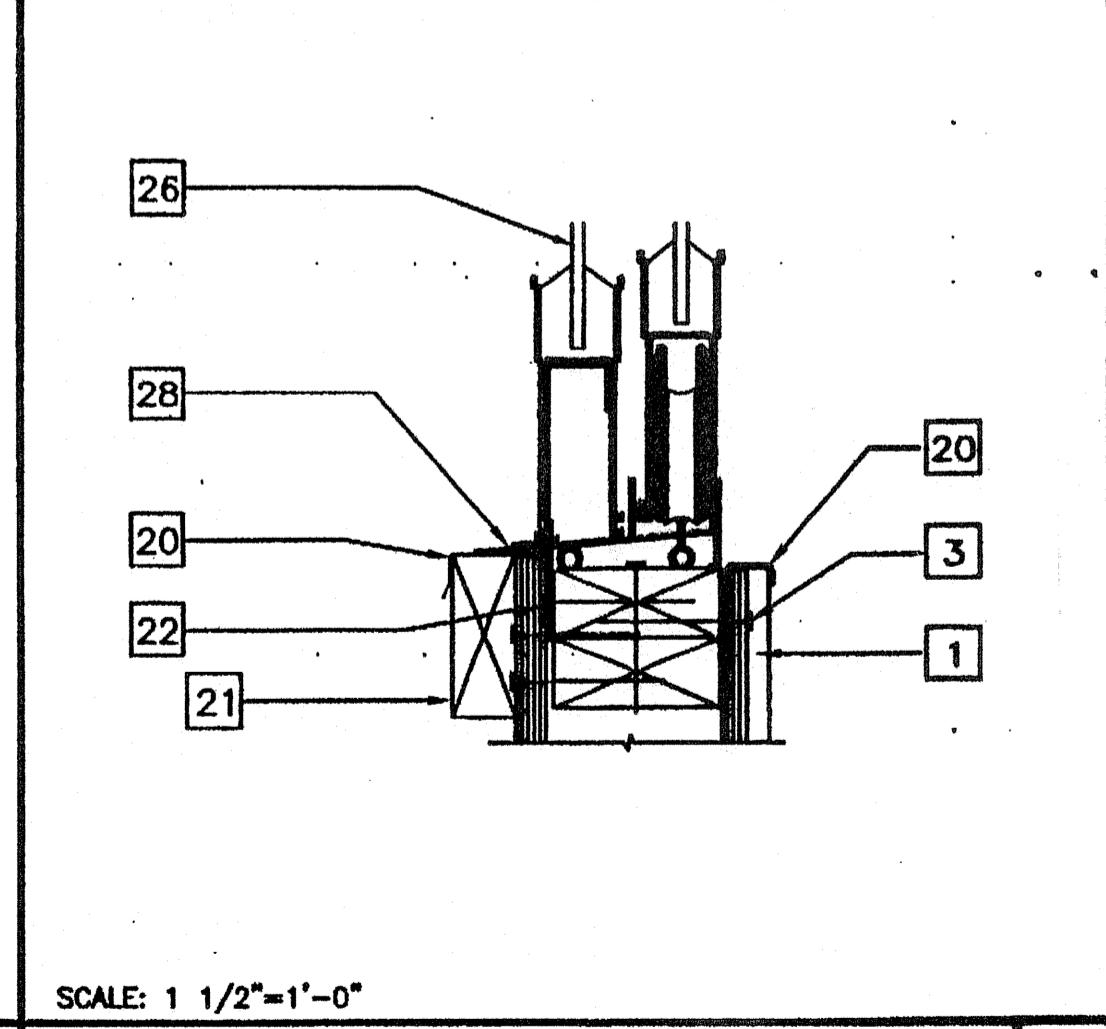

8 CORNER COLUMN

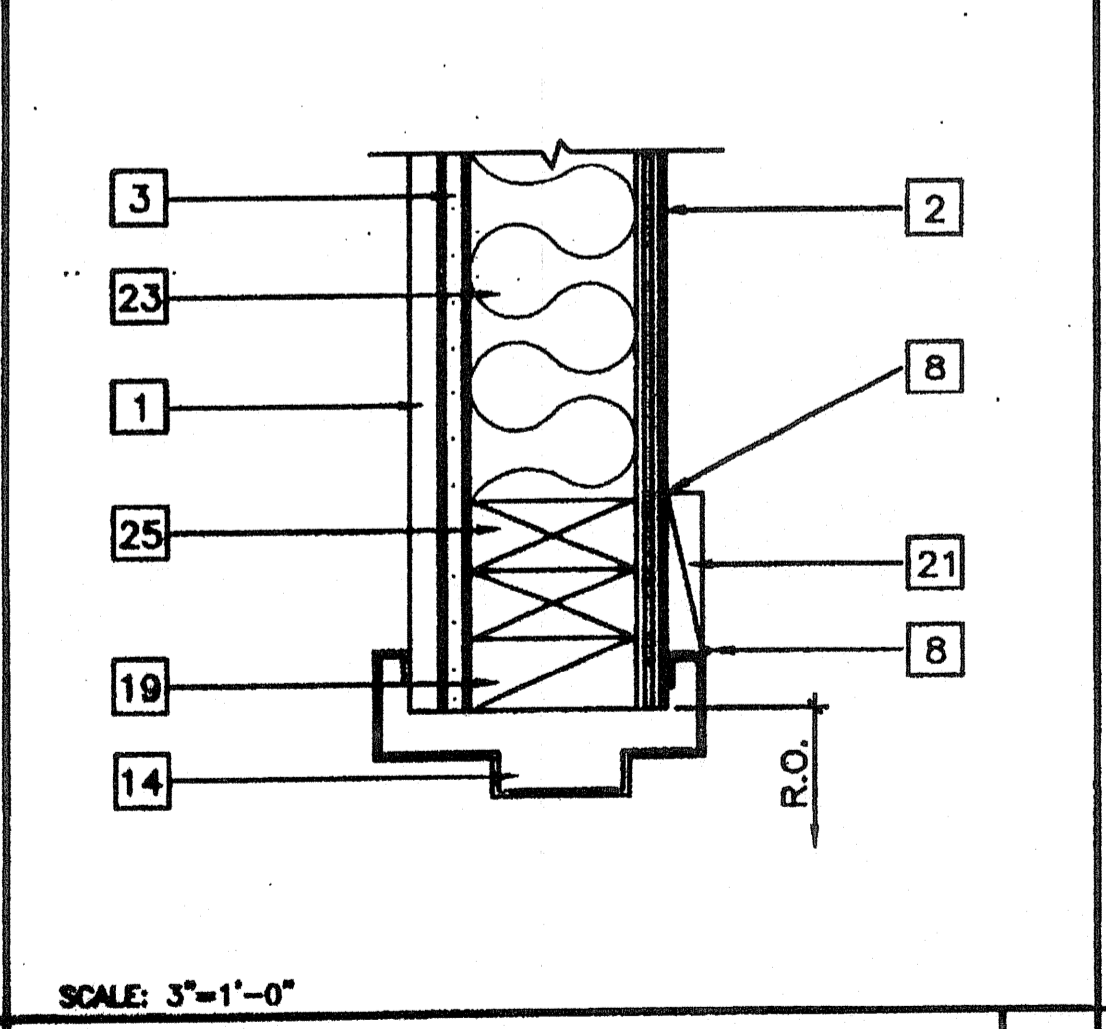

20 DOWNSPOUT ATTACHMENT

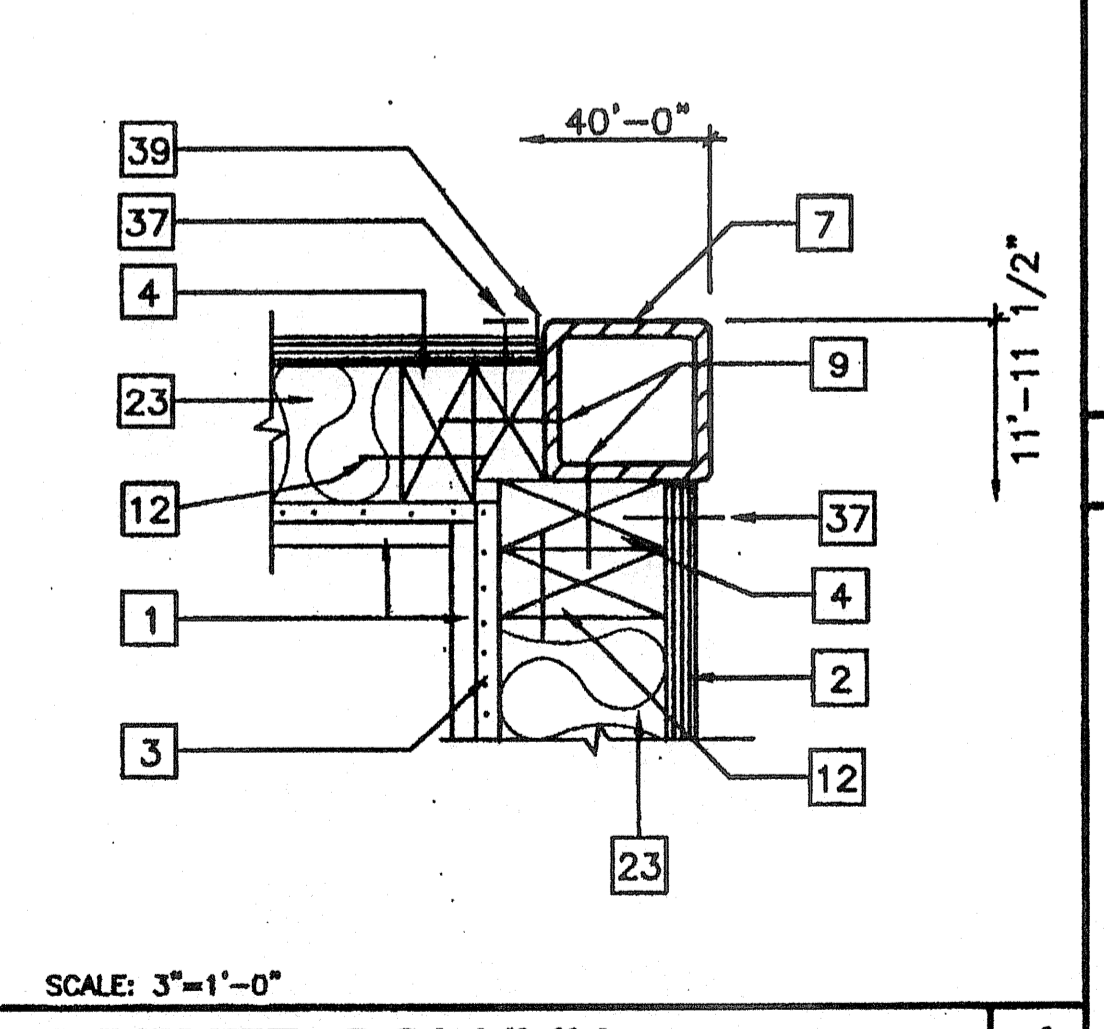

12 DOOR JAMB

NOTES

1. EN 8d ELECTRO GALV. AT 6" O.C.
 2. FN 8d ELECTRO GALV. AT 12" O.C.
 3. SEE SHEET S5.0 FOR TYPICAL WALL FRAMING NAILING
- INSULATION MATERIALS INSULATED WITHIN FLOOR-CEILING ASSEMBLIES, ROOF-CEILING ASSEMBLIES, WALLS, CRAWL SPACES, OR ATTICS SHALL HAVE A FLAMESPREAD RATING NOT TO EXCEED 25 AND A SMOKE DENSITY NOT TO EXCEED 450. EXCEPTIONS:
A: FOAM PLASTIC INSULATION SHALL COMPLY WITH SEC. 2602
B: WHEN MATERIALS ARE INSULATED IN CONCEALED SPACES OF TYPES I, II, IV, AND V CONSTRUCTION, THE FLAME SPREAD AND SMOKE-DEVELOPED LIMITATIONS DO NOT APPLY TO FACINGS. IF THE FACING IS INSTALLED IN SUBSTANTIAL CONTACT WITH THE UNEXPOSED SURFACE OF THE CEILING, FLOOR OR WALL FINISH. (SEC. 707.3 CBC)

NO.	DESCRIPTION	DATE

Electrical Engineer's Seal
Mechanical Engineer's Seal
PC Professional of Record Seal
Architect's Seal

PC
CBC 2001
IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
No. C-24629
PC-04
104796
DATE 5/26/03


MODTECH™
2830 BARRETT AVENUE FAX (909) 943-4014
PERRIS, CALIF. 92572 FAX (909) 940-0427

PROJECT NUMBER: 4736
WILLIAM SCOTTSMAN
ARCHITECTURAL DETAILS


© MODTECH, INC. 2002
ALL RIGHTS RESERVED
DRAWN BY: GL
DATE: 07/07/03
CHECKED BY:
DATE:
MODTECH Inset No. 4.03
A4.03

FILE PATH:


PROJECT NO. 4736
PC-04-104796

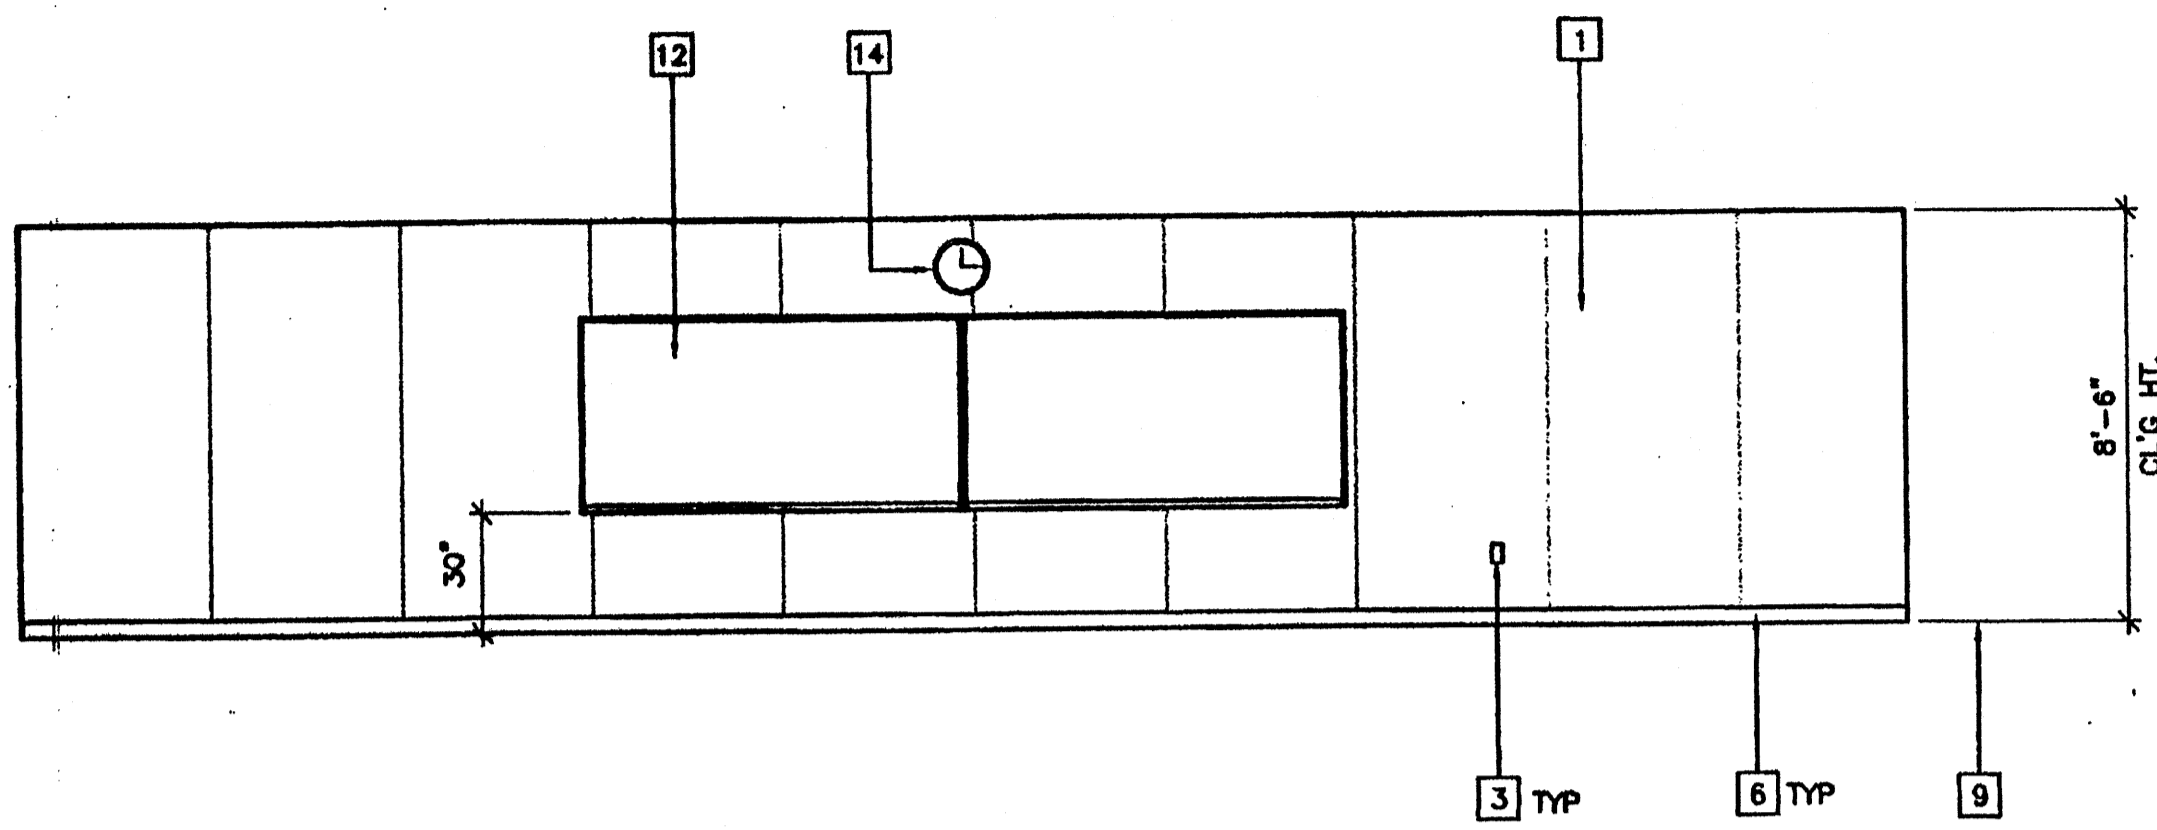


1 LEFT ELEVATION

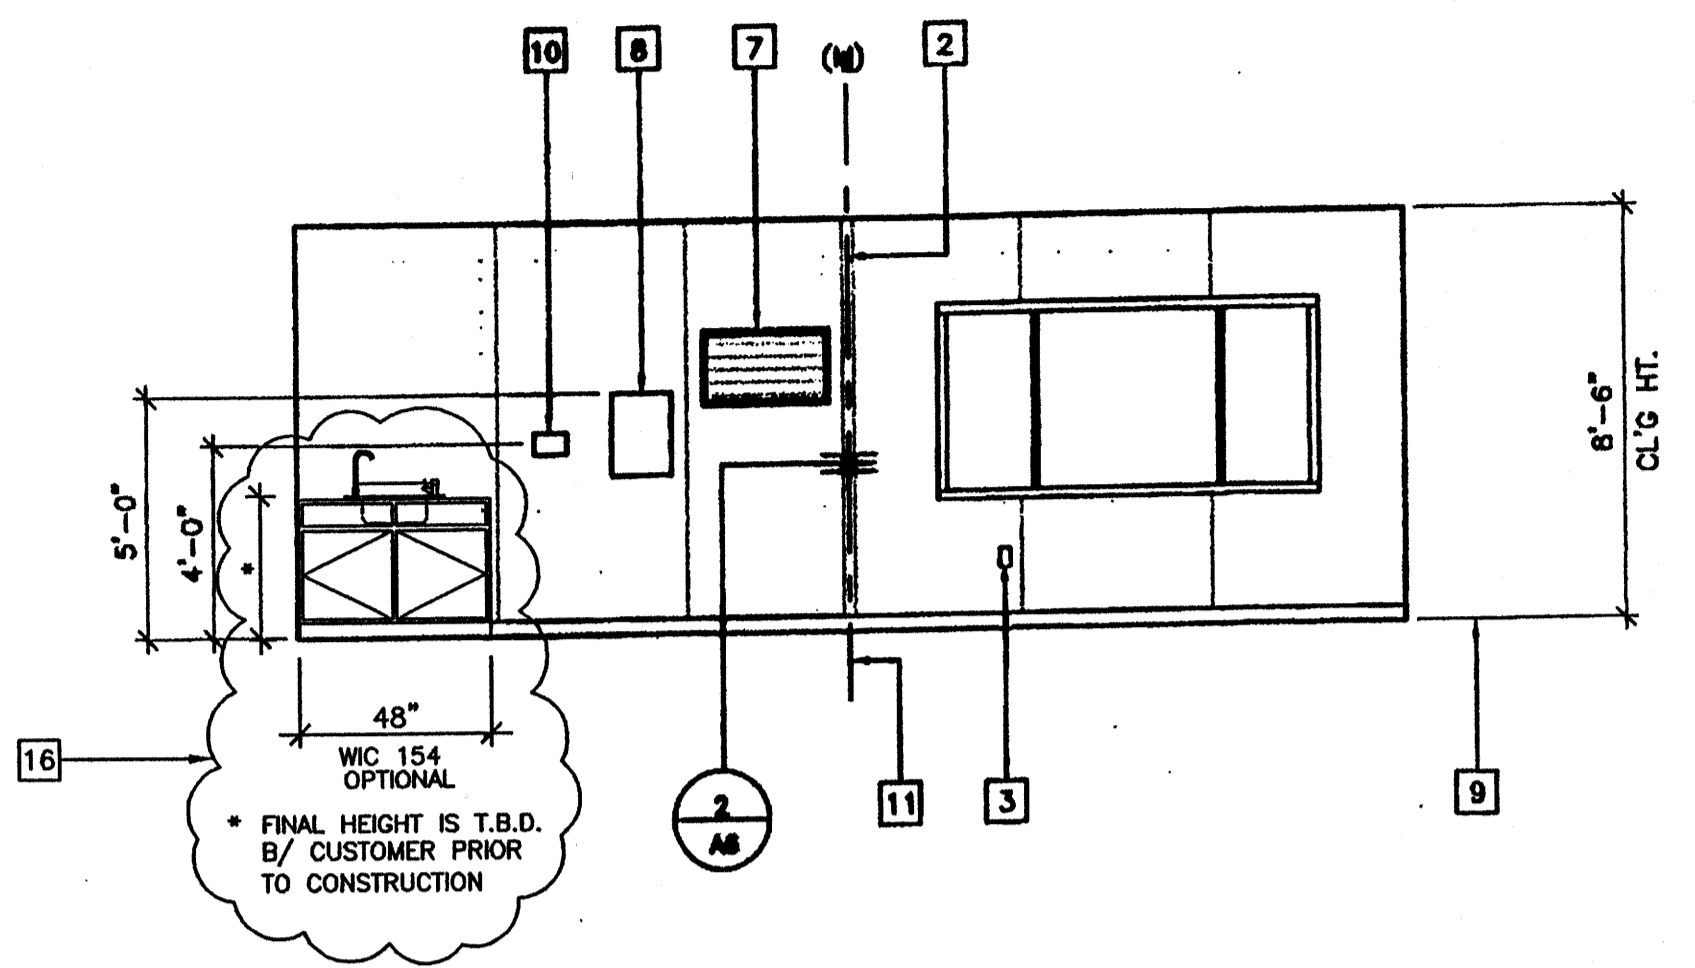




2 REAR ELEVATION
OPP-HAND

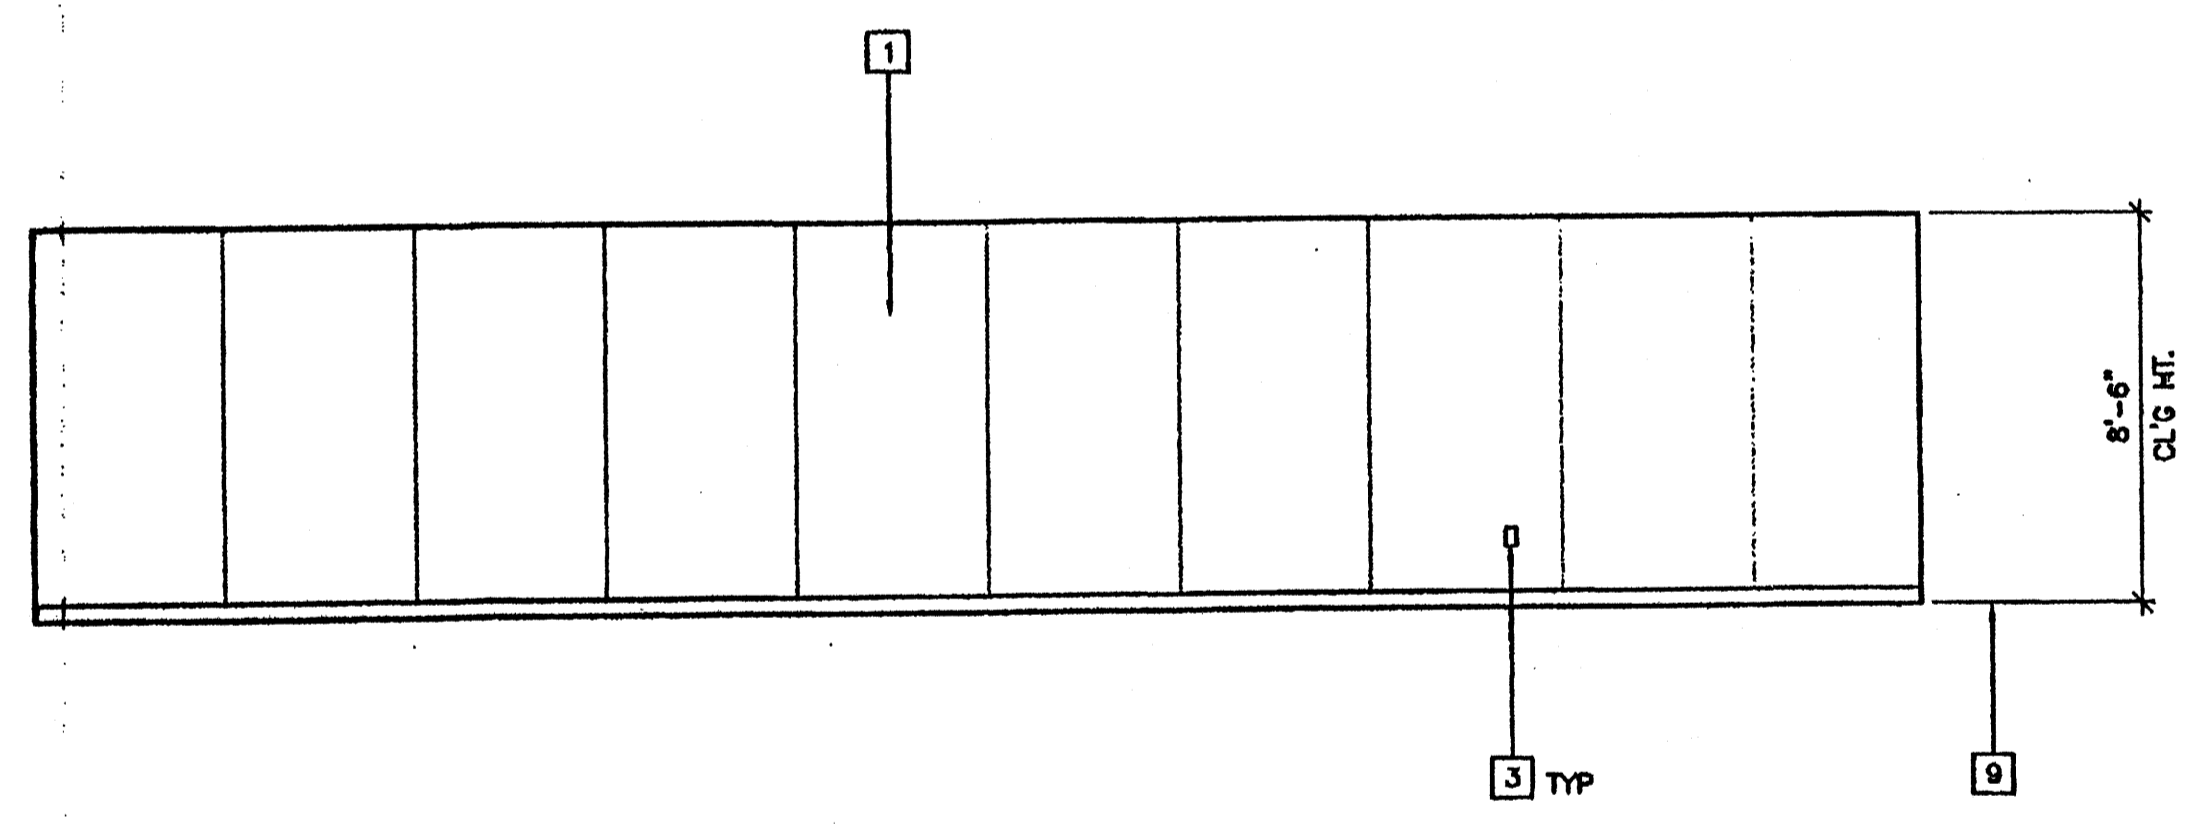

3 RIGHT SIDE ELEVATION

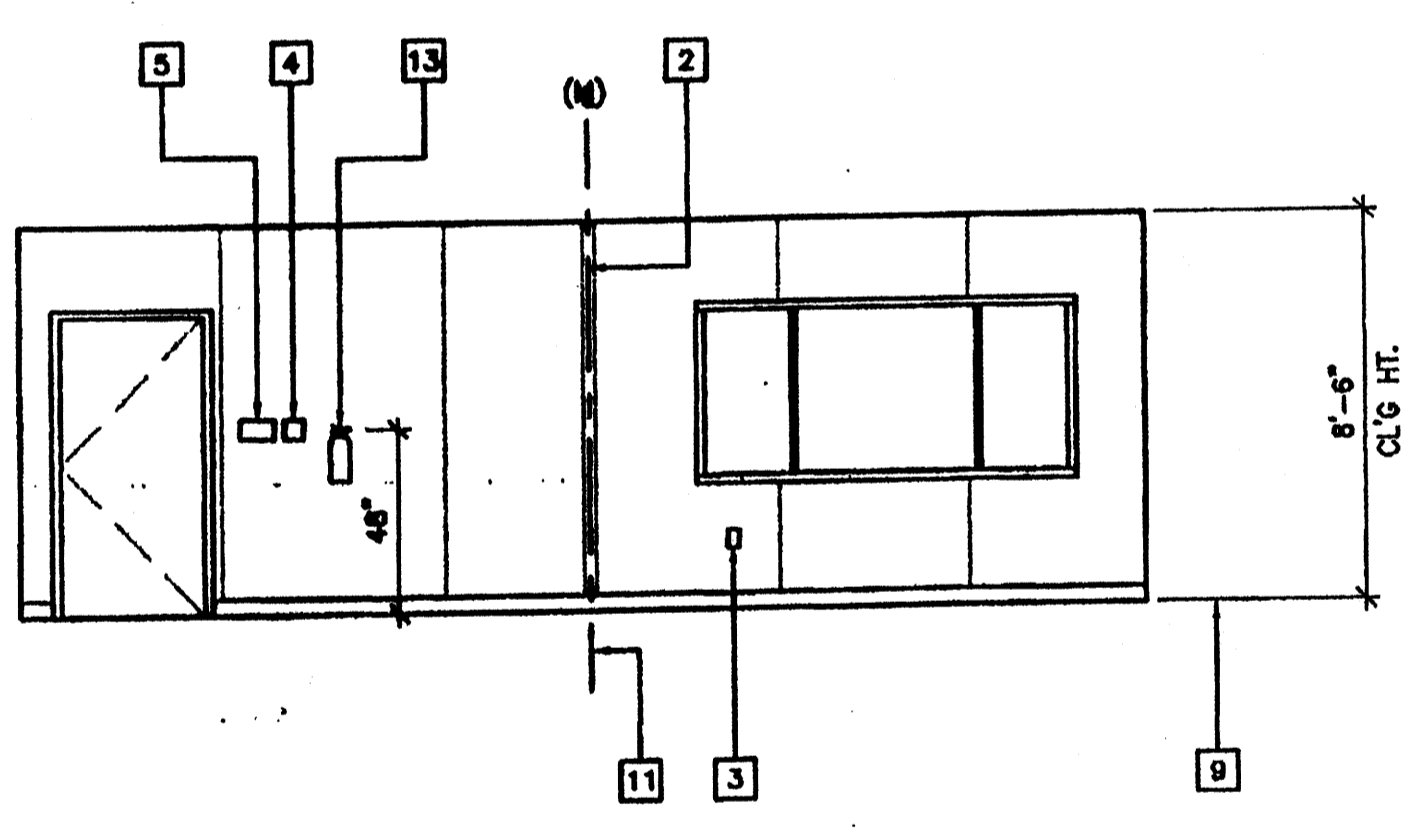

4 FRONT ELEVATION
OPP-HAND

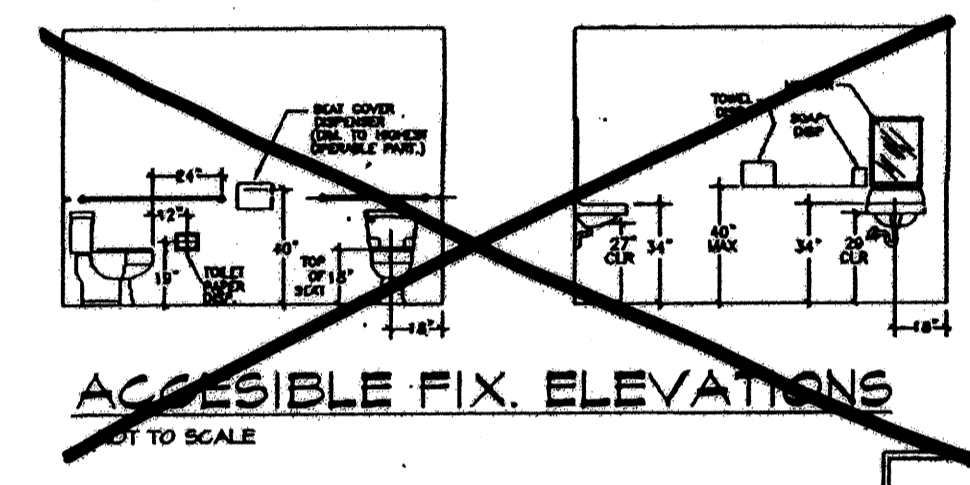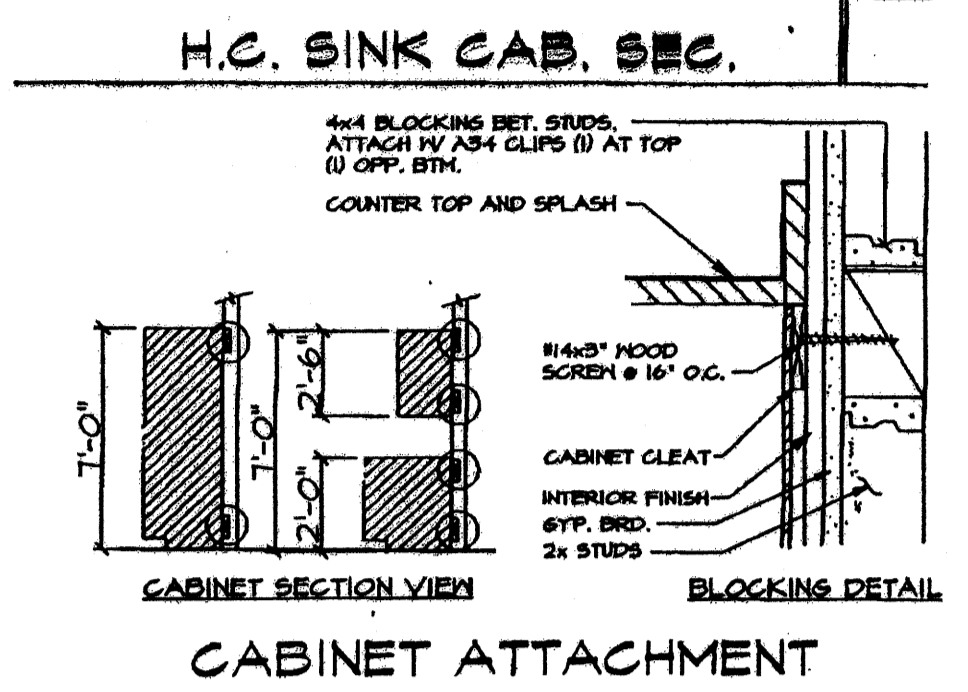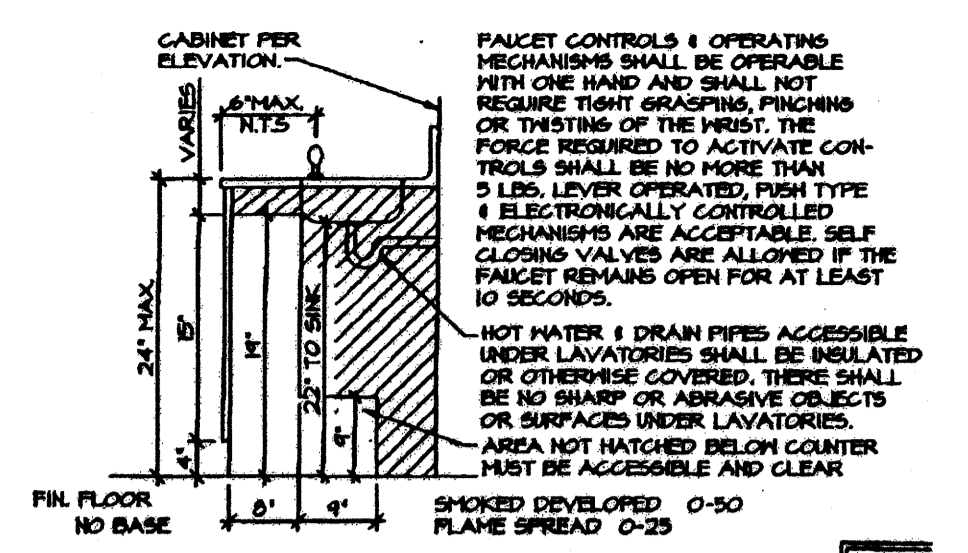

THE DIVISION OF THE STATE ARCHITECT, OFFICE OF GENERAL SERVICES, RECOMMENDS THE FOLLOWING DIMENSIONS AS A MINIMUM TO MEET THE NEEDS OF DISABLED PERSONS USING THE FACILITIES DESCRIBED IN THESE PLANS. THESE DIMENSIONS ARE BASED ON THE FOLLOWING ASSUMPTIONS:

- A = 17" MINIMUM CLEARANCE FROM WALL
- B = 17" MINIMUM CLEARANCE FROM WALL
- C = 17" MINIMUM CLEARANCE FROM WALL
- D = 17" MINIMUM CLEARANCE FROM WALL
- E = 17" MINIMUM CLEARANCE FROM WALL
- F = 17" MINIMUM CLEARANCE FROM WALL
- G = 17" MINIMUM CLEARANCE FROM WALL
- H = 17" MINIMUM CLEARANCE FROM WALL
- I = 17" MINIMUM CLEARANCE FROM WALL
- J = 17" MINIMUM CLEARANCE FROM WALL
- K = 17" MINIMUM CLEARANCE FROM WALL

DIMENSION	SUGGESTED		
	A	E	K
TOILET CENTERLINE FROM HALL	15"	15"	12"
TOILET SEAT HEIGHT	17"-18"	15"	10"-12"
GRAB BAR HEIGHT (SIDE)	33"	27"	20"-22"
TOILET PAPER IN FRONT OF TOILET	12" MAX.	6" MAX.	6" MAX.
WIPER DISPOSAL IN FRONT OF TOILET	12" MAX.	12" MAX.	N/A
DISPENSER OR MIRROR HEIGHT	40" MAX.	36" MAX.	32" MAX.
LAVATORY/SINK TOP HEIGHT	34" MAX.	28" MAX.	24" MAX.
LAVATORY/SINK KNEE CLEARANCE	28" MIN.	24" MIN.	18" MAX.
URINAL LIP HEIGHT	17" MAX.	15" MIN.	15" MIN.
URINAL FLUSH HANDLE HEIGHT	44" MAX.	37" MAX.	32" MAX.
DRINKING FOUNTAIN BUNDELER HEIGHT	36" MAX.	32" MAX.	30" MAX.
DRINKING FOUNTAIN KNEE CLEARANCE	27" MIN.	24" MIN.	22" MIN.
RAMP/STAIR HANDRAIL HEIGHT	54"-58"	27"	22"

** DEVIATES FROM CODE REQUIREMENTS AND REQUIRES A WRITTEN FINDING OF UNREASONABLE HARDSHIP

RECOMMENDED ACCESSIBILITY DIMENSIONS

KEY NOTES

- 1 TYPICAL INTERIOR FINISH (FN)
- 2 CLOSURE AT MODULAR JOINT
- 3 DUPLEX WALL RECEPTACLE (EL)
- 4 J-BOX FOR FIRE ALARM PULL STATION (EL)
- 5 LIGHT SWITCH (EL)
- 6 BASE
- 7 RETURN AIR GRILL
- 8 ELECTRICAL PANEL (EL)
- 9 FINISH FLOOR LINE (FN)
- 10 THERMOSTAT (HV) SEE MECHANICAL PLANS
- 11 MODULAR JOINT
- 12 8040 PORCELAIN STEEL MARKER BOARD, TYPICAL FOR (2)
- 13 FIRE EXTINGUISHER: 5 LBS DRY CHEMICAL WITH 2A-10BC UL RATING ON WALL MOUNTED BRACKET, HANDLE AT 48" AFF
- 14 ELECTRIC CLOCK (EL)
- 16 SINK/CABINET (OPTIONAL)

INTERIOR ELEVATIONS (24'x40')
SCALE: 1/4" = 1'-0"

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
04 105455
AC 12/15/03 SS 116
DATE JUL 17 2003

~~IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
04 105455
AC 12/15/03 SS 116
DATE JUL 10 2003~~

REVISIONS

NO.	DESCRIPTION	DATE

Electrical Engineer's Seal
Mechanical Engineer's Seal
PC Professional of Record Seal
Architect's Seal

FRED VANDERKAM
REGISTERED ARCHITECT
No. C-24659
12/15/03
RENEWAL DATE
STATE OF CALIFORNIA

PC
CBC 2001
IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
PC-04
104796
AC 12/15/03 SS 116
DATE 5/2/03

MODTECHTM
2830 BARRETT AVENUE FAX (909) 943-4014
PERRIS, CALIF. 92572 FAX (909) 940-0427

PROJECT NUMBER: 4736
WILLIAM SCOTTSMAN

© MODTECH, INC. 2002
ALL RIGHTS RESERVED

DRAWN BY: GL
DATE: 07/07/03
CHECKED BY:
DATE:
Modtech Index No.
A5.02

INTERIOR ELEVATIONS 24'x40'

DOOR SCHEDULE

WINDOW SCHEDULE

ROOM FINISH SCHEDULE

NOTES

DOORS		FRAMES										NOTE NO.
DOOR NUMBER	FRAME OPENING SIZE	MATERIAL	TYPE	FIRE RATING	HARDWARE SET NO.	QUANTITY	MATERIAL	HEAD DETAIL	JAMB DETAIL	SILL DETAIL	JAMB THROAT	
1	3'-0" X 6'-8"	HM	A	NA	1	1	HM	7/A4.03	8/A4.03	1/A4.03	5-1/8"	

AMT.	TYPE	WIDTH	HEIGHT	FINISH	WIN. NO.	GLASS TYPE
2	1	8'-0"	4'-0"	ANODIZED	A	7/32" MIN, SOLAR GRAY 46%, DUAL GLAZE

ROOM NUMBER	ROOM NAME	FLOOR	BASE	FINISHES						REMARKS
				FRONT WALLS	LEFT	REAR	RIGHT	CEILING	CEILING HEIGHT	
1	CLASSROOM	A	D	F	F	F	F	L	8'-6"	



- ALL FINISHES SHALL COMPLY WITH C.B.C. CHAPTERS 3,6,7,8, & 10 & C.F.C. & TITLE 19 C.C.R.
- FOR DOOR AND DOOR FRAME DATA SEE SPECIFICATIONS ON SHEET A8.0.

- HM - HOLLOW METAL
- AL - ALUMINUM
- SST - STAINLESS STEEL
- STL - STEEL
- WWF - WINDOW WALL FRAME
- SC - SOLID CORE WOOD
- HC - HOLLOW CORE WOOD
- SCL - SOLID CORE WOOD LEGACY

- A - CARPET PER STATE OF CALIF SPEC 7220-51E-04 COMPLYING WITH GROUP 1, TYPE A OR TYPE B, CLASS 2, DENSITY 4600, DIRECT GLUE DOWN WITH 4" TOPSET BASE.
- B - VINYL SHEET FLOORING
- C - SELF COVE BASE - 6"
- D - 4" BURKE
- E - 6" BRIGANTINE OR SANDOVAL
- F - 1/2" VINYL TACKBOARD CLASS-1 OVER 1/2" GYP. BOARD BACKING
- G - 1/2" W.R. GYP. BOARD TAPE TEXTURE WITH PAINTED FINISH
- H - 3/8" W.R. GYP. BOARD TAPE TEXTURE WITH PAINTED FINISH
- I - 1/2" GYP. BOARD TAPE TEXTURE WITH PAINTED FINISH
- J - 3/8" GYP. BOARD TAPE TEXTURE WITH PAINTED FINISH
- K - 1/8" MARLITE OVER 1/2" W.R. GYP. BOARD
- L - ACCOUSTICAL LAY IN GRID CEILING PANELS (SEE SPECIFICATIONS)
- M - 3/32" FRP OVER 1/2" WR GYP. BOARD

DOOR ELEVATIONS

WINDOW ELEVATIONS

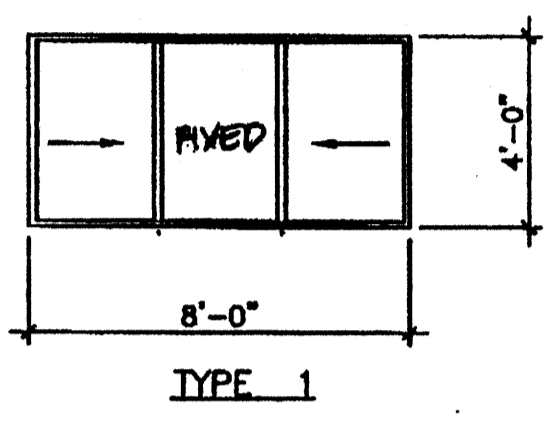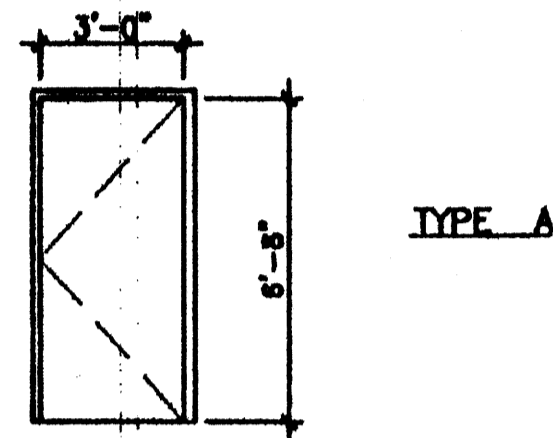

DOOR NOTES

WINDOW NOTES

FINISH NOTES

- DOOR HANDLES FOR LOCKSETS TO BE CENTERED @ 38" AFF & DEADBOLTS @ 44" AFF.
- HARDWARE TO BE OPENABLE FROM THE INSIDE WITHOUT ANY SPECIAL KNOWLEDGE OR EFFORT. LEVERS TO RETURN TO WITHIN 1/2" OF DOOR.
- ALL DOORS SHALL BE 1-3/4" THICK UNO
- DOUBLE LETTERS IN SCHEDULE, INDICATES A PAIR OF DOORS.
- SAFETY GLASS, CLEAR
- WIRE GLASS
- UNDERCUT DOOR
- FIXED LOUVER
- FUSIBLE LINK LOUVER
- VISION PANEL
- CLOSURE SHALL BE SET FOR MAXIMUM OPENING PRESSURE OF 5 LBS ON ALL DOORS

- 8040 XOX ANODIZED ALUMINUM GLAZING: EXTERIOR LITE 3/16" MIN. TEMPERED GLASS OF SOLAR GRAY WITH A LITE TRANSMISSION FACTOR OF 46%. 1/4" ALUMINUM SPACER. INTERIOR LITE - 1/8" MIN. CLEAR TEMPERED. ALL OPERABLE SASH SHALL HAVE ALUMINUM SCREENS.



- SUB-FLOOR PREP:**
PREPARATION FOR SUB FLOOR TO ACCEPT FINISH FLOORING IS BY FLOORING CONTRACTOR. PLYWOOD SUB FLOOR IS 2.4.1 PLYWOOD. OUTER PLY IS PLUGGED AND TOUCH SANDED, ANY DEFORMITIES DUE TO STANDARD CONSTRUCTION PRACTICES SHALL BE FILLED AND SANDED BY FLOORING CONTRACTOR. THE JOINT AT THE MODULE JOINING SHALL NOT BE LARGER THAN 1/8" AND SHALL BE FILLED AND SANDED BY FLOORING CONTRACTOR.

HARDWARE SCHEDULE

ACCESSIBILITY SIGNAGE (BY DISTRICT)

TOILET ROOM SIGNAGE (BY DISTRICT)

- HARDWARE SET #1**
- LOCKSET - SCHLAGE D70PD, WITH RHODES LEVER, OR EQUAL
 - BUTTS - 1-1/2 PAIR HAGER 1191 BB 4-1/2 x 4-1/2 NRP 26D OR EQUAL
 - CLOSER - NORTON 8500 DA / LCN 480 OR EQUAL
 - THRESHOLD - PEMCO 271A OR EQUAL
 - DOOR BOTTOM - PEMCO 218AV OR EQUAL
 - WEATHERSTRIP - PEMCO 298AV OR EQUAL
 - DOOR STOP - QUALITY #44 OR EQUAL
- HARDWARE SET #2**
- LOCKSET - SCHLAGE D53PD, WITH RHODES LEVER, OR EQUAL
 - BUTTS - 1-1/2 PAIR HAGER BB1279 4-1/2 x 4-1/2 26D OR EQUAL

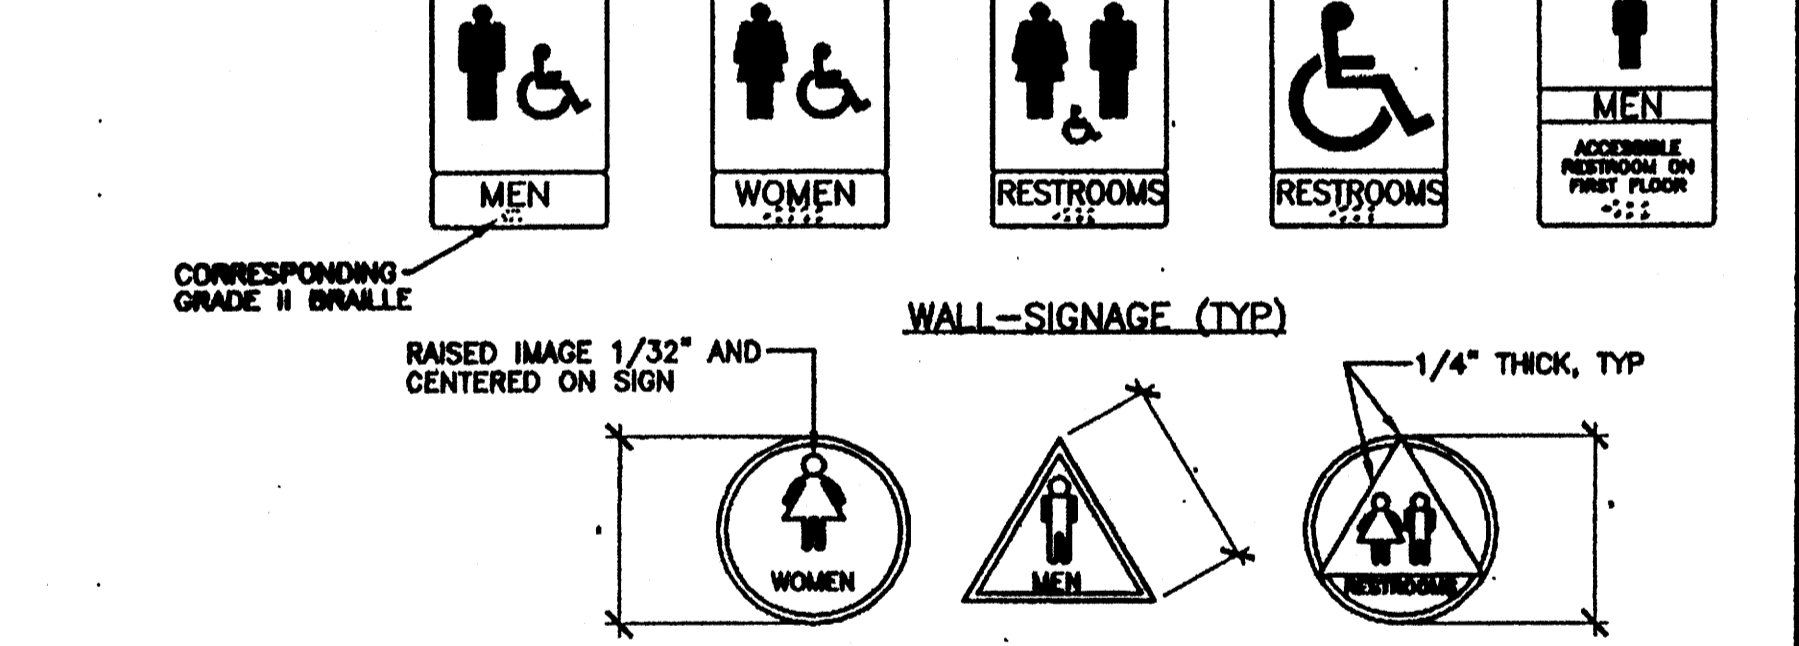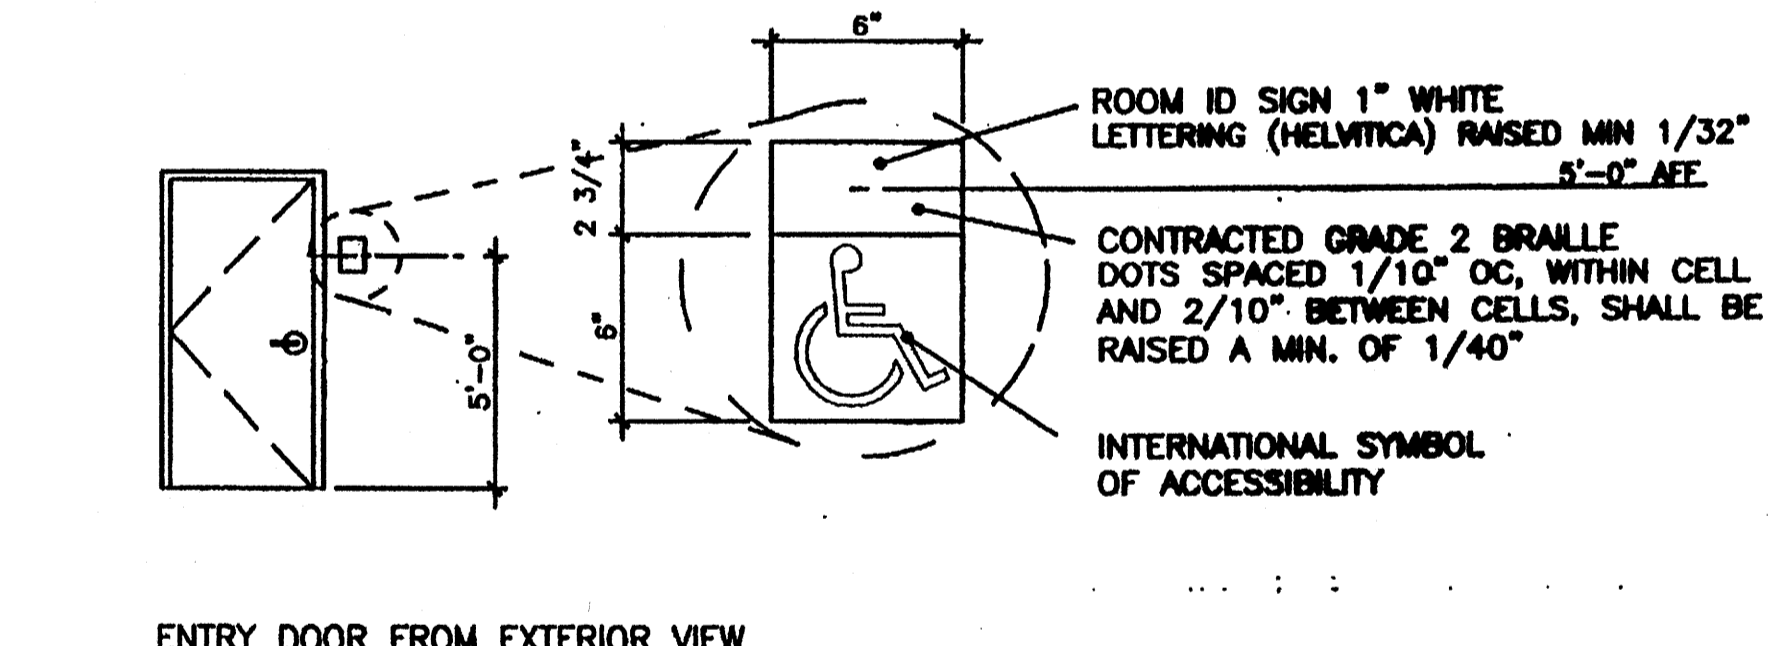

REVISIONS

Electrical Engineer's Seal Mechanical Engineer's Seal Structural Engineer's Seal Architect's Seal

MODTECH INC.
 2830 BARRETT AVENUE
 PERRIS, CALIF. 92572
 PH (909) 943-4014
 FAX (909) 940-0427

PROJECT NUMBER: 4736 © MODTECH, INC. 1999

WILLIAM SCOTTSMAN

SCHEDULE SHEET

DRAWN BY: GL
 DATE: 07/07/03
 CHECKED BY:
 DATE:
 MODTECH Index No.
A6.02

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 04 105455
 AD 13 415 233 1/6
 DATE JUL 17 2003




~~IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 04 105455
 AD 13 415 233 1/6
 DATE JUL 17 2003~~

ELECTRICAL PANEL SCHEDULE

LOAD	WATTS		BREAKER						WATTS		LOAD			
	Ap	Bp	Amps	P	A	B	C	P	Amps	Ap		Bp		
RECEPTACLE	720		20	1	1			2	2	60	7080	HVAC (3 1/2T)		
RECEPTACLE/CLOCK			720	20	1	3		4				HVAC (3 1/2T)		
						5								
						7								
INT/EXT LIGHTS	900		20	1	9			10						
						11								
INT. LIGHTS			840	20	1	11		12				FIRE ALARM (DEDICATED)		
WATTS/PHASE	A = 8700		1620	1560							7080	7120	B = 8680	WATTS/PHASE
TOTAL	17380		WATTS	72	AMPS		120/240	VOLTS		SINGLE #	THREE	WIRE		

- ### GENERAL GROUNDING NOTES
- EACH BUILDING SHALL BE SEPARATELY GROUNDING WITH A 3/4" RD. X 8" COPPERCLAD STEEL GROUND ROD. WHERE ROCK BOTTOM IS ENCOUNTERED, ROD SHALL BE DRIVEN AT AN ANGLE NOT TO EXCEED 45 DEGREES FROM THE VERTICAL OR SHALL BE BURIED IN A TRENCH THAT IS AT LEAST 30" DEEP (BY SITE ELECTRICAL)
 - TESTING: TEST FOR RESISTANCE TO GROUND. IF RESISTANCE EXCEEDS 25 OHMS, INSTALL ADDITIONAL GROUND RODS SEPARATED AT LEAST 6'-0" UNTIL RESISTANCE IS REDUCED TO 25 OHMS OR LESS. (BY SITE ELECTRICAL)
 - APPROVAL OF THIS PLAN DOES NOT CONSTITUTE APPROVAL OF THIS FIRE ALARM FOR ALL SITES. THE FIRE ALARM SYSTEM AND/OR COMPONENTS MAYBE REQUIRED TO BE CHANGED DUE TO SITE LOCATION, EXISTING CONDITIONS OR INCOMPATIBLE COMPONENTS.
 - GROUNDING TEST SHALL BE DONE IN THE PRESENCE OF THE PROJECT INSPECTOR. ALL GROUNDING SHALL BE IN ACCORDANCE WITH CEC ARTICLE 250.

- ### ELECTRICAL LEGEND
- 2'x4' T8 LIGHTS W/ELECT. BALLAST
 - EXTERIOR LIGHT FIXTURE AT +83" AFF
 - SWITCH AT +48" AFF
 - 4000V SWITCH AT +48" AFF FOR EXT. LIGHT
 - DUPLEX WALL RECEPTACLE 15A 125V 3-WIRE AT +18" AFF UON
 - HVAC UNIT (HV)
 - 4SD J-BOX FOR FIRE ALARM PULL STATION AT +48" AFF, 3/4" CO TO PULLSTRING
 - 4SD J-BOX FOR FIRE ALARM STROBE/HORN AT +80" TO BOTTOM OF DEVICE AFF, 3/4" CO TO PULLSTRING
 - 4SD J-BOX FOR FIRE ALARM HORN AT +98" AFF, 3/4" CO TO PULLSTRING
 - WEATHER PROOF CUTTER BOX (8'x8'x4') AT +18" AFF RECEIVE 3/4" CO FROM FA DEVICE, PULLSTRING
 - ELECTRICAL PANEL AT +80" AFF TO CENTERLINE 1 1/4" POWER NIPPLE POC, GND JUMPER BY SITE ELECT
 - CLOCK AT +90" AFF
 - 4SD J-BOX FOR HEAT DETECTOR (ATTIC) * MAX 25' FROM ANY WALL AND 50' BETWEEN THEM
 - 4SD J-BOX FOR SMOKE DETECTOR (ATTIC) * MAX 15' FROM ANY WALL AND 30' BETWEEN THEM
 - 2 GANG J-BOX AT 18" w/ CONDUIT STUBBED UP TO ATTIC SPACE

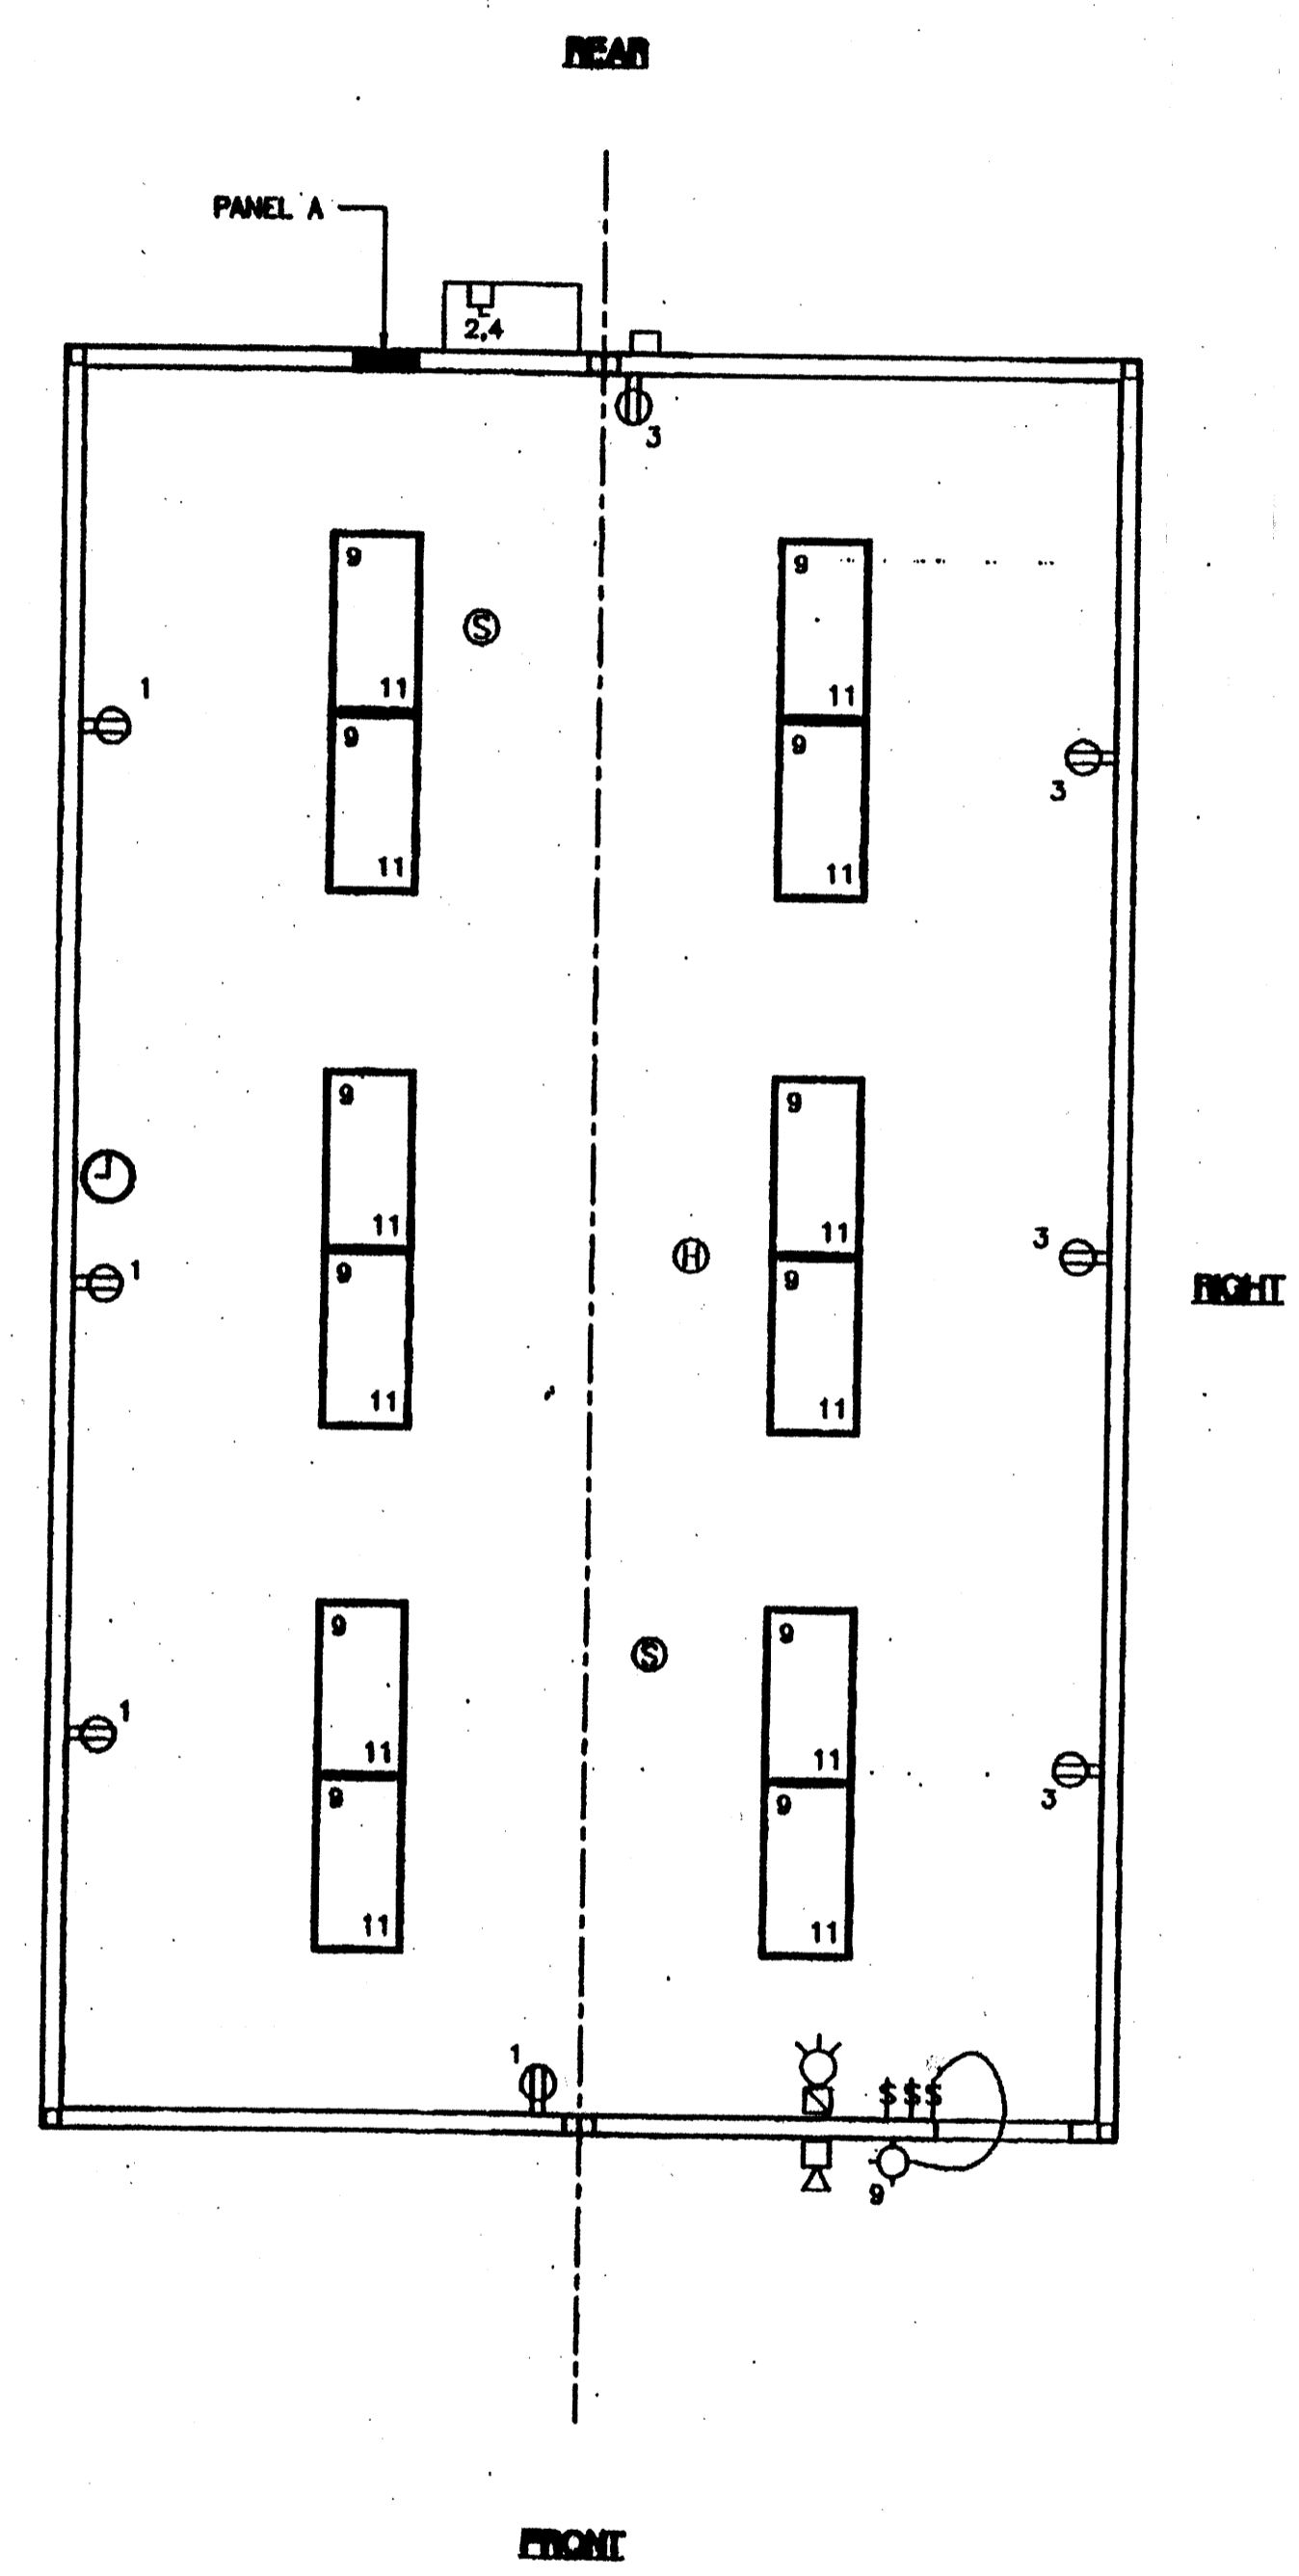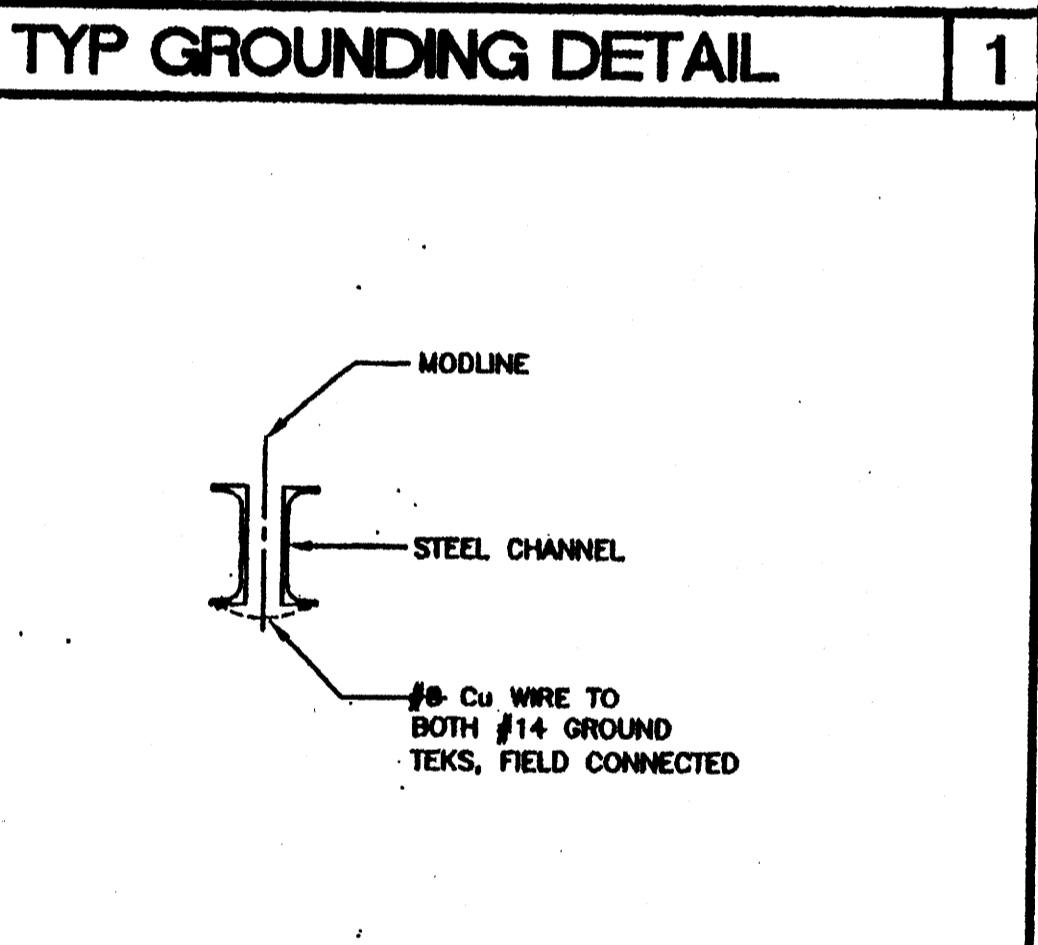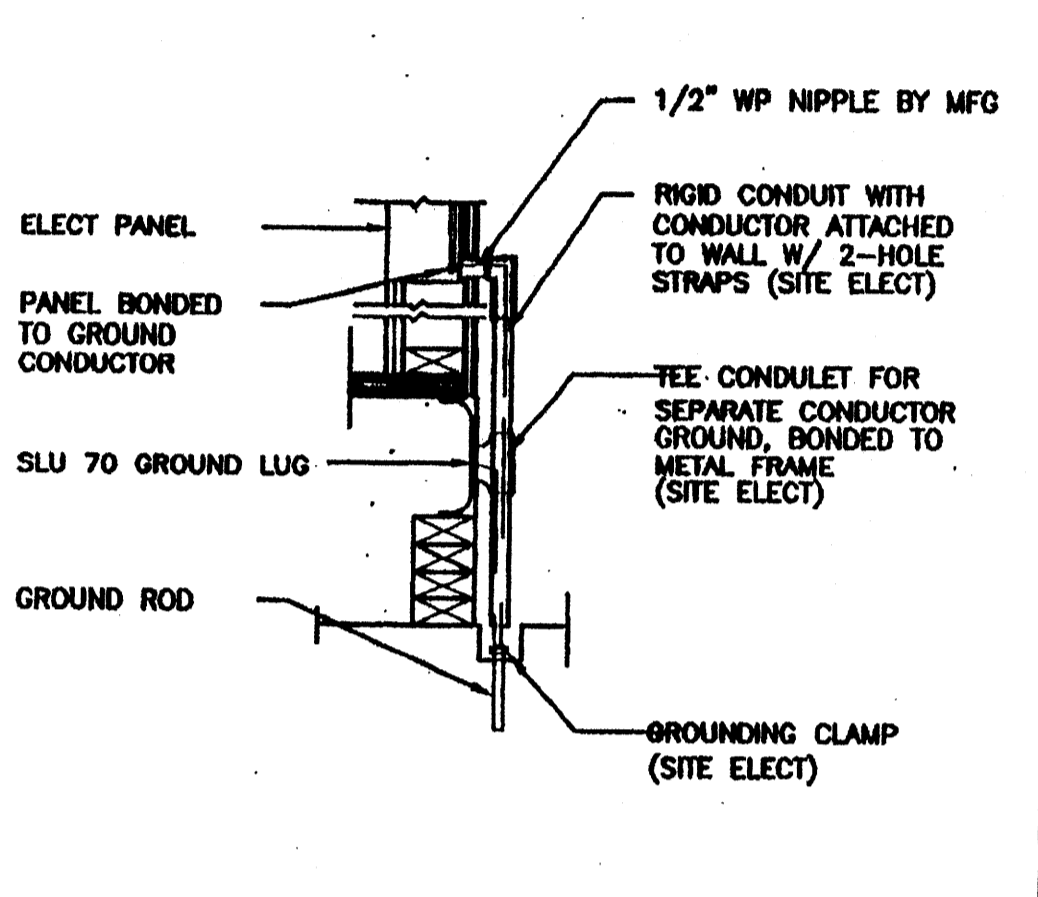

ELECTRICAL PLAN
OPP-HAND (24'x40')
SCALE: 1/4" = 1'-0"

- ### NOTES
- SCHOOL EQUIPMENT ANCHORAGE
THE FOLLOWING IS FOR THE ARCHITECTS INFORMATION ONLY:
THE SEISMIC ANCHORAGE OF ELECTRICAL EQUIPMENT SHALL CONFORM TO CCR TITLE 24, SECTION 1832A AND TABLE 18A-C. ANCHORAGE DETAILS FOR ROOF/FLOOR MOUNTED EQUIPMENT WEIGHING LESS THAN 400 LBS & HUNG EQUIPMENT WEIGHING LESS THAN 20 LBS MAY BE OMITTED FROM THE PLANS.
FOR ELECTRICAL DRAWINGS:
ALL ELECTRICAL EQUIPMENT SHALL BE BRACED OR ANCHORED TO RESIST A HORIZONTAL FORCE ACTING IN ANY DIRECTION USING THE FOLLOWING CRITERIA:

EQUIPMENT ON GRADE	33% OF OPERATING WEIGHT
EQUIPMENT ON STRUCTURE	40% OF OPERATING WEIGHT

FOR FLEXIBLY MOUNTED EQUIPMENT USE 4 TIMES THE ABOVE VALUES, AND FOR SIMULTANEOUS VERTICAL FORCE USE 1/3 TIMES THE HORIZONTAL FORCE.
THE ABOVE VALUES ARE FOR AN IMPORTANCE FACTOR, I = 1.0 AND SEISMIC ZONE, Z = 4
WHERE ANCHORAGE DETAILS ARE NOT SHOWN ON THE DRAWINGS THE FIELD INSTALLATION SHALL BE SUBJECT TO THE APPROVAL OF THE ARCHITECT AND THE FIELD ENGINEER OF THE OFFICE OF THE STATE ARCHITECT.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
04 105455
AC: PLS SS MB
DATE: JUL 17 2003

~~04 105455
DATE: JUL 17 2003~~

REVISIONS

NO.	DESCRIPTION	DATE

Electrical Engineer's Seal	Mechanical Engineer's Seal	PC Professional of Record Seal	Architects Seal	
----------------------------	----------------------------	--------------------------------	-----------------	--

MODTECH™
2830 BARRETT AVENUE FAX (909) 943-4014
PERRIS, CALIF. 92572 FAX (909) 940-0427

PROJECT NUMBER: 4736
WILLIAM SCOTTSMAN

ELECTRICAL PLAN


© MODTECH, INC. 2002
ALL RIGHTS RESERVED

DRAWN BY: GL
DATE: 07/07/03
CHECKED BY:
DATE:

MODTECH Form No. **E1.03**


PROJECT NO. 4736
PC-04-104796

3"x24" ENDWALL VENTS AS REQUIRED FOR ADJACENT BUILDING APPLICATIONS MIN. 18" FROM BUILDING CORNERS MIN. 12" BLOCKING BETWEEN VENTS

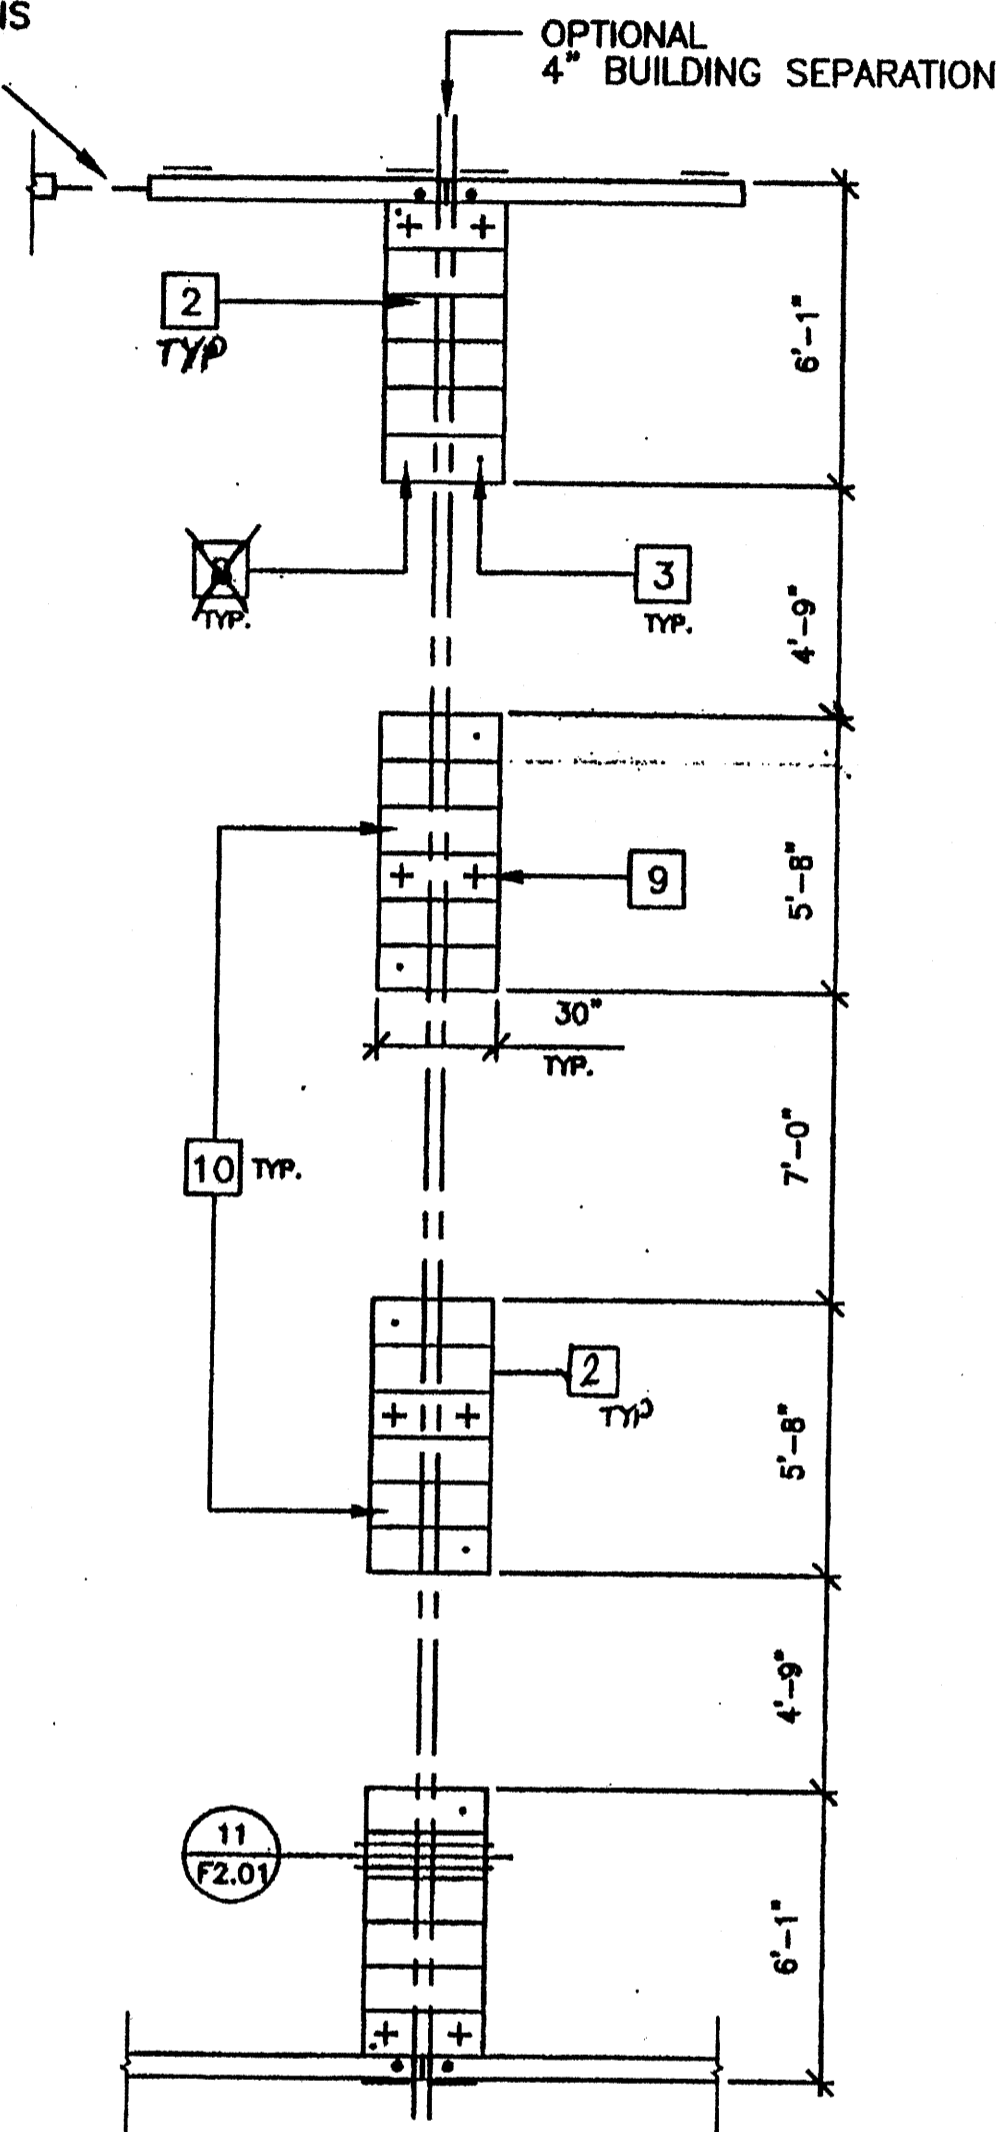


FOOTINGS AT ADJACENT BUILDING (OPTIONAL 4" SEPARATION)

BUILDING CLOSURE AT 4" SEPARATION NOTES:
 - FOR ROOF DETAIL AT ADJACENT BLDG SEE F/S2.0
 - FOR WALL DETAIL AT ADJACENT BLDG SEE 17/S4.03 OR S4.03M

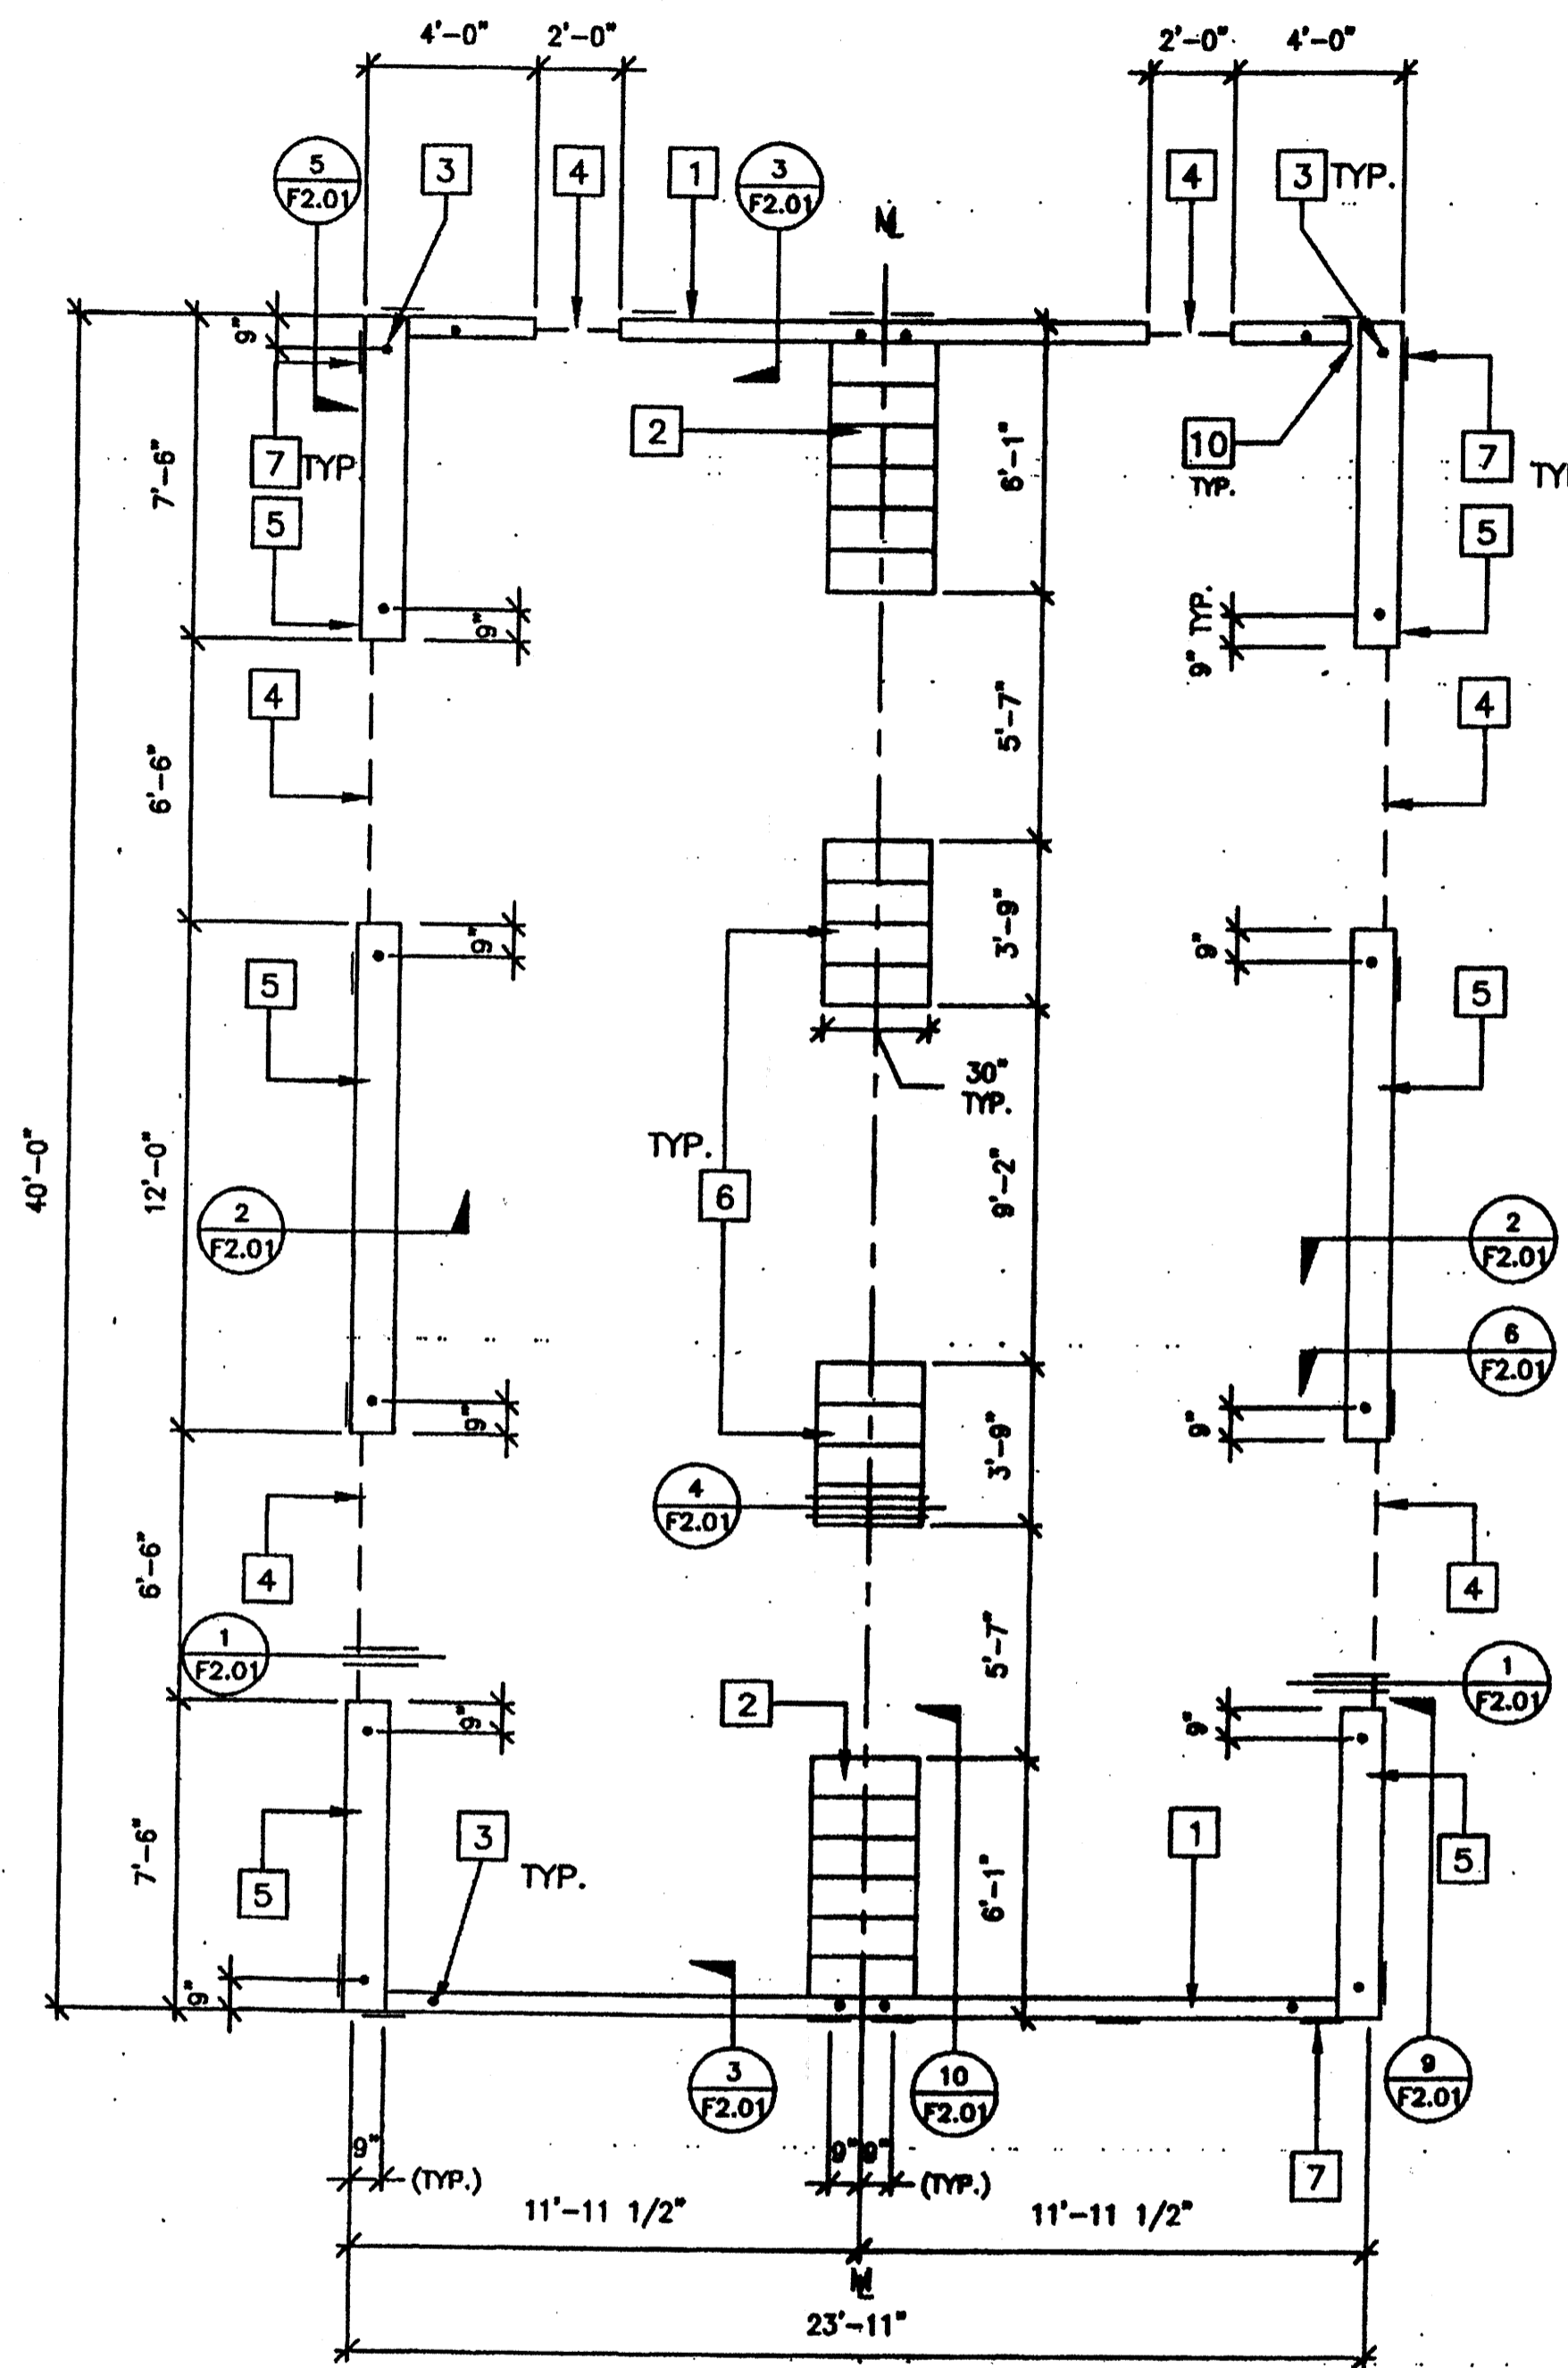

FOUNDATION - WOOD SILL 24' X 40' 50 PSF LL SCALE 1/4" = 1'

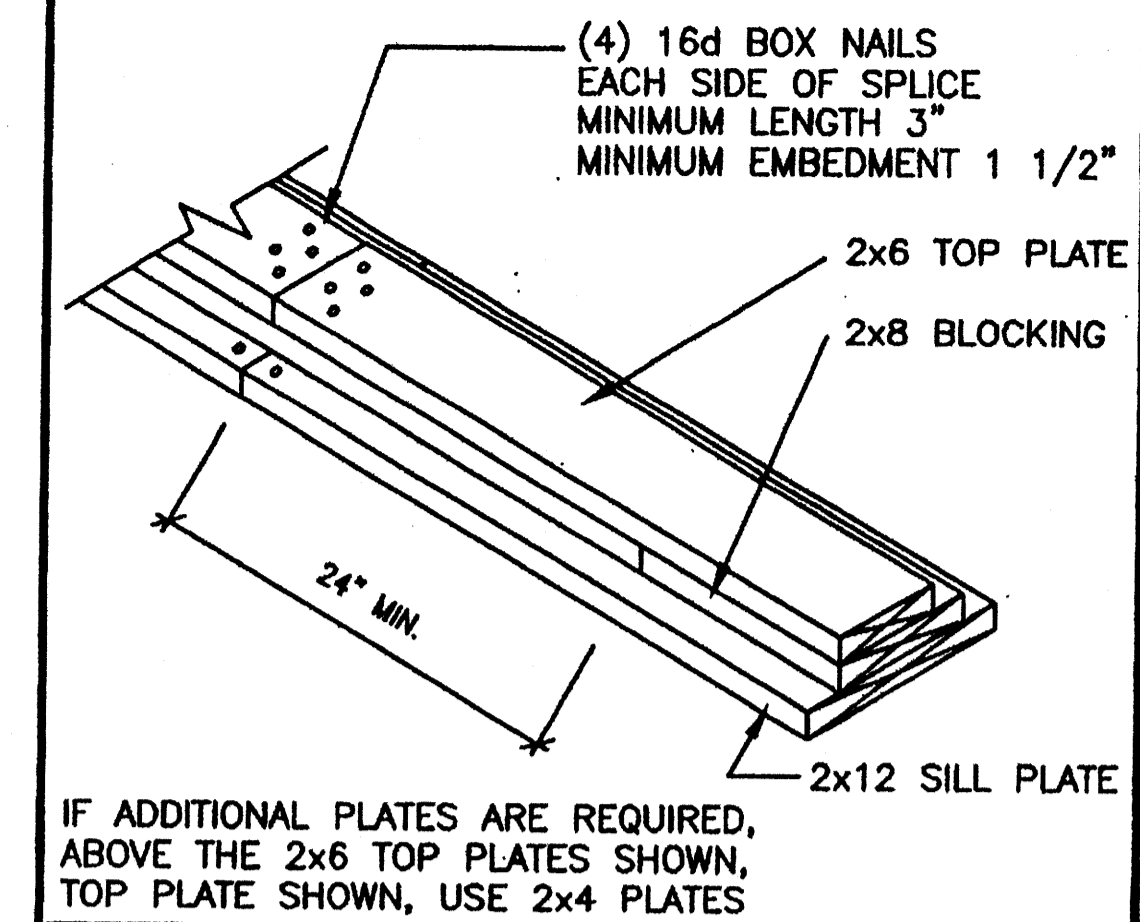


FOUNDATION SPLICE DETAIL 1

VENT CALCS.
 BLD'G SIZE 24' X 40' = 960
 VENTILATION REQ'D 960 ÷ 150 = 6.4SF
 3"x6'-6" VENT = 1.625SF X 4 = 6.5SF
 3"x2'-0" = 0.5 SF X 2 = 1.0 SF
 TOTAL VENTING PROVIDED = 7.5 SF

24'x40' VENT CALCS 2


BLD'G SIZE 48' X 40' = 1920
 VENTILATION REQ'D 1920 ÷ 150 = 12.8SF
 VENT A: 3"x6'-6" = 1.625SF X 6 = 9.725SF
 VENT B: 3"x2'-0" = 0.5 SF X 6 = 3.0 SF
 TOTAL VENTING PROVIDED = 12.72 SF OK

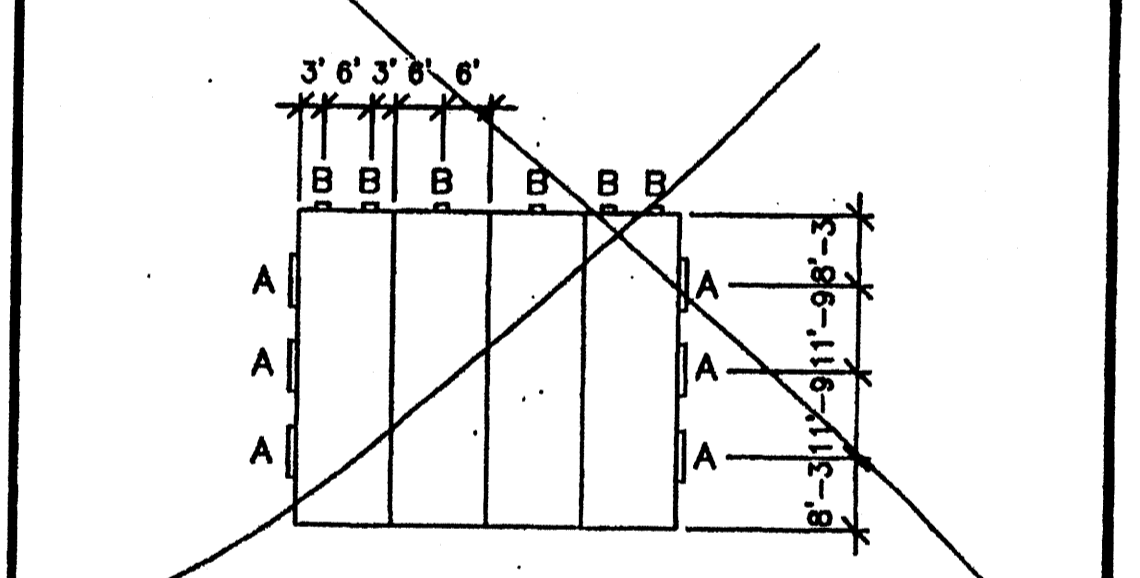

48'x40' VENT CALCS/KEY PLAN 3

- KEY NOTES**
- 2"x6" SILL PLATE (END WALL)
 - 6- 2X12X30" LONG SILL PADS
 - PIPE TO GRADE (TYP.)
 - 3" HIGH BY 6'-6" LONG VENT AT SIDEWALLS
3" HIGH BY 2'-0" LONG VENT AT ENDWALLS
 - 2X12 SILL PLATE (SIDE WALL)
 - 4-2X12X30" LONG SILL PADS
 - 6"x12"x10 GA. PLATES
5 AT ENDWALL, 4 AT SIDEWALL
 - TIE PLATE - 6.5/P2.0
AT 70 MPH WIND DESIGN LOAD:
MIN (4) AT EACH ENDWALL
(3) AT EACH SIDEWALL
AT 80 MPH WIND DESIGN LOAD:
MIN (5) AT EACH ENDWALL
(4) AT EACH SIDEWALL
 - 5/8" DIA x 4" LAGS
 - 2" CUTOUT OF SILL PLATE FOR DRAINAGE, FIELD TO LOCATE AT LOWEST CORNER OF FOUNDATION

- NOTES**
- SILL RESTRAINT: ON A.C. PAVING AND ON SOIL 1" O.D. GALVANIZED PIPE AT 10'-0", 12" PENETRATION BELOW SURFACE VERTICALLY. DRILL SILL 1-1/4" MAX. PIPE MAY BE DRIVEN MAX. OF 45° ANGLE TO VERTICAL (18-1/2" LONG PIPE REQUIRED FOR PENETRATION AT 45° ANGLE)
 - ON CONCRETE PAVING HILTI DS 82-P10 THRU SILL PLATE. END WALLS: 8" O.C. SIDE WALLS: 22" O.C.
 - WHERE SHIM STOCK IS REQUIRED FOR LEVELING USE 1/4", 1/2" OR 3/4" THICK PLYWOOD SAME WIDTH AS BLOCK. P.T.
 - VERIFY DRAINAGE TO PREVENT WATER FROM PONDING BENEATH THE STRUCTURE WITH DISTRICT ARCHITECT SITE PLANS.
 - ALL FOUNDATION MATERIAL SHALL BE DOUGLAS FIR GROUND CONTACT: LP-22 (CCA .40) ABOVE GROUND: LP-2 (CCA .25)
 - ALLOWABLE SOIL BEARING: 1000 PSF
 - "MACHINE APPLIED 16d FASTENERS SHALL HAVE AN EMBEDMENT OF NOT LESS THAN 1 1/2" INTO SECOND MEMBER, AND SHALL BE NOT LESS THAN 3" IN OVERALL LENGTH"
THE ABOVE NAILS SHALL ALSO BE ACCEPTABLE FOR HAND NAILING, PROVIDED THE REQUIRED EMBEDMENT IS MAINTAINED.
 - FOR FOUNDATIONS USING (4) PLATES, USE SHEET F2.01 FOR DETAILS IN LIEU OF SHEET F2.0

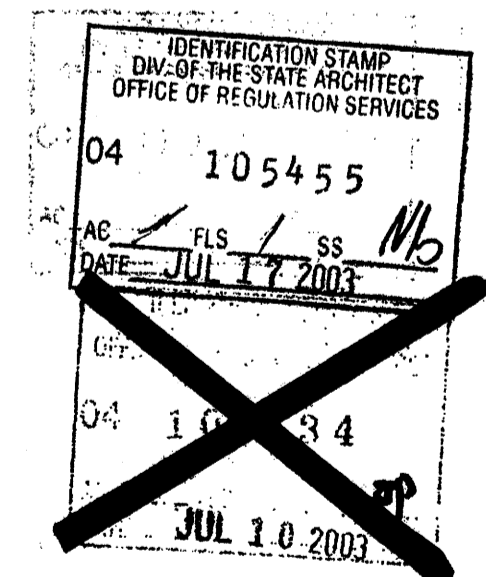

REVISIONS	Electrical Engineer's Seal	Mechanical Engineer's Seal	PC Professional of Record Seal	Architect's Seal

PC
CBC 2001



IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 PC-04
 104796
 AC: FLS: SS: PS:
 DATE: 7/7/03

MODTECH™
 2830 BARRETT AVENUE PH (909) 943-4014
 PERRIS, CALIF. 92571 FAX (909) 940-0427

PROJECT NUMBER: 4736 © MODTECH, INC. 2002
 WILLIAM SCOTTMAN
 DRAWN BY: GL
 DATE: 07/07/03
 CHECKED BY:
 DATE:
 MODTECH Index No.
F1.01

FOUNDATION PLAN

PROJECT NO. 4736

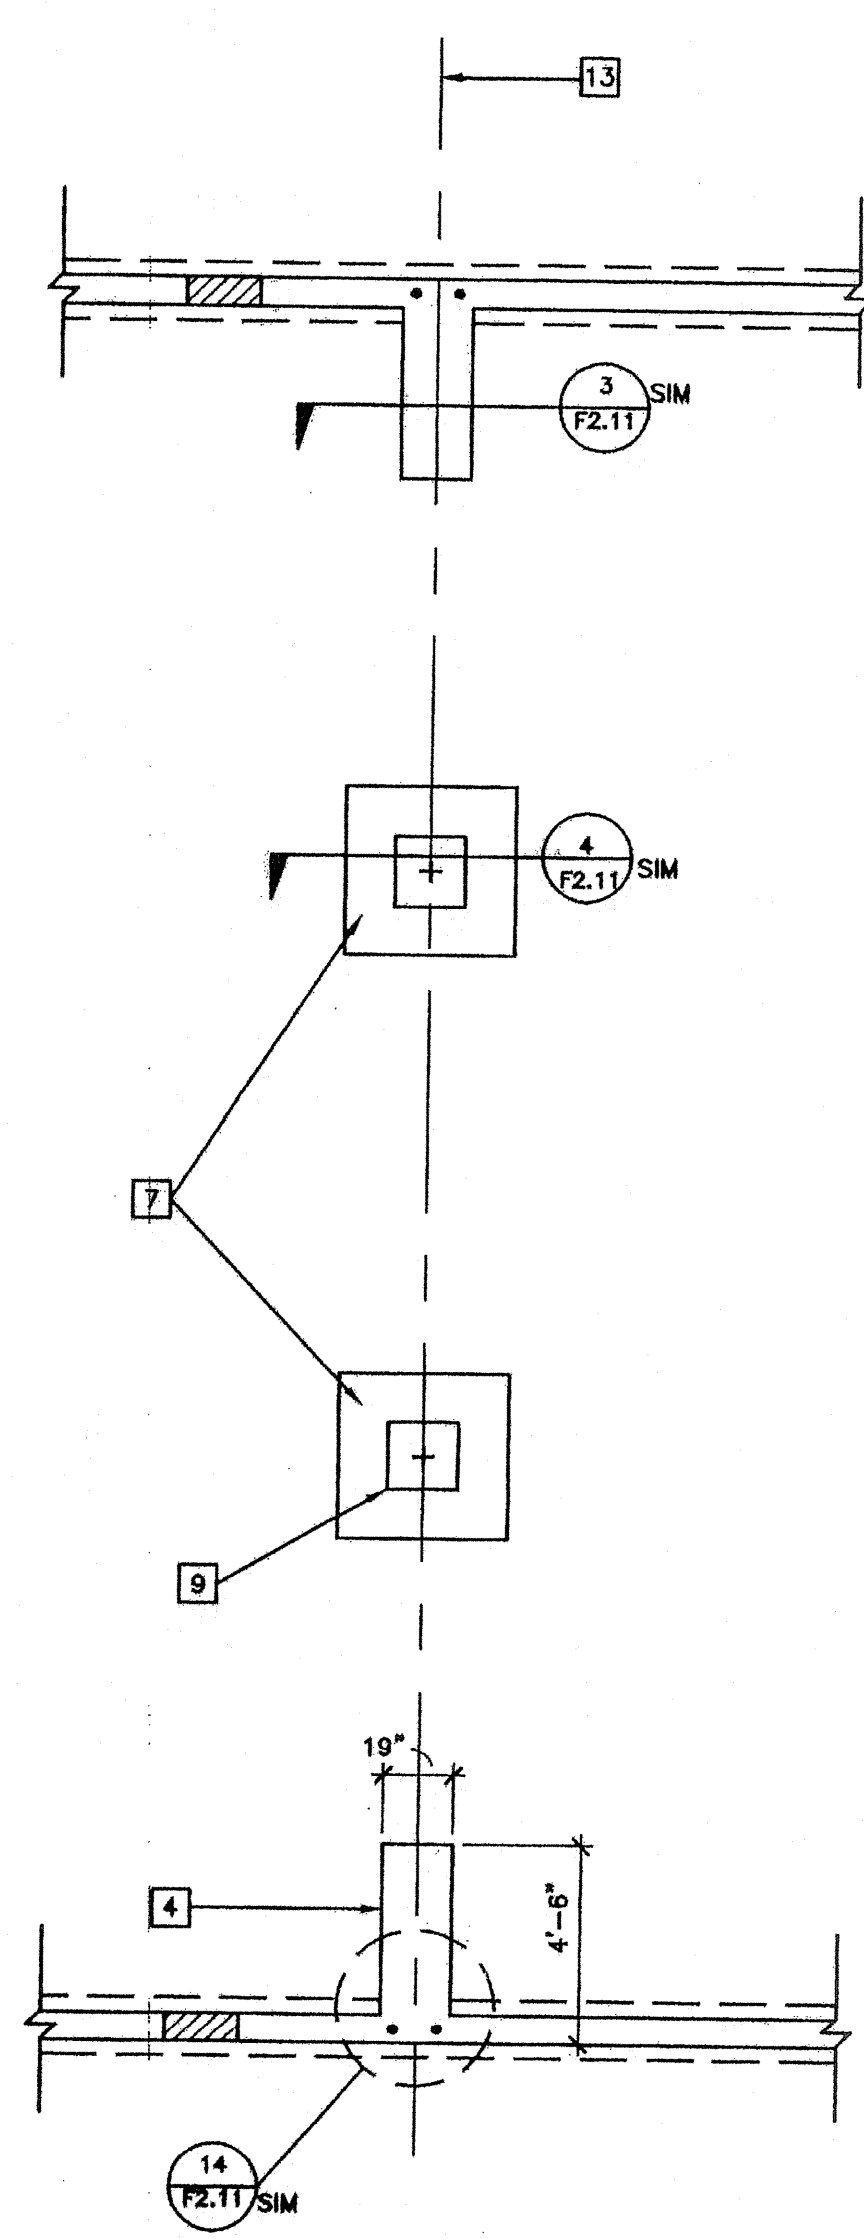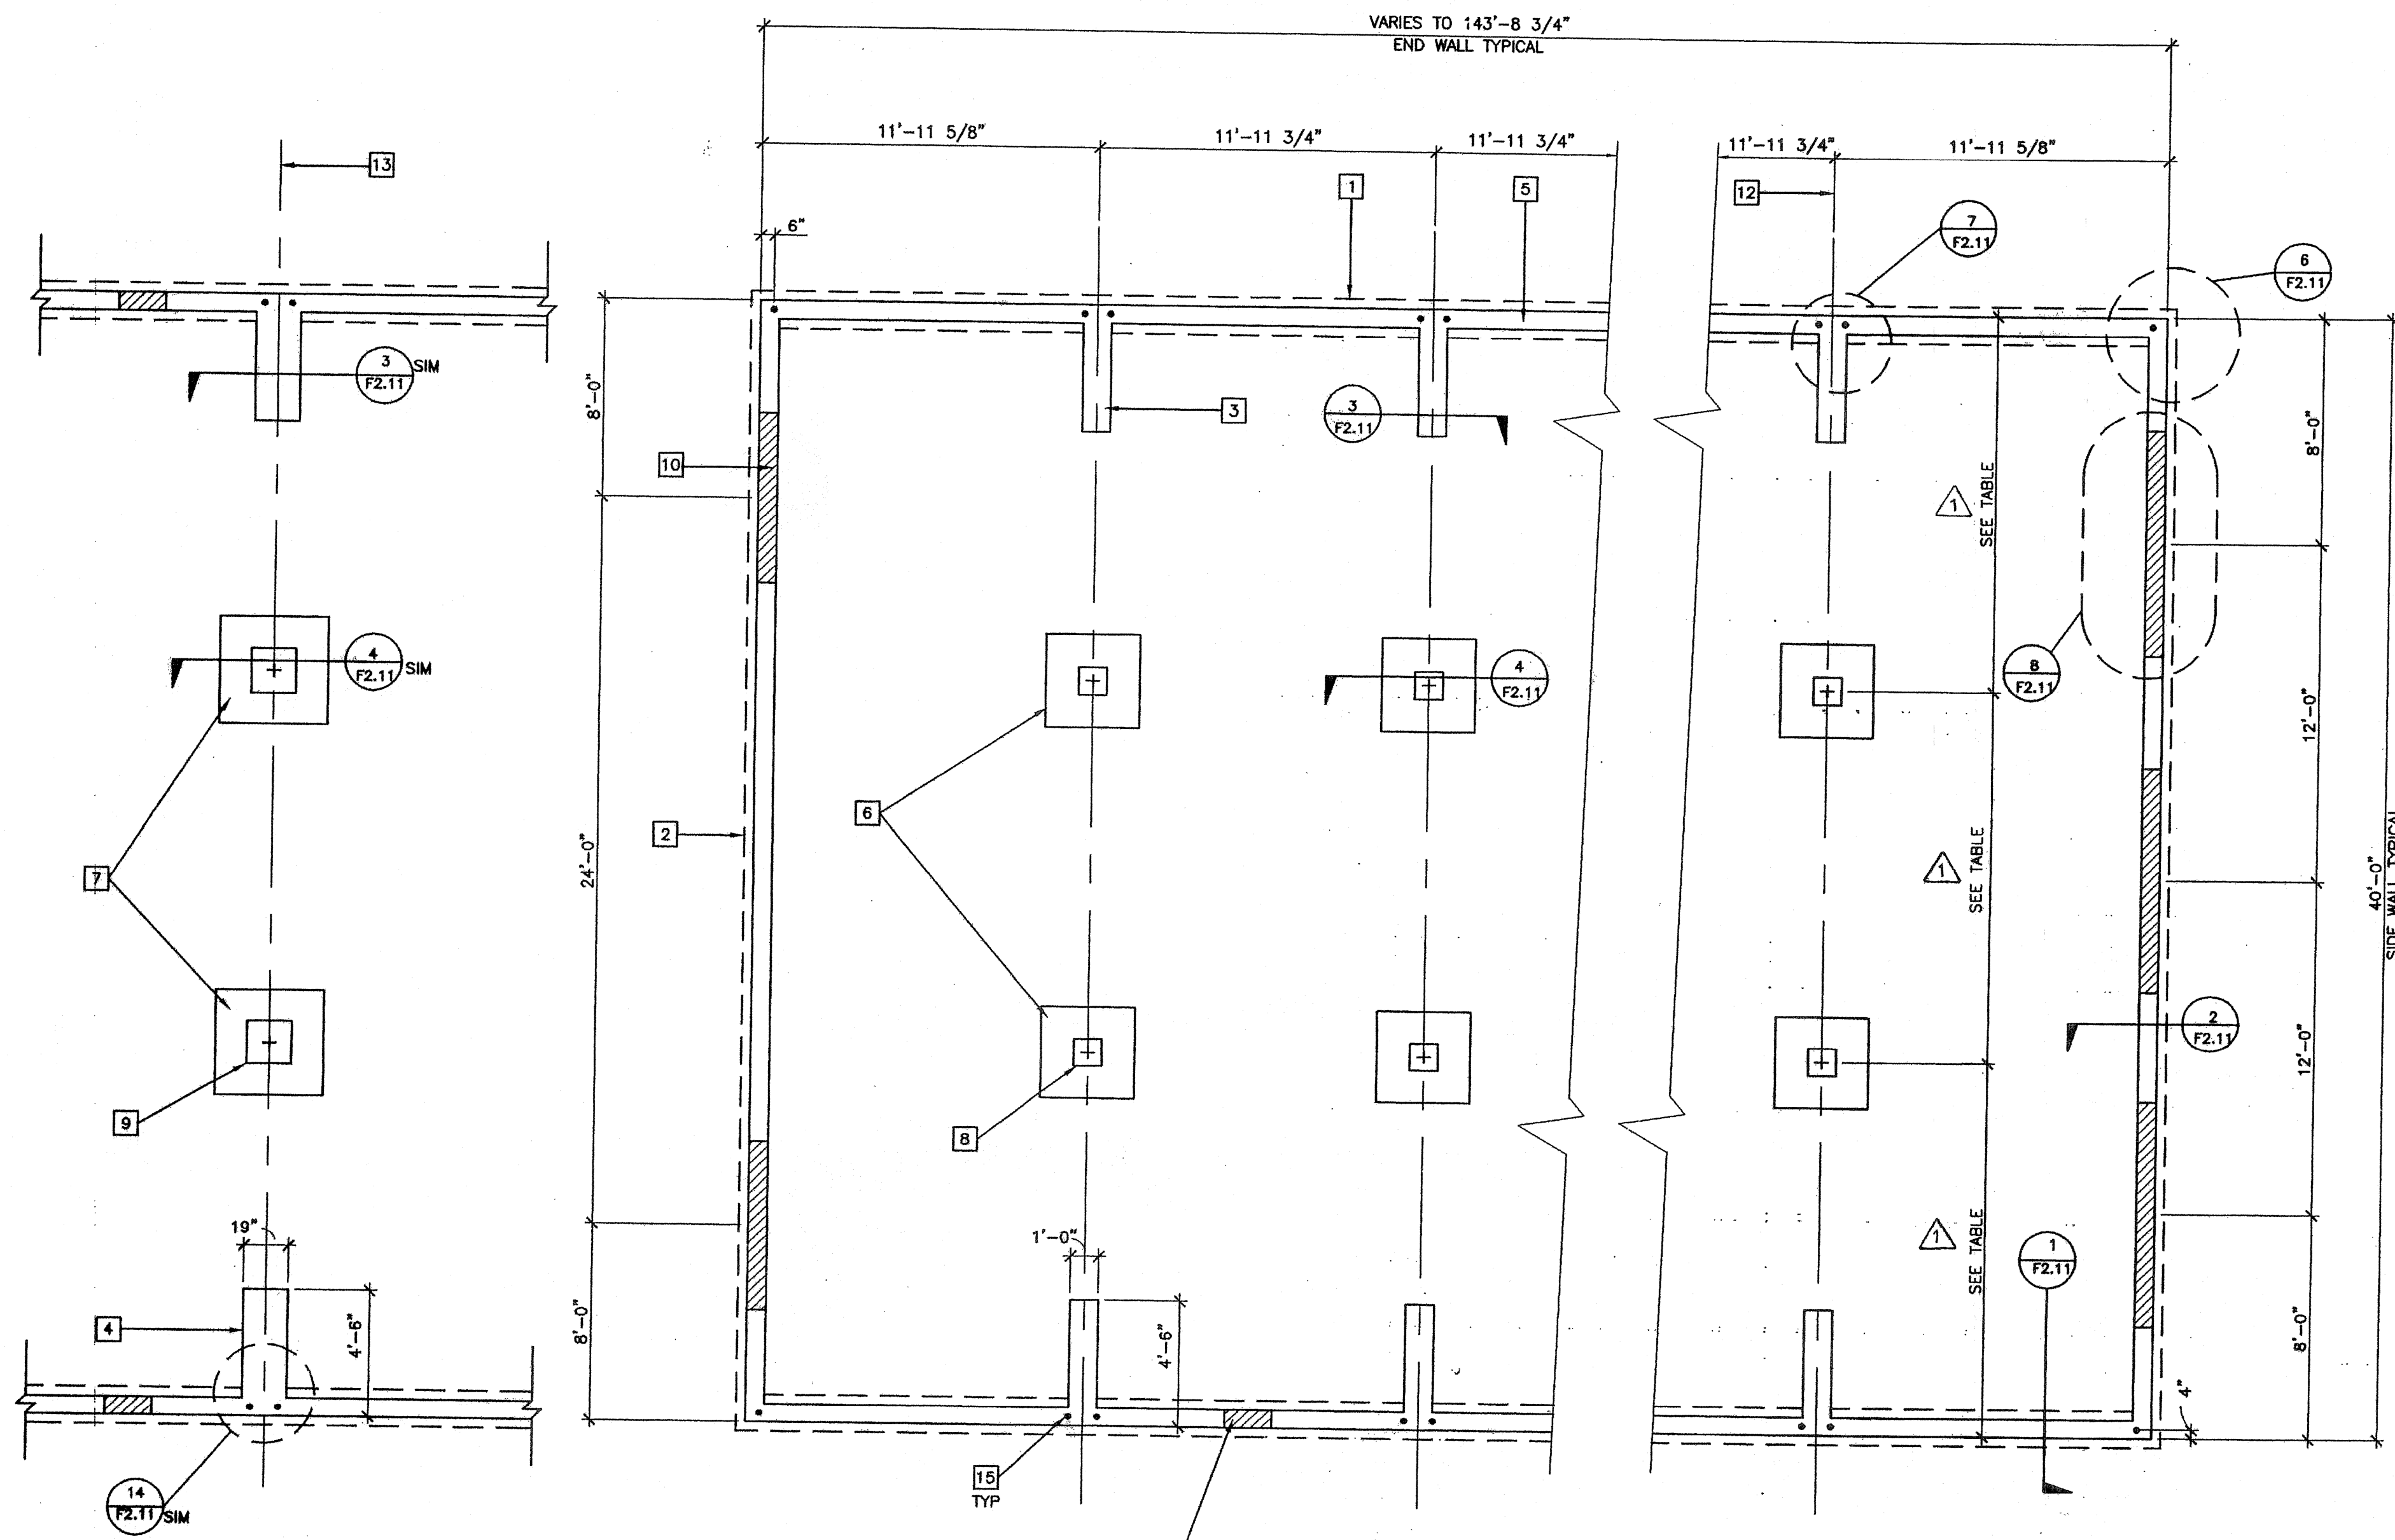

FOOTING SCHEDULE						
DESIGN FLOOR LIVE LOAD	50 PSF WOOD FLR	50 PSF CONC FLR	50+20 PSF WOOD FLR	50+20 PSF CONC FLR	100 PSF	125 PSF
SIDEWALL	12"	12"	12"	12"	SEE SHEET F3.02	SEE SHEET F3.02
ENDWALL	17"	17"	19"	19"		
PAD	3'-4" 3-#5 EW	3'-4" 2-#5 EW	4'-0" 3-#5 EW	4'-0" 2-#5 EW		
PAD AT 4" SEPARATION	3'-9" 3-#5 EW	3'-8" 2-#5 EW	4'-3" 3-#5 EW	4'-3" 2-#5 EW		
NO. OF PADS AND SPACING	2 13'-4"	3 10'-0"	2 13'-4"	3 10'-0"		

VENTING SCHEDULE (WOOD FLOORS ONLY)							
BUILDING	(SF) AREA	(SF) VENTING REQUIRED	SIDE WALL VENTING	SIDE WALL VENT AREA	END WALL VENTING	END WALL VENT AREA	TOTAL VENT SUPPLIED
24'x40'	960	6.4	(5) A	7.8	-	-	7.8
36'x40'	1440	9.6	(4) B	9.6	-	-	9.6
48'x40'	1920	12.8	(6) B	14.4	-	-	14.4
60'x40'	2400	16	(4) C (2) B	12.92 4.8	-	-	17.7
72'x40'	2880	19.2	(6) C	19.38	-	-	19.4
84'x40'	3360	22.4	(6) C	19.38	(2) A (1) D	3.65	23.03
96'x40'	3840	25.6	(6) C	19.38	(4) A (1) D	6.6	25.9
108'x40'	4320	28.8	(6) C	19.38	(6) A (1) D	9.5	28.9
120'x40'	4800	32	(6) C	19.38	(9) A	31.1	32.52
132'x40'	5280	35.2	(6) C	19.38	(11) A	16.1	35.5
144'x40'	5760	38.4	(6) C	19.38	(13) A (1) D	24.49	39.09

LEGEND	VENT	SIZE	AREA (SF)	GRATE SIZE
	A	3'-9"x5"	1.56	4'x8"
B	5'-9"x5"	2.40	6'x8"	
C	7'-9"x5"	3.23	8'x8"	
D	1'-9"x5"	0.73	2'x8"	

ACCESS (OPTIONAL) E 2'-9"x18" 4.13 3'x2'

NOTE: DELETE ALL UNDER FLOOR VENTS FOR CONCRETE FLOOR OPTION.

- ### KEY NOTES
- END WALL FOOTING - SEE FOOTING SCHEDULE
 - SIDE WALL FOOTING - SEE FOOTING SCHEDULE
 - INTERIOR RETURN FOOTING - SEE FOOTING SCHEDULE
 - MODLINE RETURN AT 4" SEPARATION - OPTIONAL
 - STEM WALL - 8" TYPICAL UON
 - MODLINE PAD
 - MODLINE PAD AT 4" SEPARATION - OPTIONAL
 - 12" DIA OR SQUARE PEDESTAL (TYPICAL AT MODLINE)
 - 19" DIA OR SQUARE PEDESTAL (TYPICAL AT MODLINE)
 - TYPICAL VENT
 - ADDITIONAL END WALL VENTS AS REQUIRED (48" MAXIMUM LENGTH) OR INCREASE VENT HEIGHT AS REQUIRED AT SIDEWALLS
 - MODLINE
 - 4" BUILDING SEPARATION AT ADJACENT BUILDINGS - OPTIONAL
 - NOT USED
 - ANCHOR BOLT LOCATION - (1) AT EACH CORNER OF BUILDING AND (2) AT EACH MODLINE LOCATION

- ### NOTES
- SOIL TYPE AND FOUNDATION**
A. BEARING: SOIL BEARING VALUE OF 1000 PSF USED FOR DESIGN.
B. FOOTINGS: ALL FOOTINGS SHALL EXTEND 12 INCHES MINIMUM INTO NATIVE SOIL OR APPROVED ENGINEERED FILL.
 - CONCRETE**
ALL CONCRETE SHALL HAVE THE FOLLOWING MINIMUM STRENGTH AT 28 DAYS: FOOTINGS: $f'_c = 3000$ PSI (DESIGN BASED ON $f'_c = 2000$ PSI). CONCRETE SHALL CONFORM TO TITLE 24, SECTION 1905A.2.3 METHOD A OR B. ALL CEMENT SHALL BE TYPE 1 OR TYPE 11 PER ASTM C-150.
METHOD "A" NON-DESIGNED MIX PER TABLE 19A-A-B.
MINIMUM 7.1 SACKS PER YARD. WATER CONTENT SHALL NOT EXCEED 6 GALLONS PER SACK. AGGREGATE SHALL BE 3/4" TO 1" MAXIMUM SIZE BUT NOT MORE THAN 3/4" OF MINIMUM CLEAR BAR SPACING.
METHOD "B" PER SECTION 1905A.3.1.
CONCRETE SUPPLIER SHALL PROVIDE CONCRETE MIX DESIGN AND A BREAK HISTORY OF 30 CONSECUTIVE BREAKS IDENTIFIED TO THAT MIX DESIGN. ALTERNATE - PROVIDE 15 CONSECUTIVE BREAKS IDENTIFIED TO THAT MIX DESIGN WITH A STANDARD DEVIATION CALCULATIONS.
ANCHOR BOLTS, DOWELS, REINFORCING STEEL AND EMBEDDED ITEMS ARE TO BE SECURELY TIED IN PLACE BEFORE CONCRETE IS POURED.
 - REINFORCING STEEL GRADE 40**
ALL REINFORCING STEEL SHALL BE BILLET STEEL PER ASTM A-615 WELDED REINFORCING STEEL SHALL CONFORM TO ASTM A-706, AND WELDED PER AWS D1.4-98
 - FOR FOOTINGS USING TRENCH FOR FORMING WIDTH SHALL BE INCREASED 2" EA. SIDE
 - THE ABOVE FOUNDATION HAS 1/4" ADDED AT EACH MOD LINE AND 1/8" AT EACH SIDE WALL AND DOES NOT MATCH THE FLOOR PLAN. THIS IS REQUIRED FOR GROWTH THAT IS EXPERIENCED WHEN SETTING MULTIPLE MODULE BUILDINGS.
 - MAX VENT LENGTH AT SIDE WALLS IS 8'-0"
MAX VENT LENGTH AT END WALLS IS 4'-0"
MIN DISTANCE FROM VENT TO EDGE OF MODULE IS 2'-0"
MIN DISTANCE BETWEEN VENTS IS 2'-0"
 - DELETE ALL UNDER FLOOR VENTS WHEN SINGLE STORY BUILDING OR BOTTOM FLOOR OF TWO STORY BUILDING UTILIZES THE CONCRETE FLOOR OPTION.
 - FOR WELDED ANCHORAGE DELETE CANNOTS. PROVIDE 1-ANCHOR PLATE AT EACH CORNER OF BUILDING AND 2-ANCHOR PLATES AT EACH MODLINE.
24X40 = 8 72X40 = 24
36X40 = 12 84X40 = 28
48X40 = 16 96X40 = 32
60X40 = 20 108X40 = 36

DATE SIGNED
APR 30 2003

PC
CBC 2001

FOUNDATION PLAN

ABOVE GRADE CONCRETE
SCALE: 1/4" = 1'-0"

REVISIONS		
▲	MCA	ADDED PAD SPACING TABLE 11/06/03
▲		
▲		
▲		

Electrical Engineer's Seal	Mechanical Engineer's Seal	PC Professional of Record Seal	Architects Seal
----------------------------	----------------------------	--------------------------------	-----------------

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES

PC-04
104801

AC: FLS. SS. DVL
DATE: 5/17/03
Revised 11/16/03 Rev 55

MODTECH INC.

2830 BARRETT AVENUE PH (909) 943-4014
PERRIS, CALIF. 92571 FAX (909) 940-0427

PROJECT NUMBER: © MODTECH, INC. 2002

FOUNDATION PLAN AGC - 50, 50+20 PSF

DRAWN BY:
DATE:
CHECKED BY:
DATE:

MODTECH Index No. **F2.01**

FILE PATH: 2440-F2.01.DWG PROJECT NO. PC-04-104801

FOOTING SCHEDULE

DESIGN FLOOR LIVE LOAD	50 PSF	50+20 PSF	100 PSF	125 PSF
SIDEWALL			12"/15"	14"/15"
ENDWALL			20"/21"	21"/23"
PAD			4'-0"/4'-0"	4'-4"/4'-9"
PAD AT 4" SEPARATION			3-#5 EW	3-#5 EW
			4'-3"/4'-7"	4'-7"/4'-11"
			3-#5 EW	3-#5 EW

VENTING SCHEDULE (WOOD FLOORS ONLY)

BUILDING	(SF) AREA	(SF) VENTING REQUIRED	SIDE WALL VENTING	SIDE WALL VENT AREA	END WALL VENTING	END WALL VENT AREA	TOTAL VENT SUPPLIED
24'x40'	960	6.4	(4) A	7.0	-	-	7.0
36'x40'	1440	9.6	(6) A	10.5	-	-	10.5
48'x40'	1920	12.8	(6) B	14	-	-	14
60'x40'	2400	16	(6) B	14	(2) C	2.33	16.33
72'x40'	2880	19.2	(6) B	14	(4) C (1) D	2.25	19.25
84'x40'	3360	22.4	(6) B	14	(7) C (1) D	8.75	22.75
96'x40'	3840	25.6	(6) B	14	(10) C	11.66	25.66
108'x40'	4320	28.8	(6) B	14	(13) C	15.16	29.16
120'x40'	4800	32	(6) B	14	(15) C (1) D	18.07	32.07
132'x40'	5280	35.2	(6) B	14	(18) C (1) D	21.57	33.57
144'x40'	5760	38.4	(6) B	14	(21) C	24.49	38.49

LEGEND

VENT A 6'x3.5" = 1.75 SF
 VENT B 8'x3.5" = 2.33 SF
 VENT C 4'x3.5" = 1.166 SF
 VENT D 2'x3.5" = 0.583 SF


NOTE: DELETE ALL UNDER FLOOR VENTS THE CONCRETE FLOOR OPTION.

KEY NOTES

- 1 END WALL FOOTING - SEE FOOTING SCHEDULE.
- 2 SIDE WALL FOOTING - SEE FOOTING SCHEDULE.
- 3 INTERIOR RETURN FOOTING - SEE FOOTING SCHEDULE.
- 4 MODLINE RETURN AT 4" SEPARATION - OPTIONAL.
- 5 STEM WALL - 8" TYPICAL UON.
- 6 MODLINE PAD.
- 7 MODLINE PAD AT 4" SEPARATION - OPTIONAL.
- 8 12" DIA OR SQUARE PEDESTAL (TYPICAL AT MODLINE).
- 9 19" DIA OR SQUARE PEDESTAL (TYPICAL AT 4" SEPARATION).
- 10 TYPICAL VENT.
- 11 ADDITIONAL END WALL VENTS AS REQUIRED (24" MAXIMUM LENGTH) OR INCREASE VENT HEIGHT AS REQUIRED AT SIDEWALLS.
- 12 MODLINE.
- 13 4" BUILDING SEPARATION - ADJACENT BUILDINGS - OPTIONAL.
- 14 NOT USED.
- 15 ANCHOR BOLT LOCATION - (1) AT EACH CORNER OF BUILDING. (2) AT EACH MODLINE LOCATION.
- 16 ANCHOR BOLT AT SIDEWALL - 13'-4" OC FOR BUILDING SIZE 60'x40' OR LARGER.

NOTES

1. SOIL TYPE AND FOUNDATION
 - A. BEARING: SOIL BEARING VALUE OF 1000 PSF USED FOR DESIGN.
 - B. FOOTINGS: ALL FOOTINGS SHALL EXTEND 12 INCHES MINIMUM INTO NATIVE SOIL OR APPROVED ENGINEERED FILL.
2. CONCRETE
 - ALL CONCRETE SHALL HAVE THE FOLLOWING MINIMUM STRENGTH AT 28 DAYS: FOOTINGS: f'c = 3000 PSI (DESIGN BASED ON f'c = 2000 PSI), CONCRETE SHALL CONFORM TO TITLE 24 SECTION 1905A.2.3 METHOD A OR B. ALL CEMENT SHALL BE TYPE 1 OR TYPE 11 PER ASTM C-150. METHOD "A" NON-DESIGNED MIX PER TABLE 19A-A-B. MINIMUM 7.1 SACKS PER YARD. WATER CONTENT SHALL NOT EXCEED 6 GALLONS PER SACK. AGGREGATE SHALL BE 3/4" TO 1" MAXIMUM SIZE BUT NOT MORE THAN 3/4" OF MINIMUM CLEAR BAR SPACING. METHOD "B" PER SECTION 1905A.3.1. CONCRETE SUPPLIER SHALL PROVIDE CONCRETE MIX DESIGN AND A BREAK HISTORY OF 30 CONSECUTIVE BREAKS IDENTIFIED TO THAT MIX DESIGN. ALTERNATE - PROVIDE 15 CONSECUTIVE BREAKS IDENTIFIED TO THAT MIX DESIGN WITH A STANDARD DEVIATION CALCULATIONS.
 - ANCHOR BOLTS, DOWELS, REINFORCING STEEL AND EMBEDDED ITEMS ARE TO BE SECURELY TIED IN PLACE BEFORE CONCRETE IS POURED.
3. REINFORCING STEEL GRADE 40.
 - ALL REINFORCING STEEL SHALL BE BILLET STEEL PER ASTM A-615 WELDED REINFORCING STEEL SHALL CONFORM TO ASTM A-706, AND WELDED PER AWS D1.4-98
4. FOR FOOTINGS USING TRENCH FOR FORMING WIDTH SHALL BE INCREASED 2" EA. SIDE
5. THE ABOVE FOUNDATION PLAN HAS 1/4" ADDED AT EACH MOD LINE AND 1/8" AT EACH SIDE WALL AND DOES NOT MATCH THE FLOOR PLAN. THIS IS REQUIRED FOR GROWTH THAT IS EXPERIENCED WHEN SETTING MULTIPLE MODULE BUILDINGS.
6. MAX VENT LENGTH AT SIDE WALLS IS 8'-0"
 MAX VENT LENGTH AT END WALLS IS 4'-0"
 MIN DISTANCE FROM VENT TO EDGE OF MODULE IS 2'-0"
 MIN DISTANCE BETWEEN VENTS IS 2'-0"

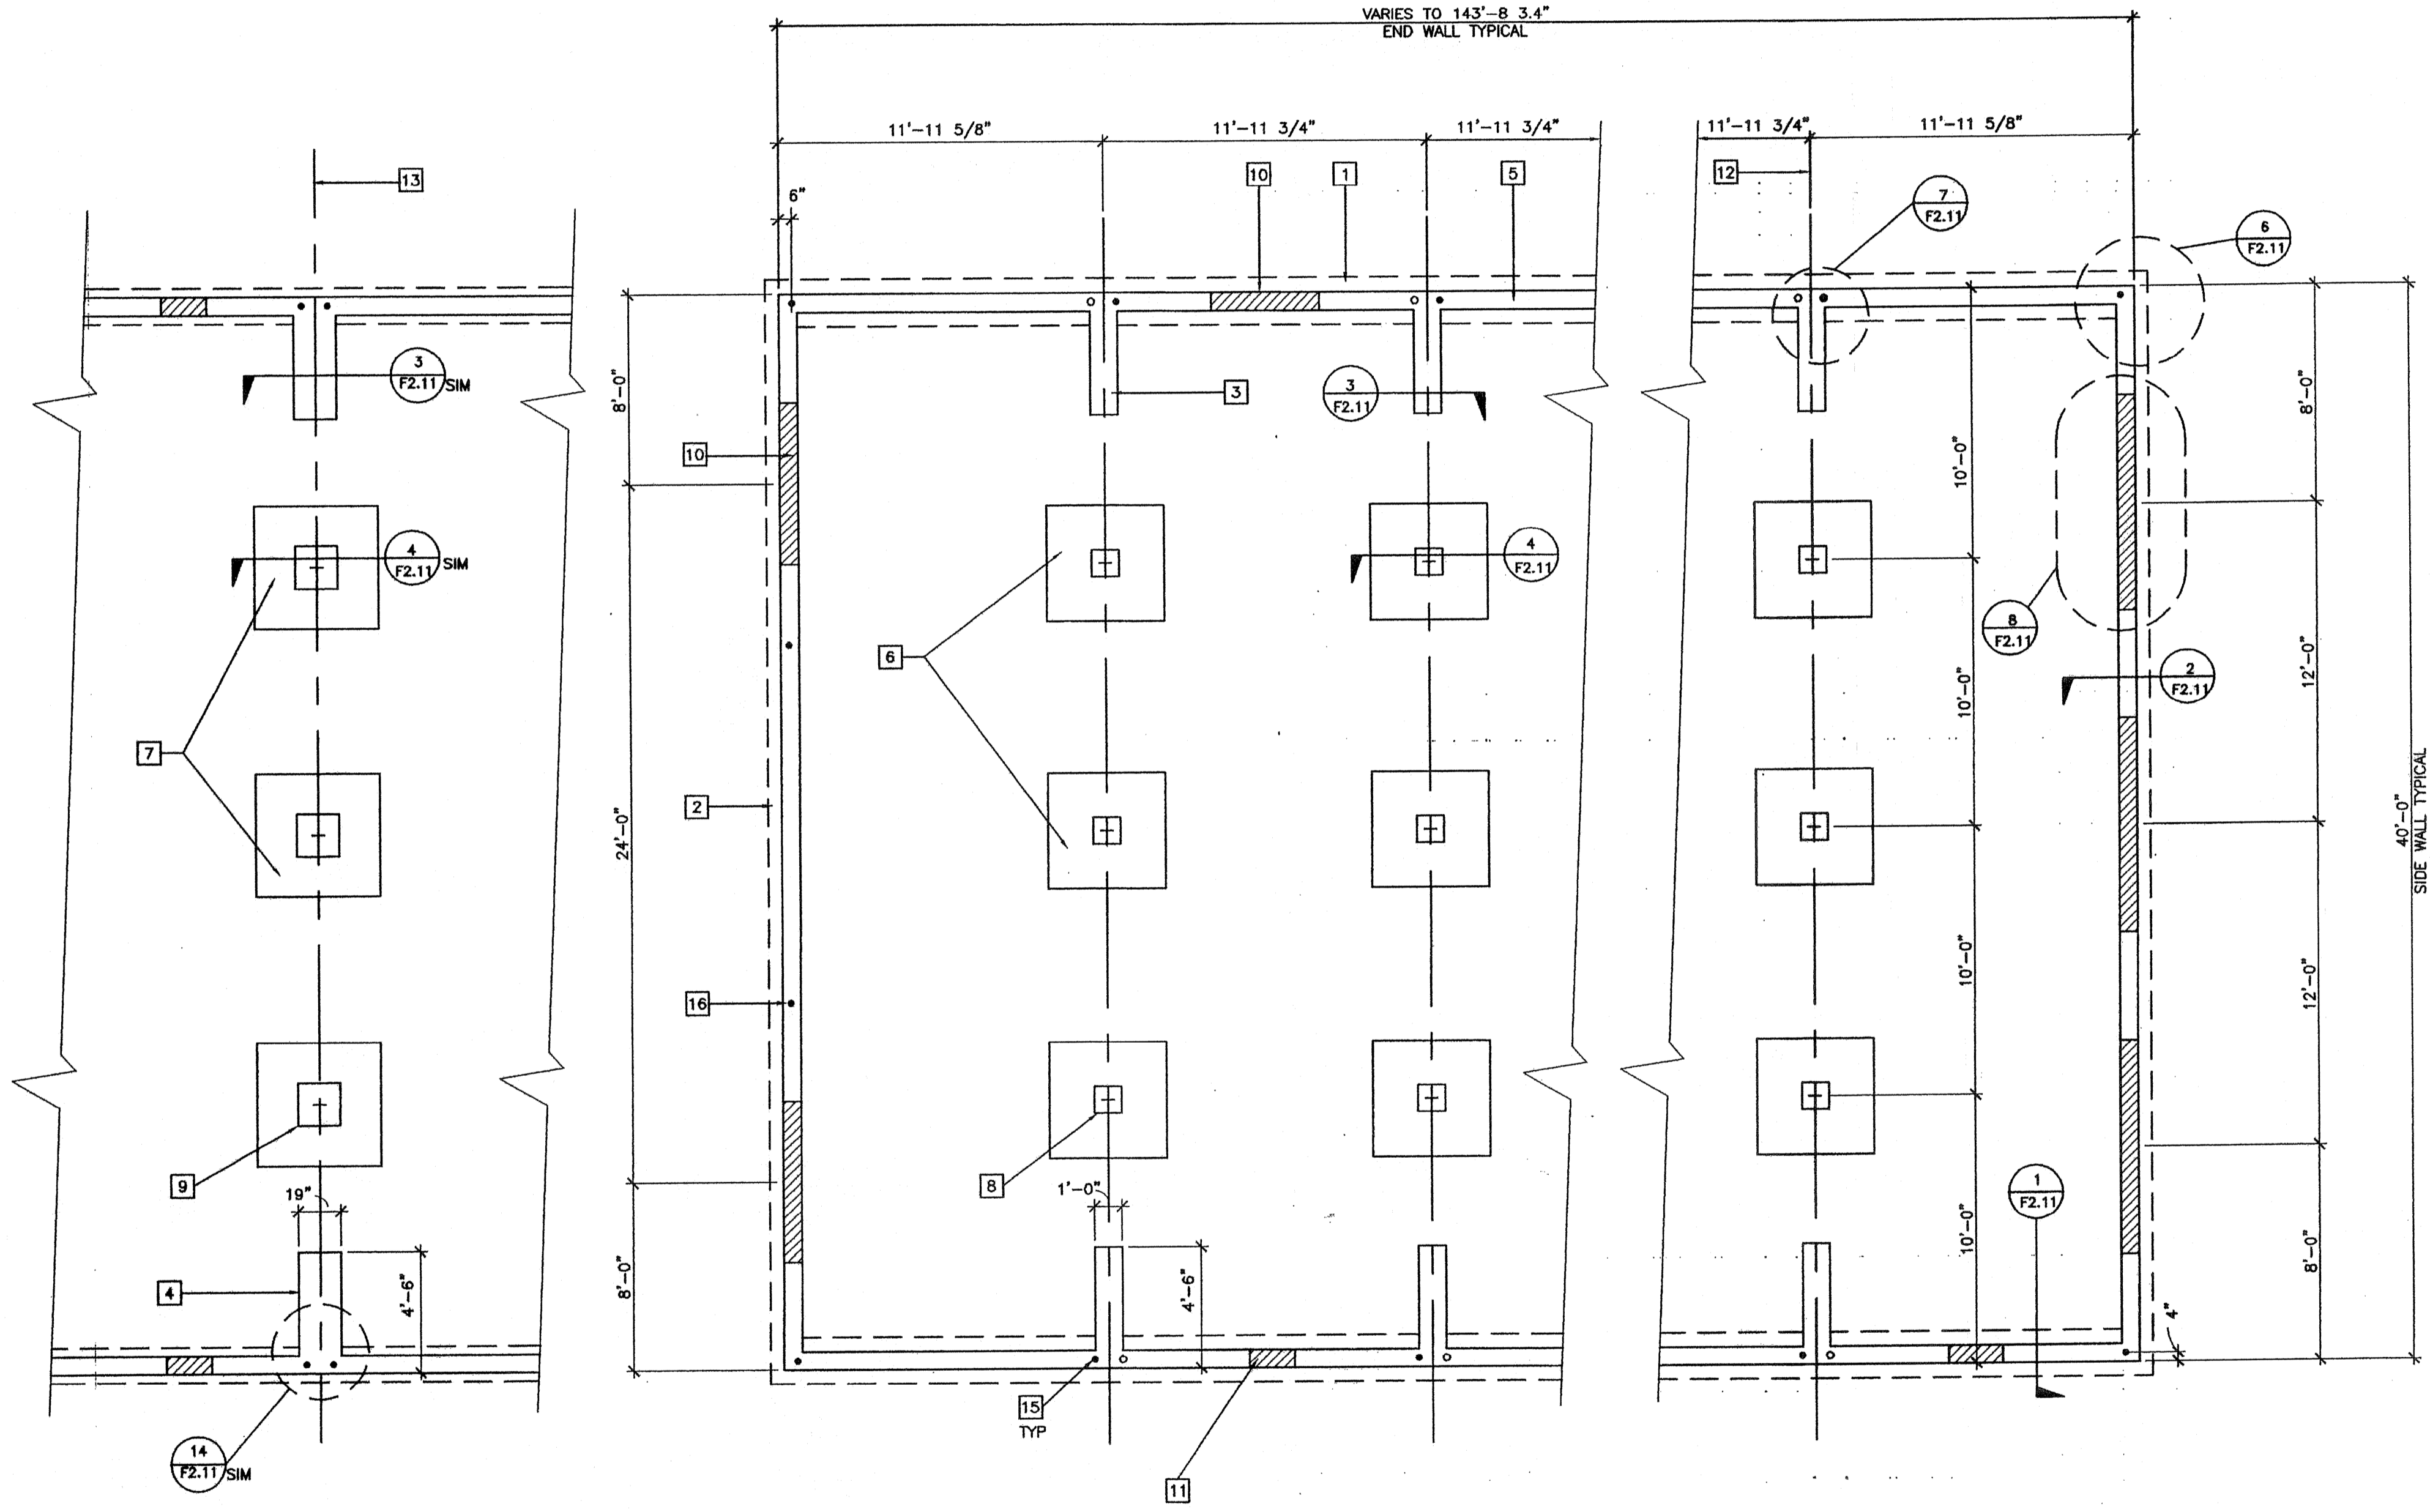

FOUNDATION PLAN ABOVE GRADE CONCRETE SCALE: 1/4" = 1'-0"

DATE SIGNED
APR 20 2003

PC
CBC 2001

REV 1
IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
04 105455
AC - PLS - SS 1/8
DATE MAY 20 2004

REVISIONS

Electrical Engineer's Seal

Mechanical Engineer's Seal

PC Professional of Record Seal
No. 3602

Architects Seal


IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
PC-04
104801
AC - PLS - SS 1/8
DATE 5/17/03

MODTECH INC.
2830 BARRETT AVENUE PERRIS, CALIF. 92571
PH (909) 943-4014 FAX (909) 940-0427

PROJECT NUMBER: © MODTECH, INC. 2002
FOUNDATION PLAN AGC - 100, 125 PSF

DRAWN BY:
DATE:
CHECKED BY:
DATE:
MODTECH Index No.
F2.02

FILE PATH: 2440-F2.02.DWG PROJECT NO. PC-04-104801

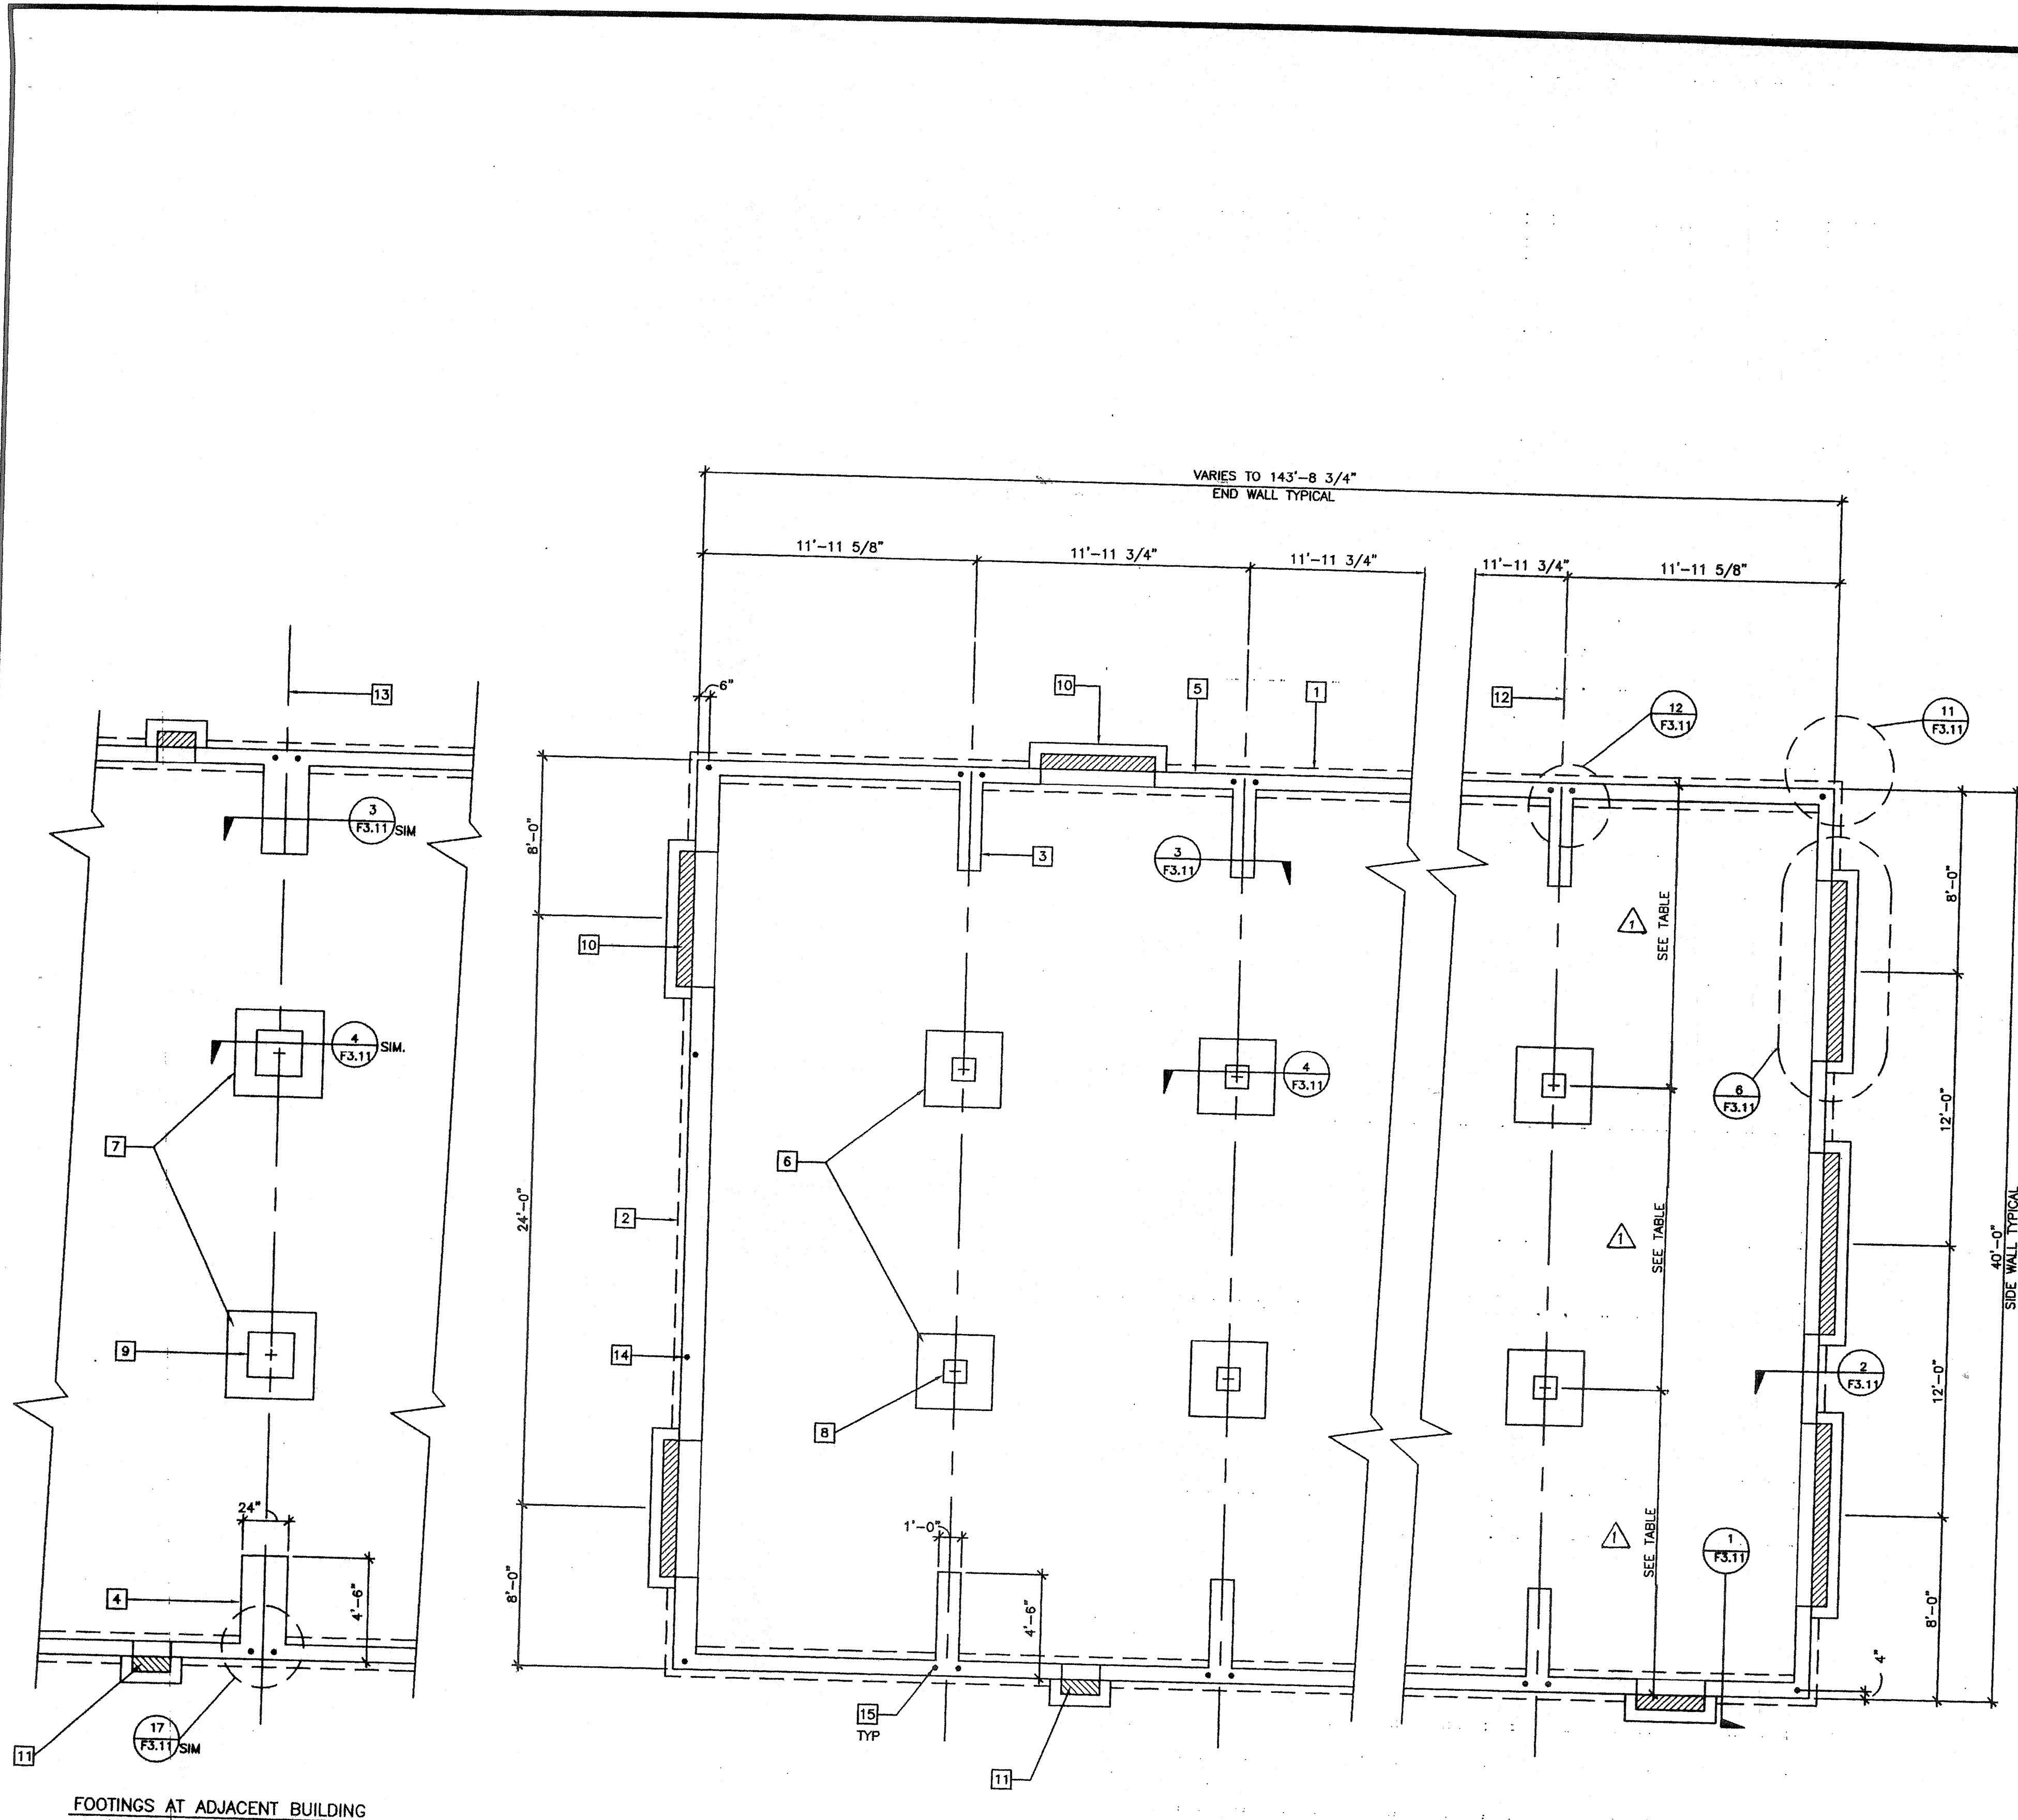

DESIGN FLOOR LIVE LOAD	50 PSF WOOD FLR	50 PSF CONC FLR	50+20 PSF WOOD FLR	50+20 PSF CONC FLR	100 PSF	125 PSF
SIDEWALL	12"	12"	12"	12"	SEE SHEET F3.02	SEE SHEET F3.02
ENDWALL	17"		19"			
PAD	3'-4" 3-#5 EW	3'-6" 2-#5 EW	4'-0" 3-#5 EW	3'-0" 2-#5 EW		
PAD AT 4" SEPARATION	3'-9" 3-#5 EW	2'-8" 2-#5 EW	4'-3" 3-#5 EW	4'-1" 2-#5 EW		
NO. OF PADS AND SPACING	2 13'-4"	3 10'-0"	2 13'-4"	3 10'-0"		

BUILDING	(SF) VENTING AREA	(SF) VENTING REQUIRED	SIDE WALL VENTING	SIDE WALL VENT AREA	END WALL VENTING	END WALL VENT AREA	TOTAL VENT SUPPLIED
24'x40'	960	6.4	(5) A	7.8	-	-	7.8
36'x40'	1440	9.6	(4) B	9.6	-	-	9.6
48'x40'	1920	12.8	(6) B	14.4	-	-	14.4
60'x40'	2400	16	(4) C (2) B	12.92 4.8	-	-	17.7
72'x40'	2880	19.2	(6) C	19.38	-	-	19.4
84'x40'	3360	22.4	(6) C	19.38	(2) A (1) D	3.65	23.03
96'x40'	3840	25.6	(6) C	19.38	(4) A (1) D	6.6	25.9
108'x40'	4320	28.8	(6) C	19.38	(6) A (1) D	9.5	28.9
120'x40'	4800	32	(6) C	19.38	(9) A	31.1	32.52
132'x40'	5280	35.2	(6) C	19.38	(11) A	16.1	35.5
144'x40'	5760	38.4	(6) C	19.38	(13) A (1) D	24.49	39.09

LEGEND	VENT	SIZE	AREA (SF)	GRATE SIZE
	A	3'-9"x5"	1.56	4"x8"
	B	5'-9"x5"	2.40	6"x8"
	C	7'-9"x5"	3.23	8"x8"
	D	1'-9"x5"	0.73	2"x8"
ACCESS (OPTIONAL)	E	2'-9"x18"	4.13	3'x2'

NOTE: DELETE ALL UNDER FLOOR VENTS FOR CONCRETE FLOOR OPTION.

- ### KEY NOTES
- END WALL FOOTING - SEE FOOTING SCHEDULE
 - SIDE WALL FOOTING - SEE FOOTING SCHEDULE
 - INTERIOR RETURN FOOTING - SEE FOOTING SCHEDULE
 - MODLINE RETURN AT 4" SEPARATION - OPTIONAL
 - STEM WALL - 8" TYPICAL UON
 - MODLINE PAD
 - MODLINE PAD AT 4" SEPARATION - OPTIONAL
 - 12" DIA OR SQUARE PEDESTAL (TYPICAL AT MODLINE)
 - 19" DIA OR SQUARE PEDESTAL (TYPICAL AT 4" SEPARATION)
 - TYPICAL VENT
 - ADDITIONAL END WALL VENTS AS REQUIRED (20" MAXIMUM LENGTH) OR INCREASE VENT HEIGHT AS REQUIRED AT SIDEWALLS
 - MODLINE
 - 4" BUILDING SEPARATION AT ADJACENT BUILDING - OPTIONAL
 - ANCHOR BOLT AT SIDEWALL - 13'-4" OC FOR BUILDING SIZE 60'x40' OR LARGER
 - ANCHOR BOLT LOCATION - (1) AT EACH CORNER OF BUILDING AND (2) AT EACH MODLINE LOCATION

- ### NOTES
- SOIL TYPE AND FOUNDATION**
A. BEARING: SOIL BEARING VALUE OF 1000 PSF USED FOR DESIGN.
B. FOOTINGS: ALL FOOTINGS SHALL EXTEND 12 INCHES MINIMUM INTO NATIVE SOIL OR APPROVED ENGINEERED FILL.
 - CONCRETE**
ALL CONCRETE SHALL HAVE THE FOLLOWING MINIMUM STRENGTH AT 28 DAYS: FOOTINGS: f'c = 3000 PSI (DESIGN BASED ON f'c = 2000 PSI). CONCRETE SHALL CONFORM TO TITLE 24 SECTION 1905A.2.3 METHOD A OR B. ALL CEMENT SHALL BE TYPE 1 OR TYPE 11 PER ASTM C-150. METHOD "A" NON-DESIGNED MIX PER TABLE 19A-A-8.
MINIMUM 7.1 SACKS PER YARD. WATER CONTENT SHALL NOT EXCEED 6 GALLONS PER SACK. AGGREGATE SHALL BE 3/4" TO 1" MAXIMUM SIZE BUT NOT MORE THAN 3/4" OF MINIMUM CLEAR BAR SPACING.
METHOD "B" PER SECTION 1905A.3.1.
CONCRETE SUPPLIER SHALL PROVIDE CONCRETE MIX DESIGN AND A BREAK HISTORY OF 30 CONSECUTIVE BREAKS IDENTIFIED TO THAT MIX DESIGN. ALTERNATE - PROVIDE 15 CONSECUTIVE BREAKS IDENTIFIED TO THAT MIX DESIGN WITH A STANDARD DEVIATION CALCULATIONS.
 - ANCHOR BOLTS, DOWELS, REINFORCING STEEL AND EMBEDDED ITEMS ARE TO BE SECURELY TIED IN PLACE BEFORE CONCRETE IS POURED.
 - REINFORCING STEEL GRADE 40.**
ALL REINFORCING STEEL SHALL BE BILLET STEEL PER ASTM A-615 WELDED REINFORCING STEEL SHALL CONFORM TO ASTM A-706, AND WELDED PER AWS D1.4-98
 - FOR FOOTINGS USING TRENCH FOR FORMING WIDTH SHALL BE INCREASED 2" EA. SIDE
 - THE ABOVE FOUNDATION PLAN HAS 1/4" ADDED AT EACH MOD LINE AND 1/8" AT EACH SIDE WALL AND DOES NOT MATCH THE FLOOR PLAN. THIS IS REQUIRED FOR GROWTH THAT IS EXPERIENCED WHEN SETTING MULTIPLE MODULE BUILDINGS.
 - MAX VENT LENGTH AT SIDE WALLS IS 8'-0"
MAX VENT LENGTH AT END WALLS IS 4'-0"
MIN DISTANCE FROM VENT TO EDGE OF MODULE IS 2'-0"
MIN DISTANCE BETWEEN VENTS IS 2'-0"
 - FOR WELDED ANCHORAGE DELETE CANNOTS. PROVIDE 1-ANCHOR PLATE AT EACH CORNER OF BUILDING AND 2-ANCHOR PLATES AT EACH MODLINE.
24X40 = 8 72X40 = 24
36X40 = 12 84X40 = 28
48X40 = 16 96X40 = 32
60X40 = 20 108X40 = 36

REV
IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
04 105455
AC - FLS - SS
DATE MAY 20 2004

DATE SIGNED
APR 30 2003

PC
CBC 2001

FOUNDATION PLAN

BELOW GRADE CONCRETE
SCALE: 1/4" = 1'-0"

REVISIONS	MCA	ADDED PAD SPACING TABLE	DATE
1			11/06/03
2			
3			
4			
5			

Electrical Engineer's Seal
Mechanical Engineer's Seal
PC Professional of Record Seal
Architects Seal

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
PC-04
104801
AC - FLS - NV
DATE 5/11/03
Registered 11/12/03 PRC-63

MODTECH™
2830 BARRETT AVENUE PH (909) 943-4014
PERRIS, CALIF. 92571 FAX (909) 940-0427

PROJECT NUMBER: © MODTECH, INC. 2002

DRAWN BY:
DATE:
CHECKED BY:
DATE:

FOUNDATION PLAN BGC - 50, 50+20 PSF

MODTECH Index No.
F3.01

FILE PATH: 2440-F3.01.DWG PROJECT NO. PC-04-104801

FILE PATH: 2440-F3.02.DWG

FOOTING SCHEDULE

DESIGN FLOOR LIVE LOAD	50 PSF	50+20 PSF	100 PSF	125 PSF
SIDEWALL	SEE SHEET F3.01	SEE SHEET F3.01	12"/14"	14"/15"
ENDWALL			20"/21"	21"/23"
PAD			4'-0"/4'-4"	4'-4"/4'-8"
PAD AT 4" SEPARATION			3-#5 EW	3-#5 EW
			4'-3"/4'-7"	4'-7"/4'-11"
			3-#5 EW	3-#5 EW

* = VALUE FOR CONCRETE FLOOR

VENTING SCHEDULE (WOOD FLOORS ONLY)

BUILDING	(SF) AREA	(SF) VENTING REQUIRED	SIDE WALL VENTING	SIDE WALL VENT AREA	END WALL VENTING	END WALL VENT AREA	TOTAL VENT SUPPLIED
24'x40'	960	6.4	(5) A	7.8	-	-	7.8
36'x40'	1440	9.6	(4) B	9.6	-	-	9.6
48'x40'	1920	12.8	(6) B	14.4	-	-	14.4
60'x40'	2400	16	(4) C (2) B	12.92 4.8	-	-	17.7
72'x40'	2880	19.2	(6) C	19.38	-	-	19.4
84'x40'	3360	22.4	(6) C	19.38	(2) A (1) D	3.65	23.03
96'x40'	3840	25.6	(6) C	19.38	(4) A (1) D	6.6	25.9
108'x40'	4320	28.8	(6) C	19.38	(6) A (1) D	9.5	28.9
120'x40'	4800	32	(6) C	19.38	(9) A	31.1	32.52
132'x40'	5280	35.2	(6) C	19.38	(11) A	16.1	35.5
144'x40'	5760	38.4	(6) C	19.38	(13) A (1) D	24.49	39.09

LEGEND	VENT	SIZE	AREA (SF)	GRATE SIZE
	A	3'-9"x5"	1.56	4'x8"
B	5'-9"x5"	2.40	6'x8"	
C	7'-9"x5"	3.23	8'x8"	
D	1'-9"x5"	0.73	2'x8"	
ACCESS (OPTIONAL)	E	2'-9"x18"	4.13	3'x2'


NOTE: DELETE ALL UNDER FLOOR VENTS THE CONCRETE FLOOR OPTION.

KEY NOTES

- 1 END WALL FOOTING - SEE FOOTING SCHEDULE
- 2 SIDE WALL FOOTING - SEE FOOTING SCHEDULE
- 3 INTERIOR RETURN FOOTING - SEE FOOTING SCHEDULE
- 4 MODLINE RETURN AT 4" SEPARATION - OPTIONAL
- 5 STEM WALL - 8" TYPICAL UON
- 6 MODLINE PAD
- 7 MODLINE PAD AT 4" SEPARATION - OPTIONAL
- 8 12" DIA OR SQUARE PEDESTAL (TYPICAL AT MODLINE)
- 9 24" DIA OR SQUARE PEDESTAL (TYPICAL AT 4" SEPARATION)
- 10 TYPICAL VENT
- 11 ADDITIONAL END WALL VENTS AS REQUIRED (20" MAXIMUM LENGTH) OR INCREASE VENT HEIGHT AS REQUIRED AT SIDEWALLS
- 12 MODLINE
- 13 4" BUILDING SEPARATION AT ADJACENT BUILDING - OPTIONAL
- 14 NOT USED
- 15 ANCHOR BOLT LOCATION - (1) AT EACH CORNER OF BUILDING. (2) AT EACH MODLINE LOCATION.
- 16 ANCHOR BOLT AT SIDEWALL - 13'-4" OC FOR BUILDING SIZE 60'x40' OR LARGER

NOTES

1. SOIL TYPE AND FOUNDATION
 - A. BEARING: SOIL BEARING VALUE OF 1000 PSF USED FOR DESIGN.
 - B. FOOTINGS: ALL FOOTINGS SHALL EXTEND 12 INCHES MINIMUM INTO NATIVE SOIL OR APPROVED ENGINEERED FILL.
2. CONCRETE
 - ALL CONCRETE SHALL HAVE THE FOLLOWING MINIMUM STRENGTH AT 28 DAYS: FOOTINGS: $f'_c = 3000$ PSI (DESIGN BASED ON $f'_c = 2000$ PSI), CONCRETE SHALL CONFORM TO TITLE 24 SECTION 1905A.2.3 METHOD A OR B. ALL CEMENT SHALL BE TYPE 1 OR TYPE 11 PER ASTM C-150. METHOD "A" NON-DESIGNED MIX PER TABLE 19A-A-B. MINIMUM 7.1 SACKS PER YARD. WATER CONTENT SHALL NOT EXCEED 6 GALLONS PER SACK. AGGREGATE SHALL BE 3/4" TO 1" MAXIMUM SIZE BUT NOT MORE THAN 3/4" OF MINIMUM CLEAR BAR SPACING.
 - METHOD "B" PER SECTION 1905A.3.1.
 - CONCRETE SUPPLIER SHALL PROVIDE CONCRETE MIX DESIGN AND A BREAK HISTORY OF 30 CONSECUTIVE BREAKS IDENTIFIED TO THAT MIX DESIGN. ALTERNATE - PROVIDE 15 CONSECUTIVE BREAKS IDENTIFIED TO THAT MIX DESIGN WITH A STANDARD DEVIATION CALCULATIONS.
 - ANCHOR BOLTS, DOWELS, REINFORCING STEEL AND EMBEDDED ITEMS ARE TO BE SECURELY TIED IN PLACE BEFORE CONCRETE IS POURED.
3. REINFORCING STEEL GRADE 40.
 - ALL REINFORCING STEEL SHALL BE BILLET STEEL PER ASTM A-615 WELDED REINFORCING STEEL SHALL CONFORM TO ASTM A-706, AND WELDED PER AWS D1.4-98
4. FOR FOOTINGS USING TRENCH FOR FORMING WIDTH SHALL BE INCREASED 2" EA. SIDE
5. THE ABOVE FOUNDATION PLAN HAS 1/4" ADDED AT EACH MOD LINE AND 1/8" AT EACH SIDE WALL AND DOES NOT MATCH THE FLOOR PLAN. THIS IS REQUIRED FOR GROWTH THAT IS EXPERIENCED WHEN SETTING MULTIPLE MODULE BUILDINGS.
6. MAX VENT LENGTH AT SIDE WALLS IS 8'-0" MAX VENT LENGTH AT END WALLS IS 4'-0" MIN DISTANCE FROM VENT TO EDGE OF MODULE IS 2'-0" MIN DISTANCE BETWEEN VENTS IS 2'-0"

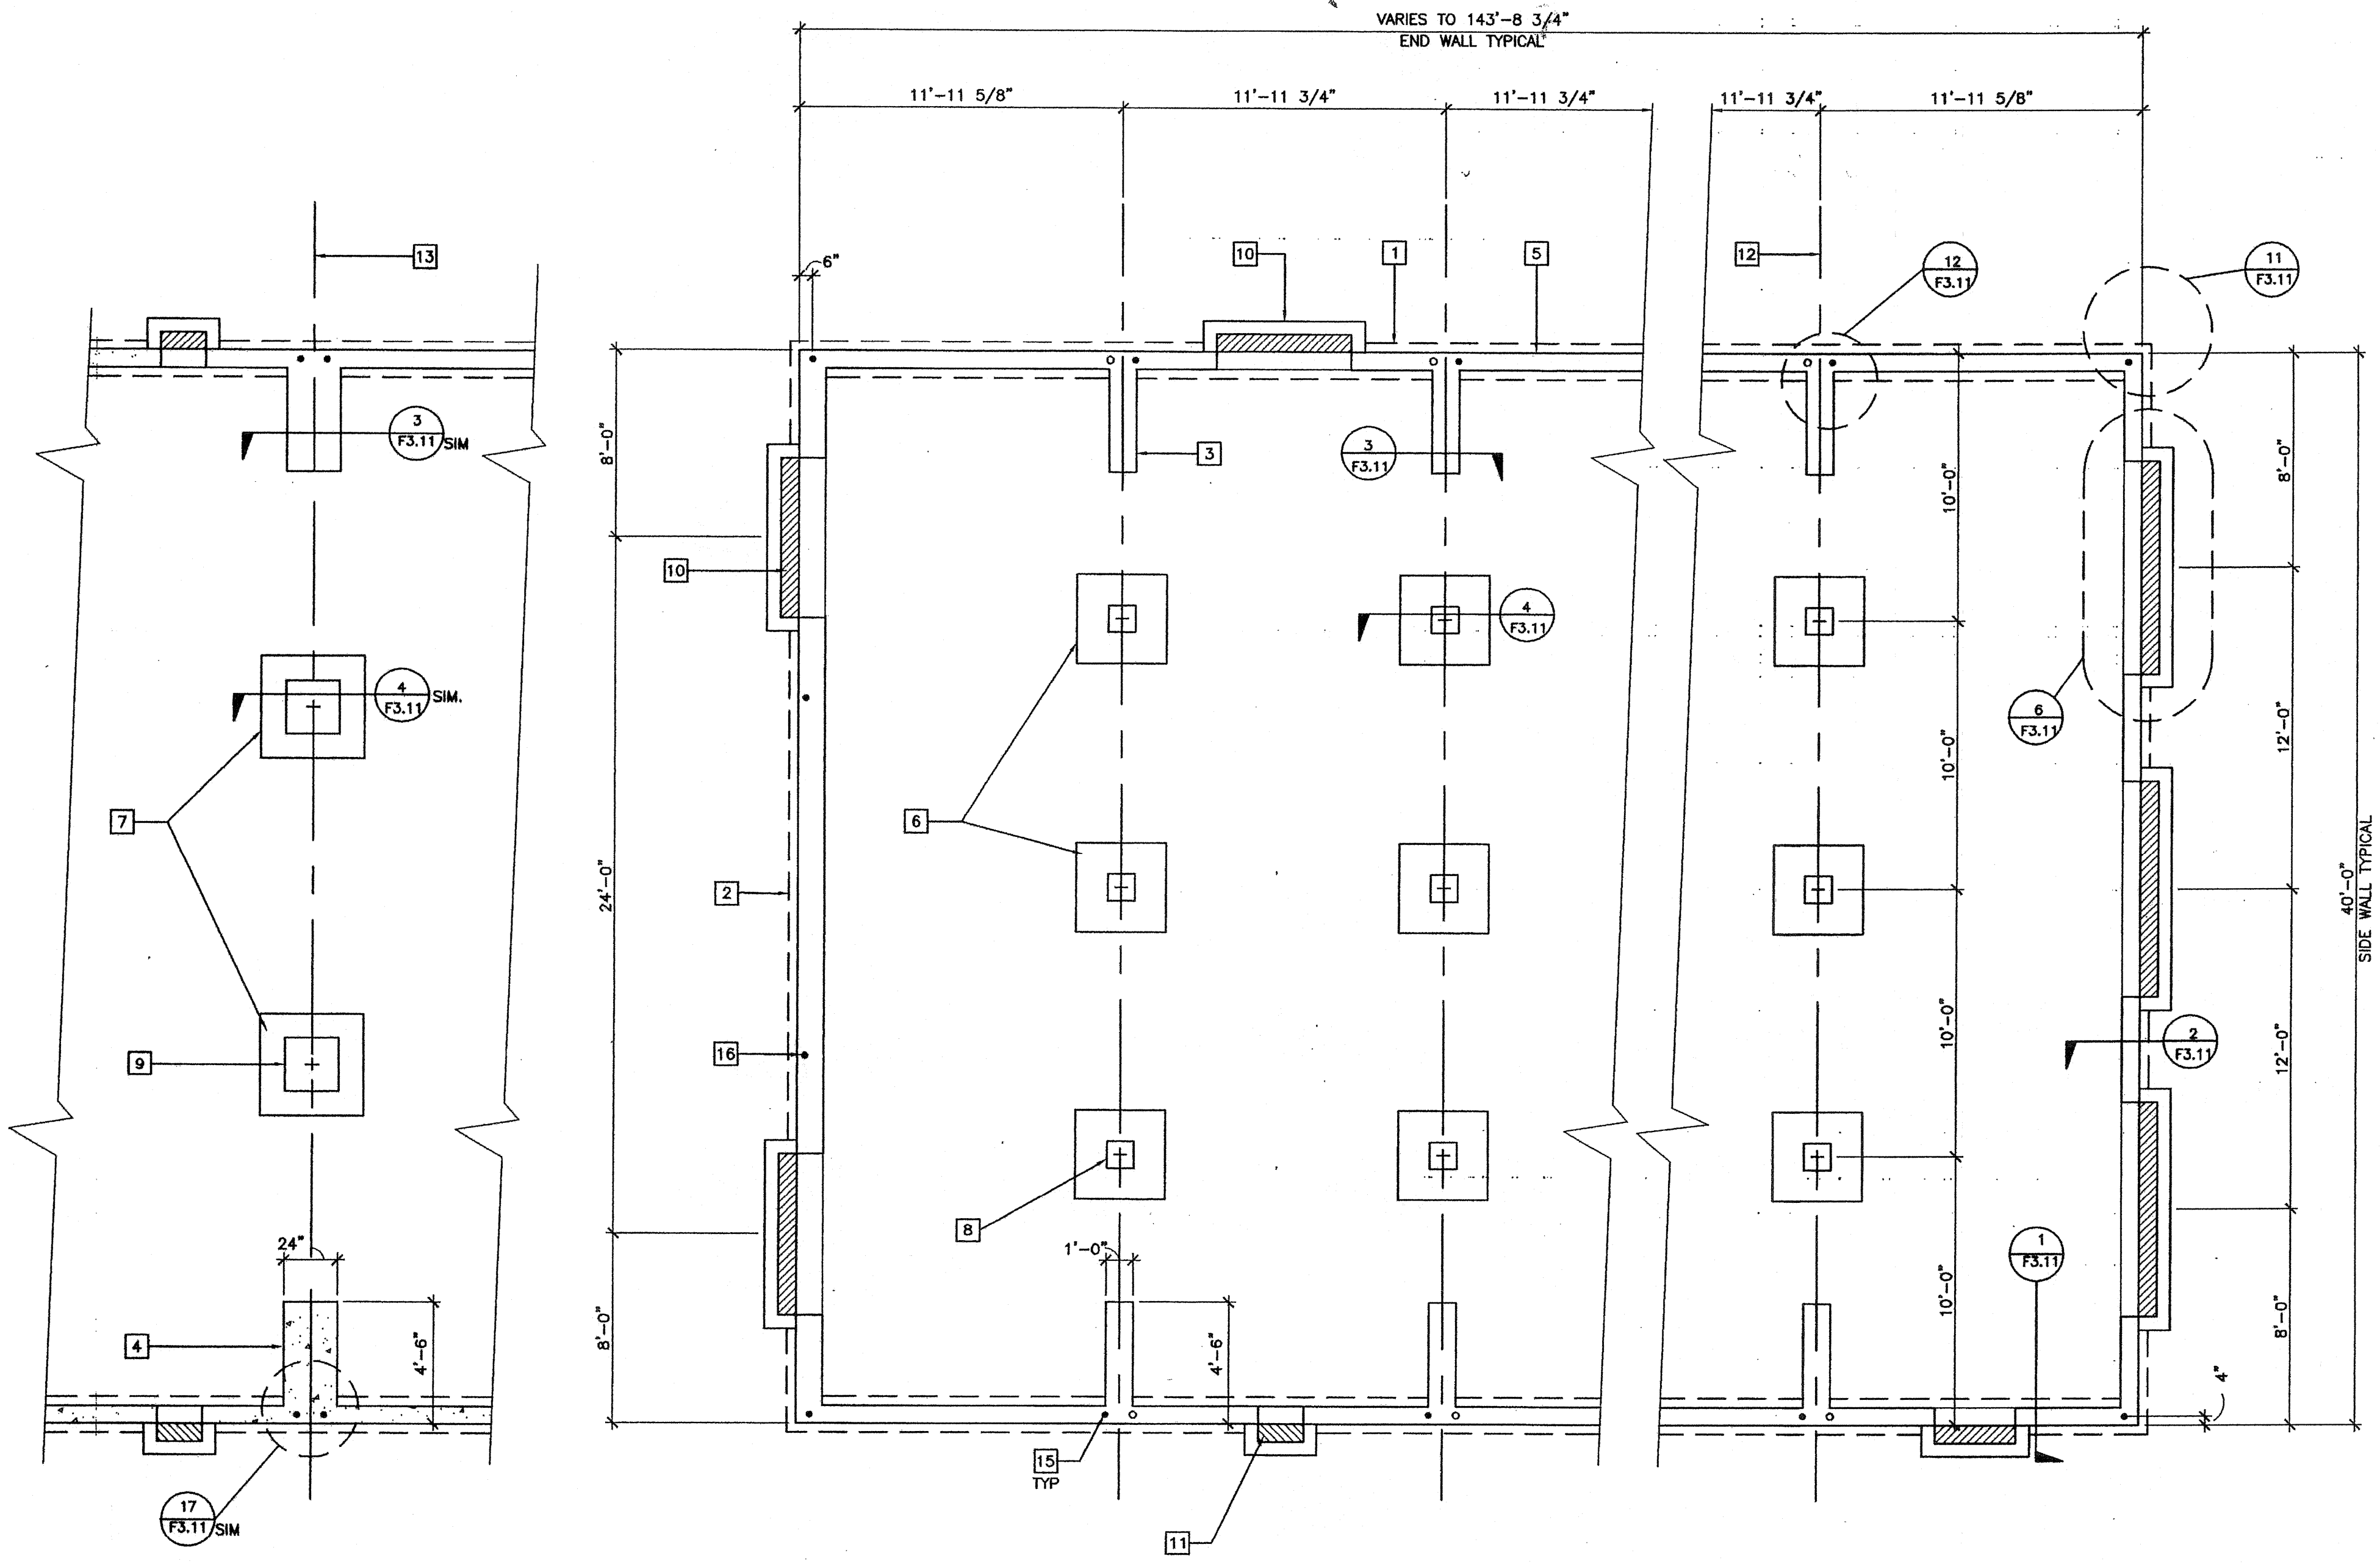

FOOTINGS AT ADJACENT BUILDING (OPTIONAL 4" SEPARATION)

DATE SIGNED
APR 28 2003

PC
CBC 2001

FOUNDATION PLAN

BELOW GRADE CONCRETE
SCALE: 1/4" = 1'-0"

REV
IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
04 105455
AC - PLS - SS NB
DATE MAY 20 2004

REVISIONS	Electrical Engineer's Seal	Mechanical Engineer's Seal	PC Professional of Record Seal	Architects Seal

Electrical Engineer's Seal
Mechanical Engineer's Seal
PC Professional of Record Seal
Architects Seal

REGISTERED PROFESSIONAL ARCHITECT
STATE OF CALIFORNIA
LICENSE EXPIRES 6-30-2004

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
PC-04
104801
AC - PLS - SS NB
DATE 5/17/03

MODTECH™
2830 BARRETT AVENUE PH (909) 943-4014
PERRIS, CALIF. 92571 FAX (909) 940-0427

PROJECT NUMBER: © MODTECH, INC. 2002
FOUNDATION PLAN BGC - 100, 125 PSF

DRAWN BY:
DATE:
CHECKED BY:
DATE:
MODTECH Index No.
F3.02

PROJECT NO. PC-04-104801

FILE PATH: 2440-F3.03.DWG

PROJECT NO. PC-04-104801

DESIGN FLOOR LIVE LOAD	50 PSF		50+20 PSF		100 PSF		125 PSF	
	STD. FLR	CONC FLR	STD. FLR	CONC FLR	STD. FLR	CONC FLR	STD. FLR	CONC FLR
SIDEWALL	12"	12"	12"	12"	14"	16"	16"	18"
ENDWALL	19"	19"	21"	21"	21"	23"	23"	25"
PAD	3'-4"	3'-5"	4'-0"	3'-10"	4'-0"	4'-4"	4'-4"	4'-9"
PAD AT 4" SEPARATION	4'-7"	4'-5"	4'-11"	4'-11"	4'-9"	5'-0"	5'-2"	5'-5"
NO. OF PADS AND SPACING	2	3	2	3	3	3	3	3
	13'-4"	10'-0"	13'-4"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"

* = VALUE FOR CONCRETE FLOOR

BUILDING	(SF) AREA	(SF) VENTING REQUIRED	SIDE WALL VENTING	SIDE WALL VENT AREA	END WALL VENTING	END WALL VENT AREA	TOTAL VENT SUPPLIED
24'x40'	960	6.4	(5) A	7.8	-	-	7.8
36'x40'	1440	9.6	(4) B	9.6	-	-	9.6
48'x40'	1920	12.8	(6) B	14.4	-	-	14.4
60'x40'	2400	16	(4) C (2) B	12.92 4.8	-	-	17.7
72'x40'	2880	19.2	(6) C	19.38	-	-	19.4
84'x40'	3360	22.4	(6) C	19.38	(2) A (1) D	3.65	23.03
96'x40'	3840	25.6	(6) C	19.38	(4) A (1) D	6.6	25.9
108'x40'	4320	28.8	(6) C	19.38	(6) A (1) D	9.5	28.9
120'x40'	4800	32	(6) C	19.38	(9) A	31.1	32.52
132'x40'	5280	35.2	(6) C	19.38	(11) A	16.1	35.5
144'x40'	5760	38.4	(6) C	19.38	(13) A (1) D	24.49	39.09

LEGEND

A	3'-9"x5"	1.56	4'x8"
B	5'-9"x5"	2.40	6'x8"
C	7'-9"x5"	3.23	8'x8"
D	1'-9"x5"	0.73	2'x8"
E	2'-9"x18"	4.13	3'x2'


ACCESS (OPTIONAL)

- ### KEY NOTES
- END WALL FOOTING - SEE FOOTING SCHEDULE
 - SIDE WALL FOOTING - SEE FOOTING SCHEDULE
 - INTERIOR RETURN FOOTING - SEE FOOTING SCHEDULE
 - MODLINE RETURN AT 4" SEPARATION - OPTIONAL
 - STEM WALL - 8" TYPICAL UON
 - MODLINE PAD
 - MODLINE PAD AT 4" SEPARATION - OPTIONAL
 - 12" DIA OR SQUARE PEDESTAL (TYPICAL AT MODLINE)
 - 24" DIA OR SQUARE PEDESTAL (TYPICAL AT MODLINE)
 - TYPICAL VENT
 - ADDITIONAL END WALL VENTS AS REQUIRED (48" MAXIMUM LENGTH) OR INCREASE VENT HEIGHT AS REQUIRED AT SIDEWALLS
 - MODLINE
 - 4" BUILDING SEPARATION AT ADJACENT BUILDING - OPTIONAL
 - NOT USED
 - ANCHOR BOLT LOCATION - (1) AT EACH CORNER OF BUILDING, (2) AT EACH MODLINE LOCATION.
 - NOT USED

- ### NOTES
- SOIL TYPE AND FOUNDATION**
A. BEARING: SOIL BEARING VALUE OF 1000 PSF USED FOR DESIGN.
B. FOOTINGS: ALL FOOTINGS SHALL EXTEND 12 INCHES MINIMUM INTO NATIVE SOIL OR APPROVED ENGINEERED FILL.
 - REINFORCING STEEL GRADE 40.**
ALL REINFORCING STEEL SHALL BE BILLET STEEL PER ASTM A-615 WELDED REINFORCING STEEL SHALL CONFORM TO ASTM A-706, AND WELDED PER AWS D1.4-98
 - FOR FOOTINGS USING TRENCH FOR FORMING WIDTH SHALL BE INCREASED 2" EA. SIDE
 - THE ABOVE FOUNDATION PLAN HAS 1/4" ADDED AT EACH MOD LINE AND 1/8" AT EACH SIDE WALL AND DOES NOT MATCH THE FLOOR PLAN. THIS IS REQUIRED FOR GROWTH THAT IS EXPERIENCED WHEN SETTING MULTIPLE MODULE BUILDINGS.
 - MAX VENT LENGTH AT SIDE WALLS IS 8'-0"
MIN VENT LENGTH AT END WALLS IS 4'-0"
MIN DISTANCE FROM VENT TO EDGE OF MODULE IS 2'-0"
MIN DISTANCE BETWEEN VENTS IS 2'-0"

NOTE: DELETE ALL UNDER FLOOR VENTS WHEN SINGLE STORY BUILDING OR BOTTOM FLOOR OF TWO STORY BUILDING UTILIZES THE CONCRETE FLOOR OPITON.

REV 1
IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
04 105455
AC - FLS - SS
DATE MAY 2 0 2004

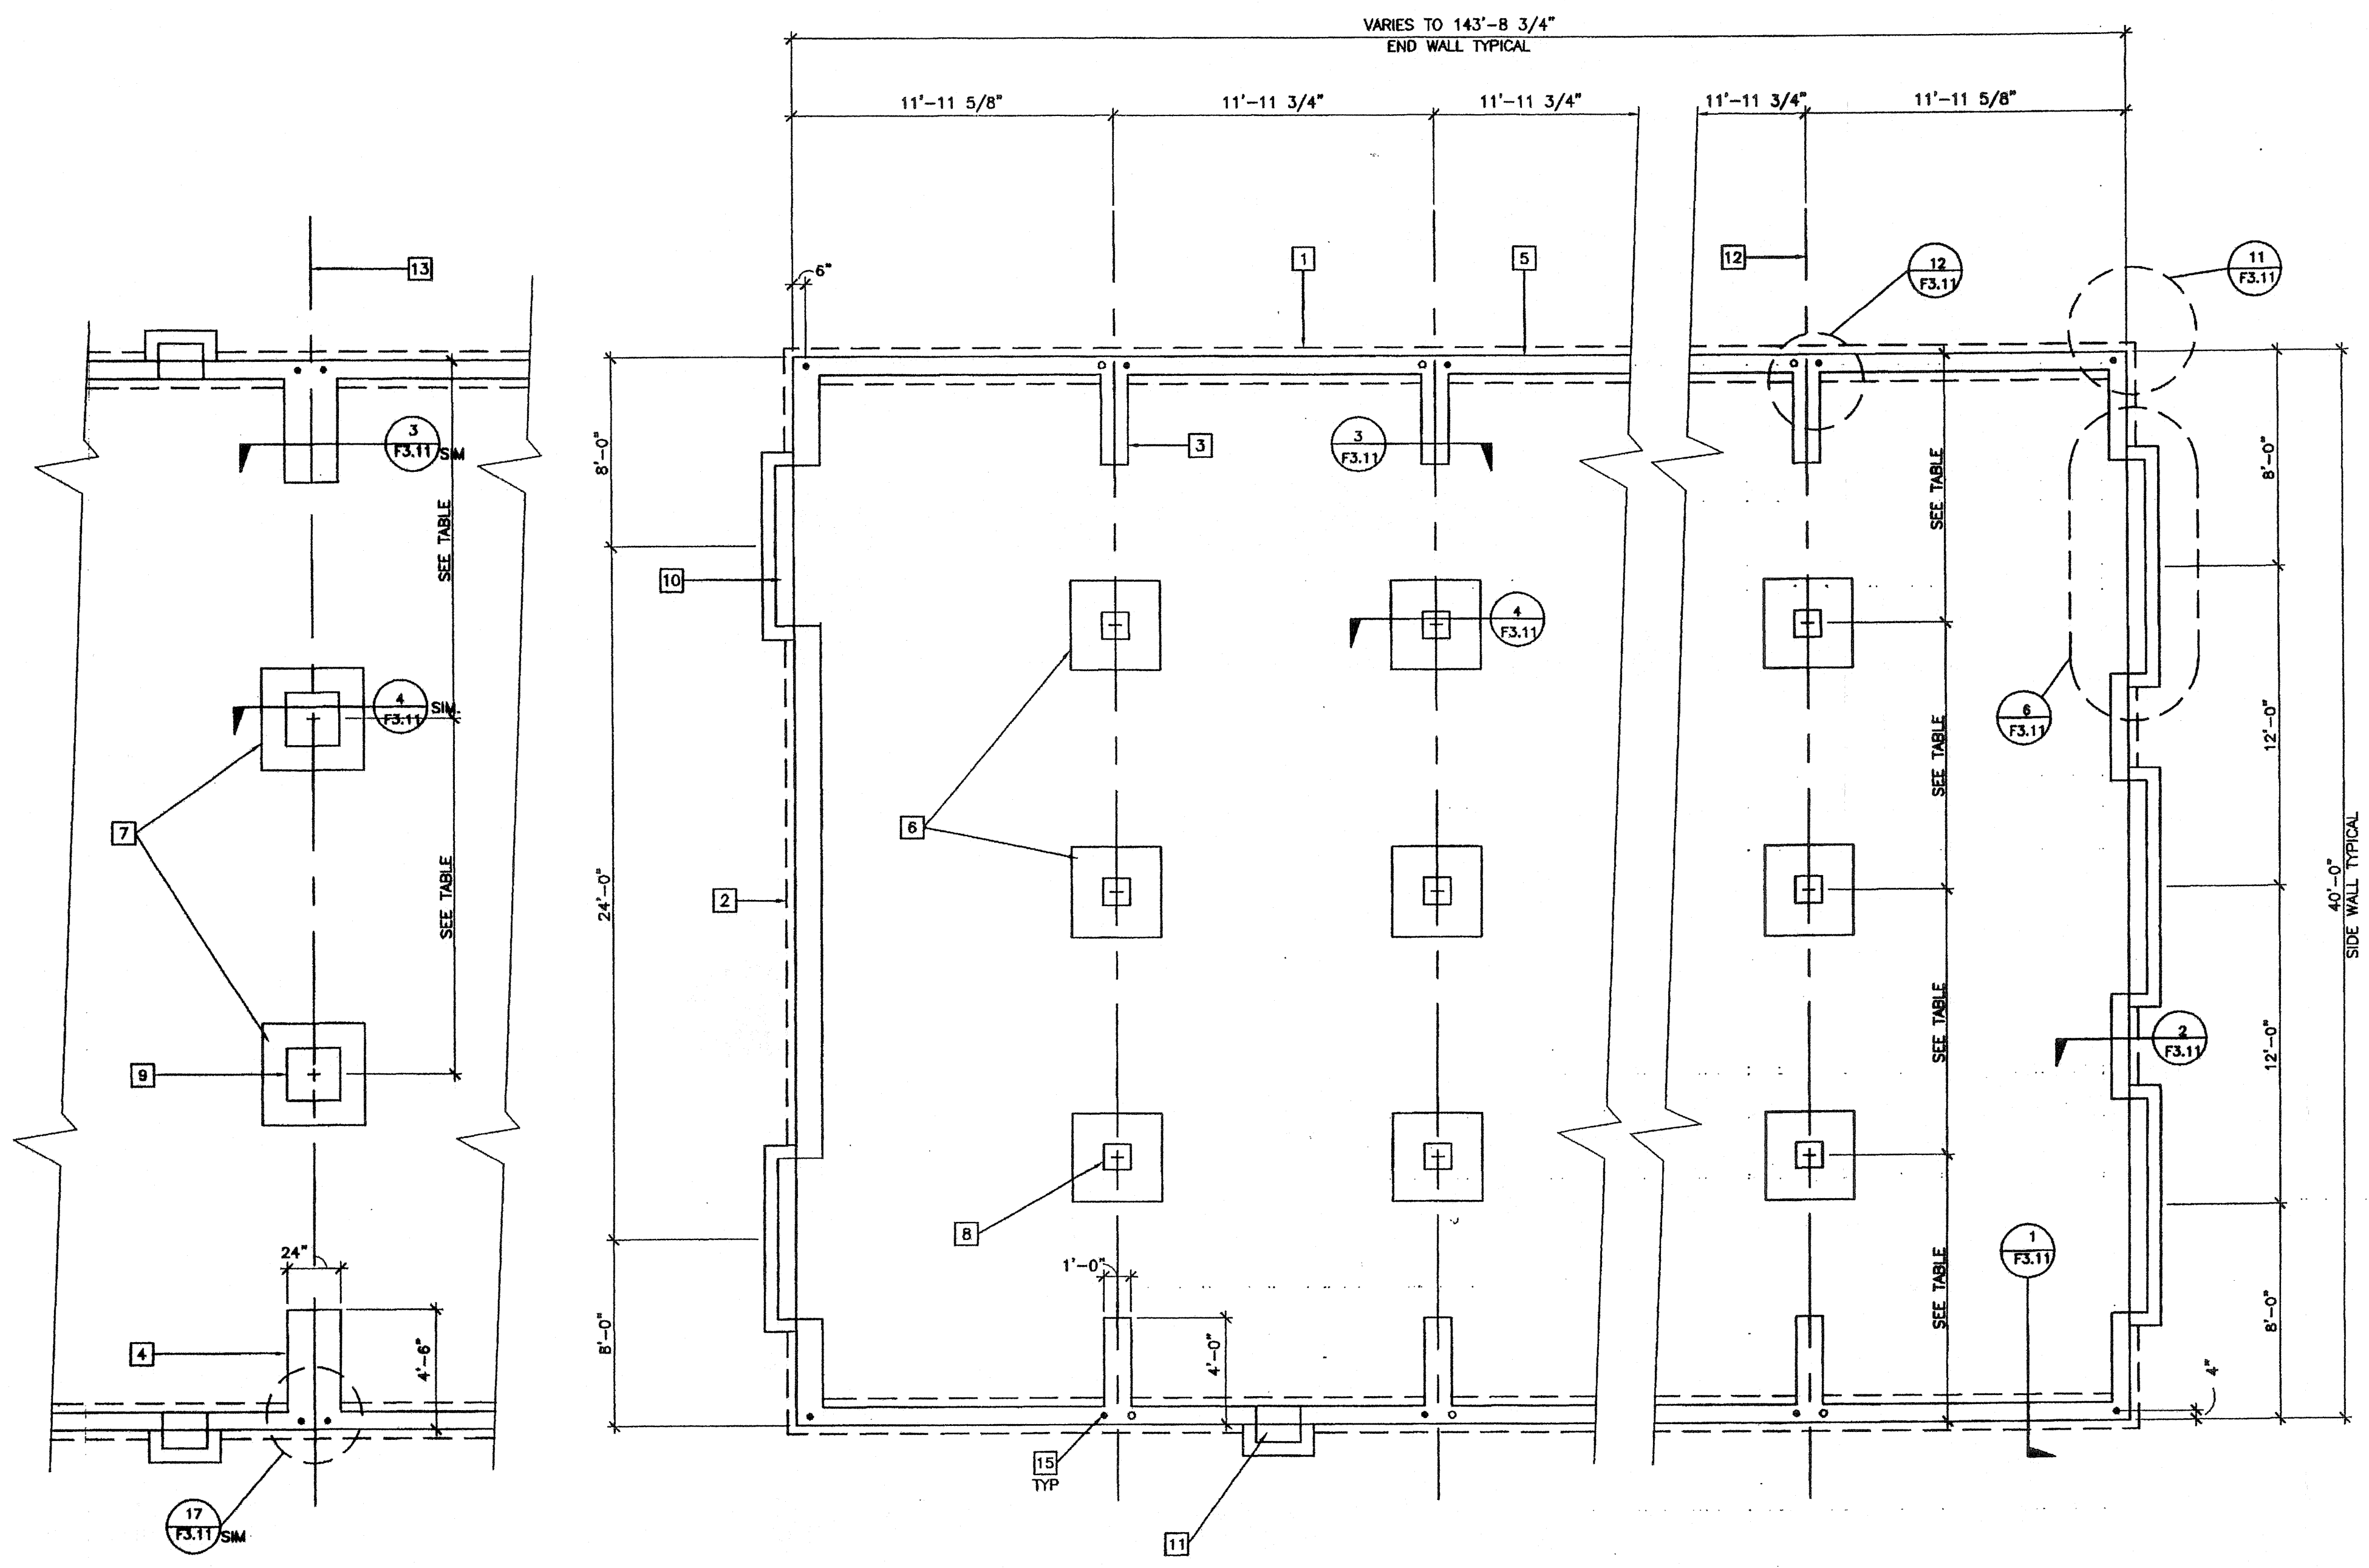

FOOTINGS AT ADJACENT BUILDING
(OPTIONAL 4" SEPARATION)

DATE SIGNED
APR 30 2003

PC
CBC 2001

FOUNDATION PLAN

BELOW GRADE CONCRETE
SCALE: 1/4" = 1'-0"

REVISIONS	Electrical	Engineer's Seal	Mechanical Engineer's Seal	PC Professional of Record Seal	Architects Seal

PROFESSIONAL SEAL
STATE OF CALIFORNIA
LICENSE EXPIRES 6-30-2004

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
PC-04
104801
AC - FLS - SS
DATE 5/10/03

MODTECH INC.
2830 BARRETT AVENUE
PERRIS, CALIF. 92571
PH (909) 943-4014
FAX (909) 940-0427

PROJECT NUMBER: © MODTECH, INC. 2002


DRAWN BY:
DATE:
CHECKED BY:
DATE:

FOR 10'-6" COLUMNS
AND 4'-0" PARAPETS


FOUNDATION PLAN

BGC - 100, 125 PSF

MODTECH Index No.
F3.03

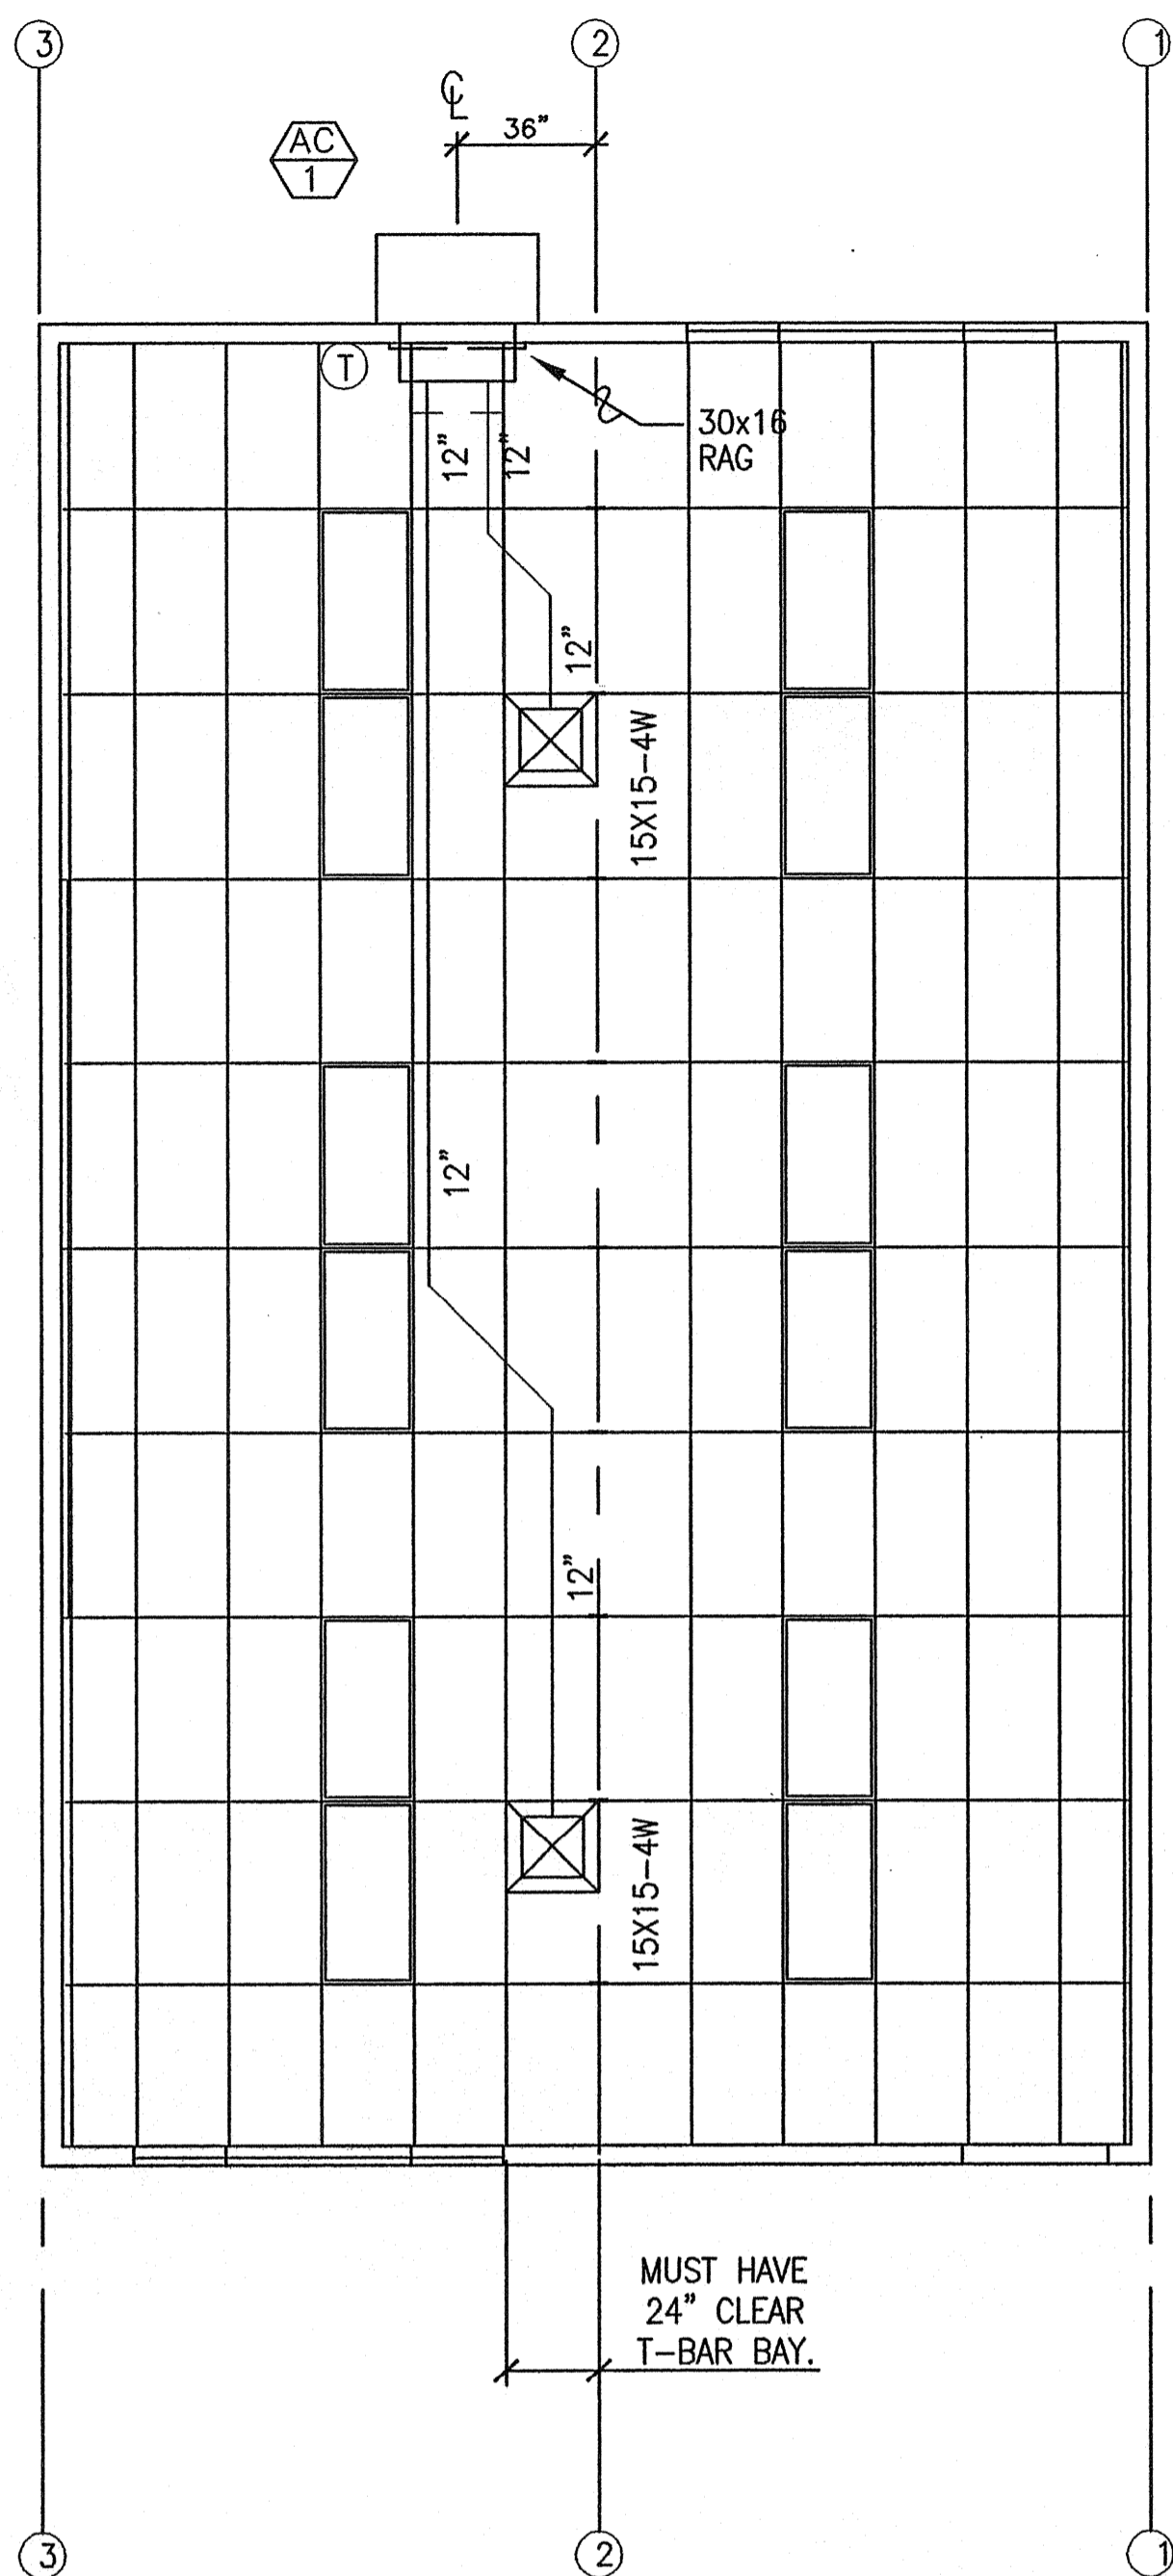

AIR CONDITIONING PLAN VIEW 24'X40' BUILDING
 SCALE: 1/4" = 1'-0" TYP. OF 1 BUILDING.

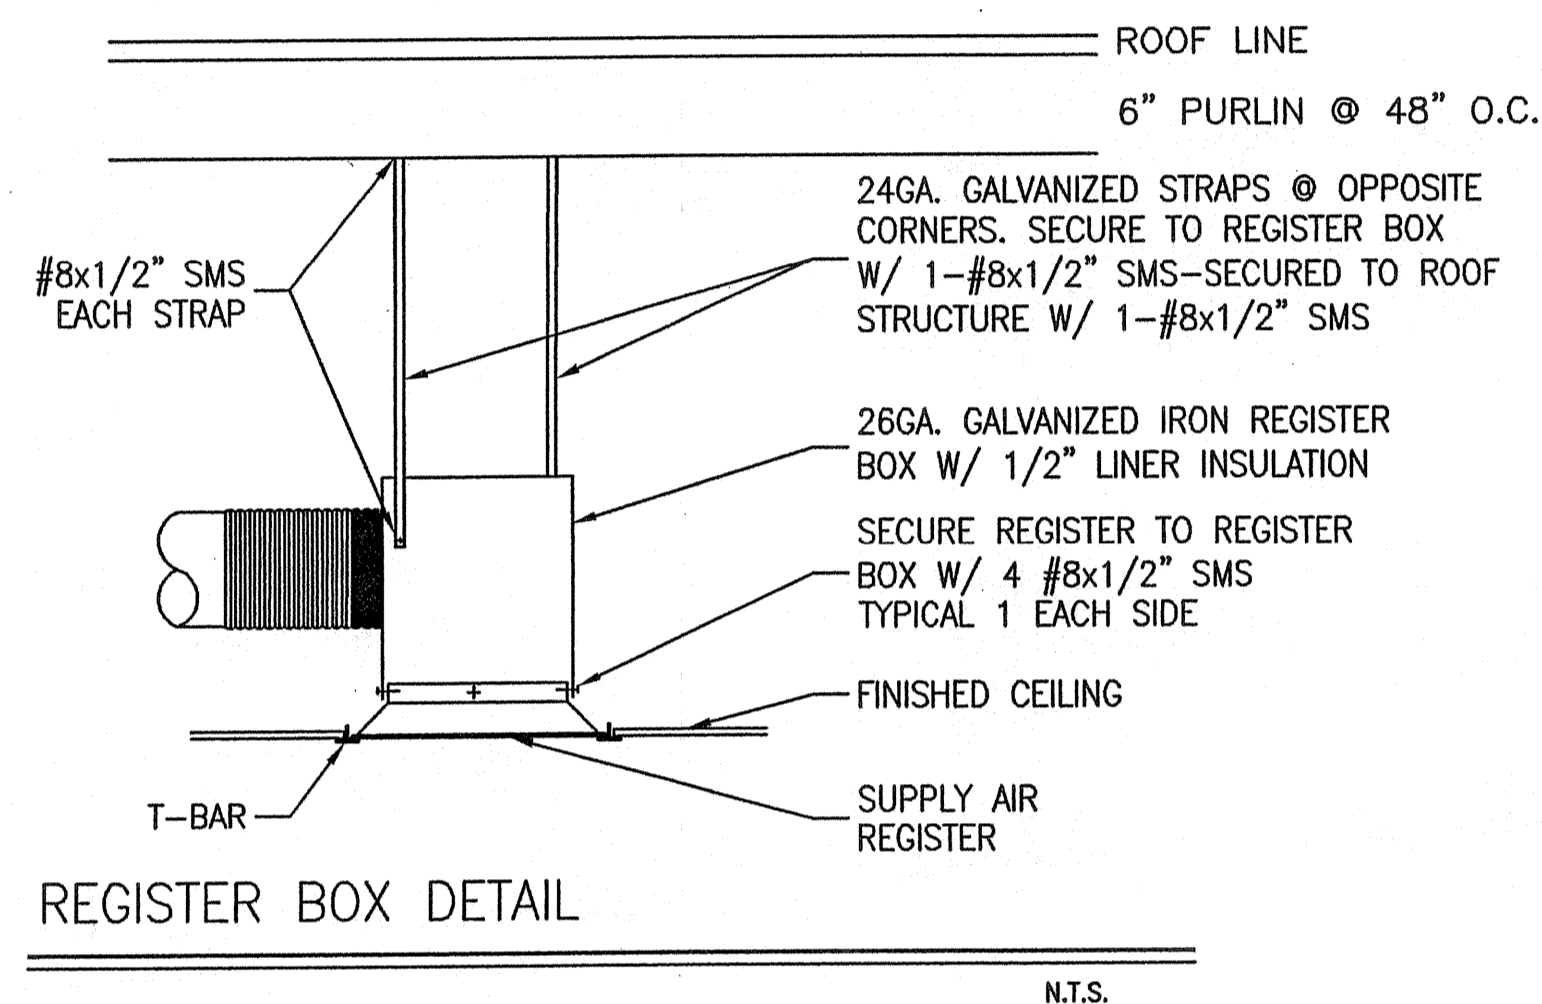

EQUIPMENT & MATERIAL SCHEDULE

AC 1 MARVAIR MODEL# AVP42HPA05NB WALL MOUNTED HEAT PUMP
 42,500 BTUH COOLING, SEER = 10.20
 42,500 BTUH HEATING, HSPF = 6.60
 1,400 CFM NOMINAL @2\"/>

SUPPLY AIR PLENUM: GALV. IRON SHEETS W/ 1/2\"/>

INTERIOR DUCTWORK:FLEX DUCT CLASS 1 UL-181

REGISTER BOXES: GALV. IRON SHEETS W/ 1/2\"/>

SUPPLY AIR REGISTERS: METALAIRE '7650-6' SERIES


RETURN AIR GRILLES: METALAIRE 'RH' SERIES

THERMOSTAT: WHITE RODGERS '1F92' SERIES

ATTACH ALL SUPPLY AND RETURN AIR REGISTERS TO REGISTER BOXES WITH 4-#8x1/2\"/>

LEGEND AND ABBREVIATIONS			
	SUPPLY DUCT		DIRECTIONAL AIR FLOW
	RETURN DUCT		BAROMETRIC RELIEF DAMPER THRU WALL
	NUMBER INDICATES DUCT SIZE		UNDERCUT DOOR
	RETURN REGISTER		BAROMETRIC RELIEF DAMPER THRU ROOF
	RETURN REGISTER		THERMOSTAT (T)
	SUPPLY REGISTER		DAMPER
	EXHAUST FAN		EQUIPMENT CALLOUT: TOP = EQUIPMENT TYPE BOTTOM = IDENTIFICATION
	12"x12" HOLE THRU BEAM	E	ELECTRICAL LOCATION
	16"x12" HOLE THRU BEAM	CD	CONDENSATE DRAIN
	FIRE DAMPER	G	GAS LOCATION

MECHANICAL (HVAC) PLAN (12-LIGHTS)
 SCALE: 1/4" = 1'-0" OPP-HAND

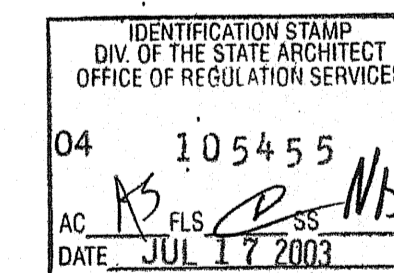

PC
 CBC 2001

REVISIONS	Electrical Engineer's Seal	Mechanical Engineer's Seal	PC Professional of Record Seal	Architect's Seal

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 PC-04
 104796
 AC FLS CS NB
 DATE 8/2/03

MODTECHTM
 2830 BARRETT AVENUE PH (909) 943-4014
 PERRIS, CALIF. 92571 FAX (909) 940-0427

PROJECT NUMBER: 4736
 WILLIAM SCOTTSMAN


© MODTECH, INC. 2002

DRAWN BY: GL
 DATE: 07/07/03
 CHECKED BY:
 DATE:


MECHANICAL (HVAC) PLAN 3 1/2 TON

MODTECH Index No.
M1.0


FILE PATH: -- PROJECT NO. 4736 PC-04-104796

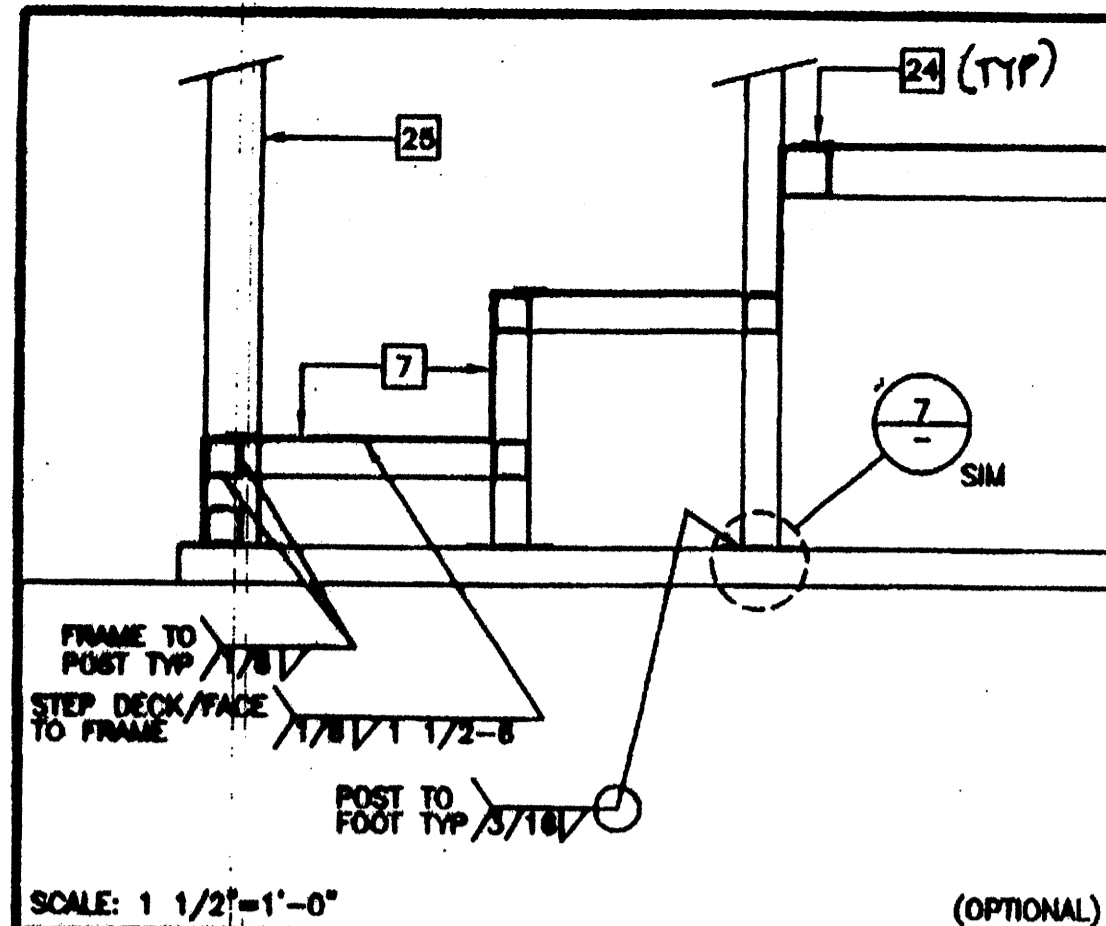


SCALE: 1/2"=1'-0" (OPTIONAL)
STAIR SECTION 16

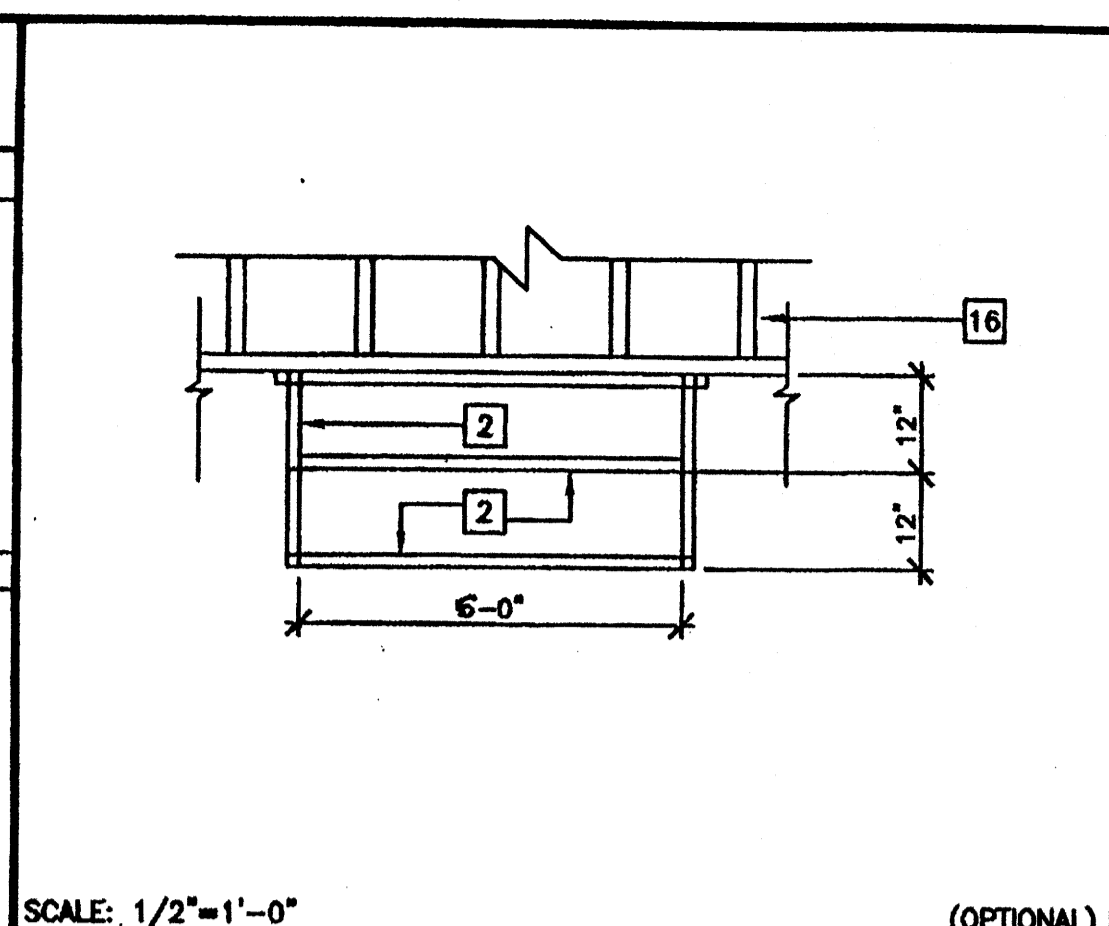


SCALE: 1/2"=1'-0" (OPTIONAL)
STAIR FRAMING PLAN 12

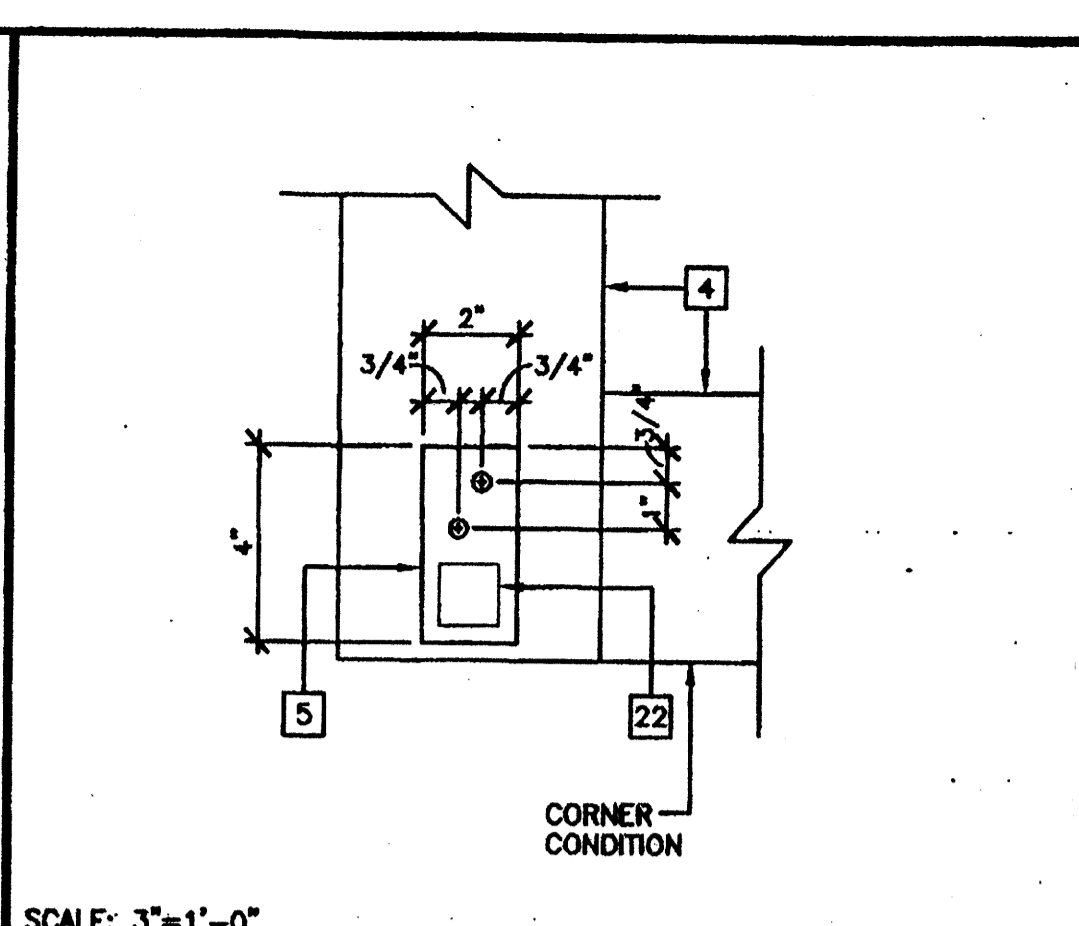


SCALE: 3"=1'-0"
ADJUSTABLE LEG BASE PLATE 8

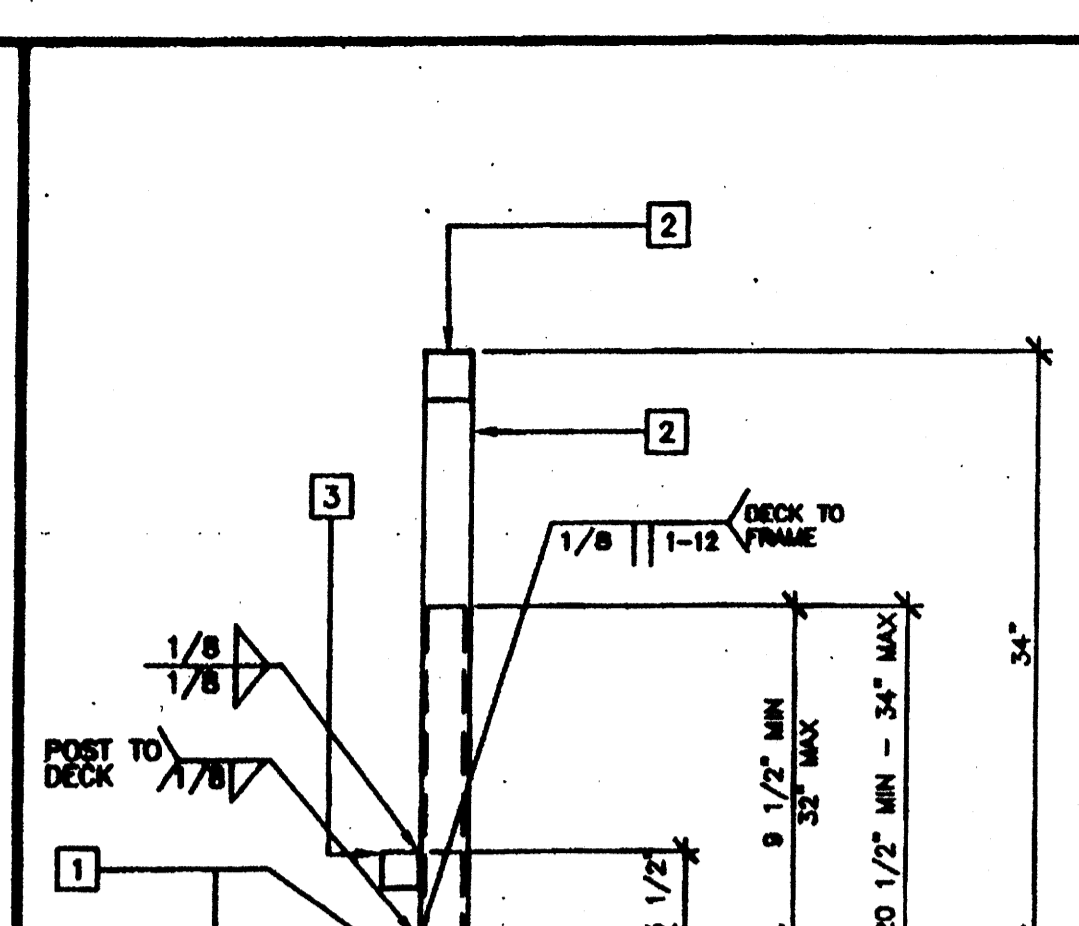


SCALE: 3"=1'-0"
ADJUSTABLE LEG 5

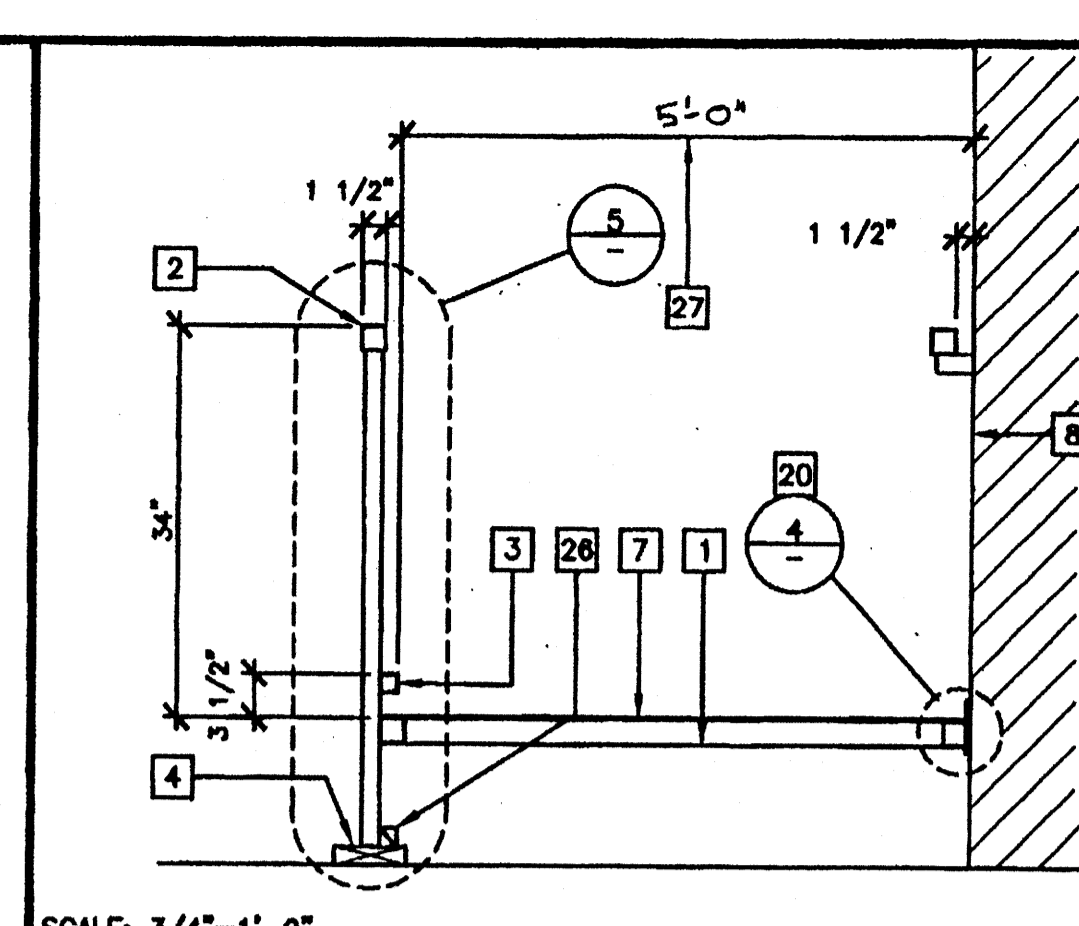


SCALE: 3/4"=1'-0"
SECTION AT RAMP 1

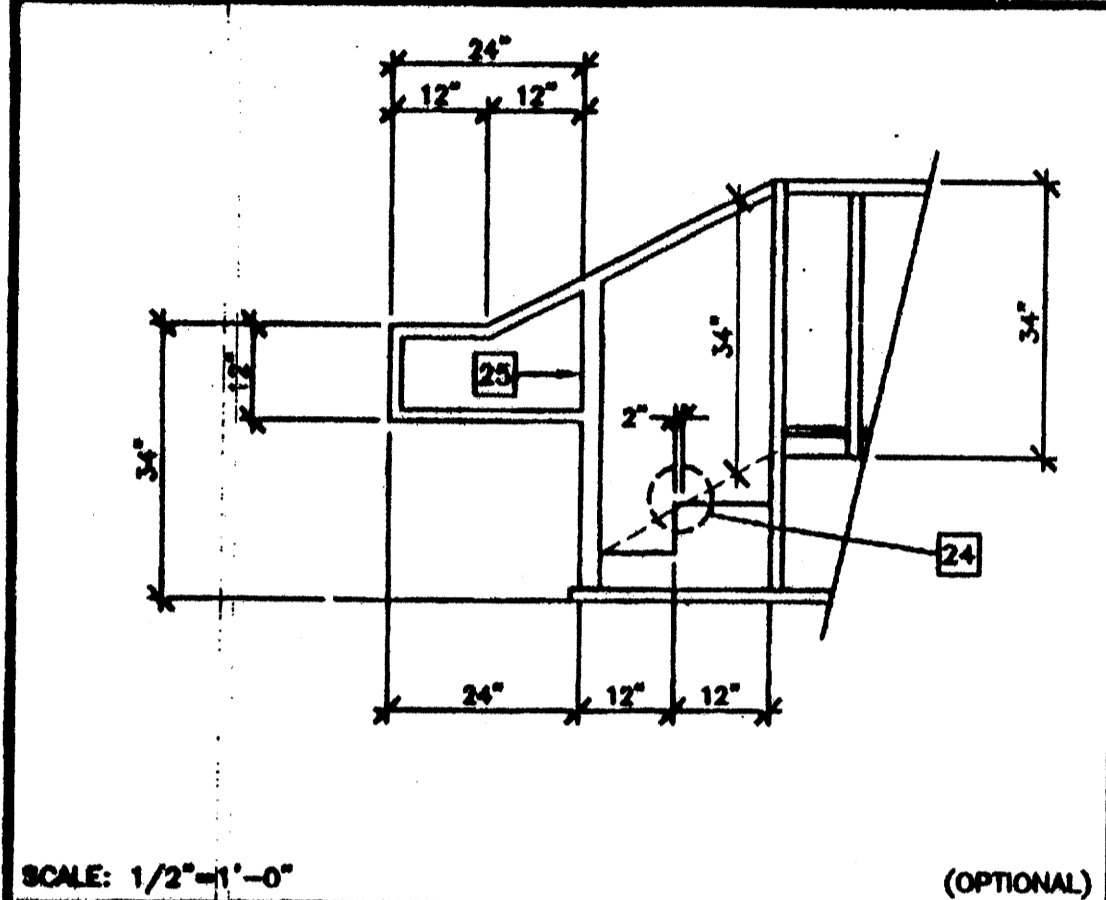


SCALE: 1/2"=1'-0" (OPTIONAL)
STAIR ELEVATION 17

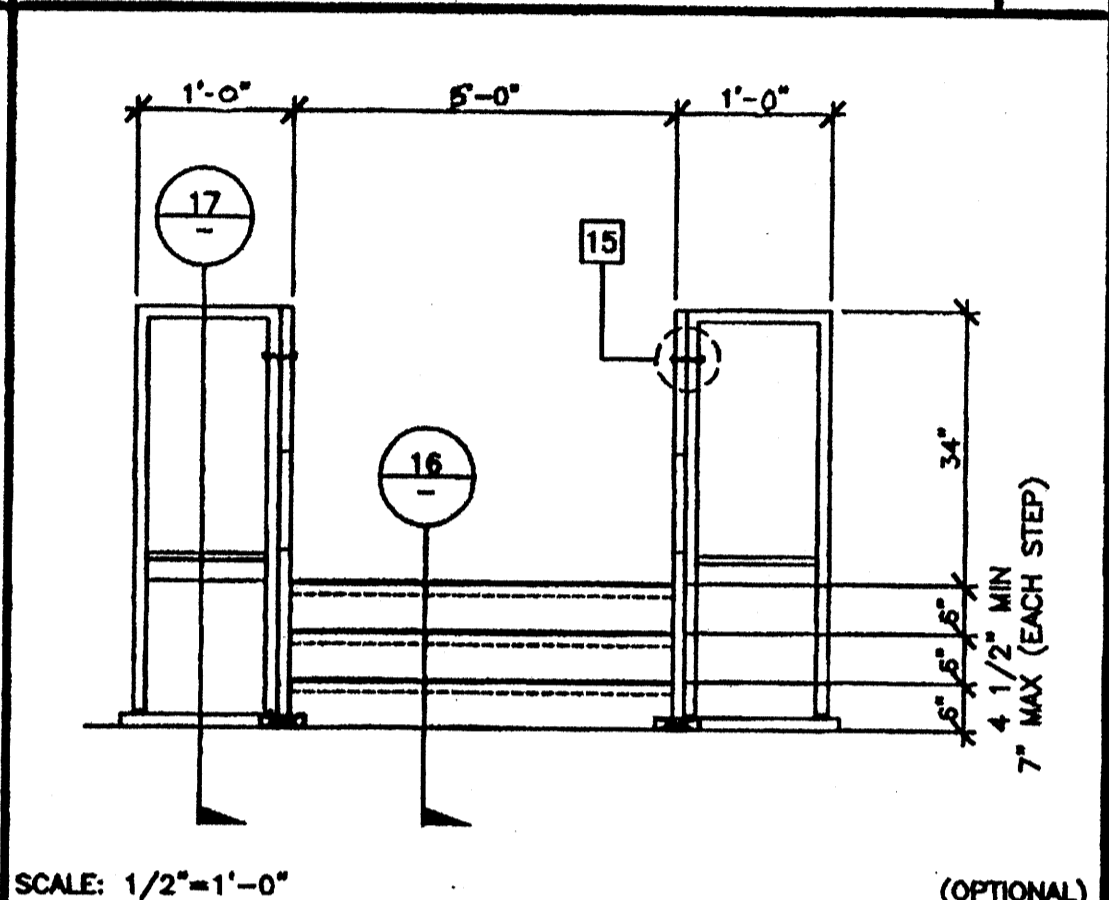


SCALE: 1/2"=1'-0" (OPTIONAL)
STAIR ELEVATION 13

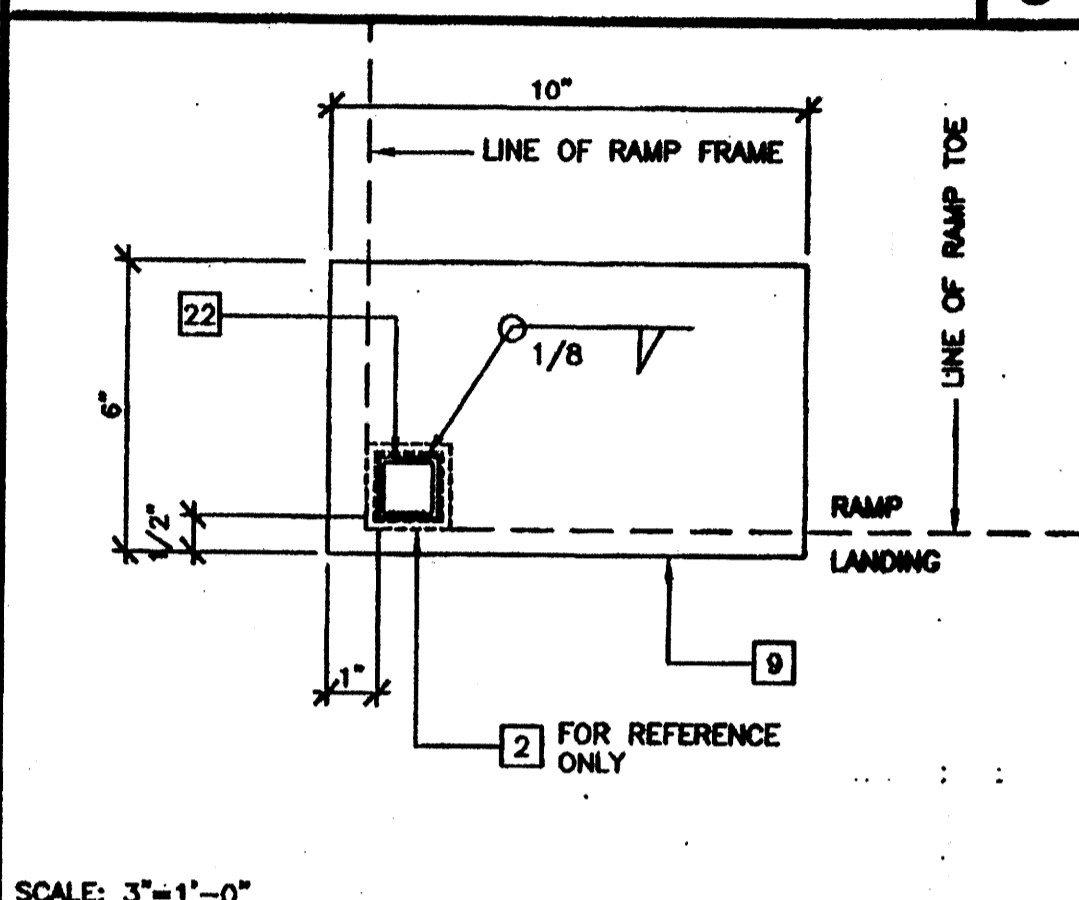


SCALE: 3"=1'-0"
BASE PLATE AT RAMP TOE 9

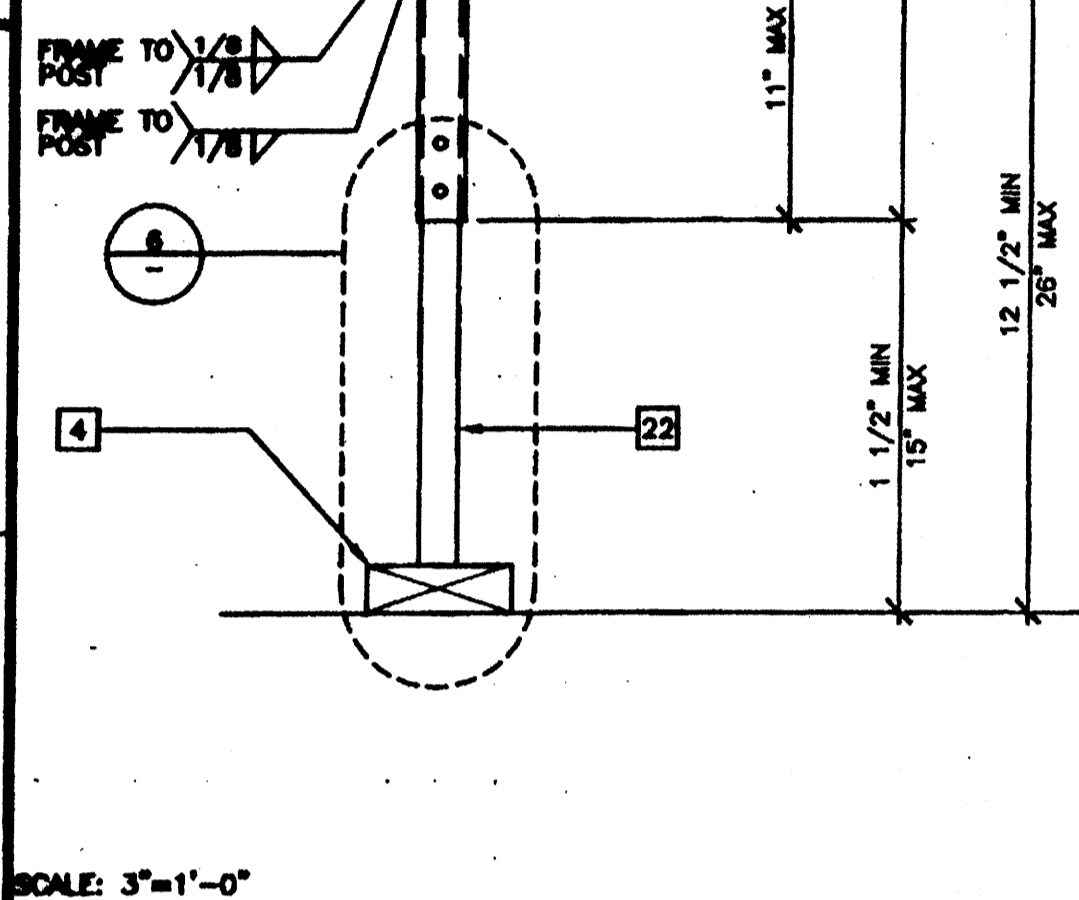


SCALE: 3"=1'-0"
ADJUSTABLE LEG 6

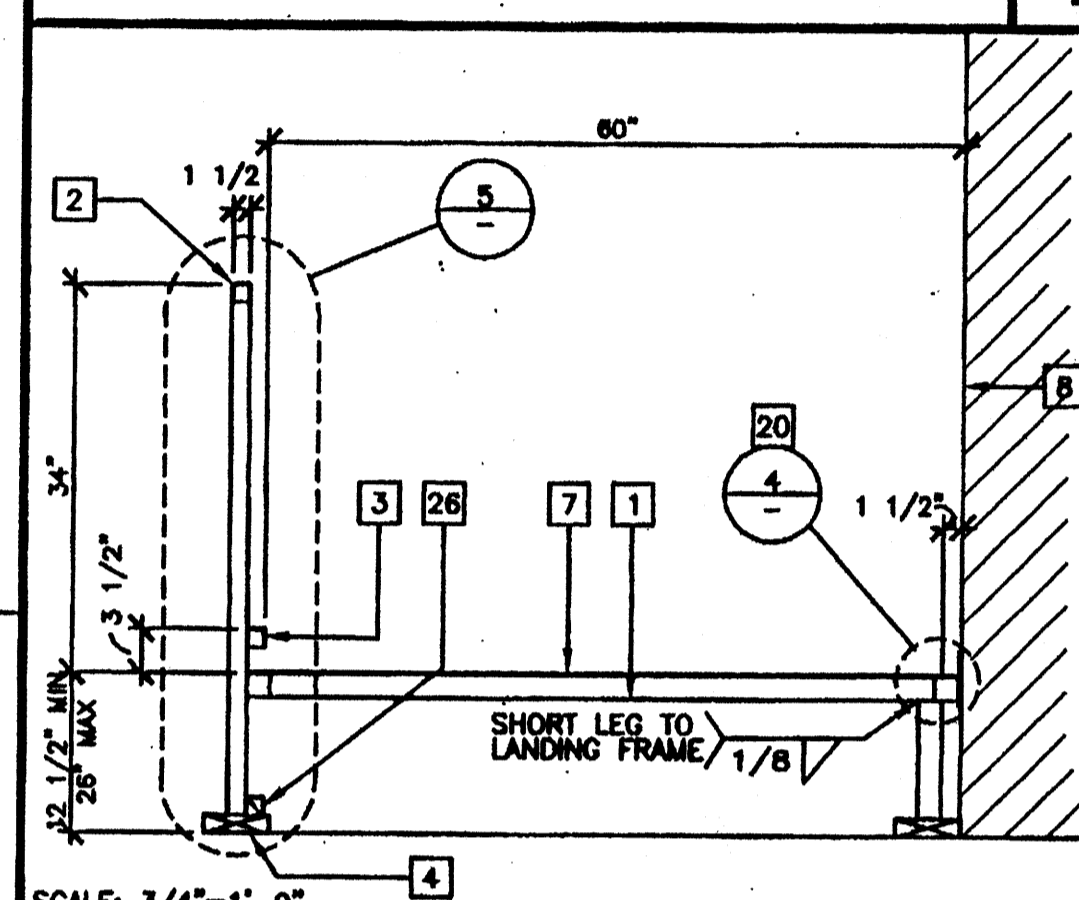


SCALE: 3/4"=1'-0"
SECTION AT LANDING 2

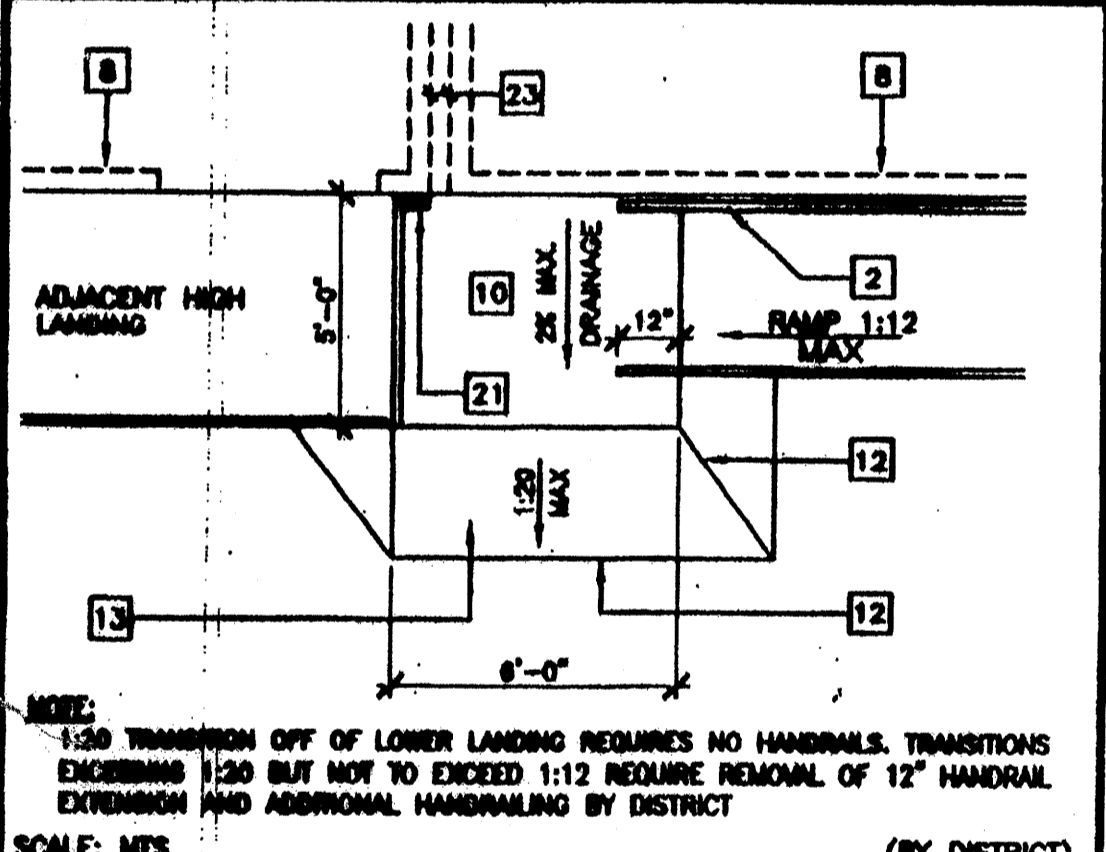


SCALE: NTS (BY DISTRICT)
RAMP TRANSITION 18

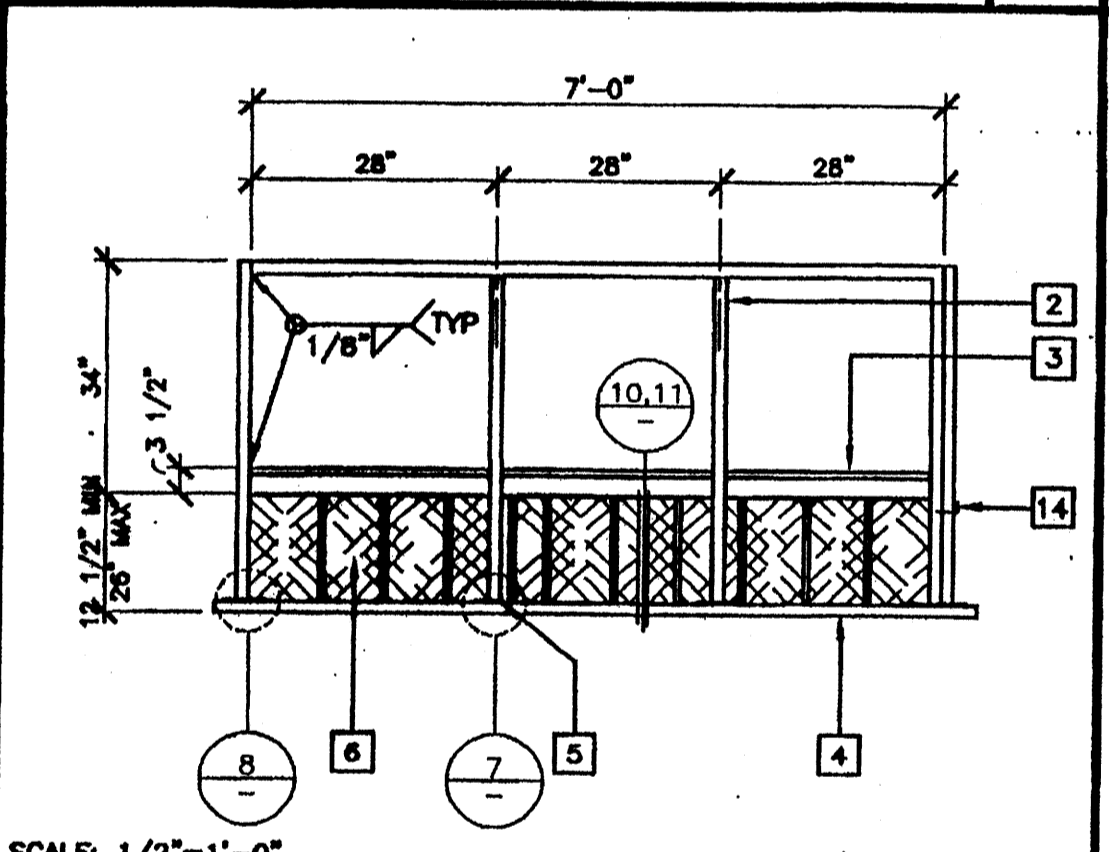


SCALE: 1/2"=1'-0"
LANDING ELEVATION 14

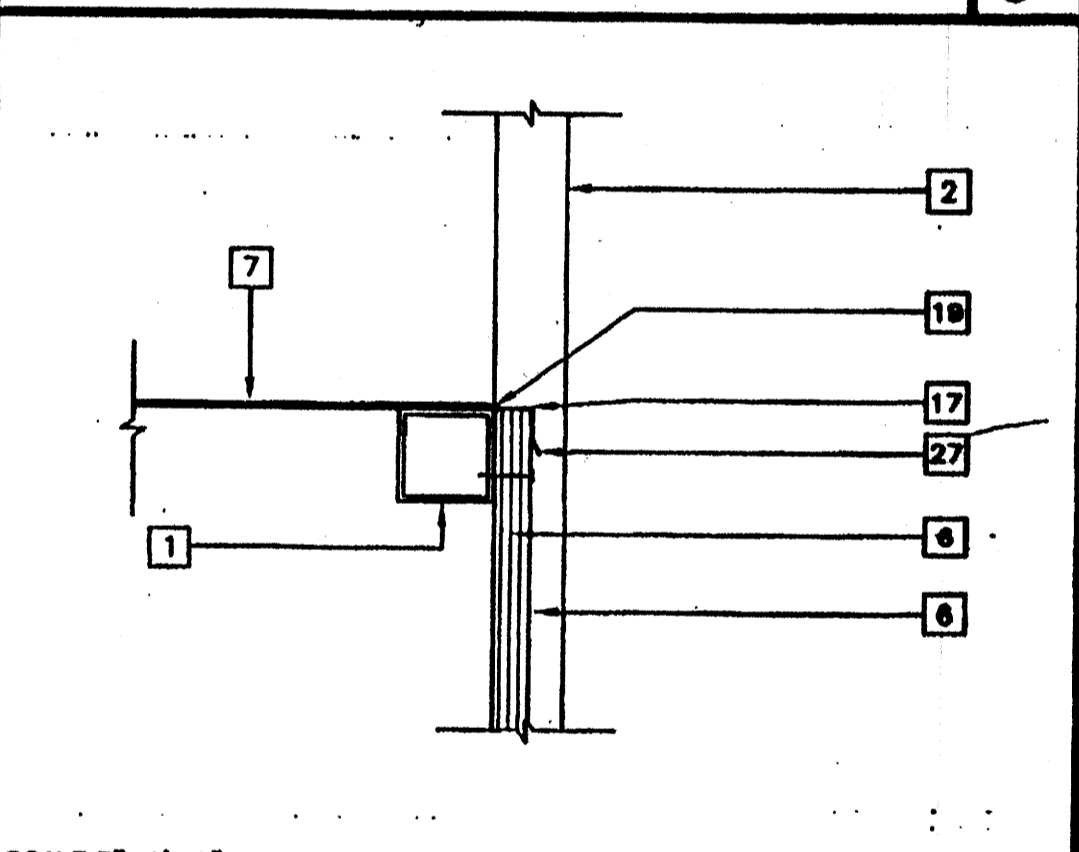


SCALE: 3"=1'-0"
SKIRT FLASHING 10

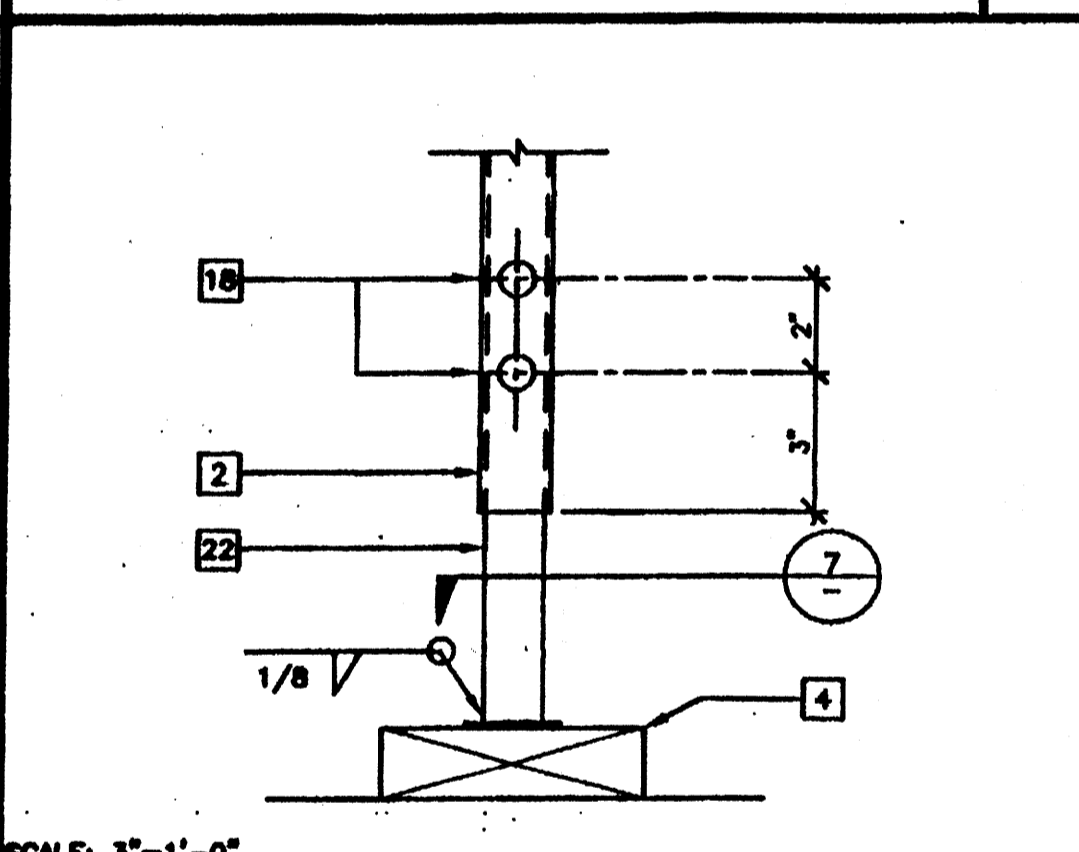


SCALE: 3"=1'-0"
ADJUSTABLE LEG 6

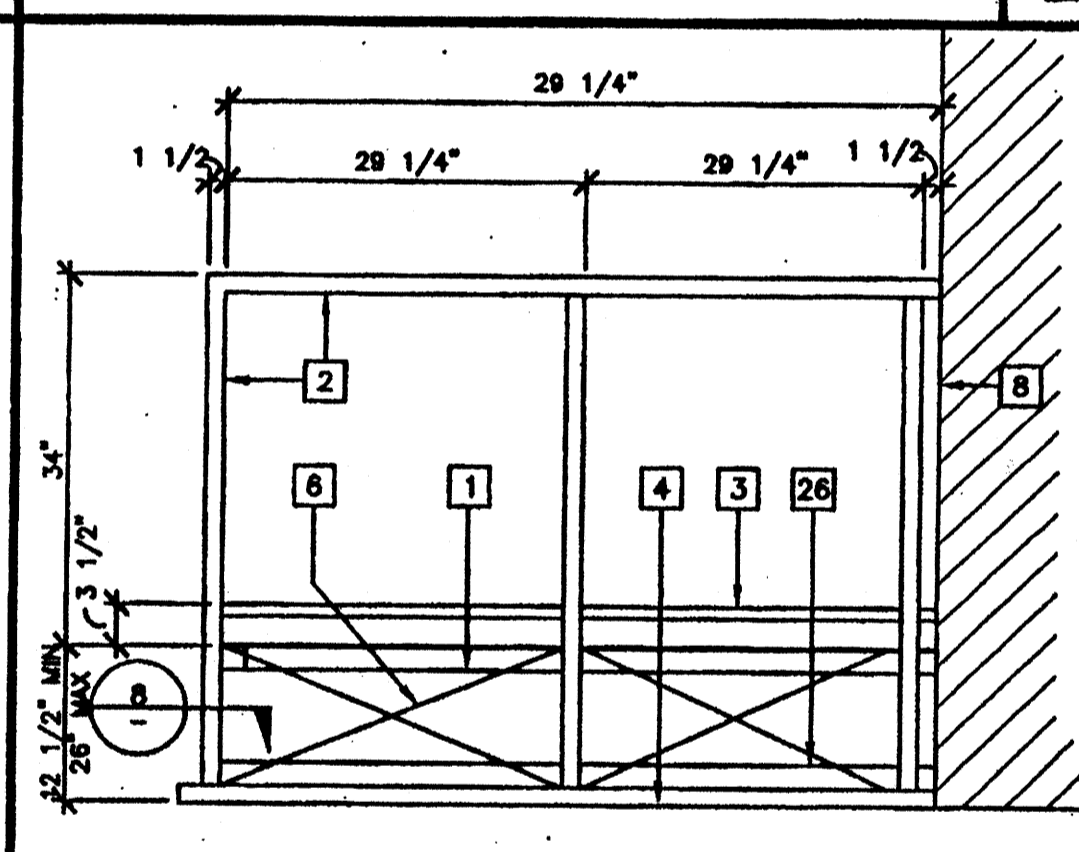


SCALE: 3/4"=1'-0"
END ELEVATION 3

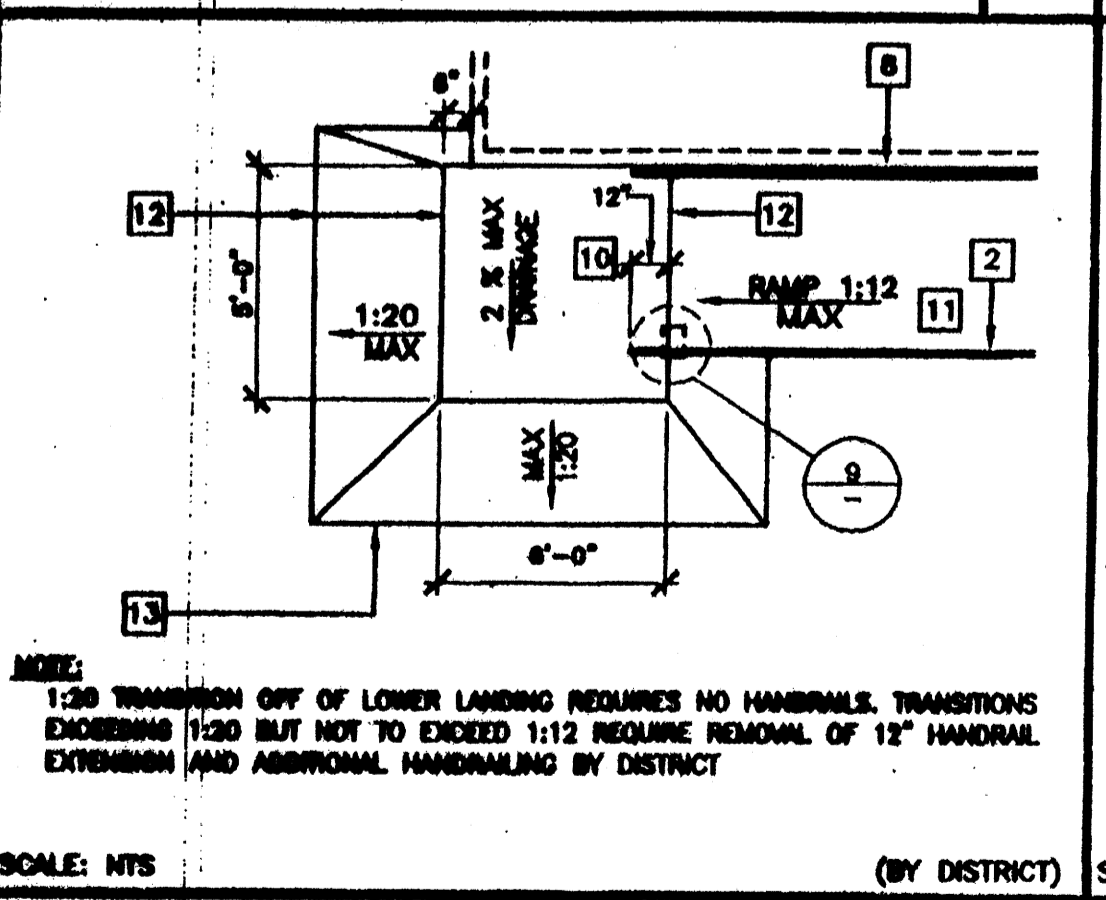


SCALE: NTS (BY DISTRICT)
RAMP TRANSITION 19

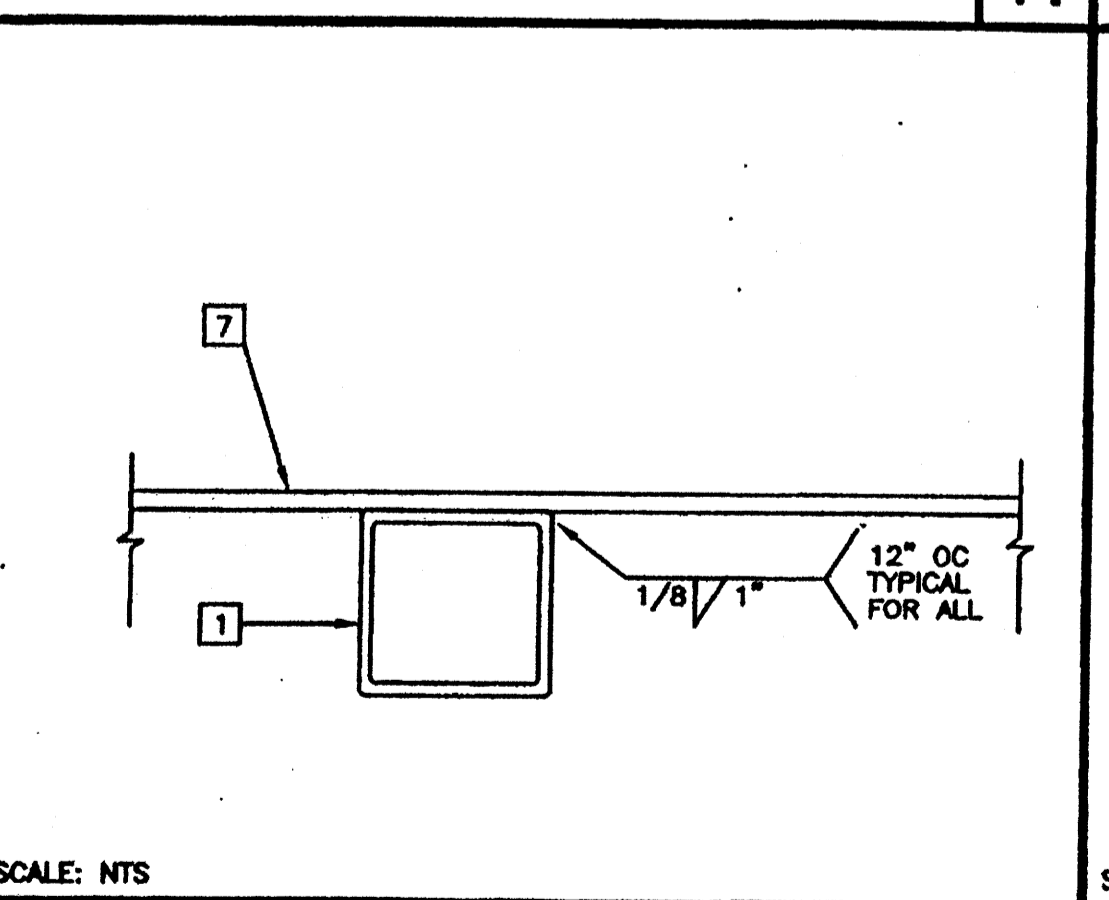


SCALE: NTS
SECTION AT INTERIOR FRAME 15

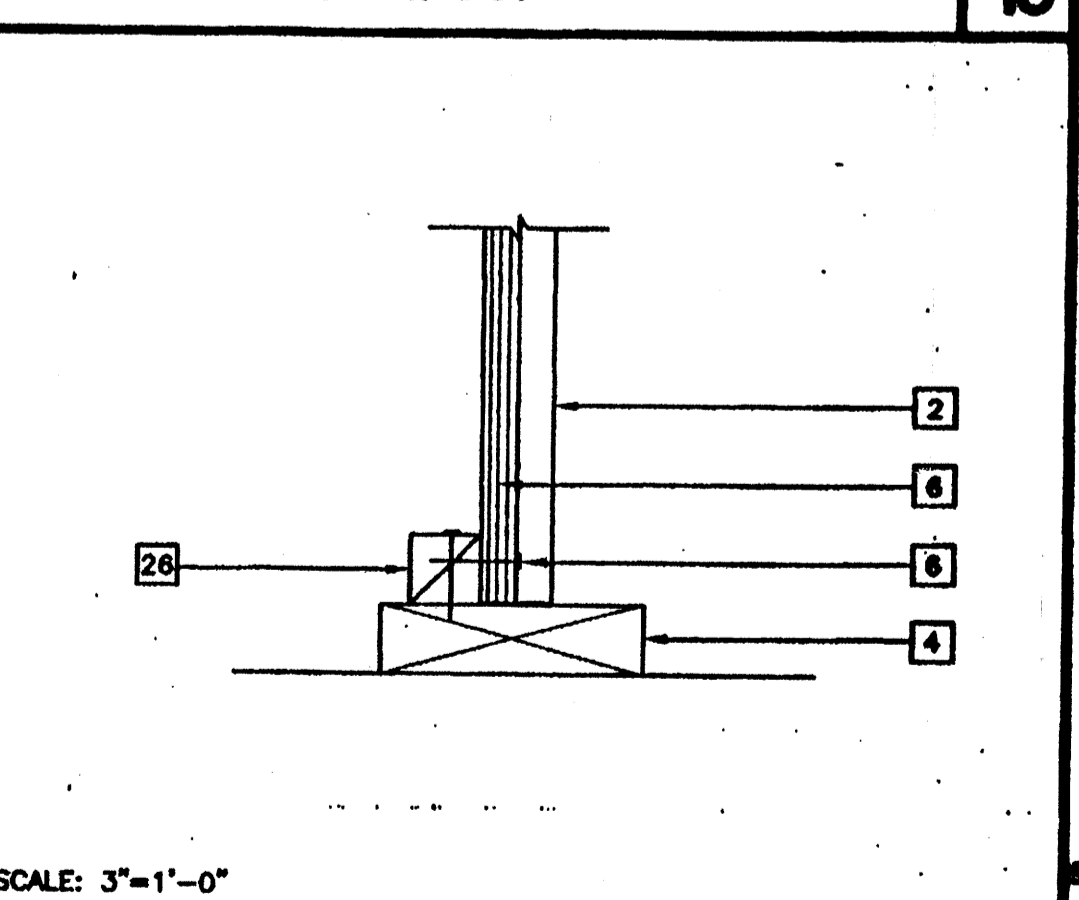

SCALE: 3"=1'-0"
SKIRT AT SILL PLATE 11


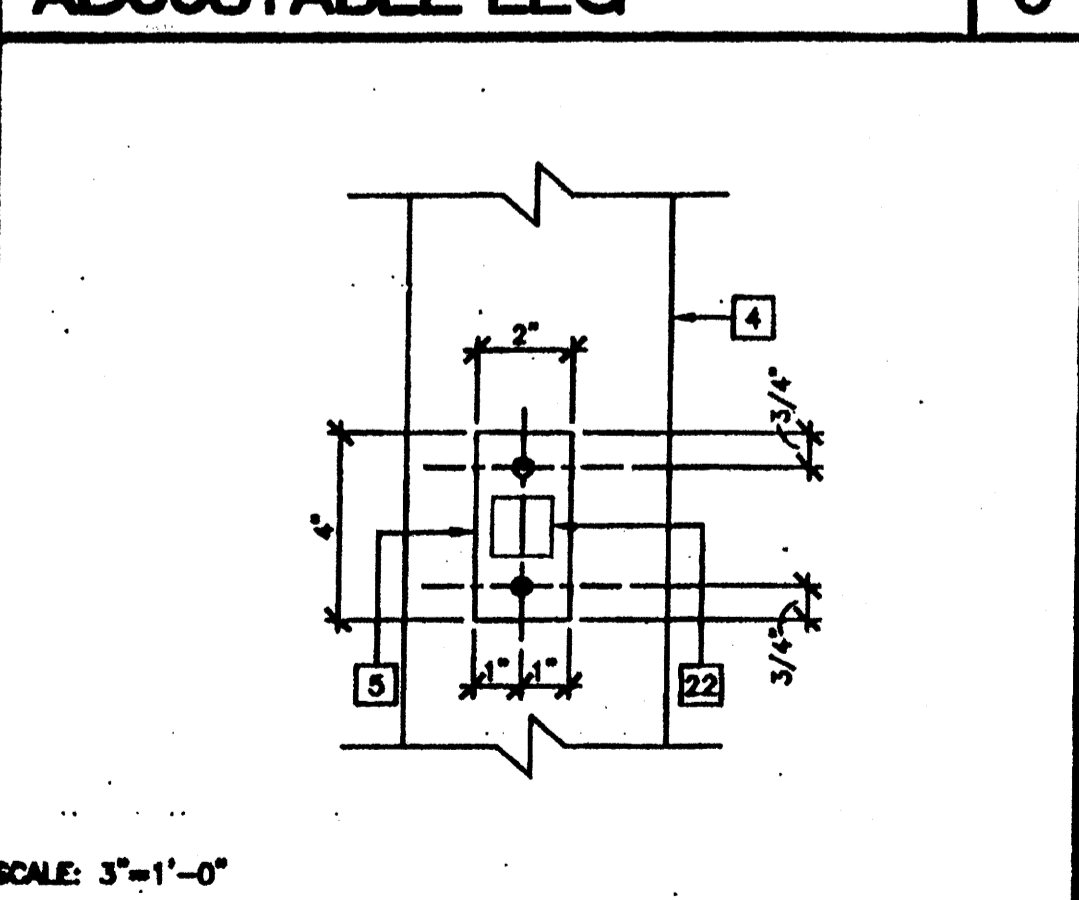


SCALE: 3"=1'-0"
ADJUSTABLE LEG BASE PLATE 7

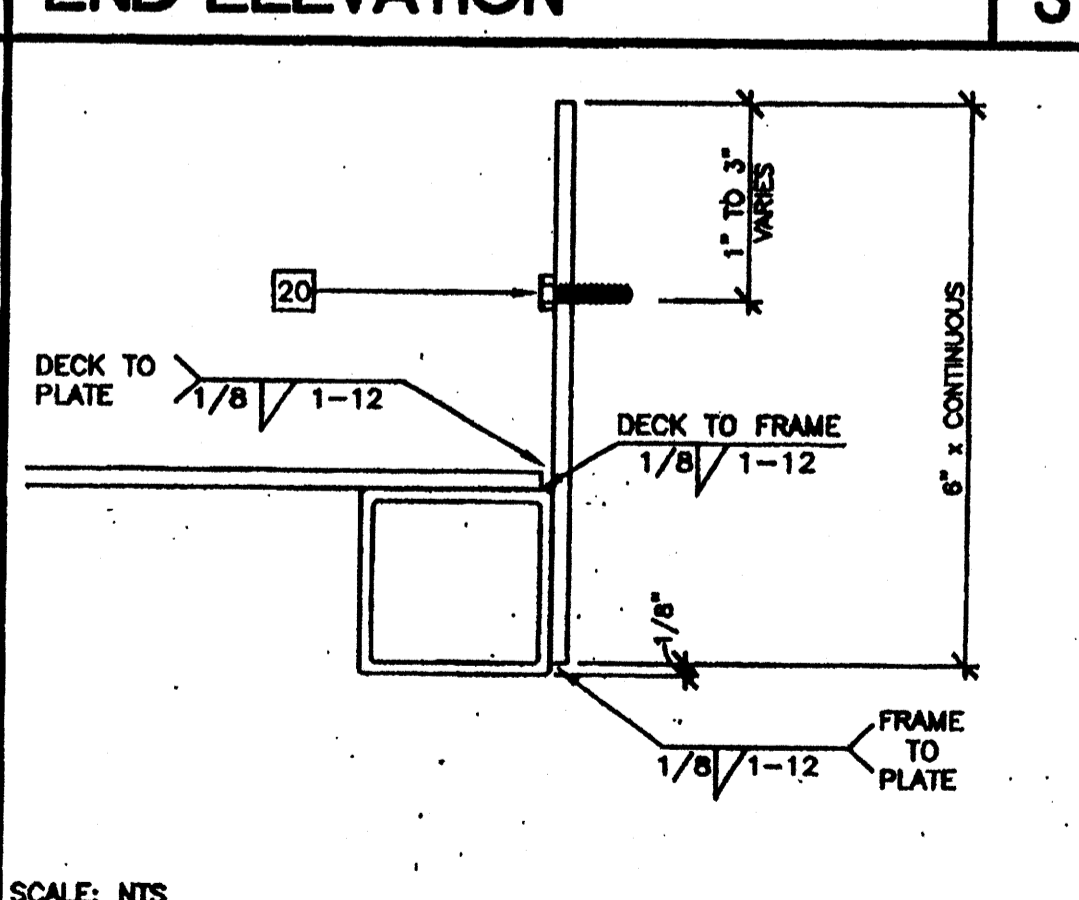

SCALE: NTS
SECTION AT PLATE 4

- KEY NOTES**
- TS 2"x2"x14 GA
 - TS 1 1/2"x1 1/2"x14 GA (Fy = 36 KSI), ROUNDED OR BEVELED AT CORNERS.
 - TS 1"x1"x16 GA WHEELCHAIR GUIDE
 - 2"x6" PRESSURE TREATED SILL PLATE
 - 2"x4"x12 GA BASE PLATE WITH 2-1/4"x1" LAGS
 - SKIRTING: PLYWOOD TO MATCH BUILDING SIDING, BLOCK ALL EDGES, ATTACH WITH 8d AT 6" OC EDGES AND 12" OC FIELD. AT EDGE CONNECTION TO TS, USE #14x2" TEK SCREWS AT 6" OC
 - 12GA METAL DECK: NON-SLIP SURFACE. DESIGN COEFFICIENT OF FRICTION GREATER THAN 0.8, MAINTAINABLE FOR 1 YR. PROVIDE ROUNDED OR BEVELED EDGES ON STAIR NOSING.
 - EXISTING BUILDING.
 - 6"x10"x12 GA BASE PLATE AT RAMP TOE.
 - LOWER LANDING BY DISTRICT
 - RAMP BY MOOTECH
 - FLUSH TRANSITION
 - PAVE BY DISTRICT
 - 3"x1"x3'-0"x10 GA BENT PLATE
 - FASTEN POSTS WITH 3/8" DIA THRU BOLT, TYPICAL
 - RAMP LANDING, TYPICAL
 - 26 GA FLASHING
 - 3/8" DIAx2" LONG MB WITH NUT & WASHERS
 - CAULKING
 - 6"x10GA CONTINUOUS PLATE WITH #14x2" TEK SCREWS AT 9" OC INTO WOOD OR FOUNDATION BLOCKS OR #14x2" TEK SCREWS INTO METAL AT 9" OC
 - PROVIDE DIVERSION FOR WATER FROM DOWNSPOUT FOR THIS CONDITION, BY DISTRICT
 - TS 1 1/4"x1 1/4"x14 GA (Fy = 36 KSI)
 - 4" MINIMUM BUILDING SEPARATION
 - 2" SLIP RESISTANT WARNING STRIPES MAX 1" FROM EVERY STAIR NOSING AND TOP LANDING, USE CONTRASTING COLOR.
 - TS 2 1/2"x1 1/2"x8 GA, ASTM A500 GRADE A
 - 2"x2" NAILER WITH 16d AT 12" OC
 - RAMP WIDTH MINIMUM CLEAR DIMENSION IS 5'-0"

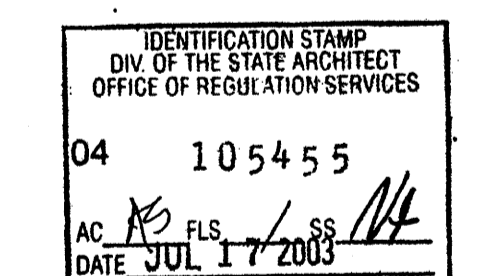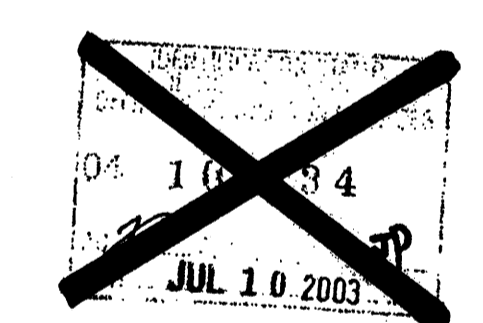

REVISIONS

Electrical Engineer's Seal
 Mechanical Engineer's Seal
 PC Professional of Record Seal
 Architects Seal

PC
 CBC 2001
 IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 No. 04
 104796
 PC-04
 104796
 AC. FLS. SS. 63
 DATE 7/17/03


MOOTECHTM
 2830 BARRETT AVENUE FAX (909) 943-4014
 PERRIS, CALIF. 92572 FAX (909) 940-0427

PROJECT NUMBER: 4736
 WILLIAM SCOTTSMAN
 © MODTECH, INC. 2002
 ALL RIGHTS RESERVED

DRAWN BY: GL
 DATE: 07/07/03
 CHECKED BY:
 DATE:
 MODTECH Index No.
R1.02


RAMP/LANDING DETAILS

PROJECT NO. 4736

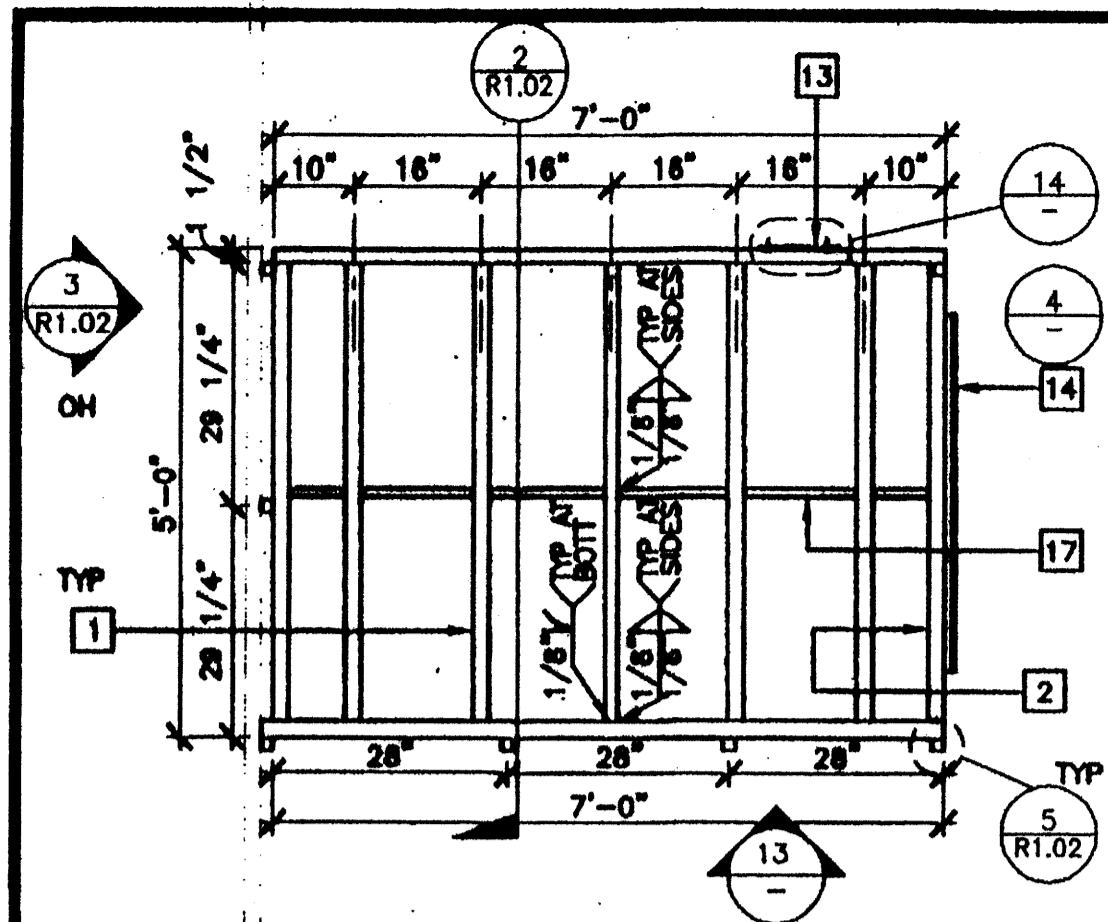


12 LANDING FRAME

SCALE: NTS

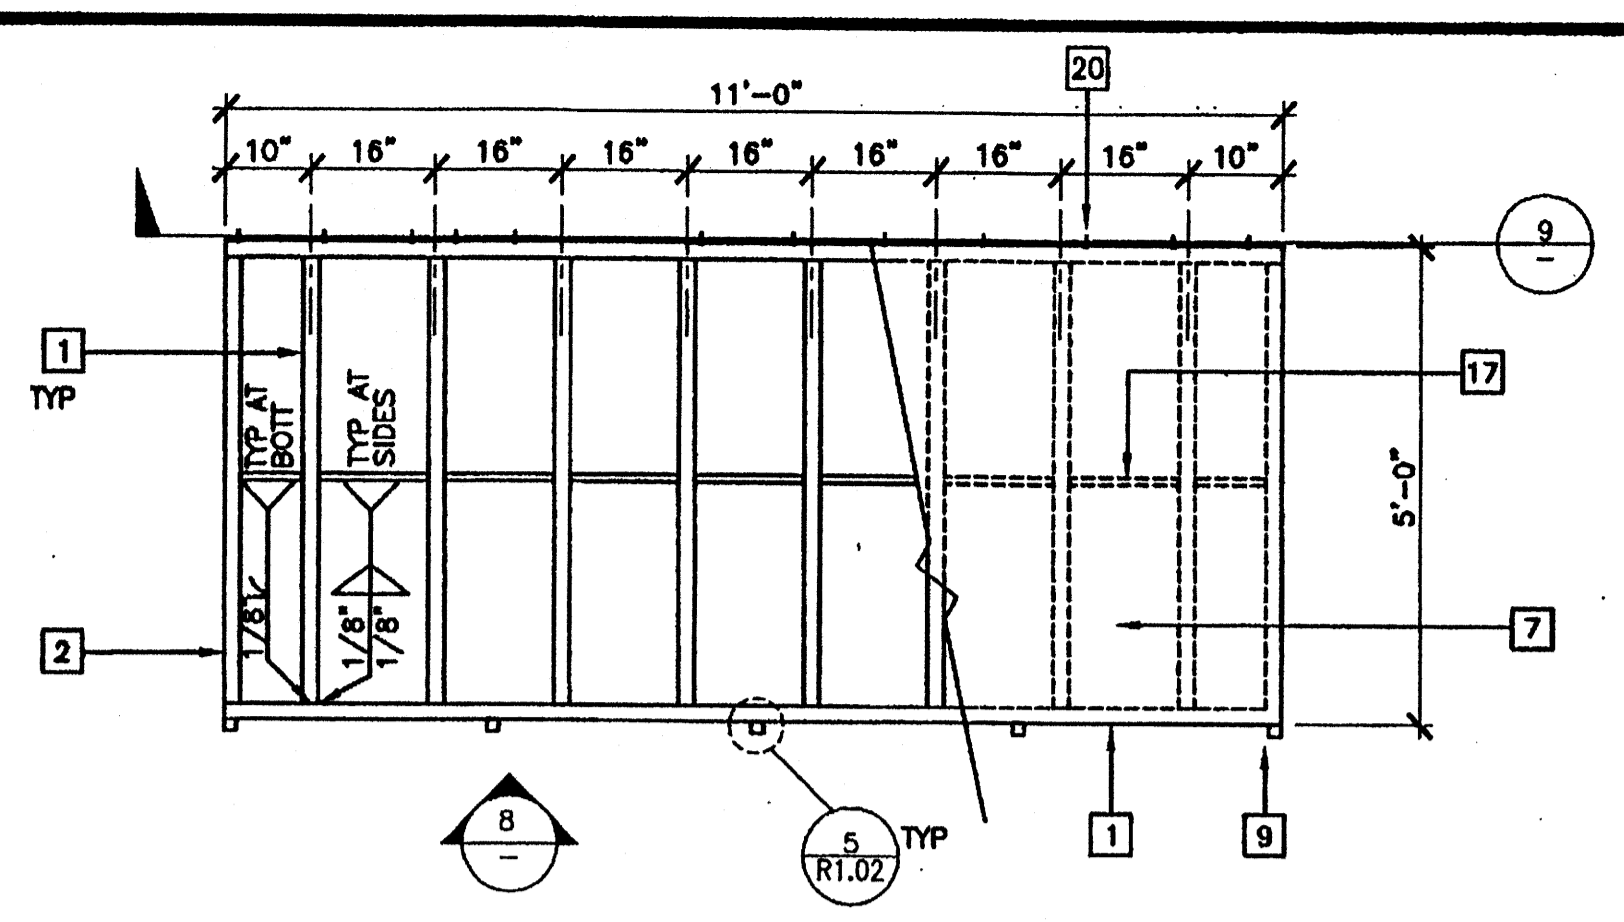

7 RAMP FRAME

SCALE: NTS

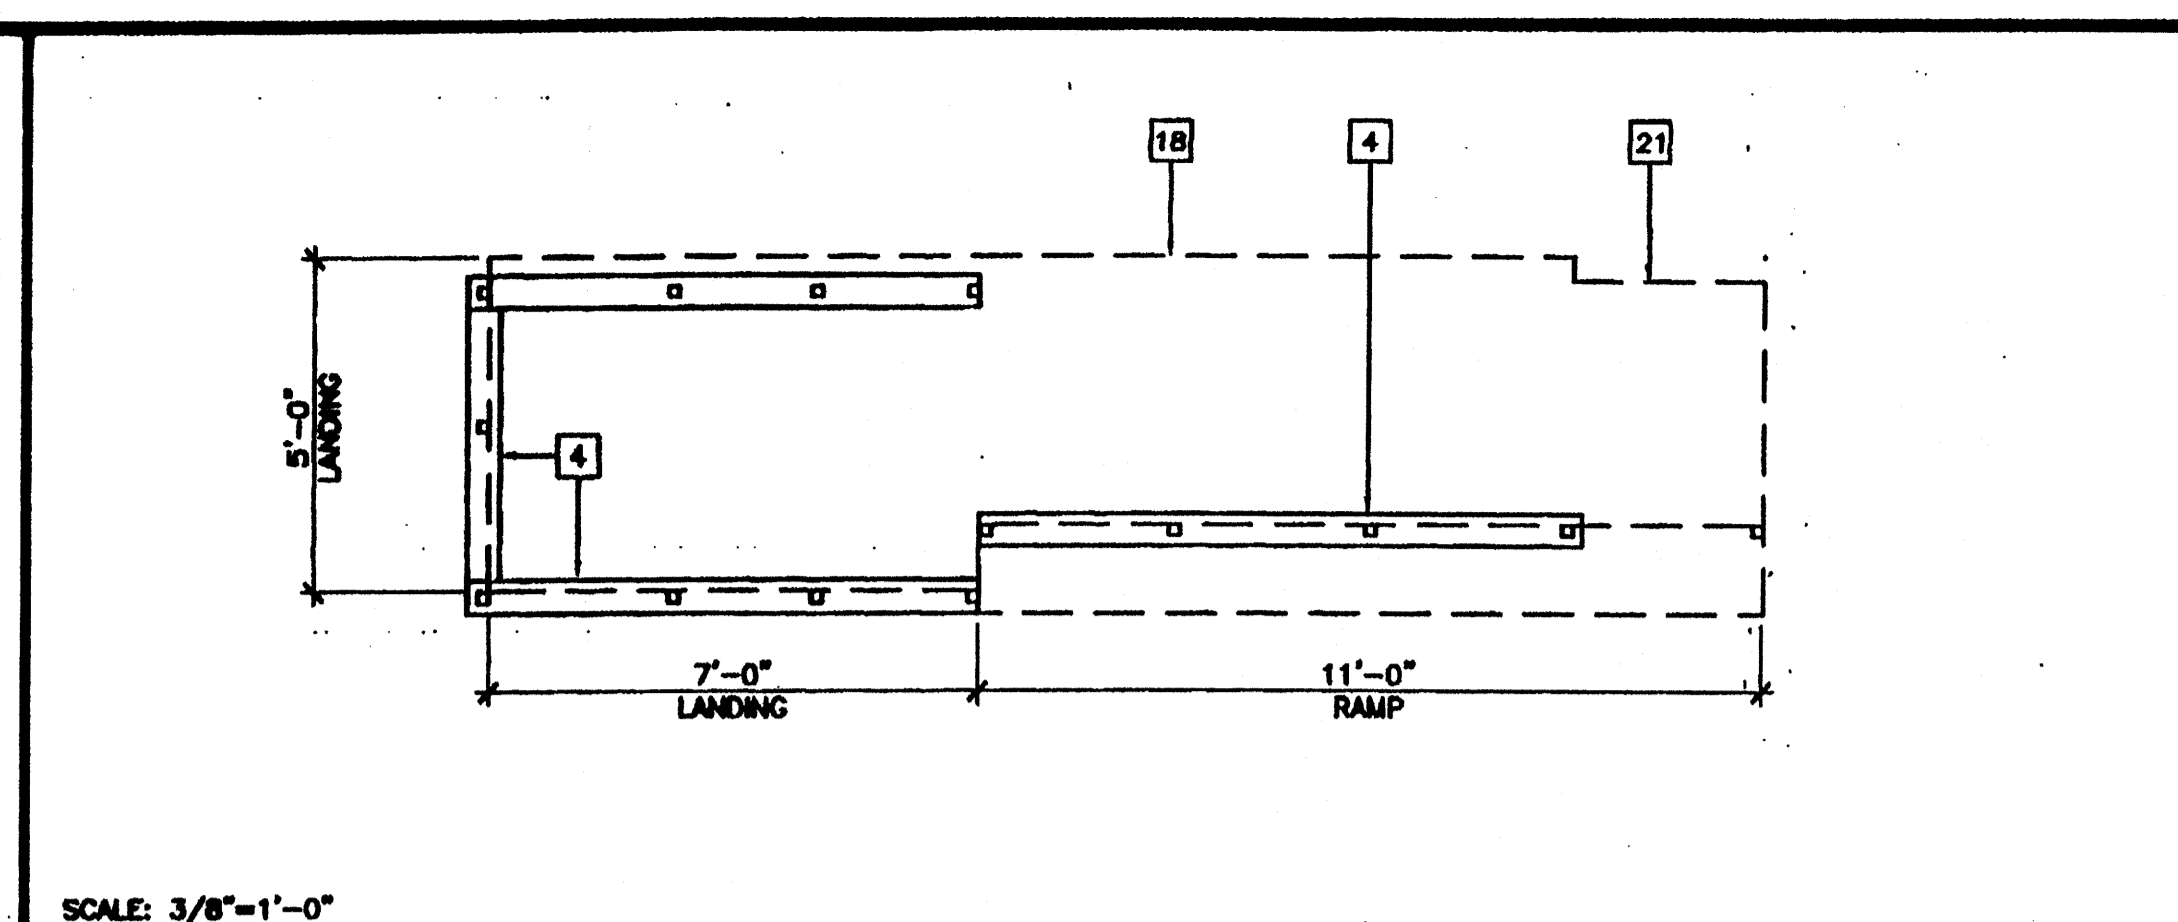


1 SILL PLAN FOR RAMP AND LANDING

SCALE: 3/8"=1'-0"


KEY NOTES

- 1 TS 2"x2"x14 GA
- 2 TS 1 1/2"x1 1/2"x14 GA (Fy = 39KSI), ROUNDED OR BEVELLED AT CORNERS
- 3 TS 1"x1"x16 GA WHEELCHAIR GUIDE
- 4 2"x6" PRESSURE TREATED SILL PLATE
- 5 2"x4"x12 GA BASE PLATE WITH (2) 1/4"x1" LAGS
- 6 SKIRTING: PLYWOOD TO MATCH BUILDING SIDING. BLOCK ALL EDGES. ATTACH WITH 8d AT 6" OC EDGES AND 12" OC FIELD. AT EDGE CONNECTION TO TUBE STEEL USE #14x2" TEK SCREWS AT 6" OC
- 7 12 GA METAL DECK: NON-SLIP SURFACE. DESIGN COEFFICIENT OF FRICTION GREATER THAN 6%. MAINTAINABLE FOR 1 YEAR
- 8 EXISTING BUILDING
- 9 6"x10"x12 GA BASE PLATE AT RAMP TOE
- 10 LOWER LANDING BY DISTRICT
- 11 RAMP BY MODTECH
- 12 FLUSH TRANSITION
- 13 6"x12"x10 GA PLATE WITH (2) 1/4"x3" LAGS TO STRUCTURAL FRAME OF BUILDING
- 14 3"x1"x3"-0"x10 GA BENT PLATE
- 15 2"x4"x 1/8" PLATE
- 16 TS 1 1/2"x1 1/2"x14 GA HANDRAIL - CONTINUOUS AND UNINTERRUPTED. ROUNDED OR BEVELLED AT CORNERS
- 17 TS 1"x1"x16 GA RAIL SUPPORT
- 18 LINE OF RAMP/LANDING ABOVE
- 19 RAMP EXTENSION FRAME
- 20 6"x10 GA CONTINUOUS PLATE WITH 1/4"x2" TEK SCREWS AT 9" OC INTO WOOD OR FOUNDATION BLOCKS OR #14x2" TEK SCREWS INTO STEEL AT 9" OC
- 21 NOTCH BOTTOM PLATE (MUD SILL) AS REQUIRED TO CLEAR RAMP TOE. MAX NOTCH 1 1/2"x4'-0" LONG.
- 22 NOTCH BOTTOM PLATE (MUD SILL) AS REQUIRED TO CLEAR RAMP TOE. MAX NOTCH 1 1/2"x4'-0" LONG.

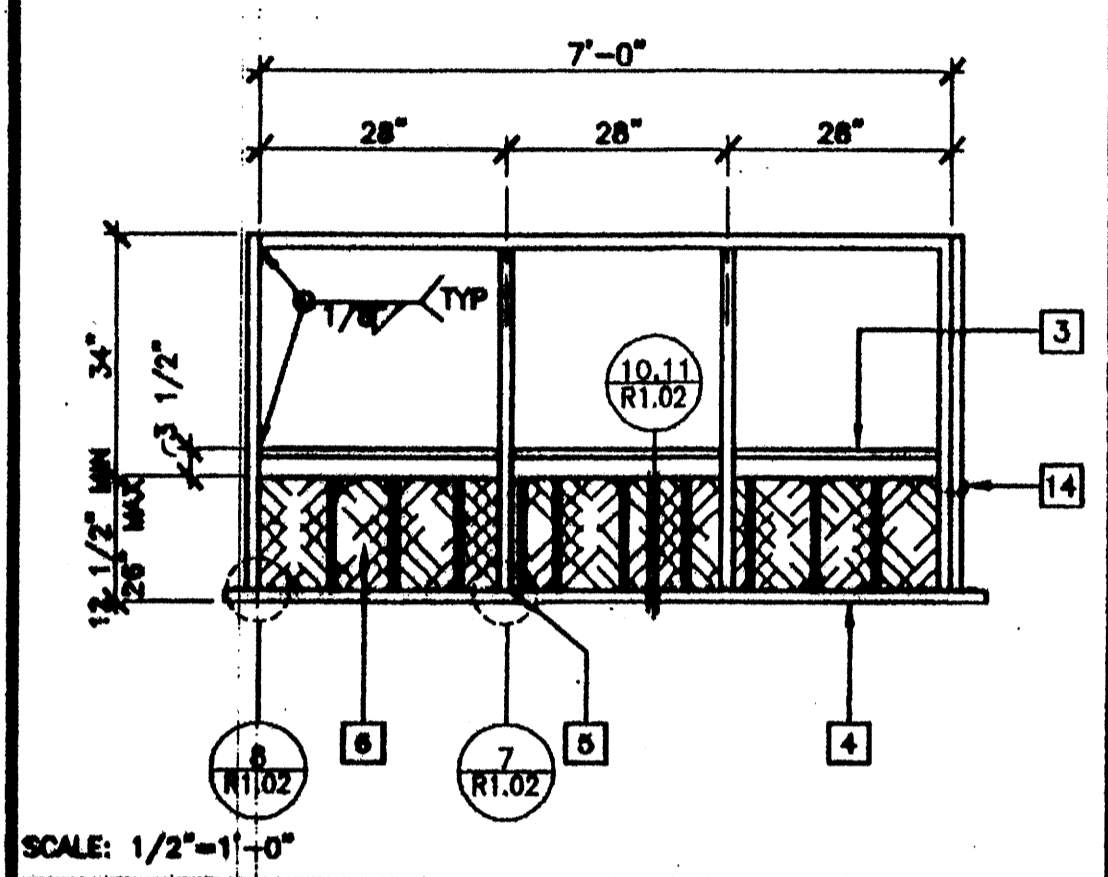


13 LANDING ELEVATION

SCALE: 1/2"=1'-0"

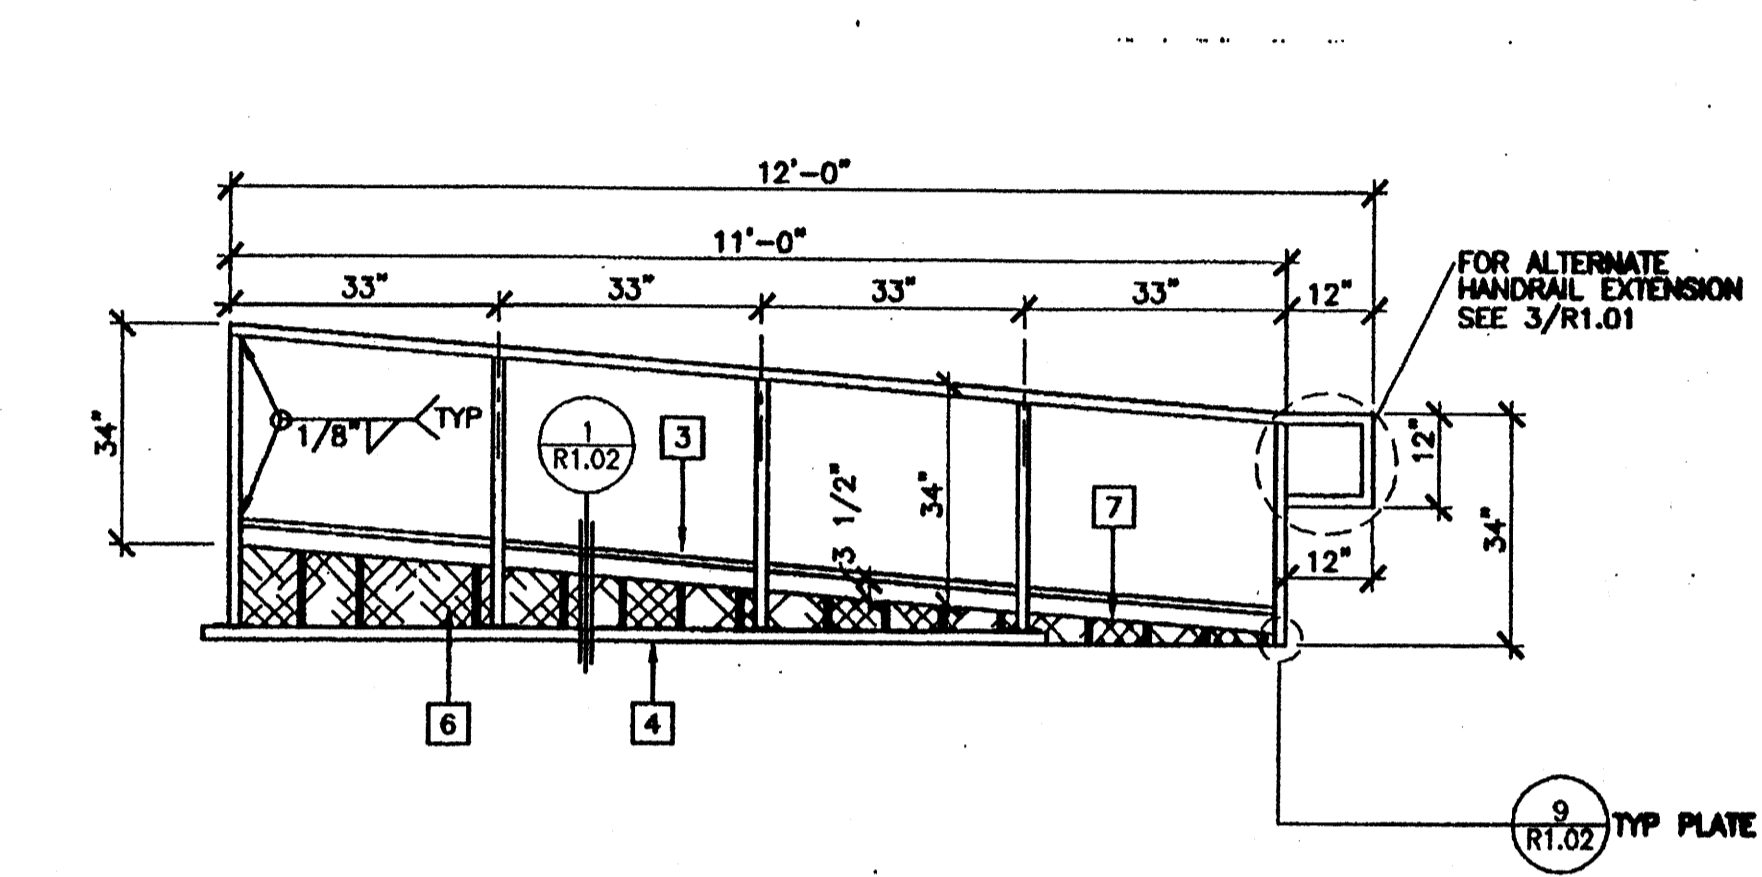


8 RAMP ELEVATION

SCALE: 1/2"=1'-0"

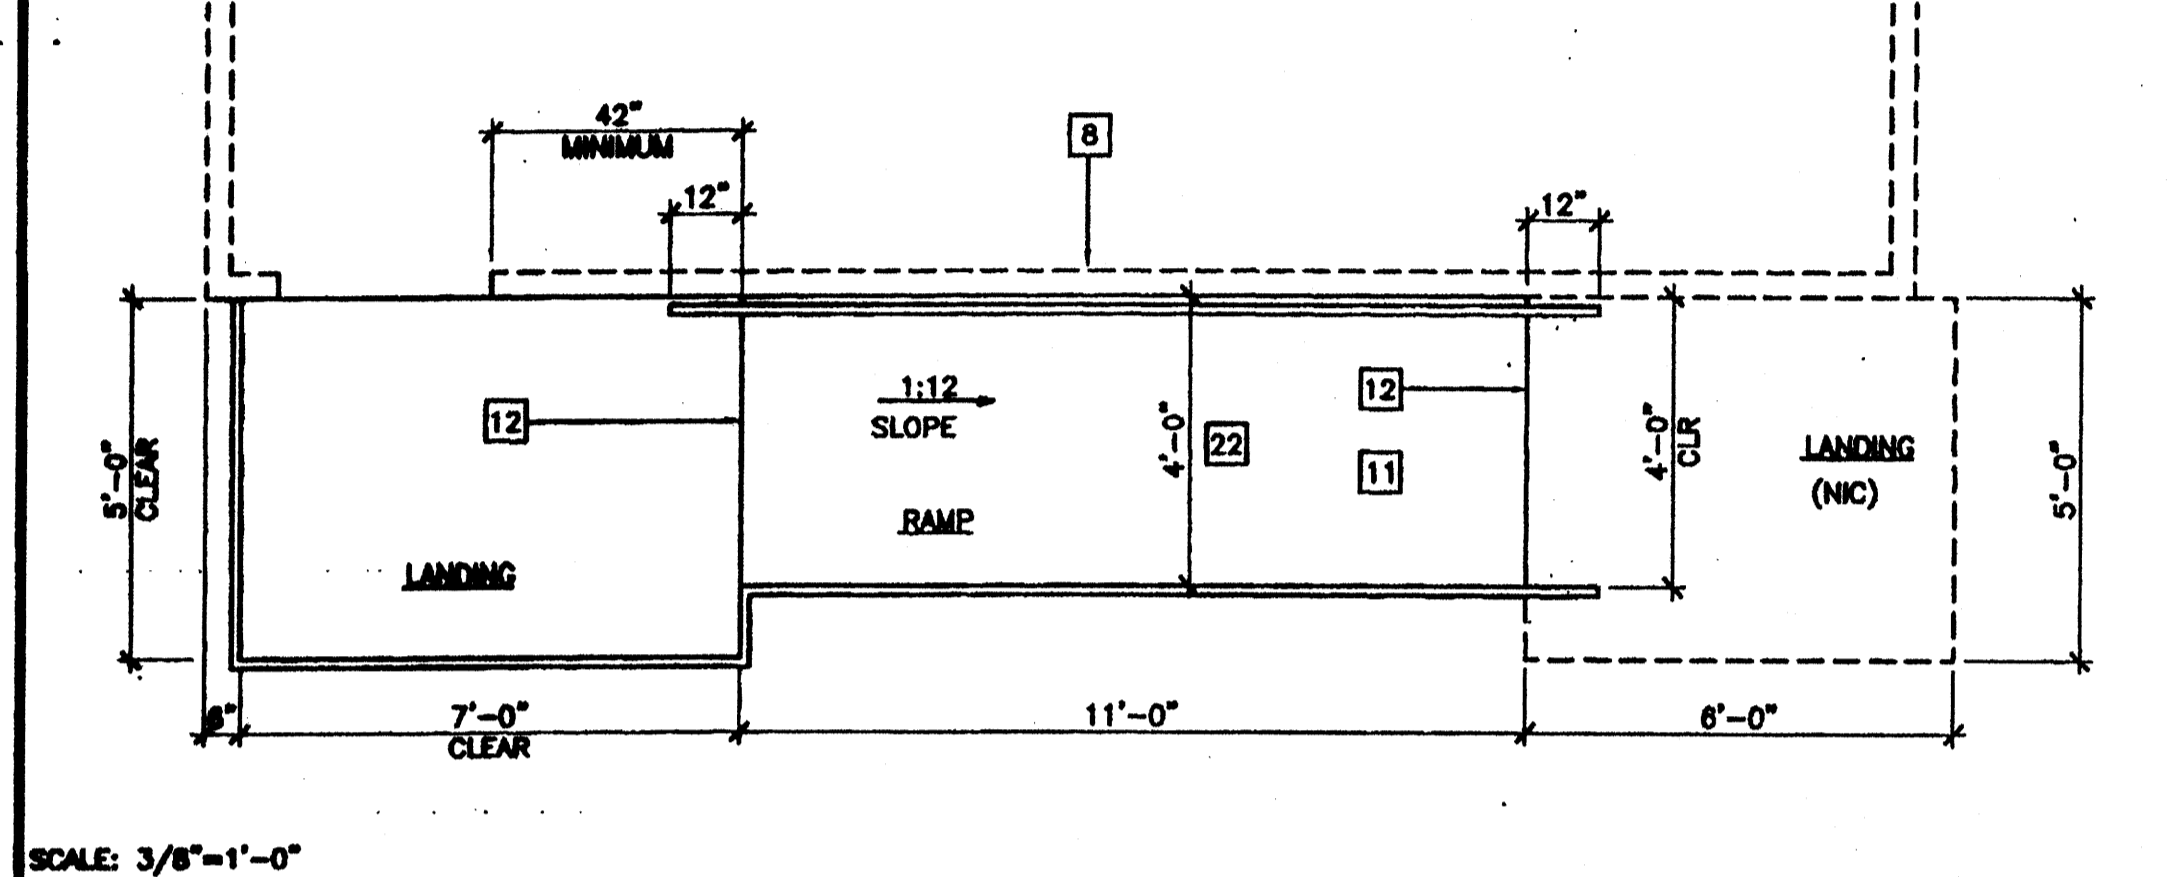


2 RAMP AND LANDING AT BUILDING

SCALE: 3/8"=1'-0"

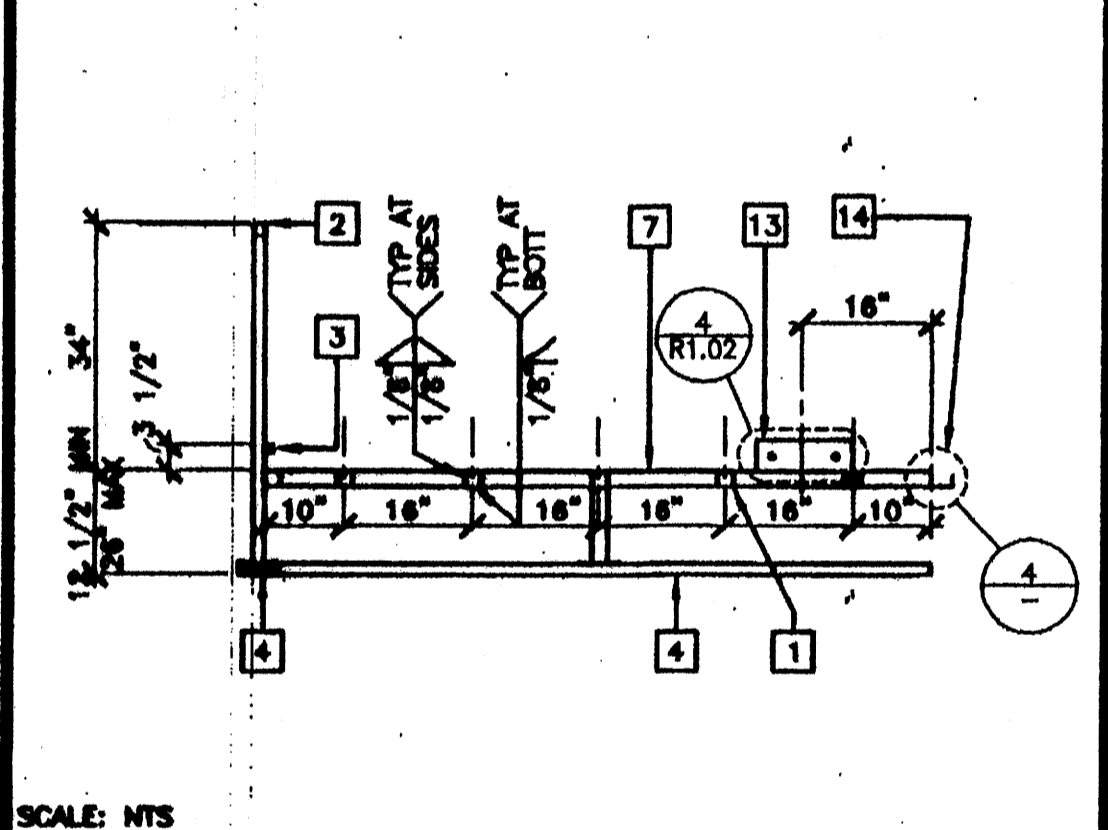


14 SECTION AT LANDING

SCALE: NTS

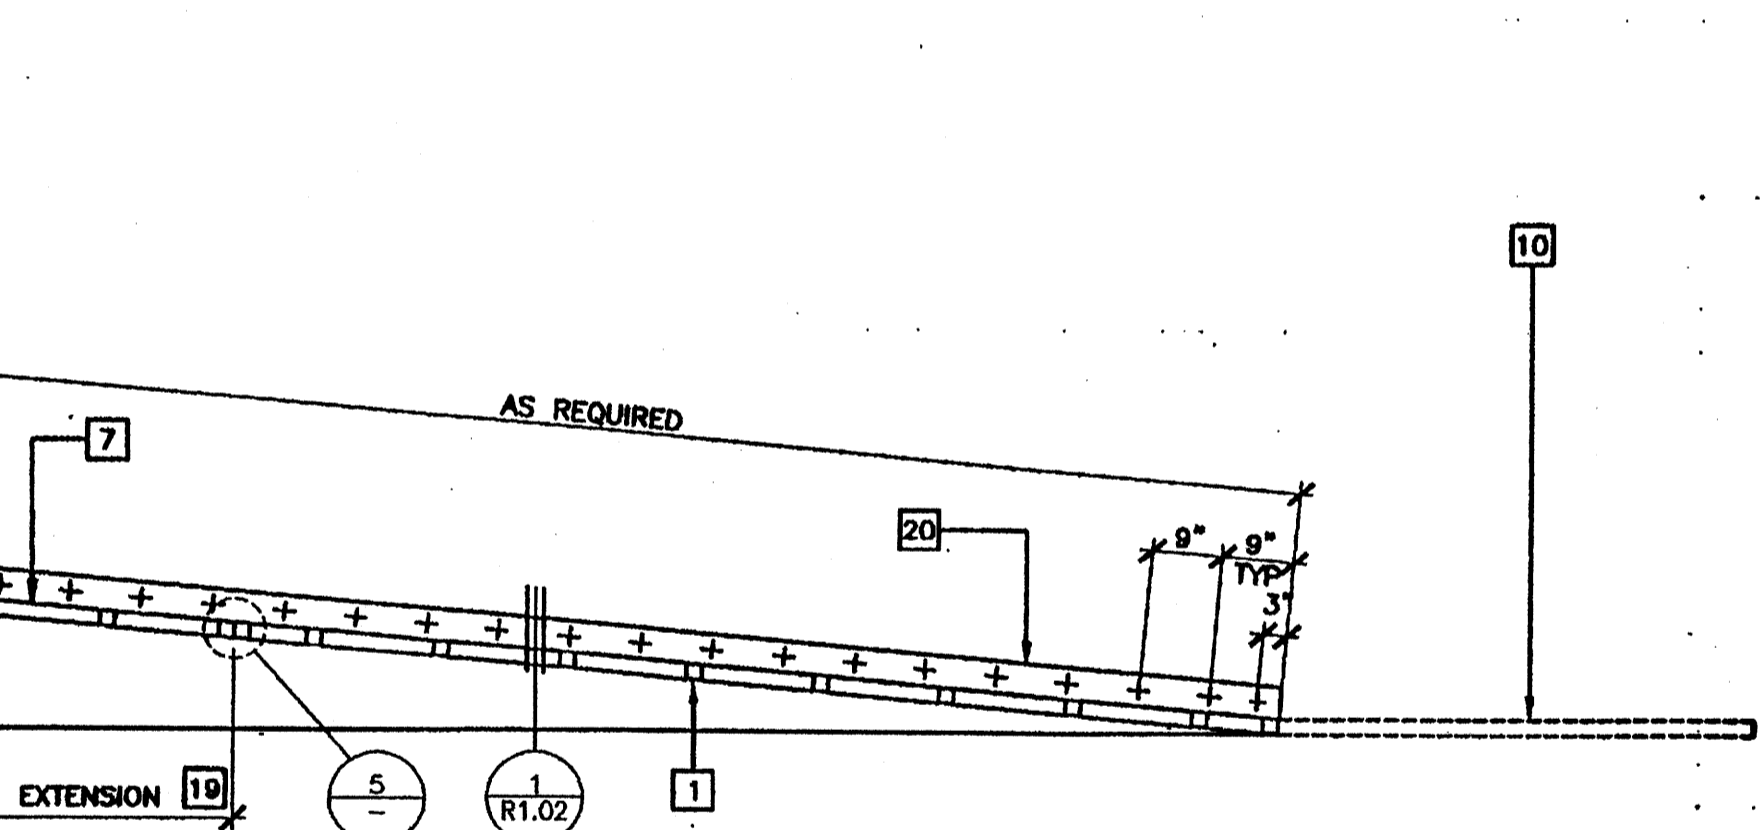


9 LONGITUDINAL SECTION AT RAMP

SCALE: NTS

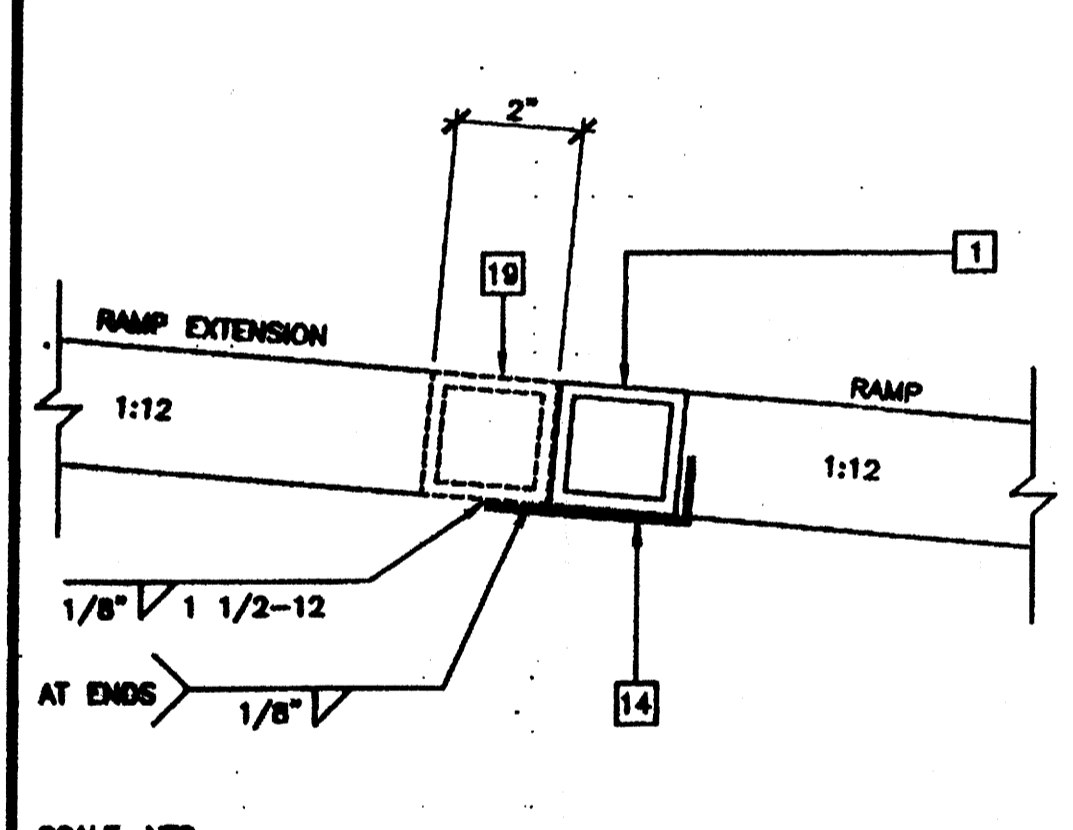

5 RAMP EXTENSION TO RAMP


SCALE: NTS

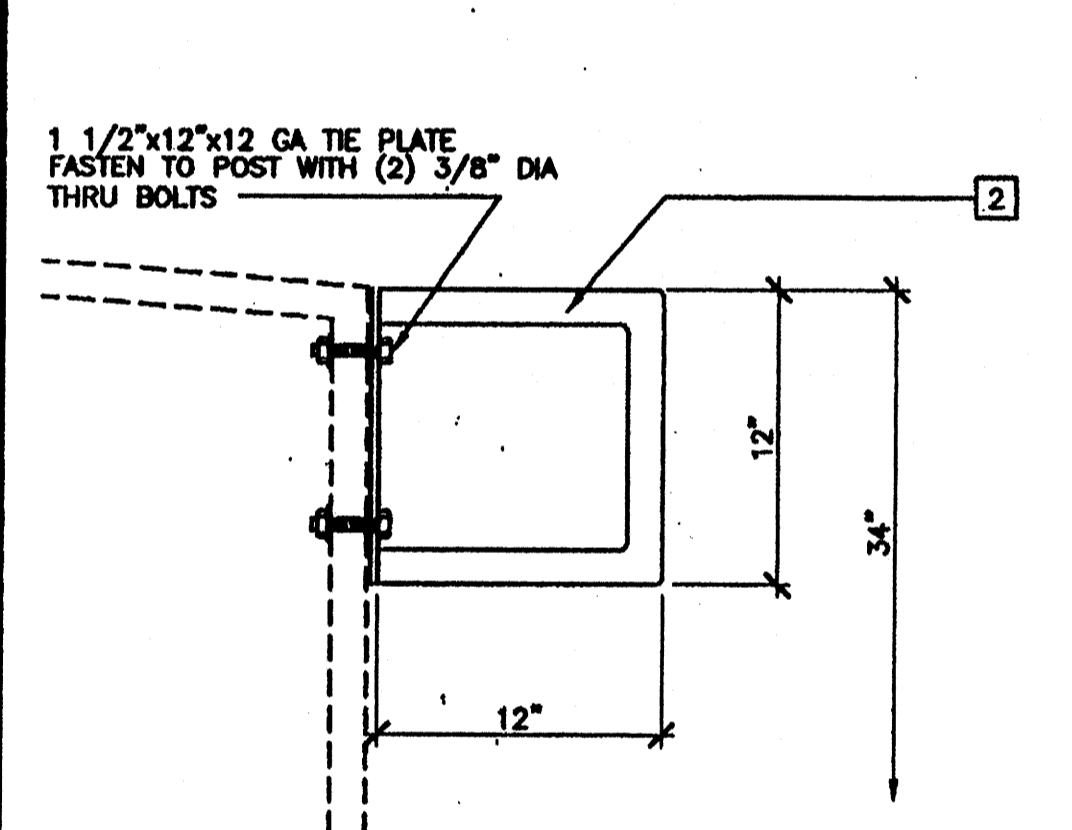

3 ALTERNATE GUARD RAIL EXTENSION


IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
04 105455
AC. PLS. SS MB
DATE: JUL 17 2002

~~105455
JUL 1 0 2002~~

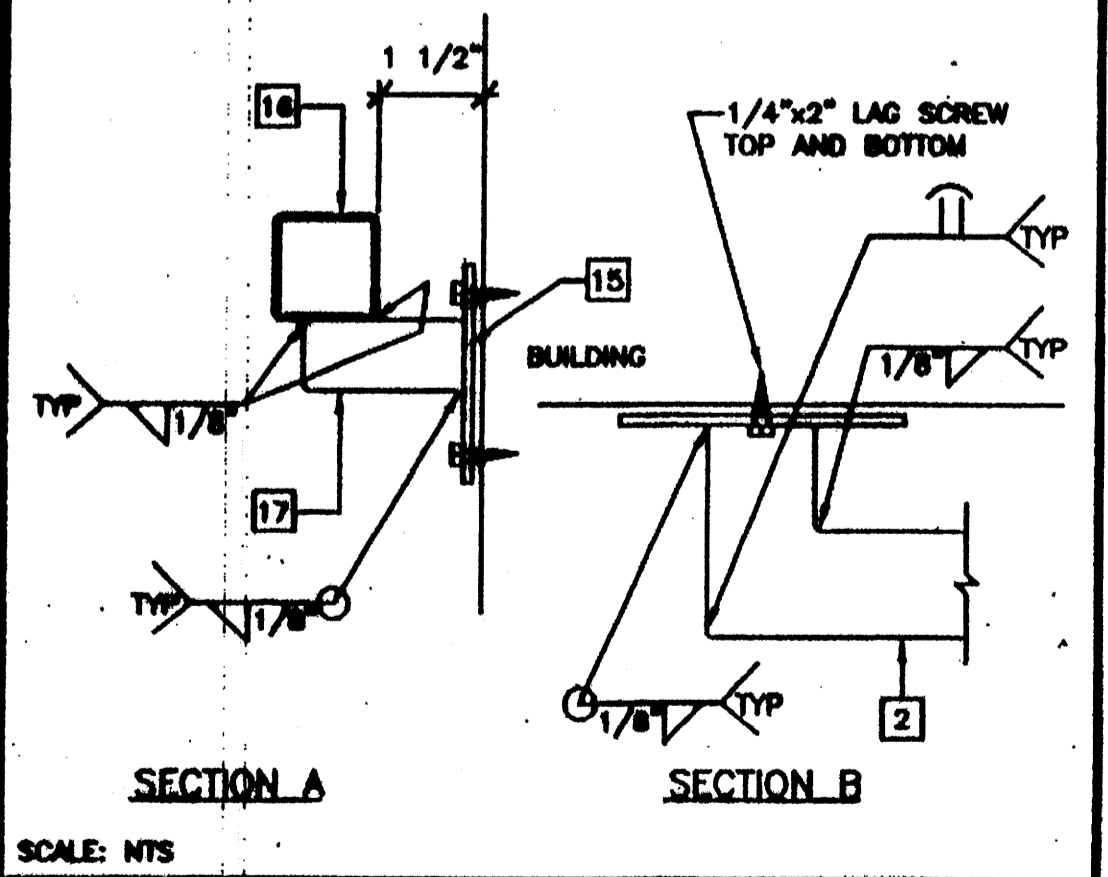


15 HANDRAIL CONNECTION

SCALE: NTS

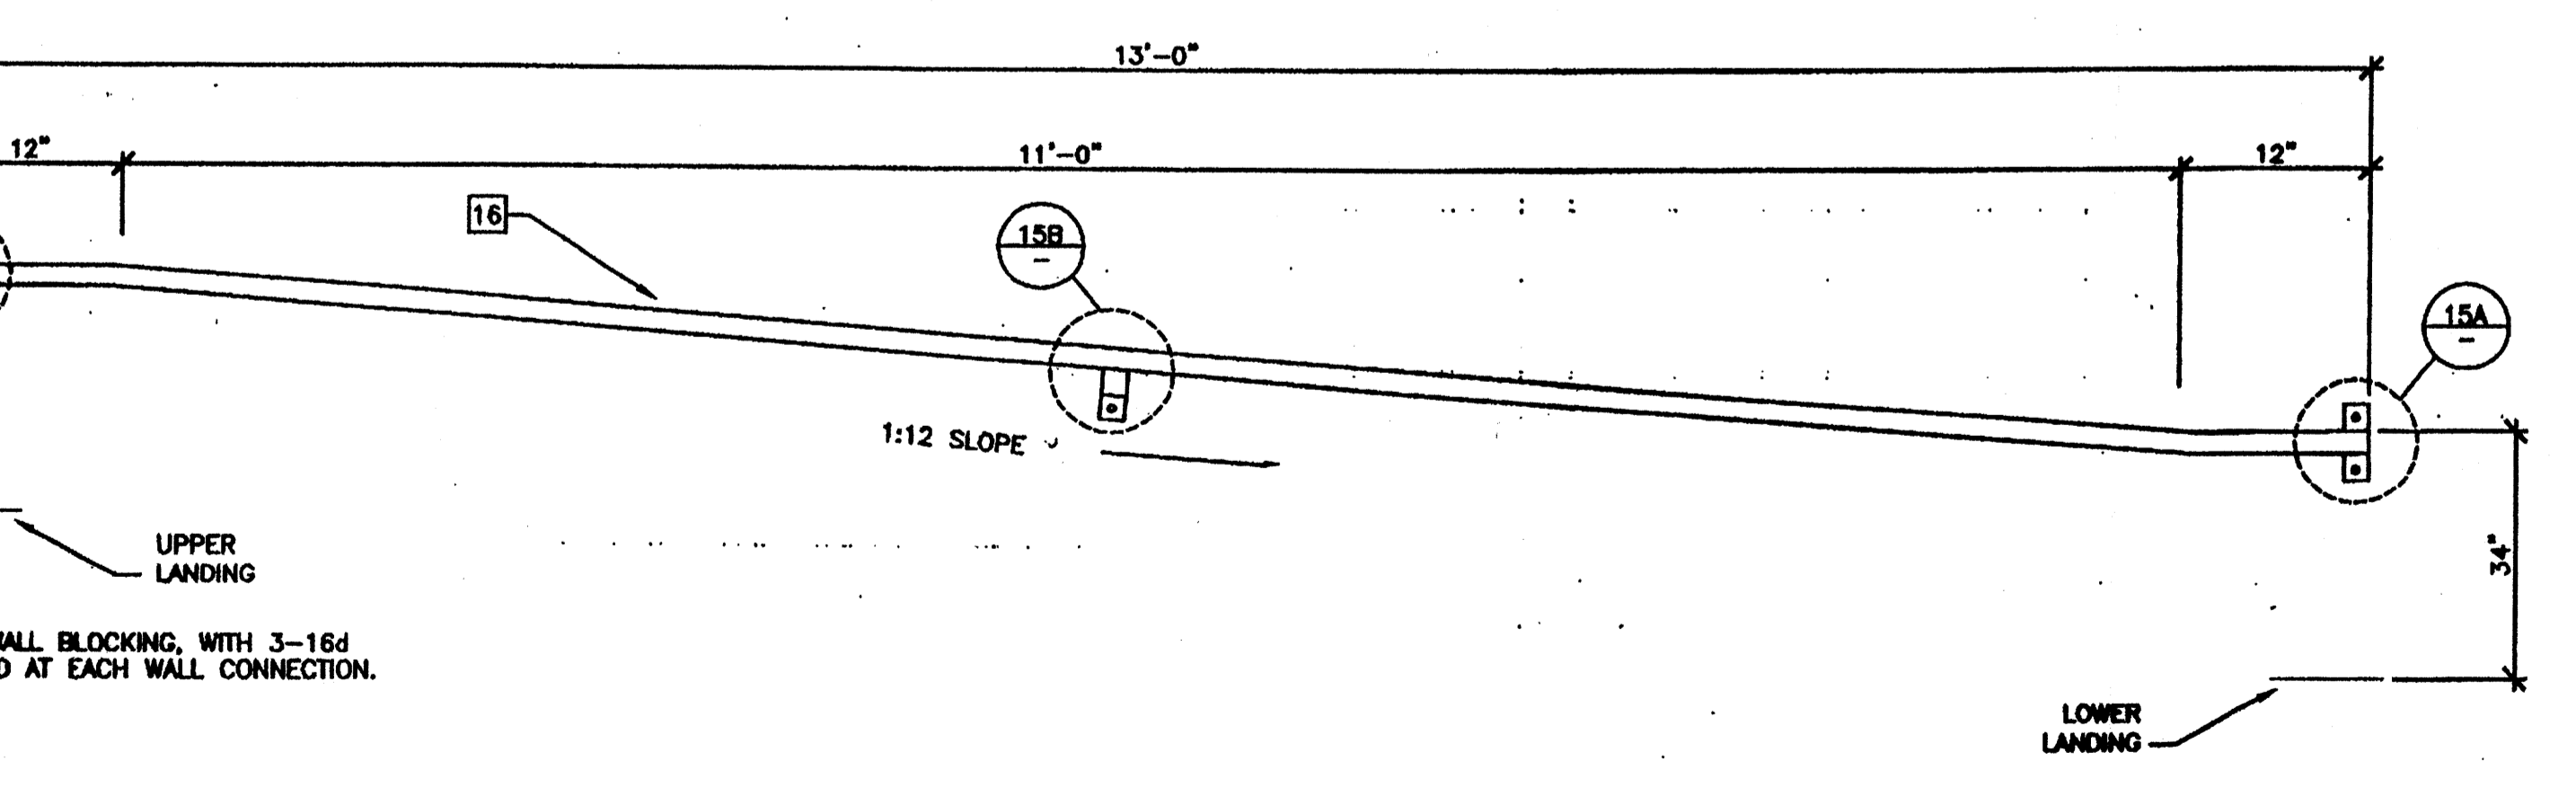

6 HANDRAIL ATTACHED TO BUILDING (OPTIONAL)

SCALE: NTS

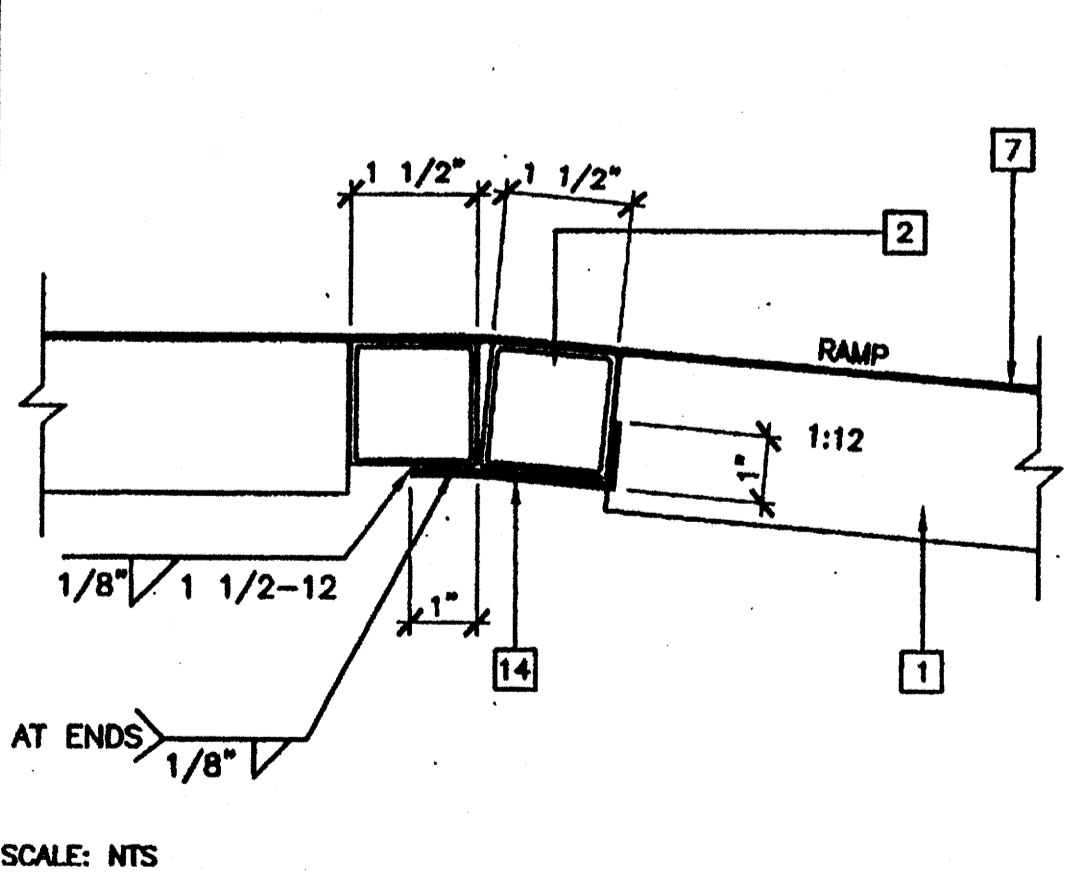

4 RAMP AT LANDING

SCALE: NTS

NOTES

1. RAMP: RAMP SHALL NOT SLOPE MORE THAN 1" IN 12"
2. HANDRAILS: HANDRAILS AT BOTH SIDES OF RAMP AT 34" HEIGHT.
3. SURFACE: LANDING & RAMP TO HAVE NON-SLIP SURFACE ANCOR GRIP II AS MANUFACTURED BY AMERICAN CHEMICAL COMPANY (OR EQUAL)
4. GROUNDING: PROVIDE GROUNDING OF RAMP TO BUILDING FRAME WITH #8 COPPER TO BOTH GROUND LUGS.
5. ARCHITECT SITE/RAMP/LANDING PLANNING: DUE TO VARYING SITE CONDITIONS THE MAXIMUM HEIGHT OF FINISH FLOOR FROM GRADE IS 26". THEREFORE IT IS POSSIBLE THAT THE ACCESS RAMP ATTACHED TO THE BUILDING COULD BE 26'-0" AT A SLOPE OF 1:12. ARCHITECT MUST TAKE INTO ACCOUNT THAT THE RAMP SUPPLIED BY MODTECH INC. IS 11'-0" AT A SLOPE OF 1:12. THEREFORE THE ARCHITECT WILL HAVE TO DESIGN AND PROVIDE DETAILS OF RAMP EXTENSIONS AND BOTTOM LANDING DEPENDING ON PARTICULAR SITE CONDITIONS. IN NO WAY IS MODTECH INC RESPONSIBLE FOR ANY RAMP EXTENDING THE ORIGINAL PLAN AS SHOWN ON THIS SHEET
6. ALL 1 1/4" AND 1 1/2" TUBE STEEL TO BE OF ASTM A500 GRADE A STEEL (Fy = 39 KSI)

REVISIONS

Professional Engineer's Seal
Mechanical Engineer's Seal
PC Professional of Record Seal
Architect's Seal

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
PC-04
104796
AC. PLS. SS MB
DATE: 7/2/03


MODTECH™
2830 BARRETT AVENUE PH (909) 943-4014
PERRIS, CALIF. 92571 FAX (909) 940-0427

PROJECT NUMBER: 4736
WILLIAM SCOTTSMAN


© MODTECH, INC. 2002
DRAWN BY: GL
DATE: 07/07/03
CHECKED BY:
DATE:
MODTECH Index No.
R5.01

RAMP/LANDING 11' RAMPS


PROJECT NO. 4736

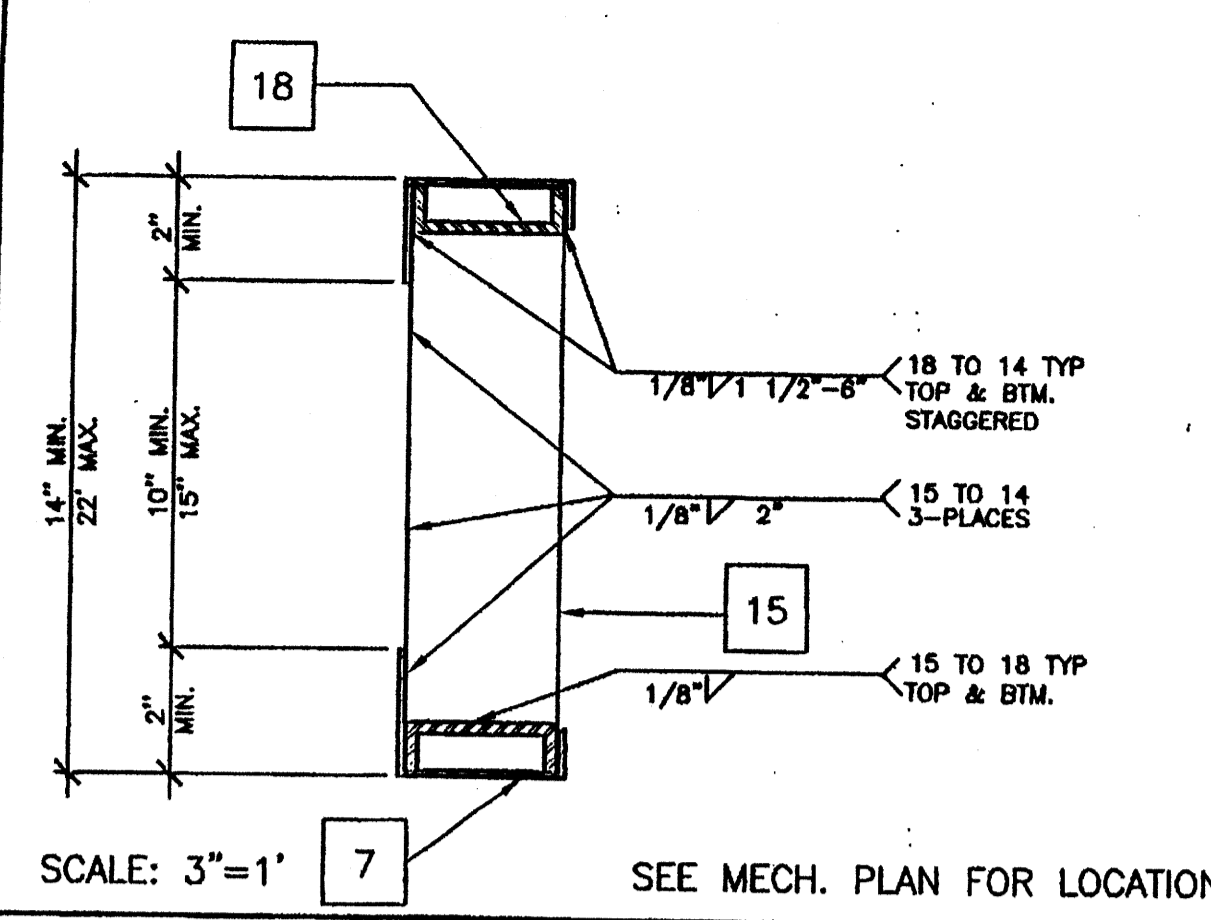


MECH. DUCT OPENING IN ROOF BM. 8

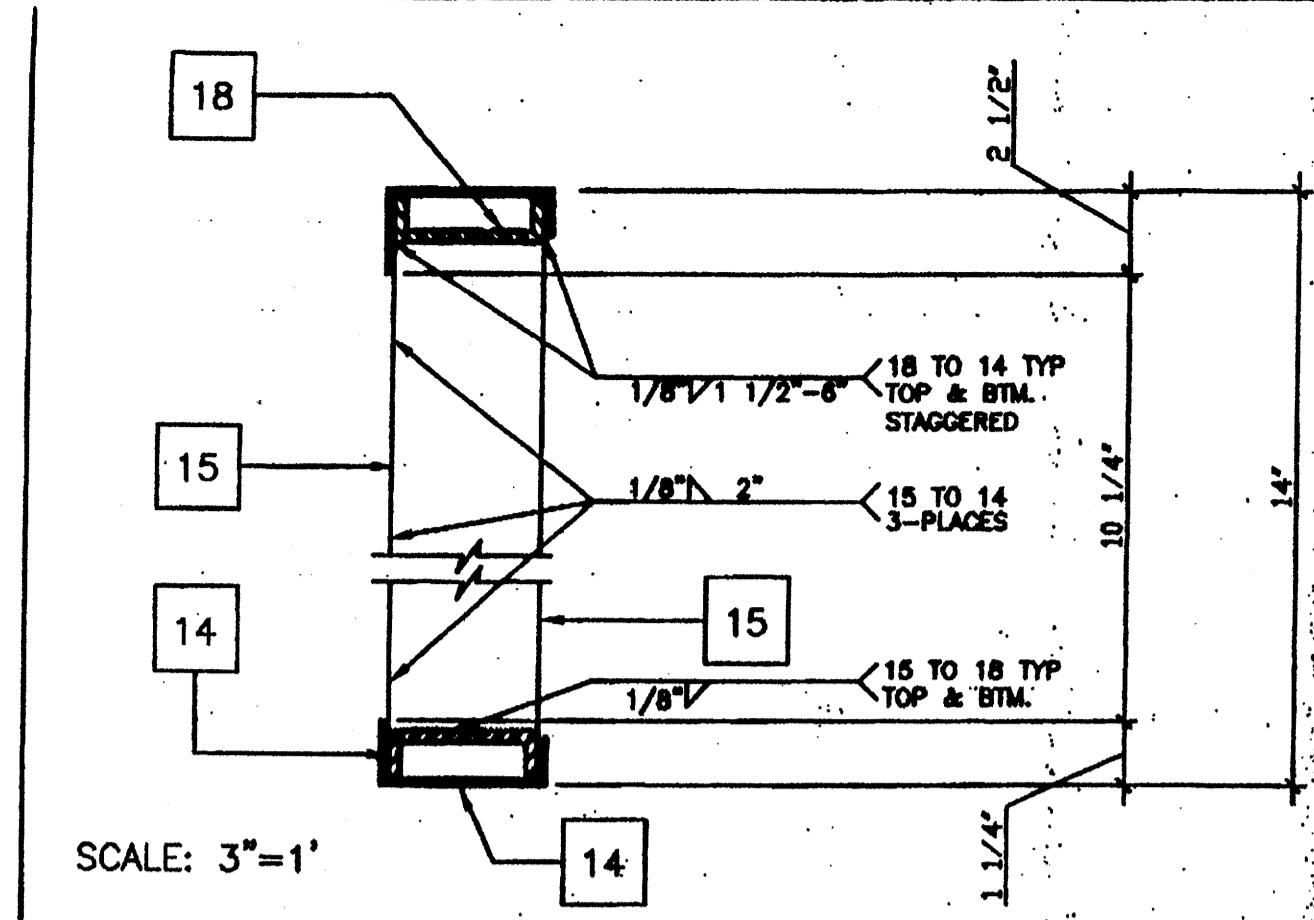


MECH. DUCT OPENING IN HEADER 4

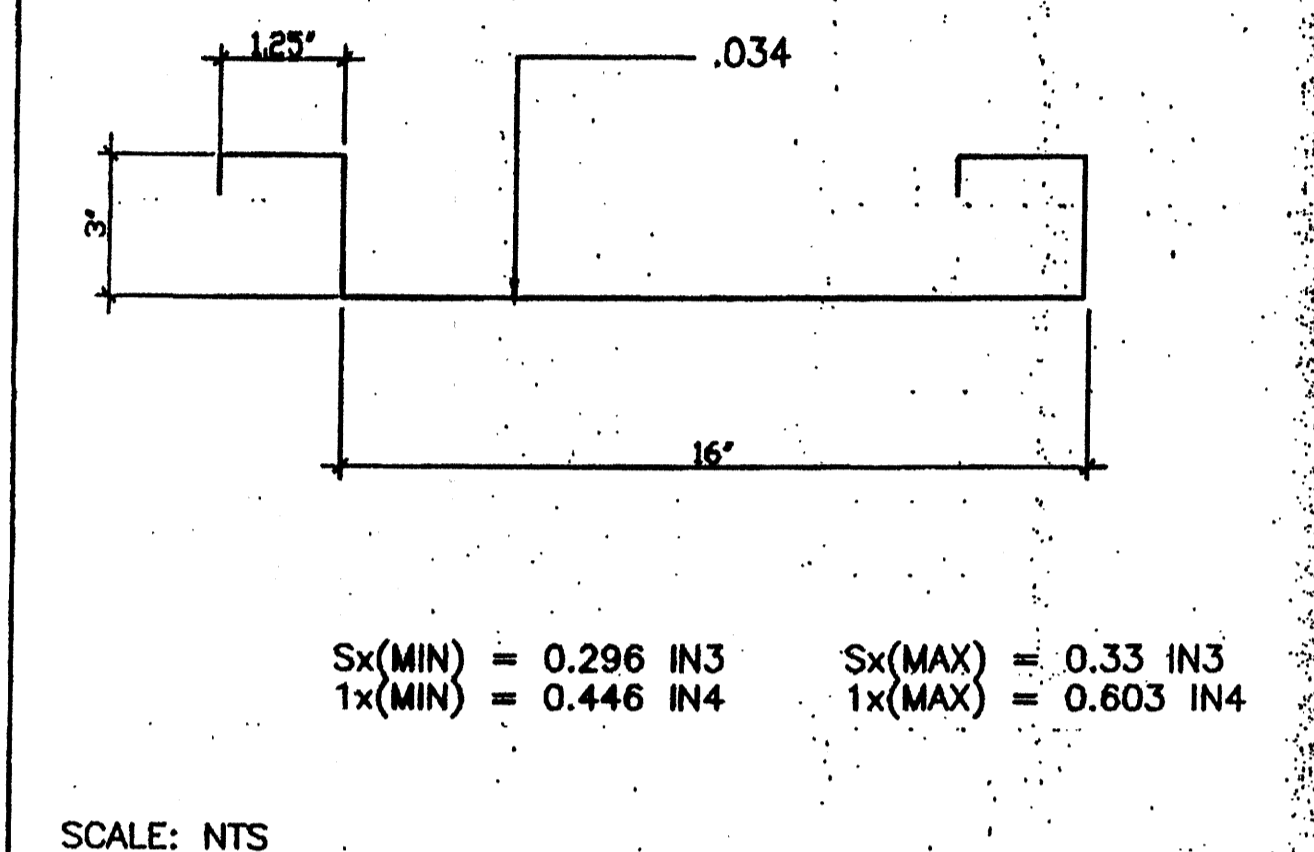


ROOF PAN (22GA.) 5

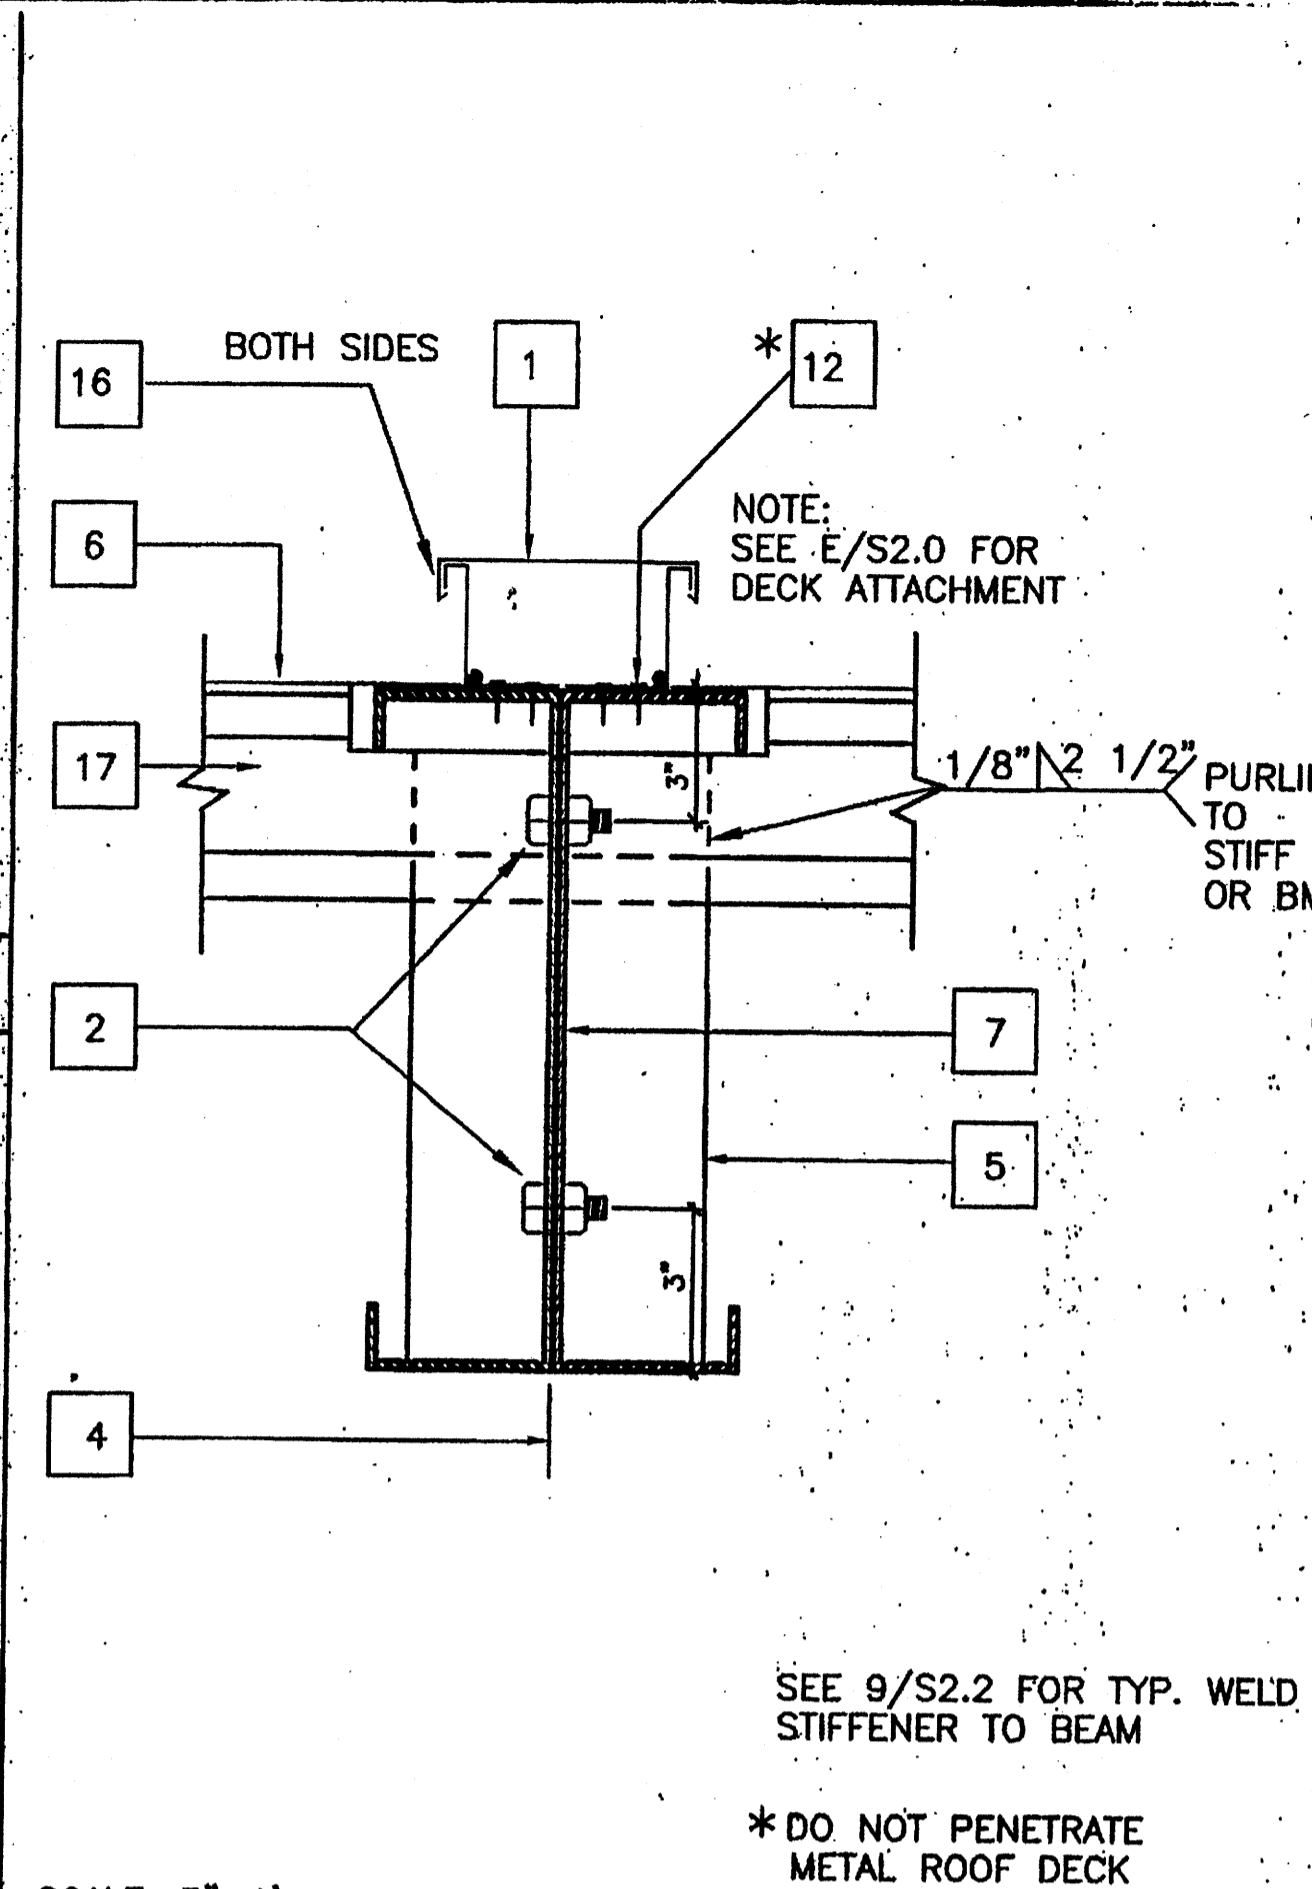


ROOFING • MODLINE 1

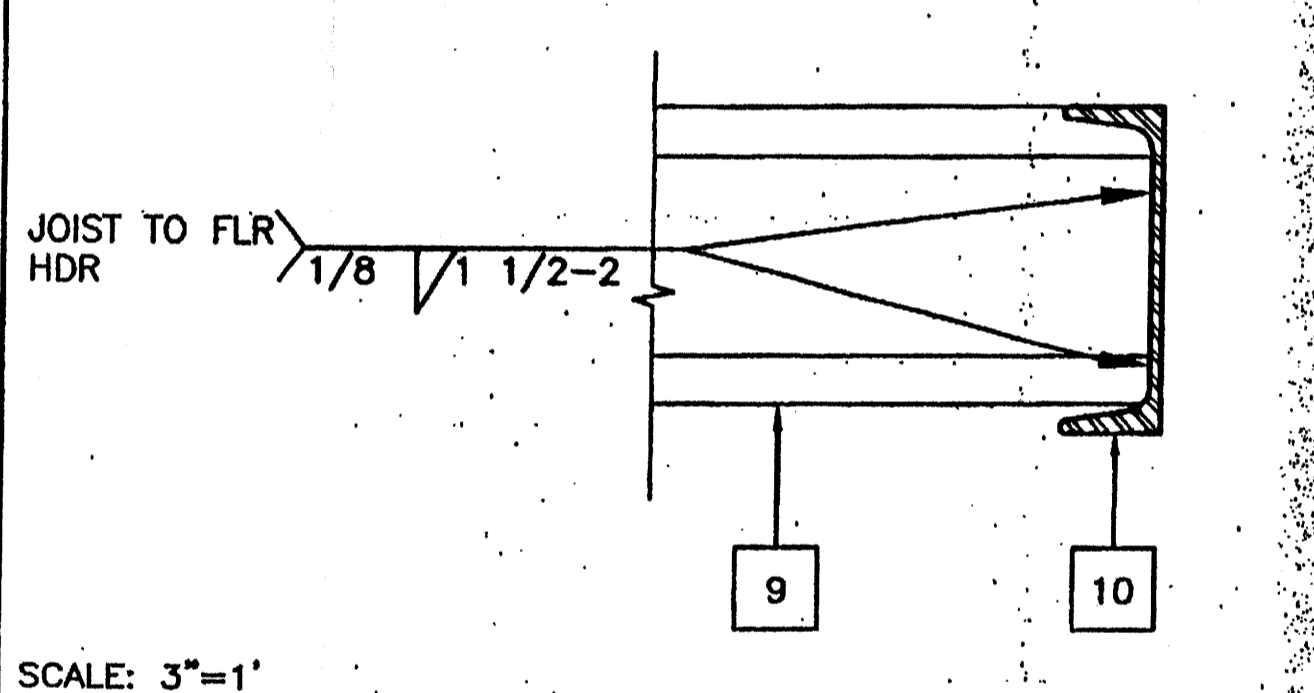


FLOOR FRAME/JOIST TO BEAM 6

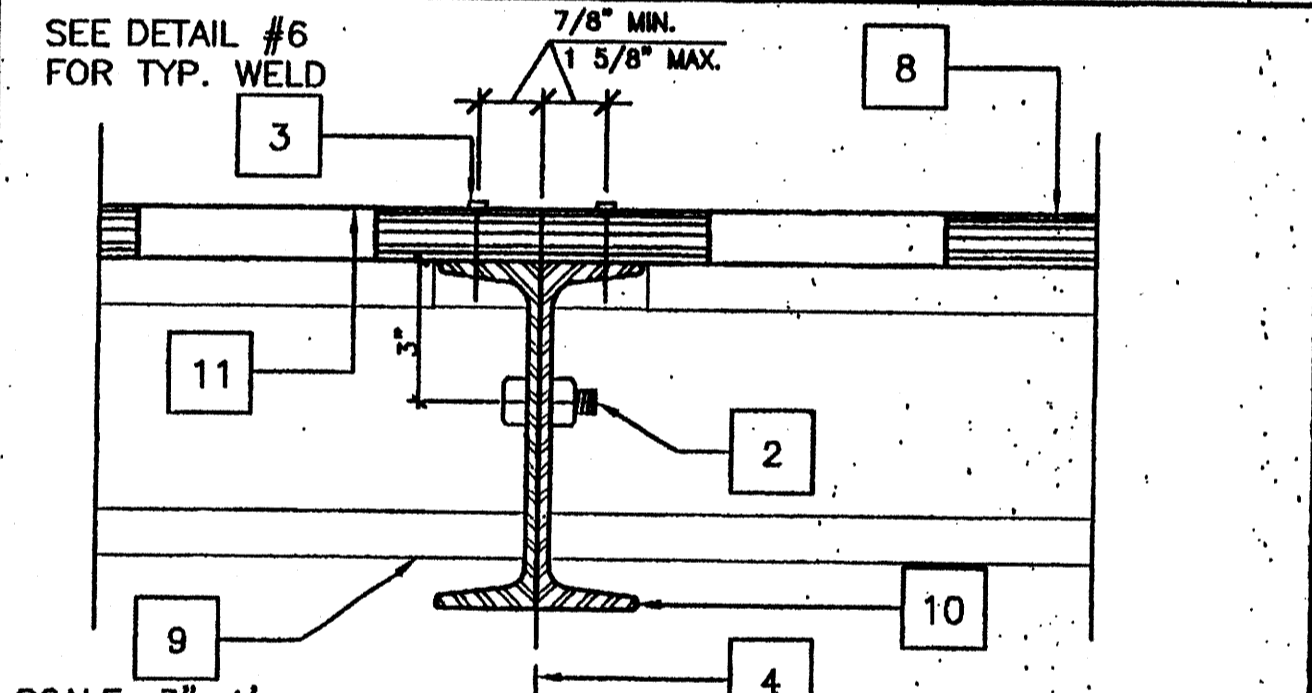

MODULE JOINT AT FLR. 12'-0" 2

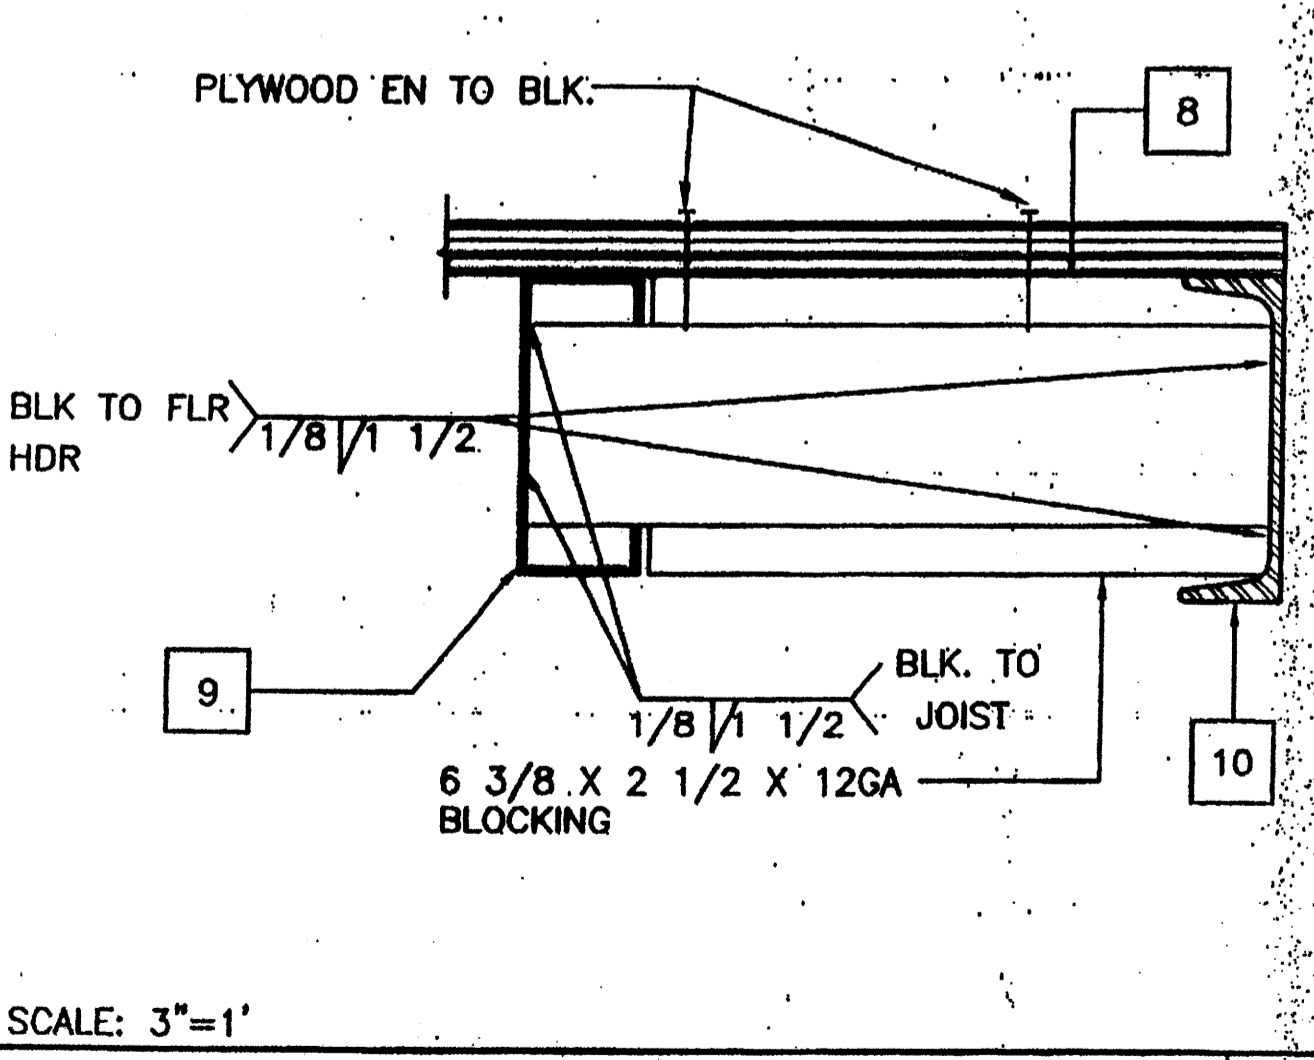

BLOCK AT MIDSPAN 10

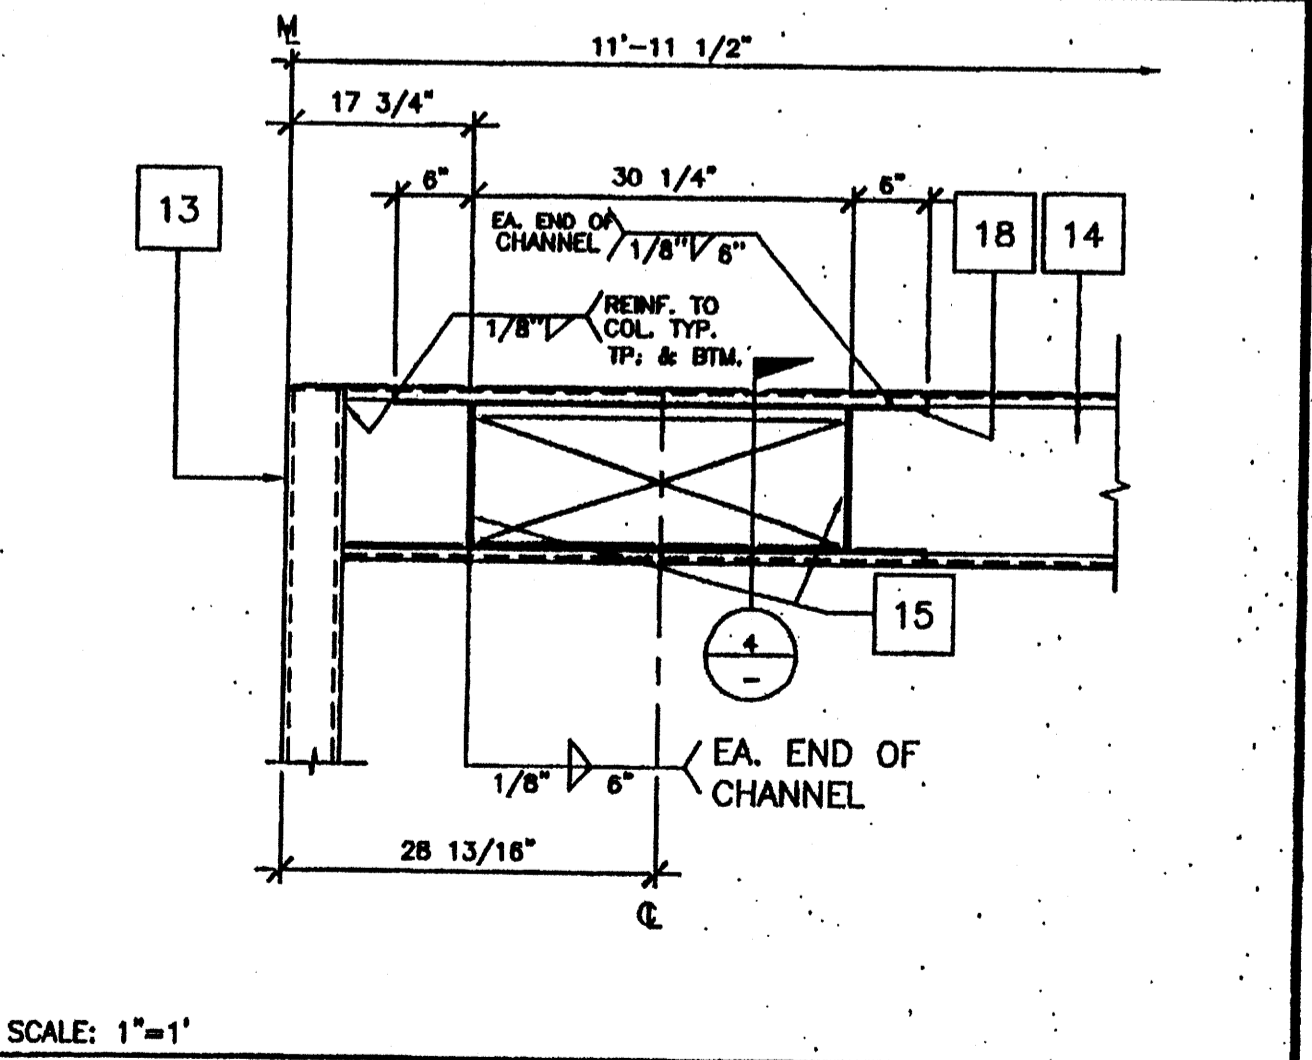

ELEVATION-OPENING 7

- KEY NOTES**
- 1 CAP CLOSURE AT RIDGE 26GA. GALV. W/#10 TYPE FASTENERS W/NEOPRENE WASHERS TO RIB BOTH SIDES OF MODLINE. SET CAP IN SEALANT. BOTH SIDES.
 - 2 5/8" M.B. A307 MODULE JOINT (SEE STRUCTURAL PLAN FOR LOCATION) AT 8" O.C.
 - 3 E.N.
 - 4 MODULE JOINT
 - 5 1/4" THK X 3" FULL DEPTH STIFFENER PLATE AT RIDGE ONLY (SEE 9/S2.2)
 - 6 STANDING ROOF SEAM (SEE A2.0)
 - 7 ROOF BEAM SEE 1/S2.2 & 7/S2.2
 - 8 PLYWOOD FLOOR SHEATHING
 - 9 FLOOR JOIST SEE 6/S2.2
 - 10 FLOOR BEAM SEE 5/S2.2
 - 11 HAND HOLE AT BOLT LOCATION
 - 12 #14 STSMS.
 - 13 3 1/2"x3 1/2"x1/4" STEEL TUBE COLUMN. SEE 12/S2.2
 - 14 ROOF HEADER SEE 3/S2.2
 - 15 1/4" STIFFENER PLATE SEE 9/S2.2 FOR TYP. WELD
 - 16 SEALANT
 - 17 ROOF PURLIN SEE 2/S2.2
 - 18 3 1/4" X 1" X 45 11/16" LG X 10GA CHANNEL TOP AND BOTTOM OF OPENING

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
04 105455
AC RES 1 16
DATE JUL 17 2002

~~04 105455
DATE JUL 10 2002~~

REVISIONS	Electrical Engineer's Seal	Mechanical Engineer's Seal	PC Professional of Record Seal	Architect's Seal

PC
CBC 2001
IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
PC-04
AC RES SS
DATE

MODTECHTM
2830 BARRETT AVENUE FAX (909) 943-4014
PERRIS, CALIF. 92572 FAX (909) 940-0427


PROJECT NUMBER: 4736
WILLIAM SCOTTSMAN
STRUCTURAL DETAILS

© MODTECH, INC. 2002
ALL RIGHTS RESERVED
DRAWN BY: GL
DATE: 07/07/03
CHECKED BY: DATE:
MODTECH Index No.
S1.2


PROJECT NO. 4736

KEY NOTES


- 1 10GA. TAPERED RF. BM. SEE DETAIL #1 & #7
- 2 NOT USED
- 3 TS 3 1/2"x3 1/2"x1/4" COLUMN
- 4 14"x12GA. RF. HDR. SEE DETAIL #3
- 5 NOT USED
- 6 FLOOR JOIST SEE DETAIL #6
- 7 10GA. BENT PLATE BACK-UP
- 8 STIFFENER PLATE 3"x1/4" THICK AT 4'-0" OC
- 9 #10 STMS @ 6" O.C. (SEE S1.0)
- 10 PLYWOOD FLR. SHEATHING
- 11 FLOOR BEAM SEE DETAIL #5
- 12 NOT USED
- 13 6" X 2 1/2" X 14GA PURLIN
ALT: 4" X 3" X 12GA DETAIL #2
- 14 STIFFENER PLATE 3"x1/4" THICK AT 8'-0" OC

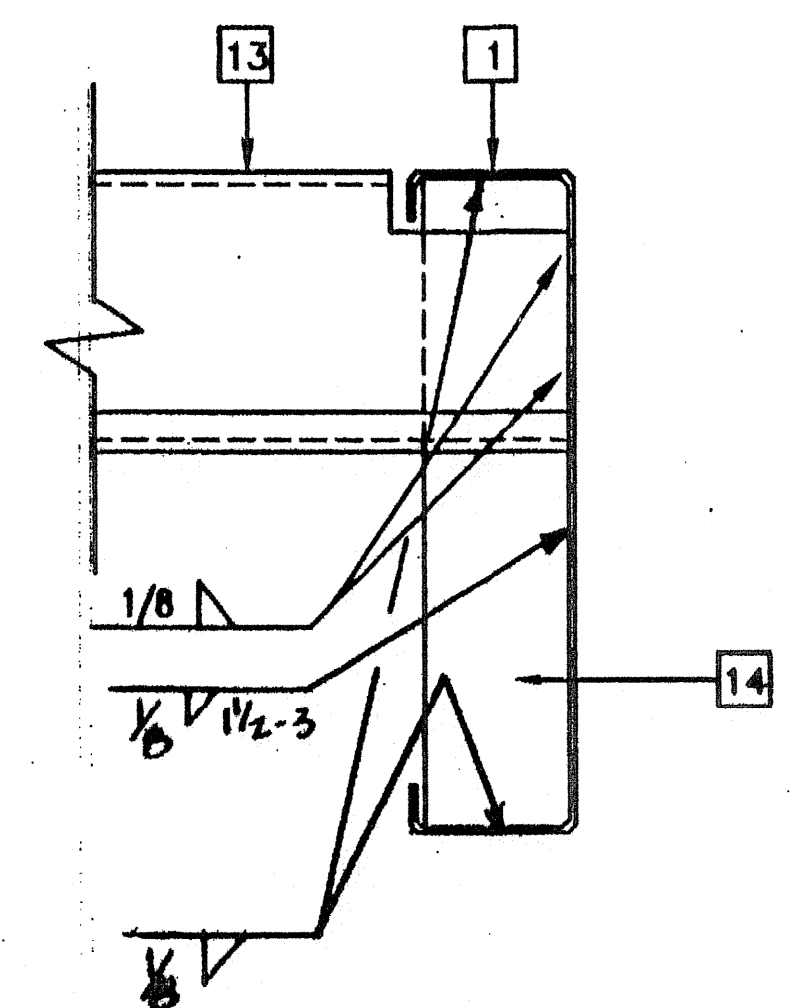


PURLIN AT INT. SIDE WALLS 13

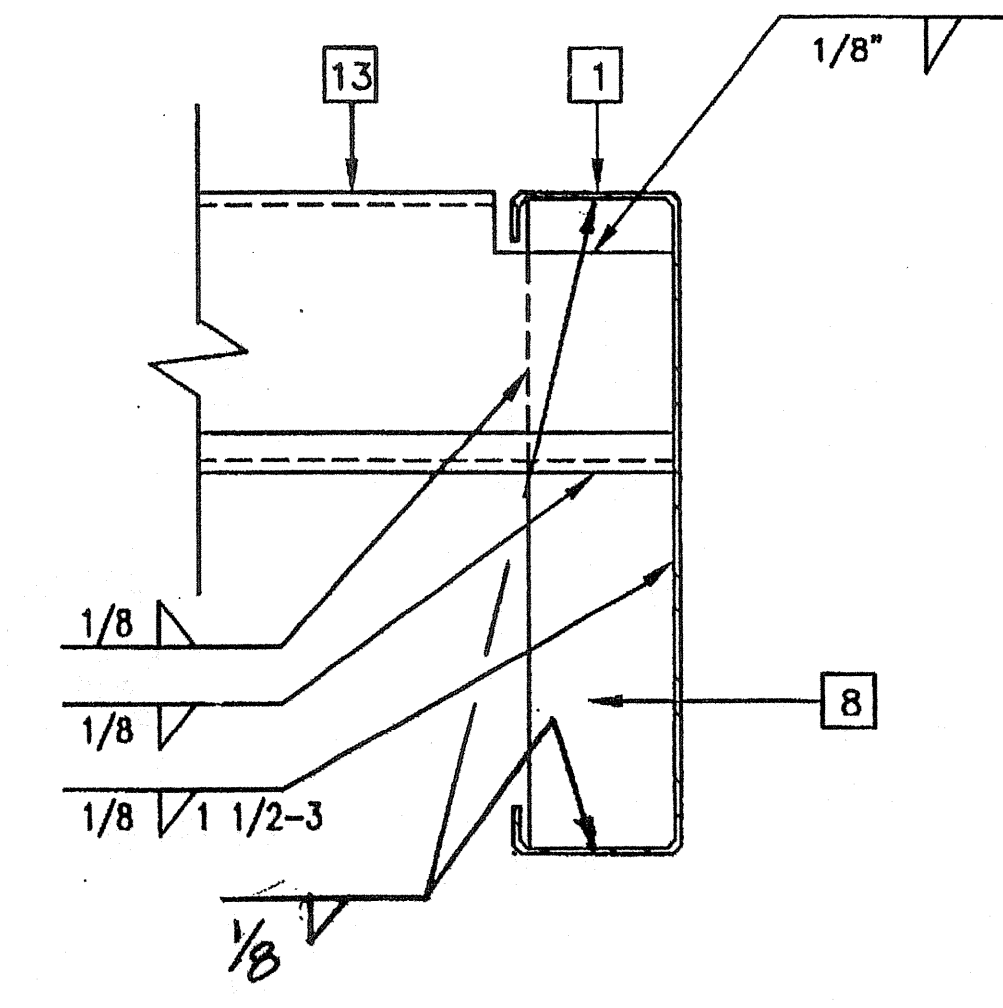


PURLIN AT EXT. SIDE WALLS 11

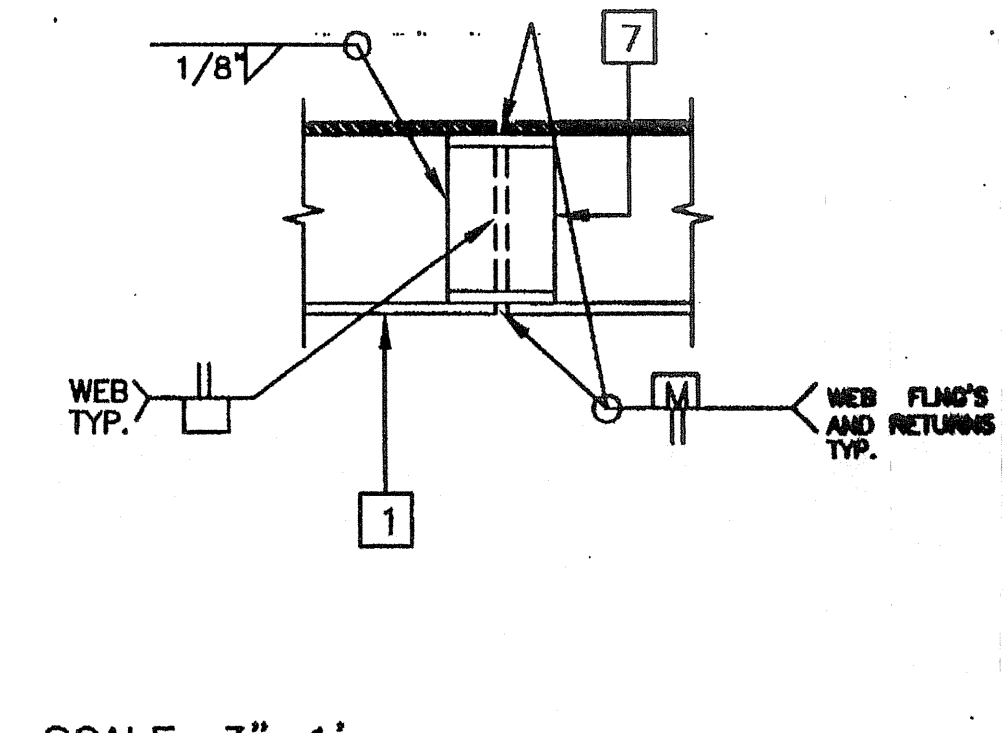


BEAM SPLICE AT RIDGE 8

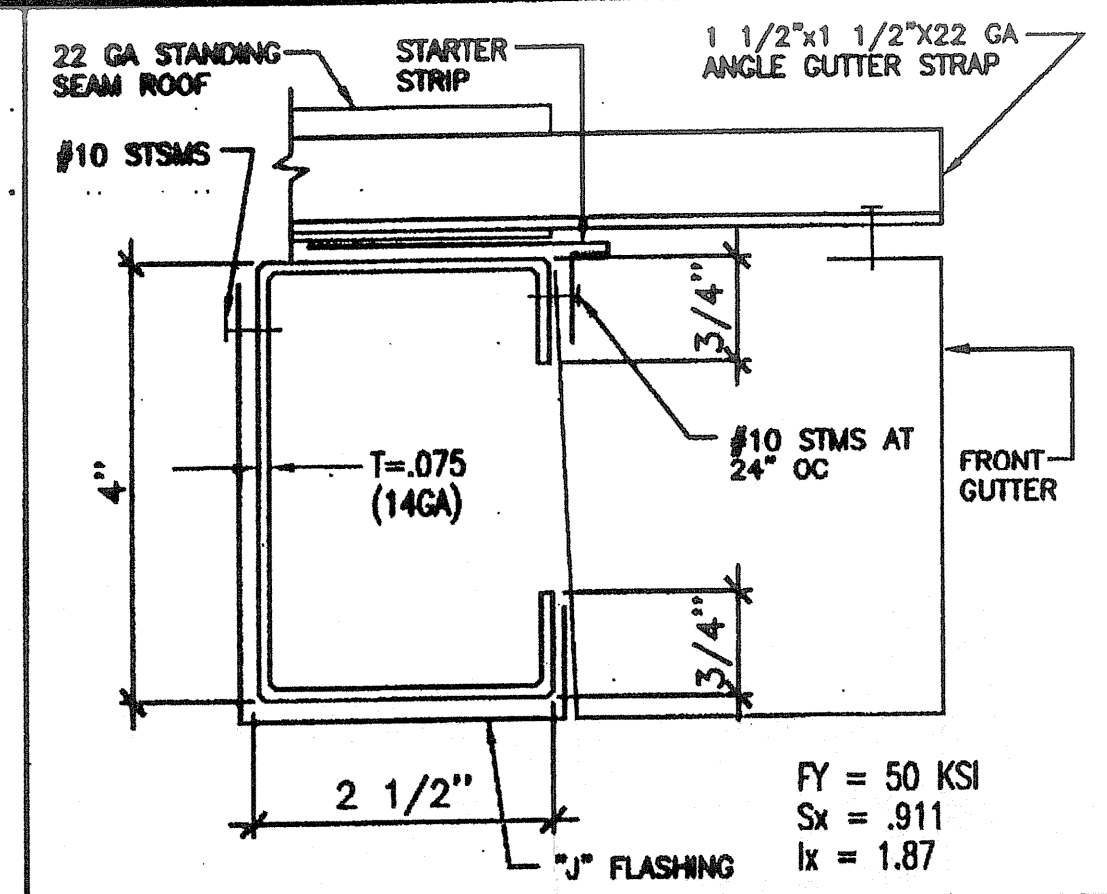


OPTIONAL FACIA AT 5' OVERHANG BM. 4

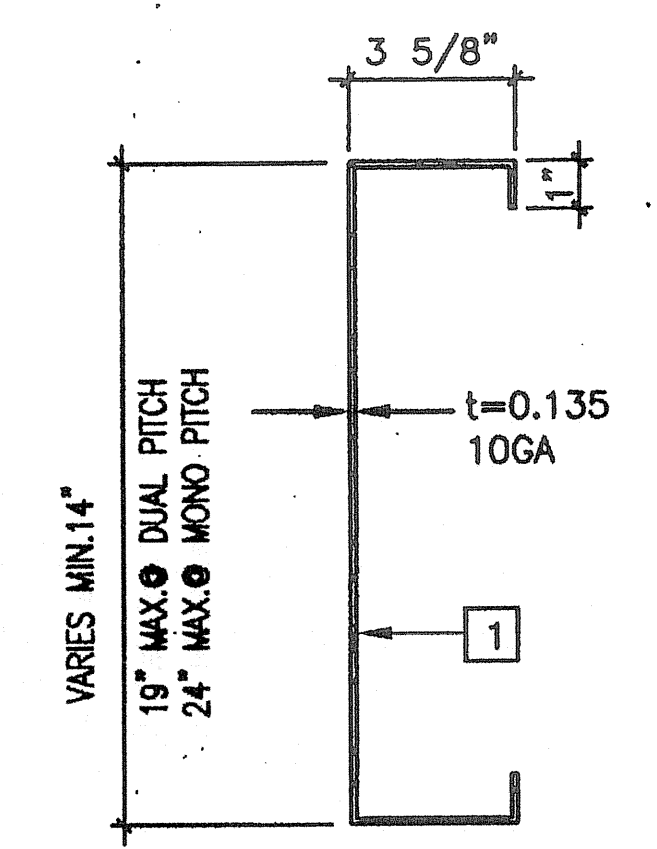



TAPERED ROOF BEAM 1

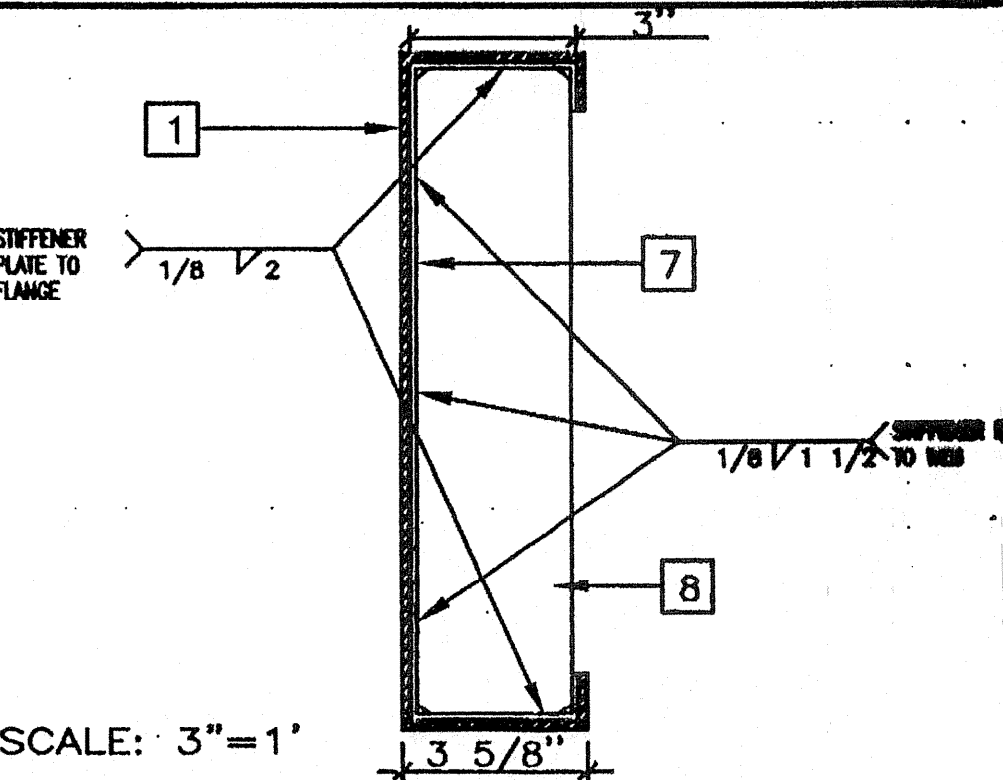


BEAM SPLICE W/STIFFENER 9

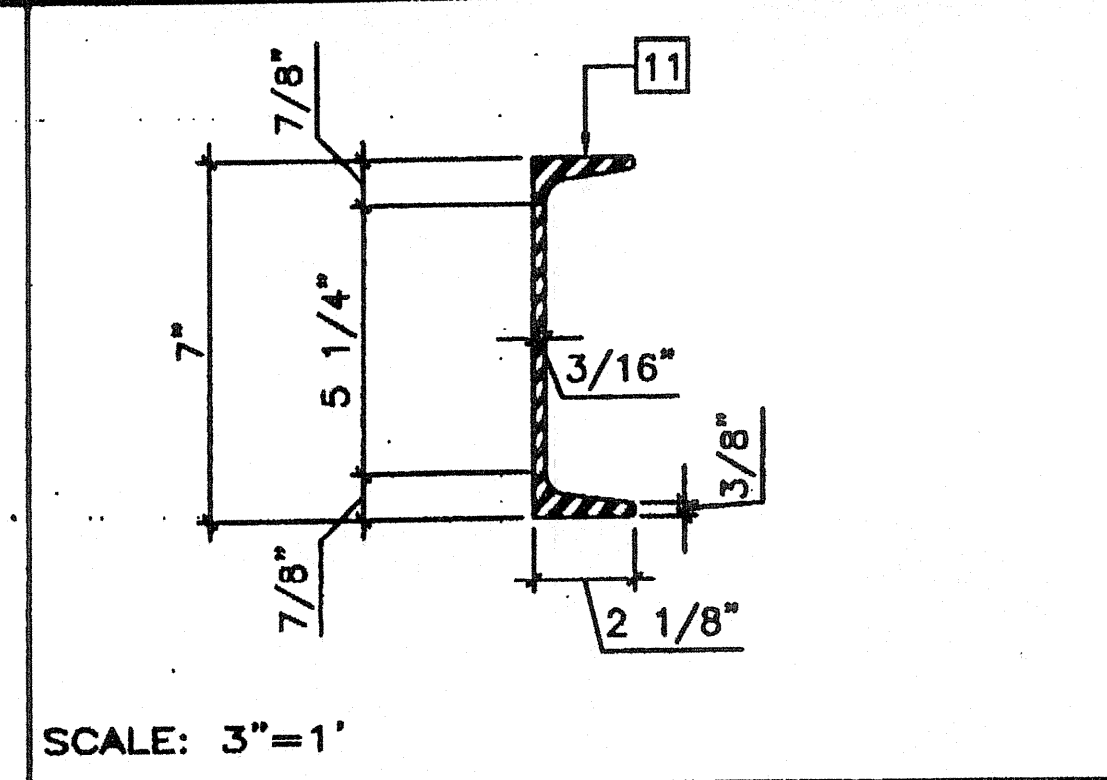


FLOOR BEAM C7X9.8 5

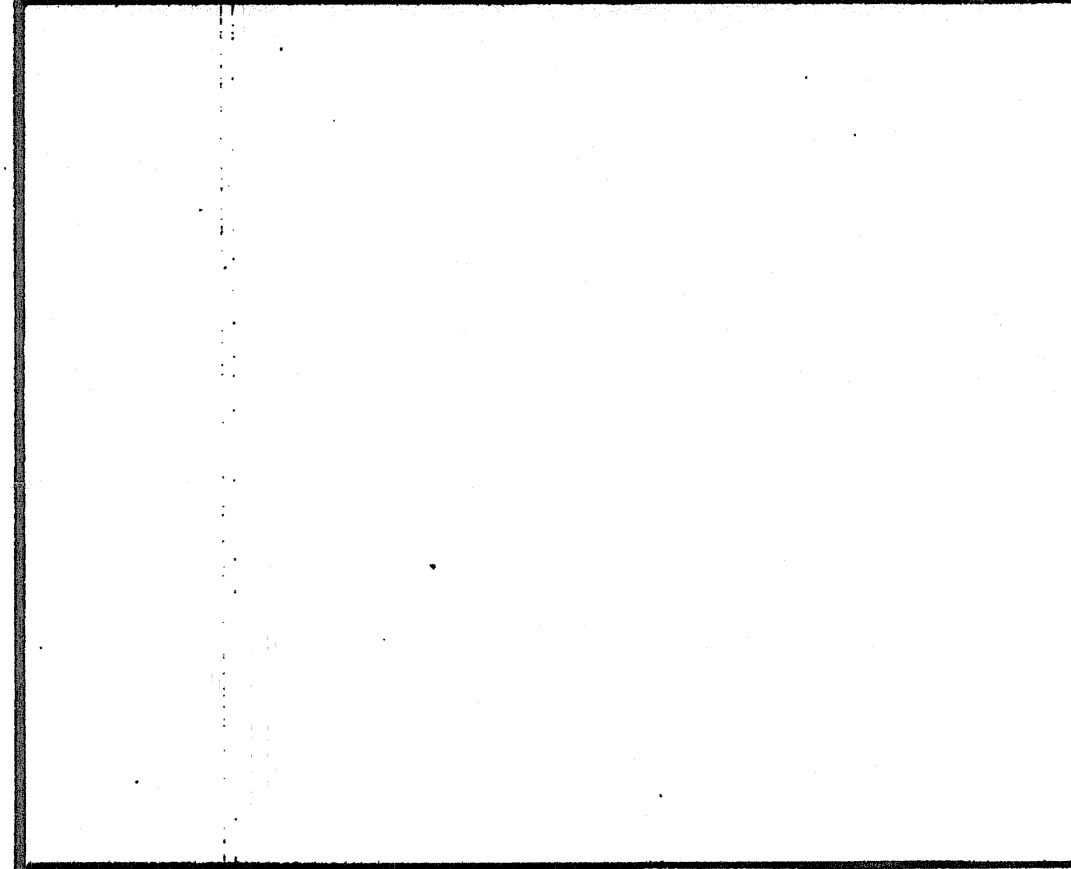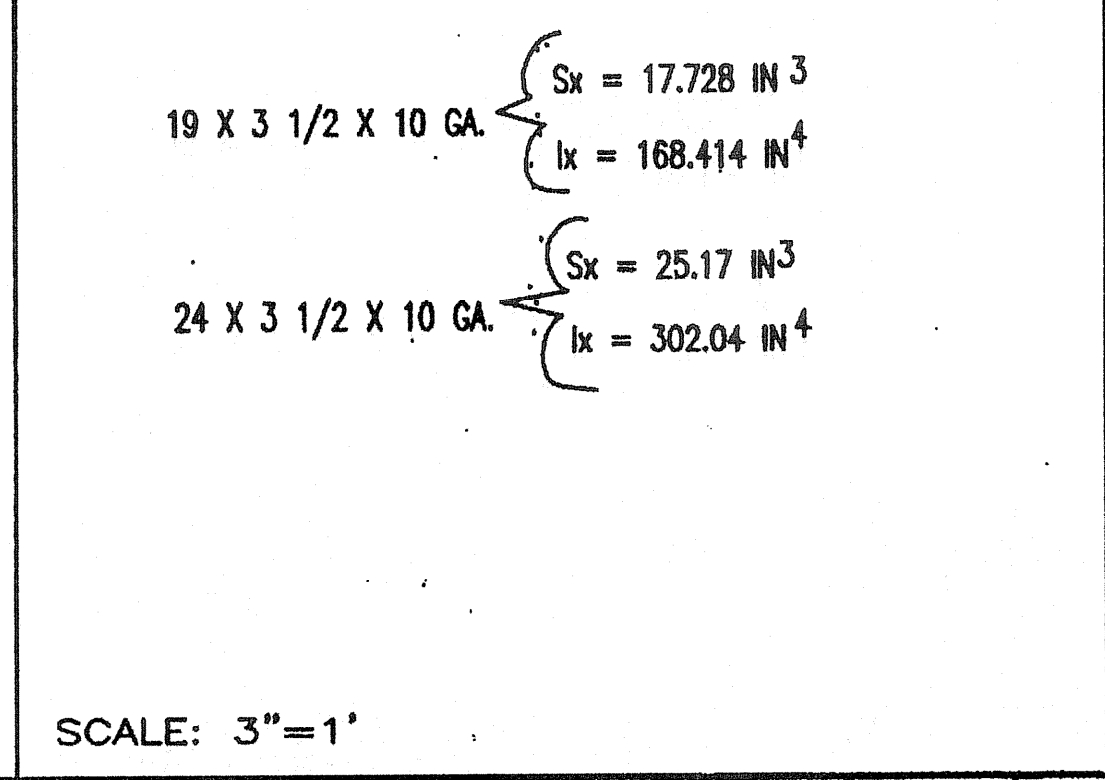


CORNER COLUMN 12

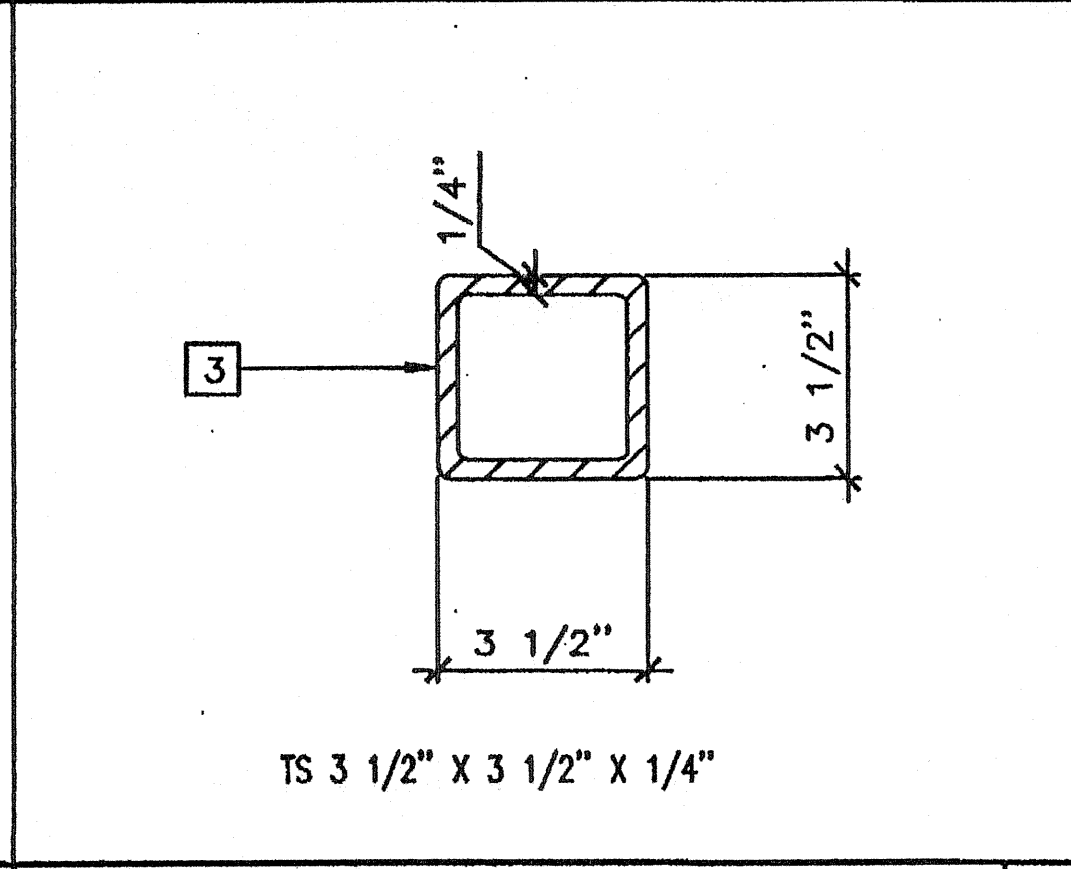


FLR LOIST AT FLOOR BEAM 10

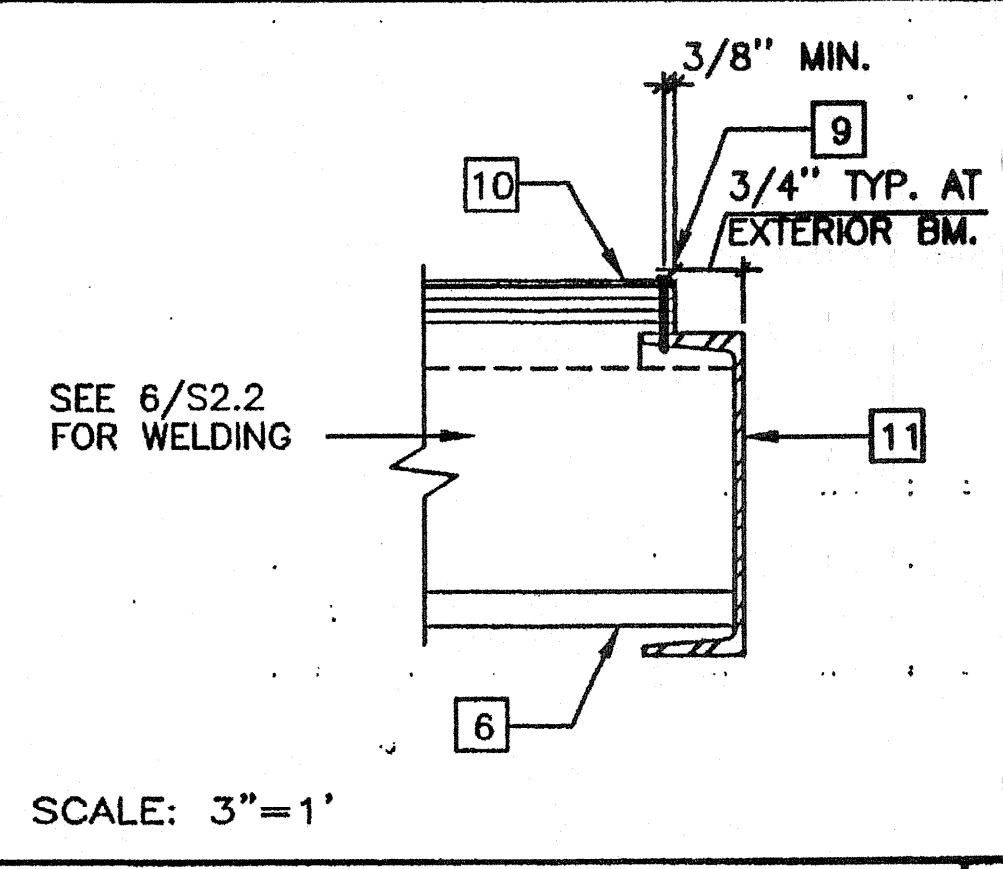


FLOOR JOIST 6

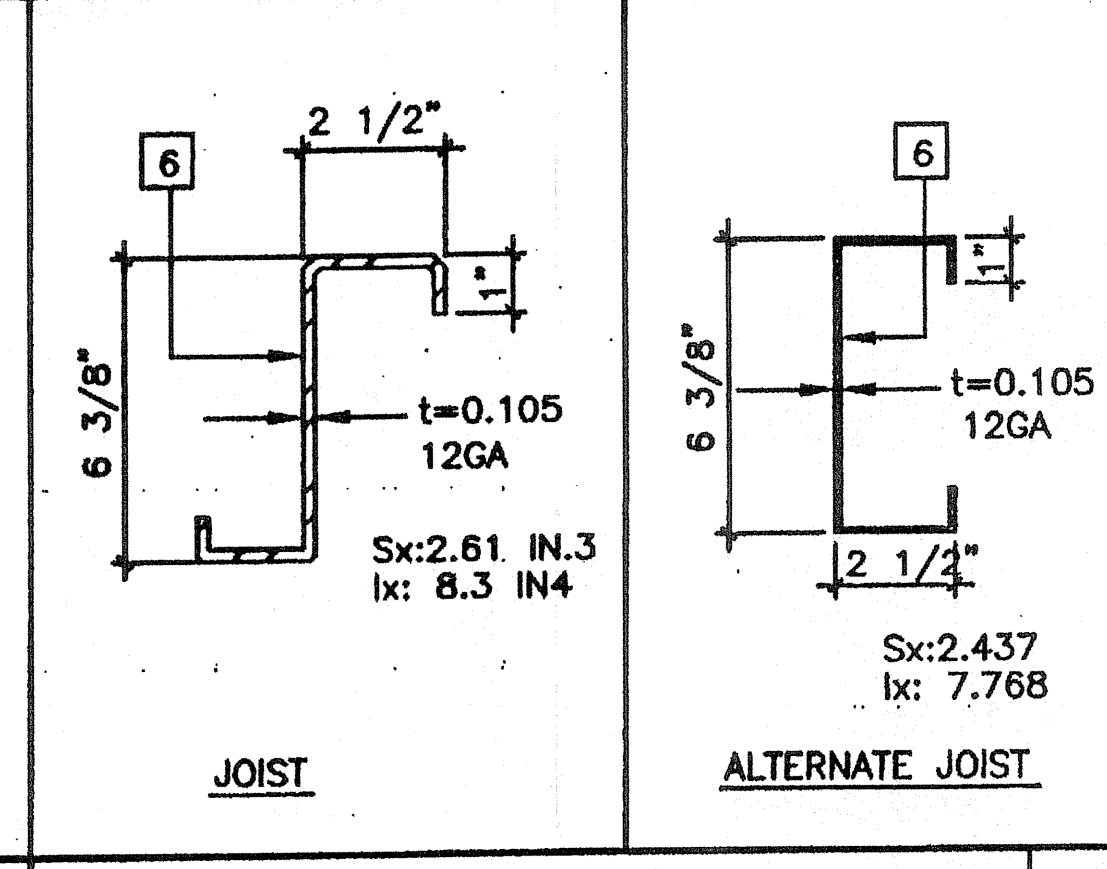


ROOF PURLIN 3" = 1'-0" 2

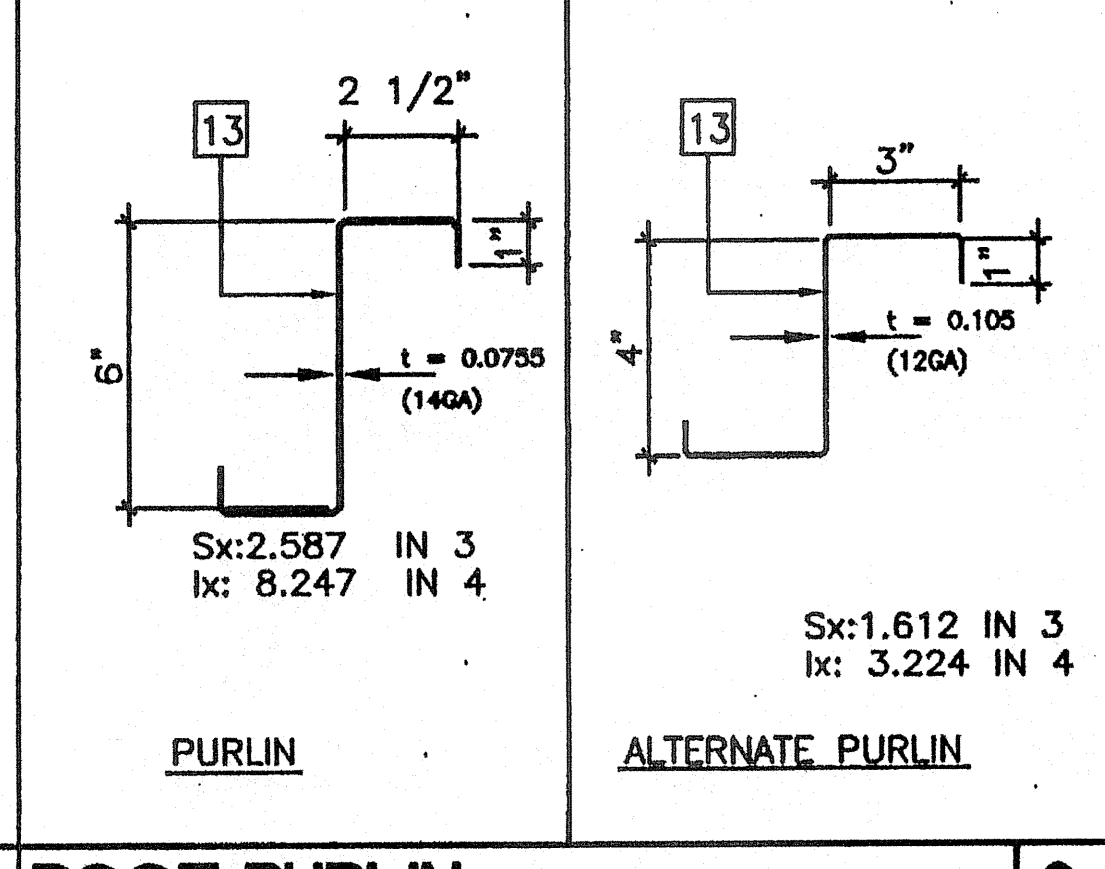


ROOF PURLIN 3" = 1'-0" 2

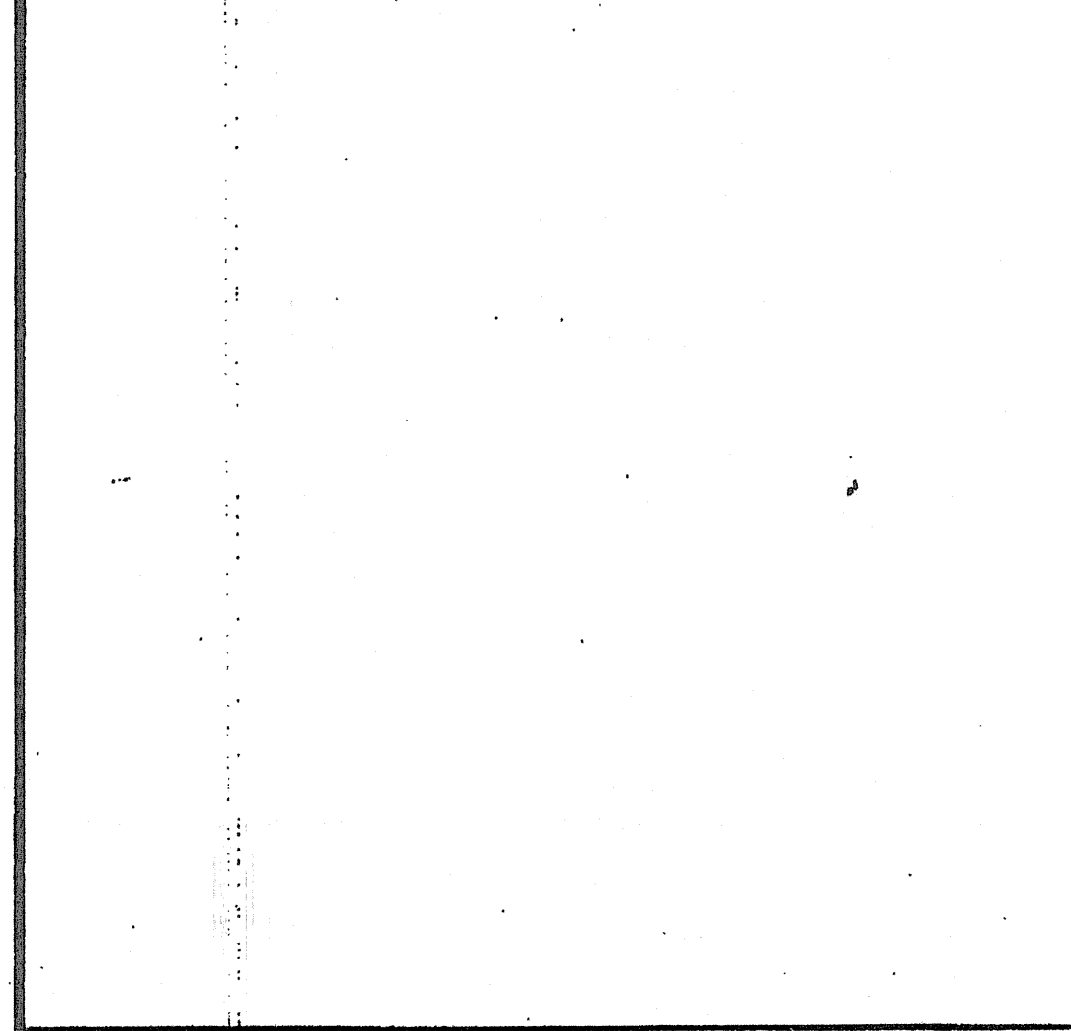


BM. SPLICE • RIDGE (DUAL SLOPE) 7

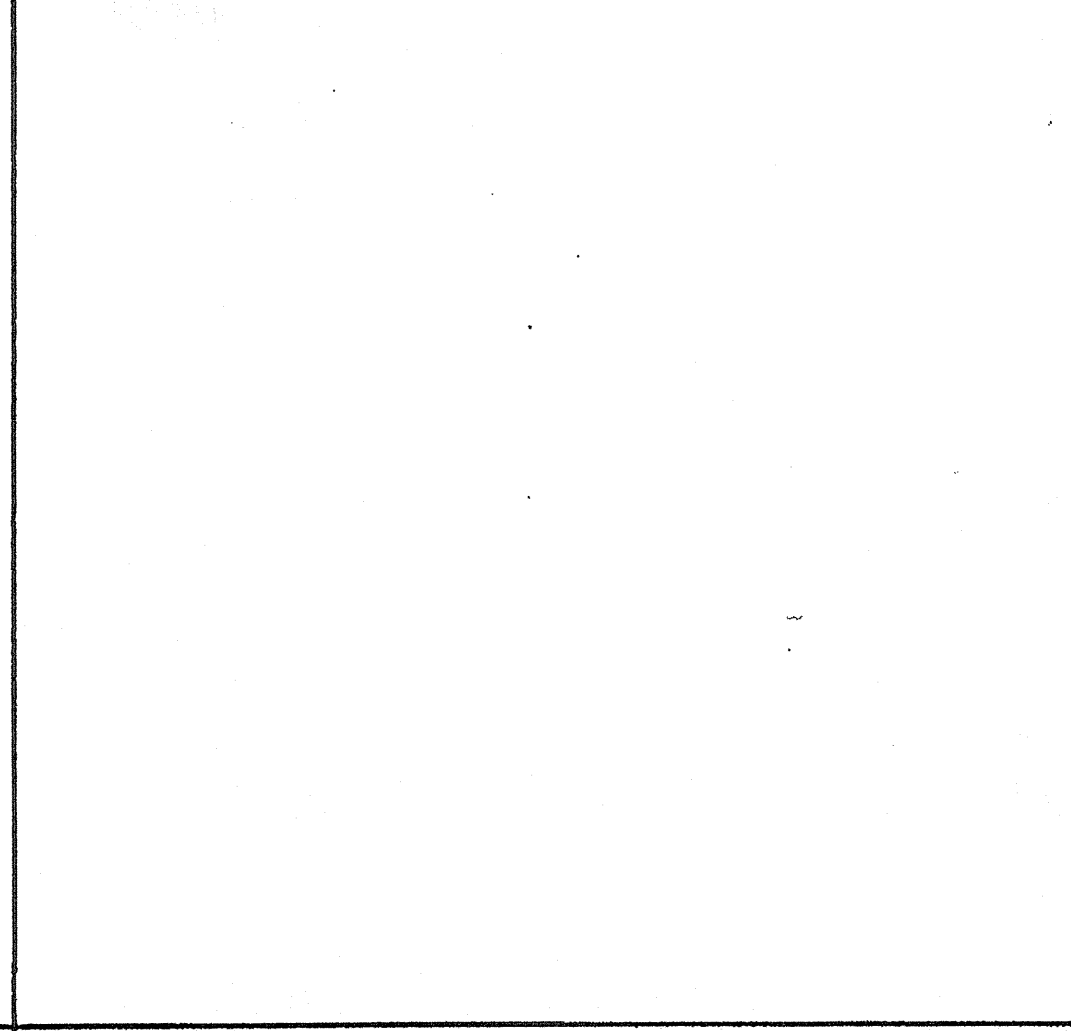


ROOF HEADER 3

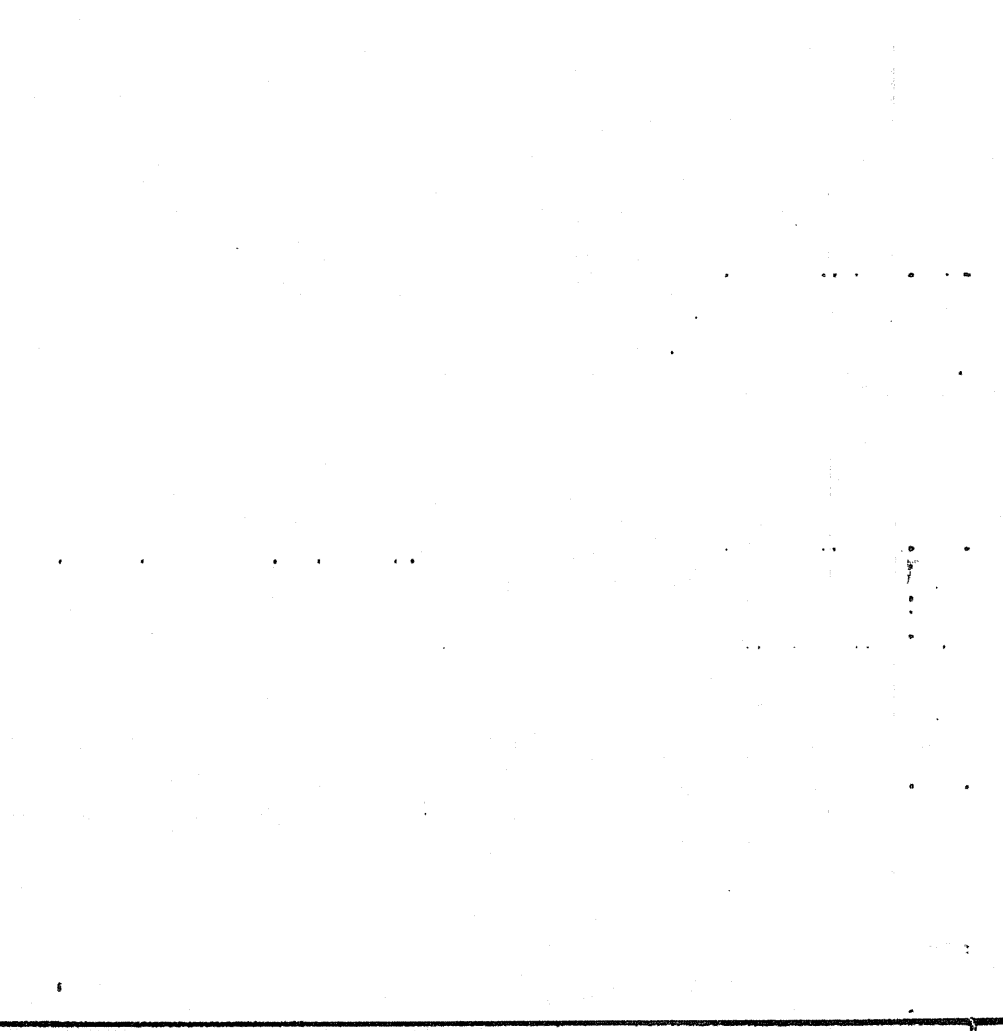

BM. SPLICE • RIDGE (DUAL SLOPE) 7

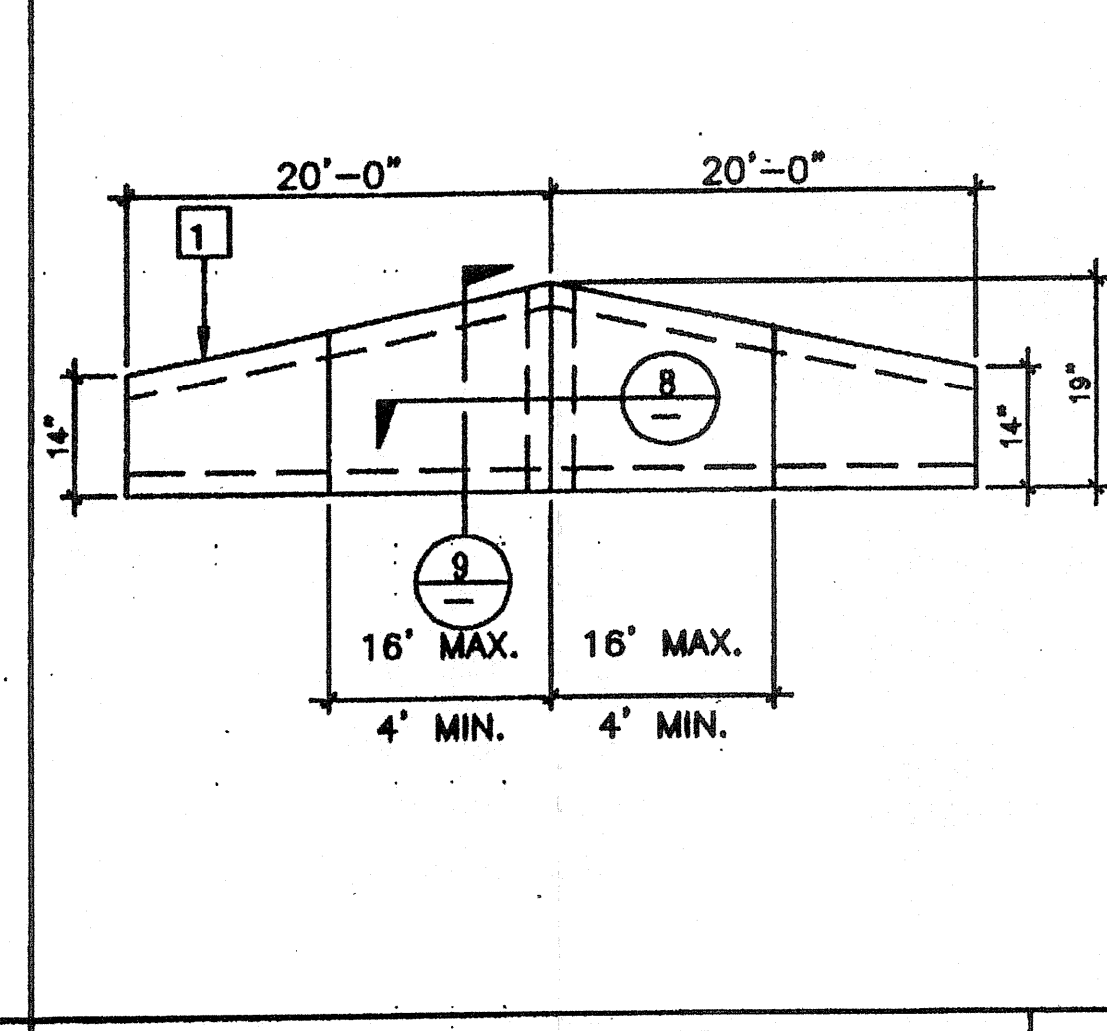

ROOF HEADER 3

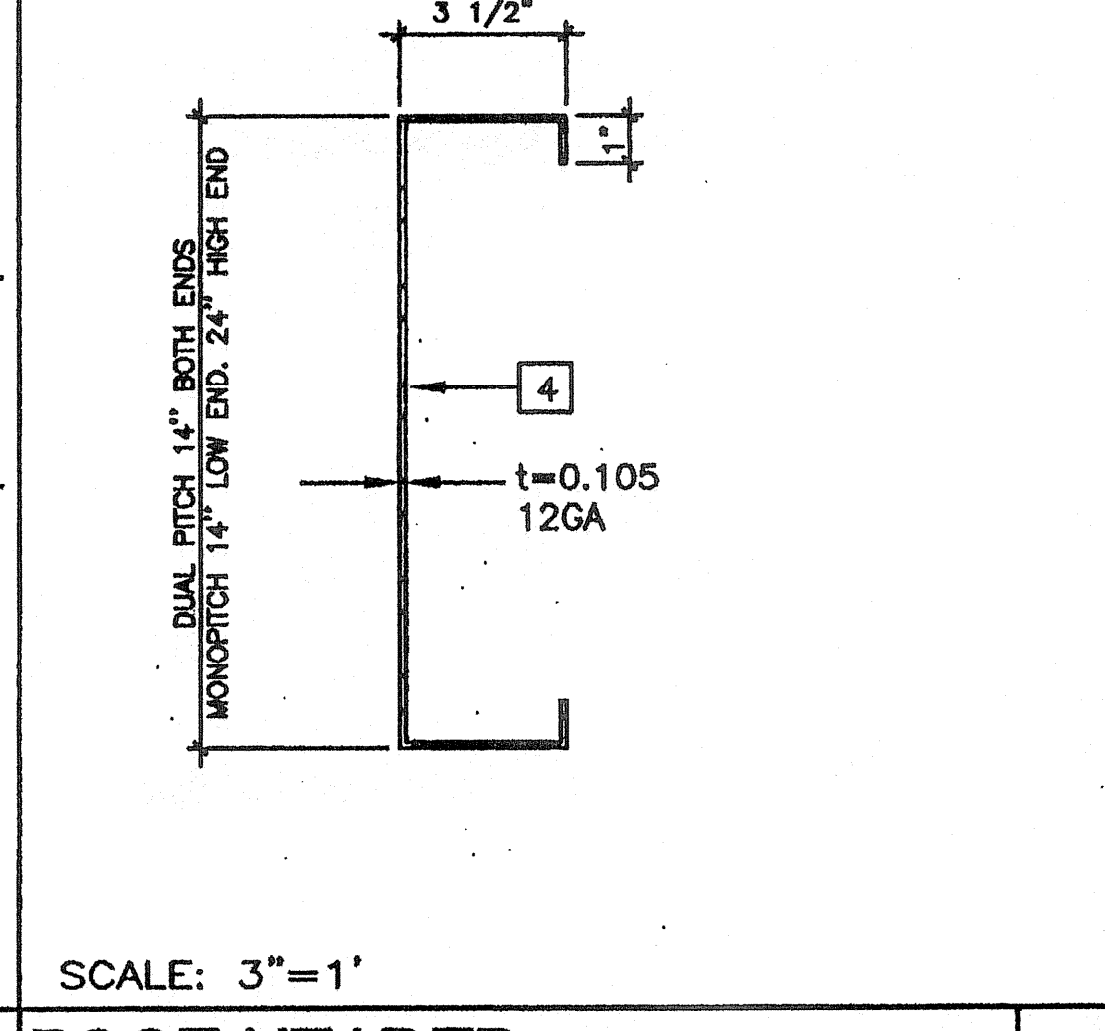

ROOF HEADER 3

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
04 105455
AC FLS 1/3
DATE JUL 17 2003

OFF: 105455
DATE: JUL 10 2003

NO.	DESCRIPTION	DATE

Professional Seals for Electrical, Mechanical, PC Professional of Record, and Architects.

PC CBC 2001 IDENTIFICATION STAMP DIV. OF THE STATE ARCHITECT OFFICE OF REGULATION SERVICES PC-04 104796

MODTECH INC. 2830 BARRETT AVENUE FAX (909) 943-4014 PERRIS, CALIF. 92572 FAX (909) 940-0427



PROJECT NUMBER: 4736 WILLIAM SCOTTSMAN

MODTECH, INC. 2002 ALL RIGHTS RESERVED

DRAWN BY: GL DATE: 07/07/03 CHECKED BY: DATE: MODTECH Index No.

STRUCTURAL DETAILS S2.2






PROJECT NO. 4736

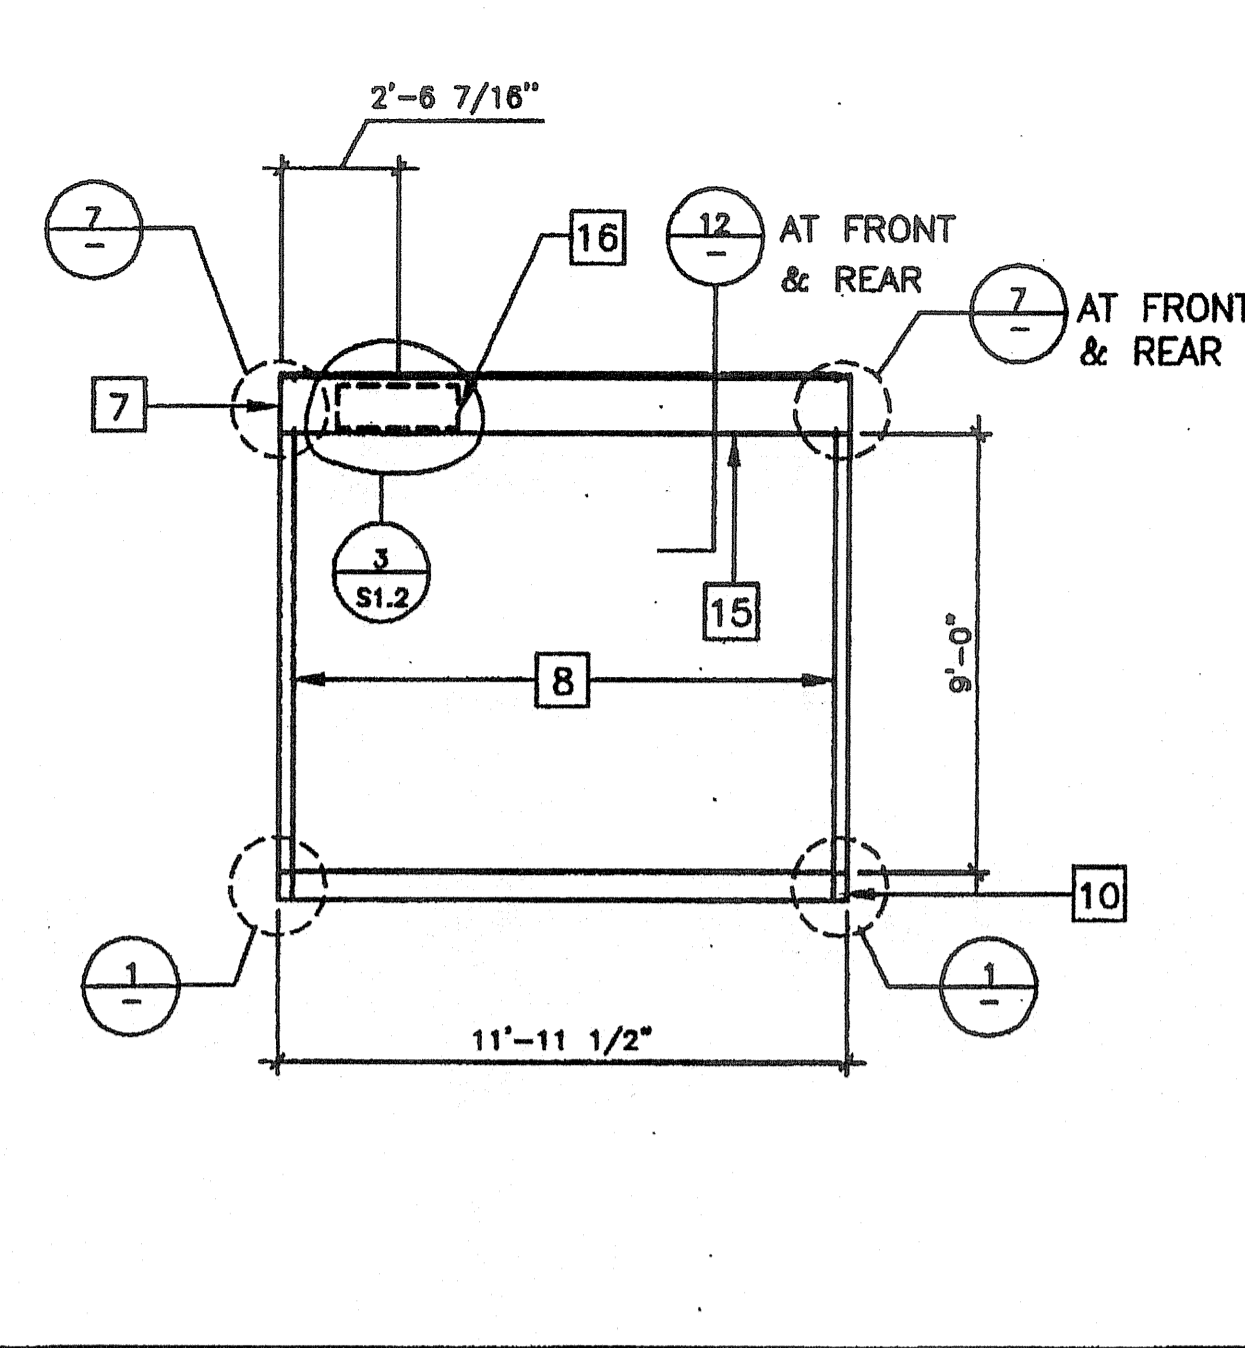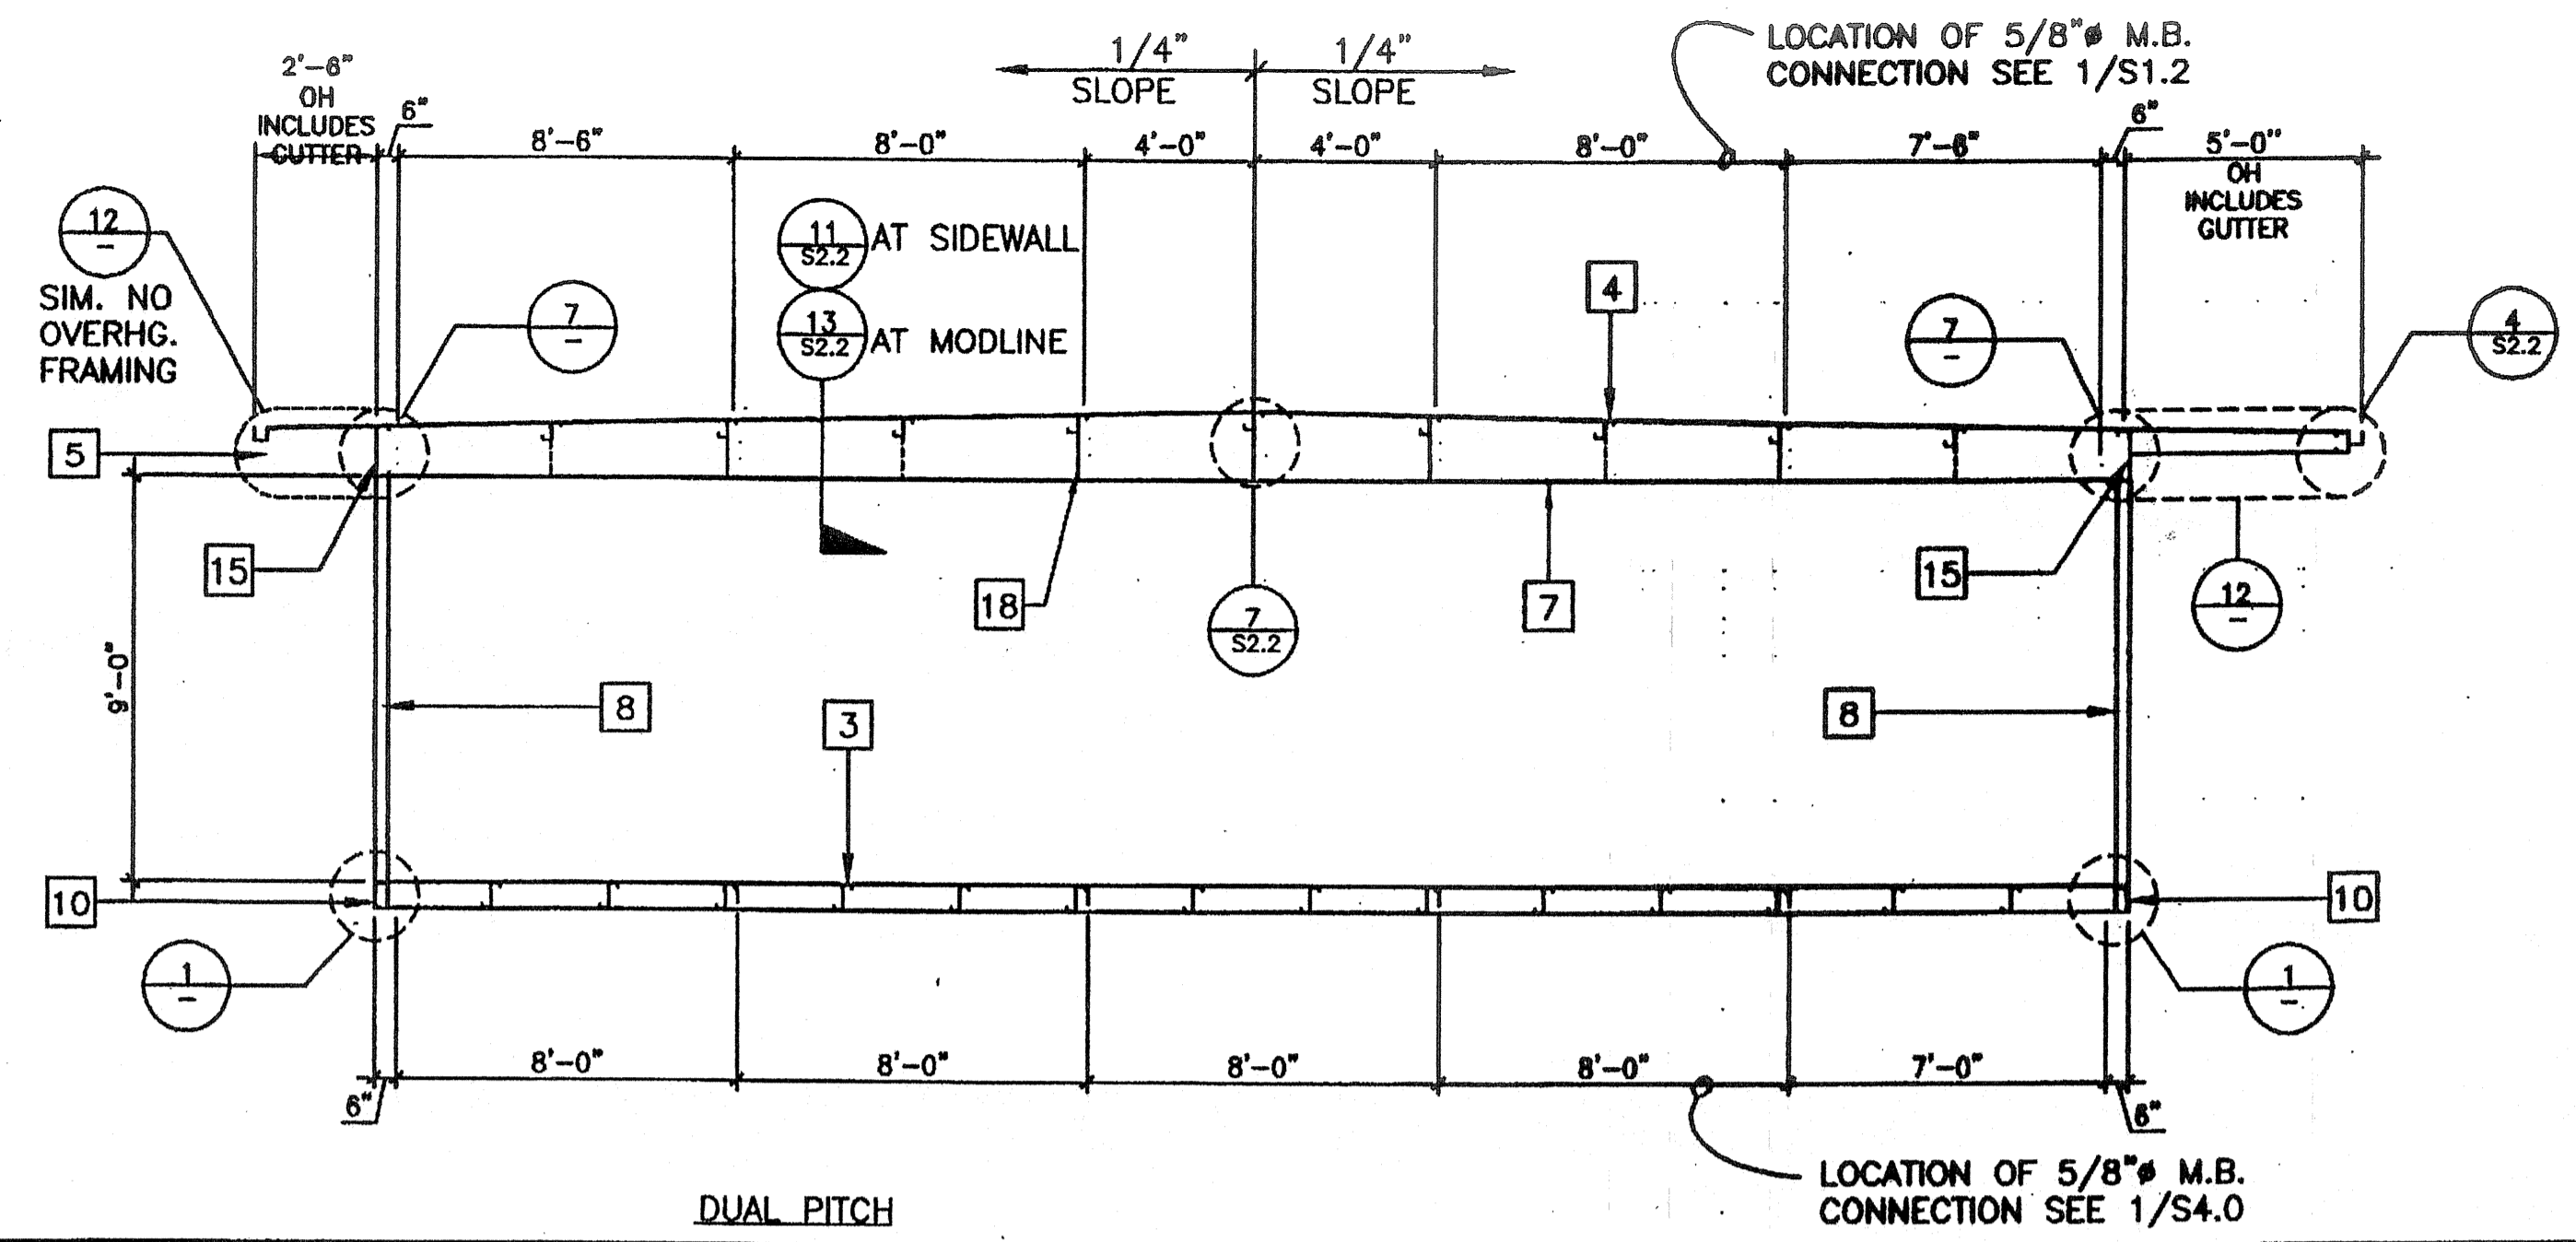

- ### KEY NOTES
- EN PLYWOOD EDGES
 - 22GA STANDING SEAM ROOF
 - 6 3/8"x2 1/2"x12GA. FLR. JOIST 6/S2.2
 - 6X2 1/2"x14GA. ROOF PURLIN 2/S2.2
 - ~~3"x3"x1/2"x26GA ROOF END CLOSURE W/ 1/2" STS W/ NEOPRENE WASHER TOP & BOT.~~
 - [7 X 9.8 FLOOR HEADER
 - [10 GA. TAPERED ROOF BEAM (SEE 1/S2.2) OR 12/S2.2 REFER TO RF. FRAMING PLAN
 - T.S. 3 1/2"x3 1/2"x1/4" COLUMN
 - BACK-UP PLATE MIN. 10 GA.
 - [7X9.8 FLOOR CHANNEL
 - 3 1/2"x3 1/2"x1/4" STEEL PLATE WELDED FLUSH TO TOP AND BOTTOM OF CHANNEL FLANGES
 - NOT USED
 - 3 1/2"x3 1/2"x1/4" STIFFENER ANGLE COPE TO FIT C7 X 9.8
 - STIFFENER TS 3 1/2"x3 1/2"x1/4"
 - [14"x3 1/2"x12GA. HEADER (SEE 3/S2.2)
 - LOCATION OF HVAC OPENING
 - 3"x3"x1/4" THICK X 1/2" LONG INSERT POST
 - 1/4" FULL DEPTH STIFFENER PLATE AT 4'-0" OC AT EXTERIOR SIDEWALLS ONLY FOR 80 MPH DESIGN WIND LOAD ONLY
 - 1/4" BASE PLATE-INSERT FLUSH WITH STIFFENER TUBE
 - (1) 3"x3"x10 GA TUBE STEEL BACK-UP TUBE OR (4) 10 GA BACK-UP PLATES

10 SECTION AT SIDEWALL

B SECTION AT ENDWALL A

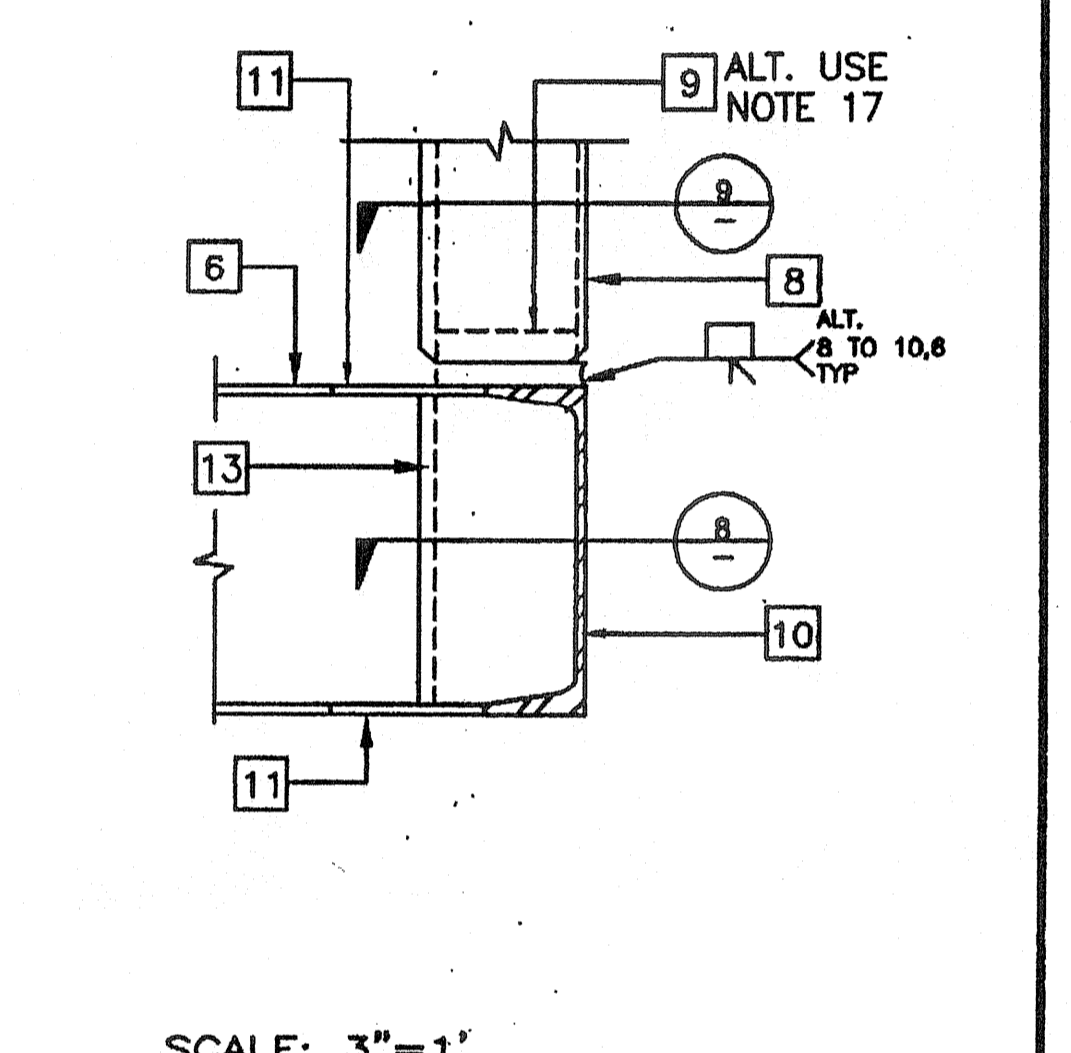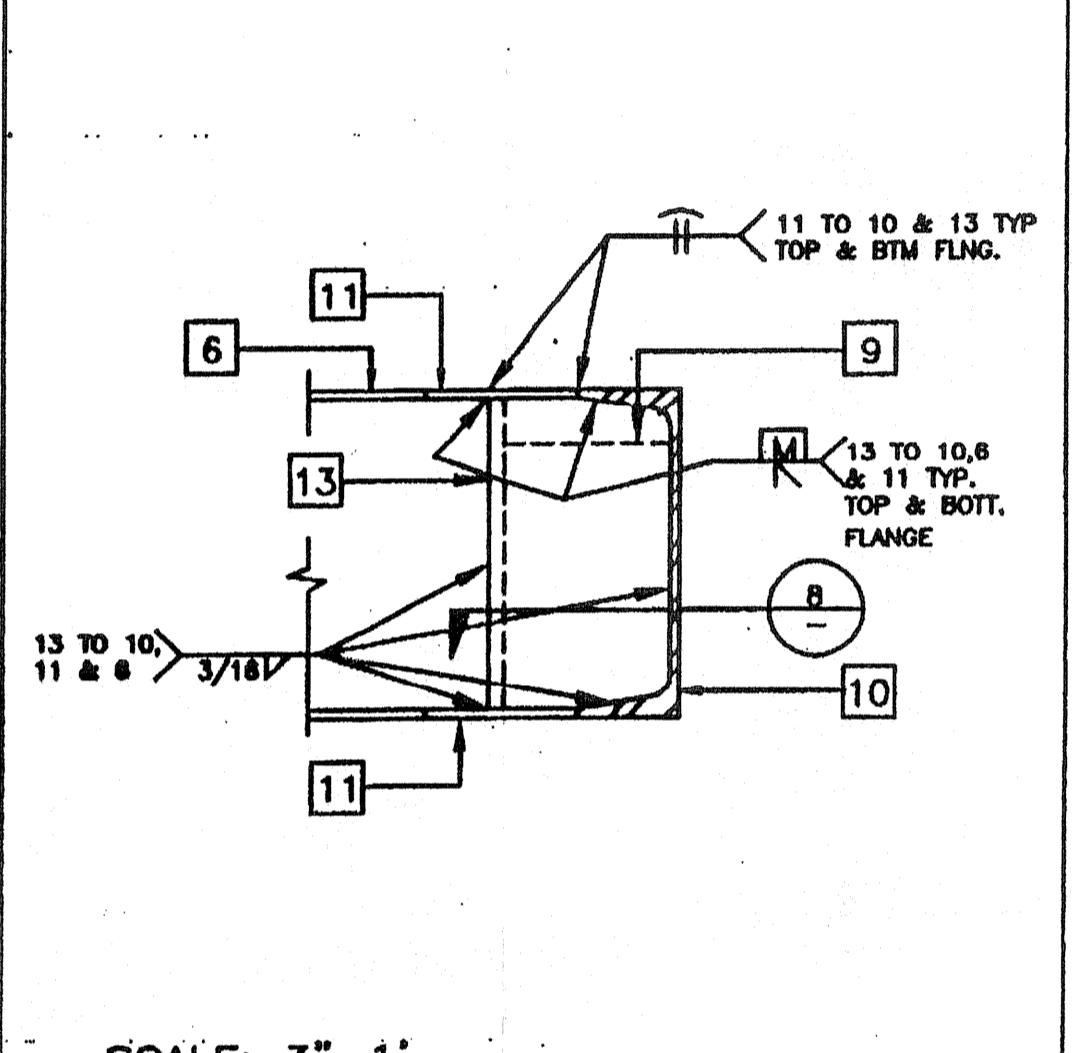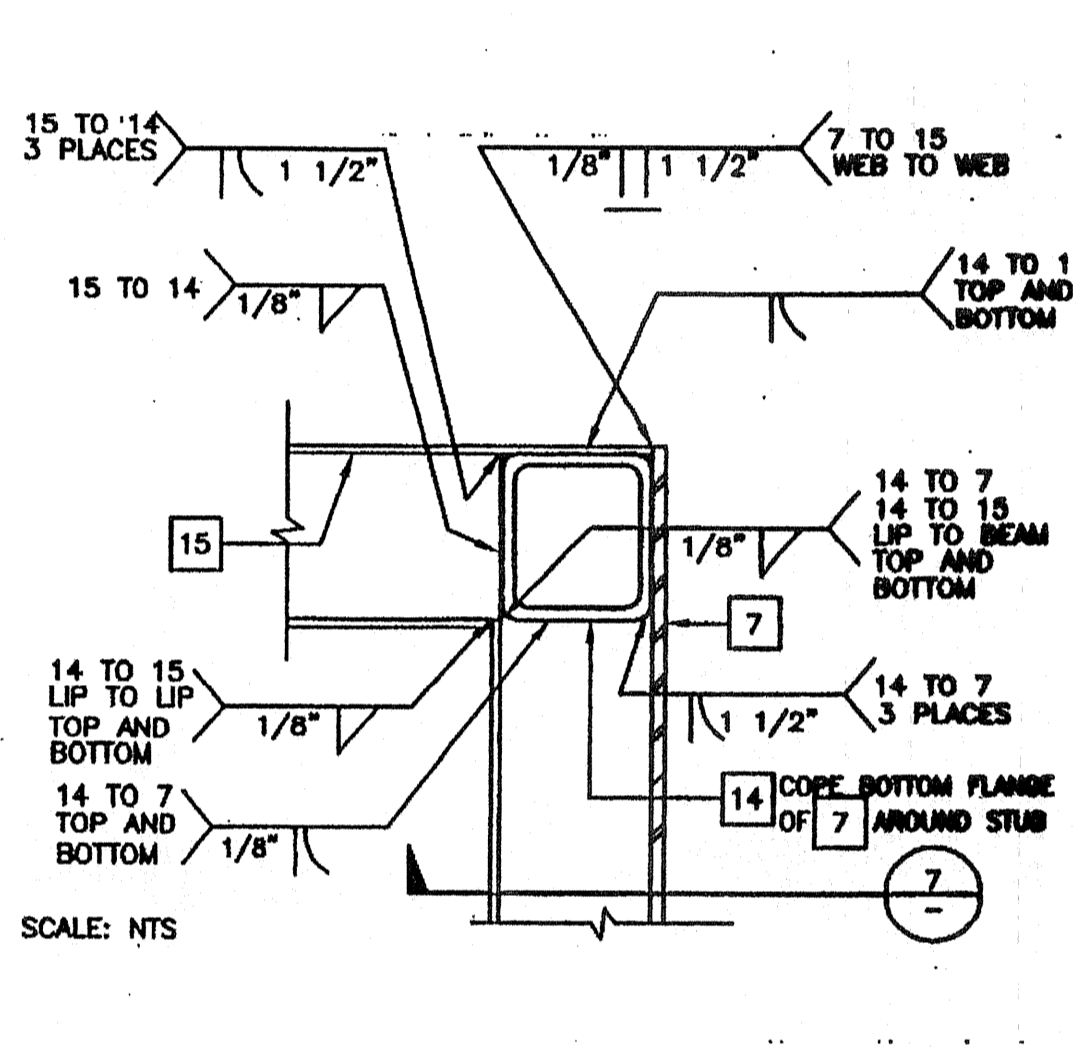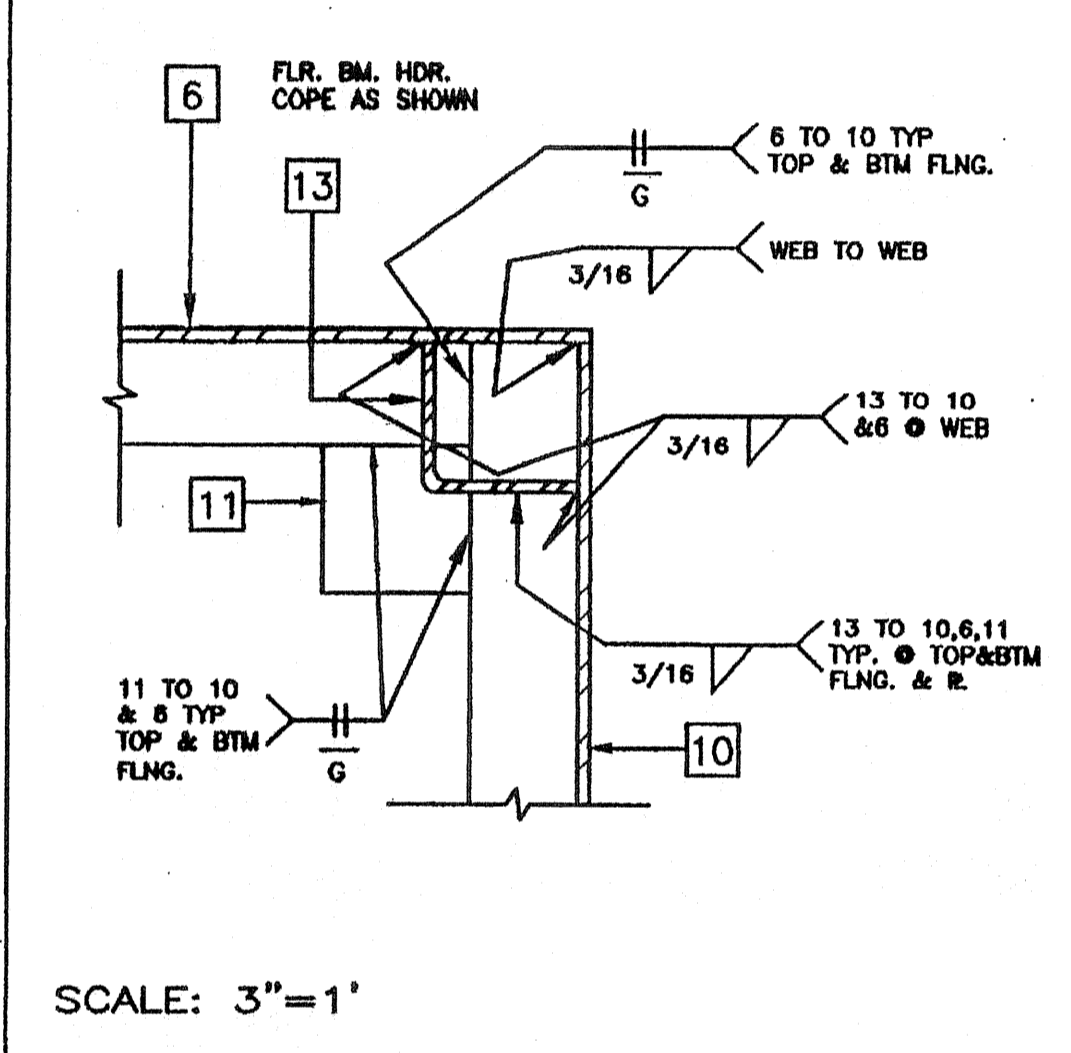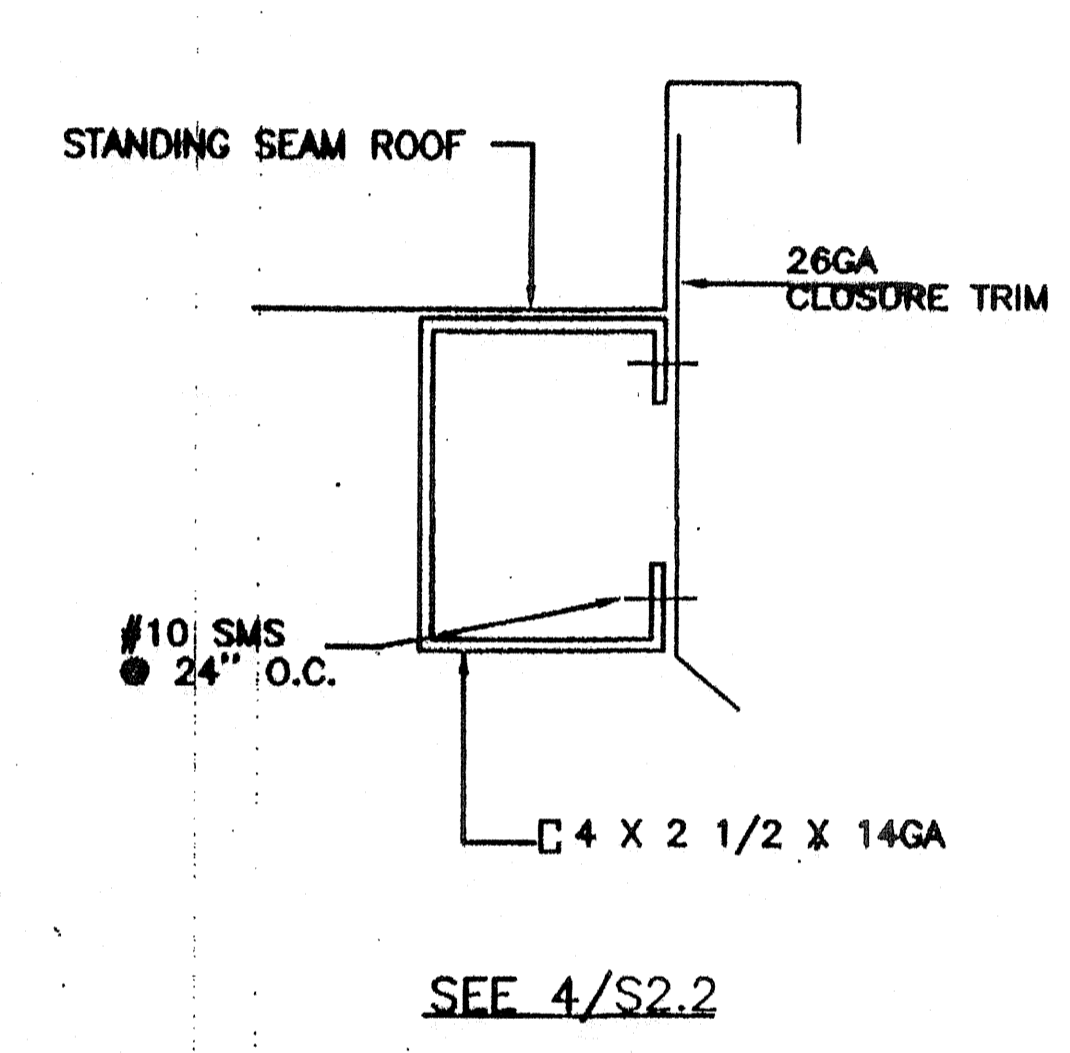






SECTION THRU OVERHANG BEAM

11 STIFFENER SECTION AT FLOOR

8 STIFFENER AT ROOF

6 COLUMN CONN. AT FLOOR

4 COLUMN CONN. AT FLR.

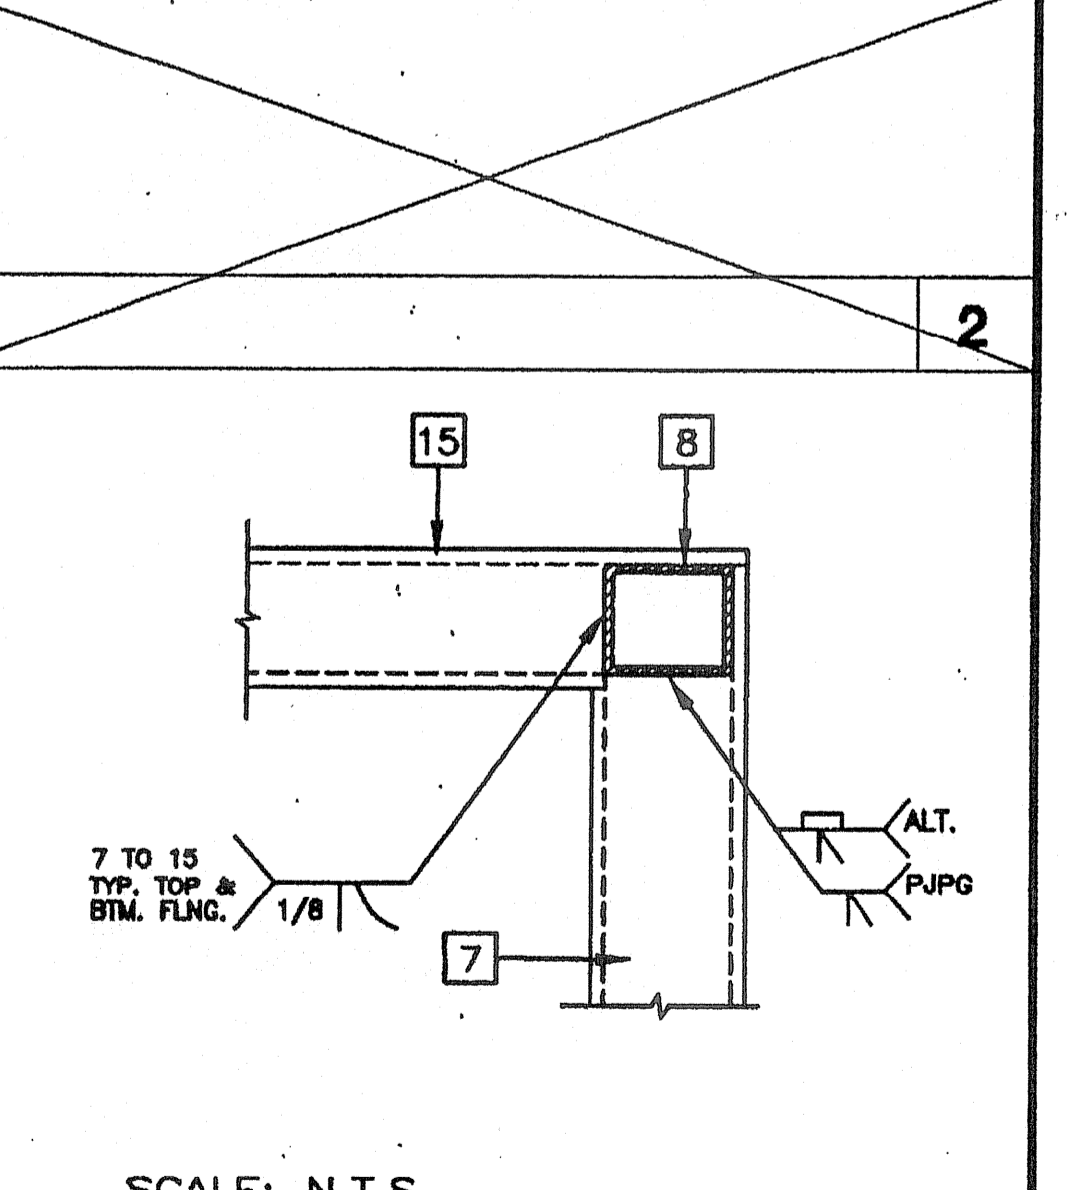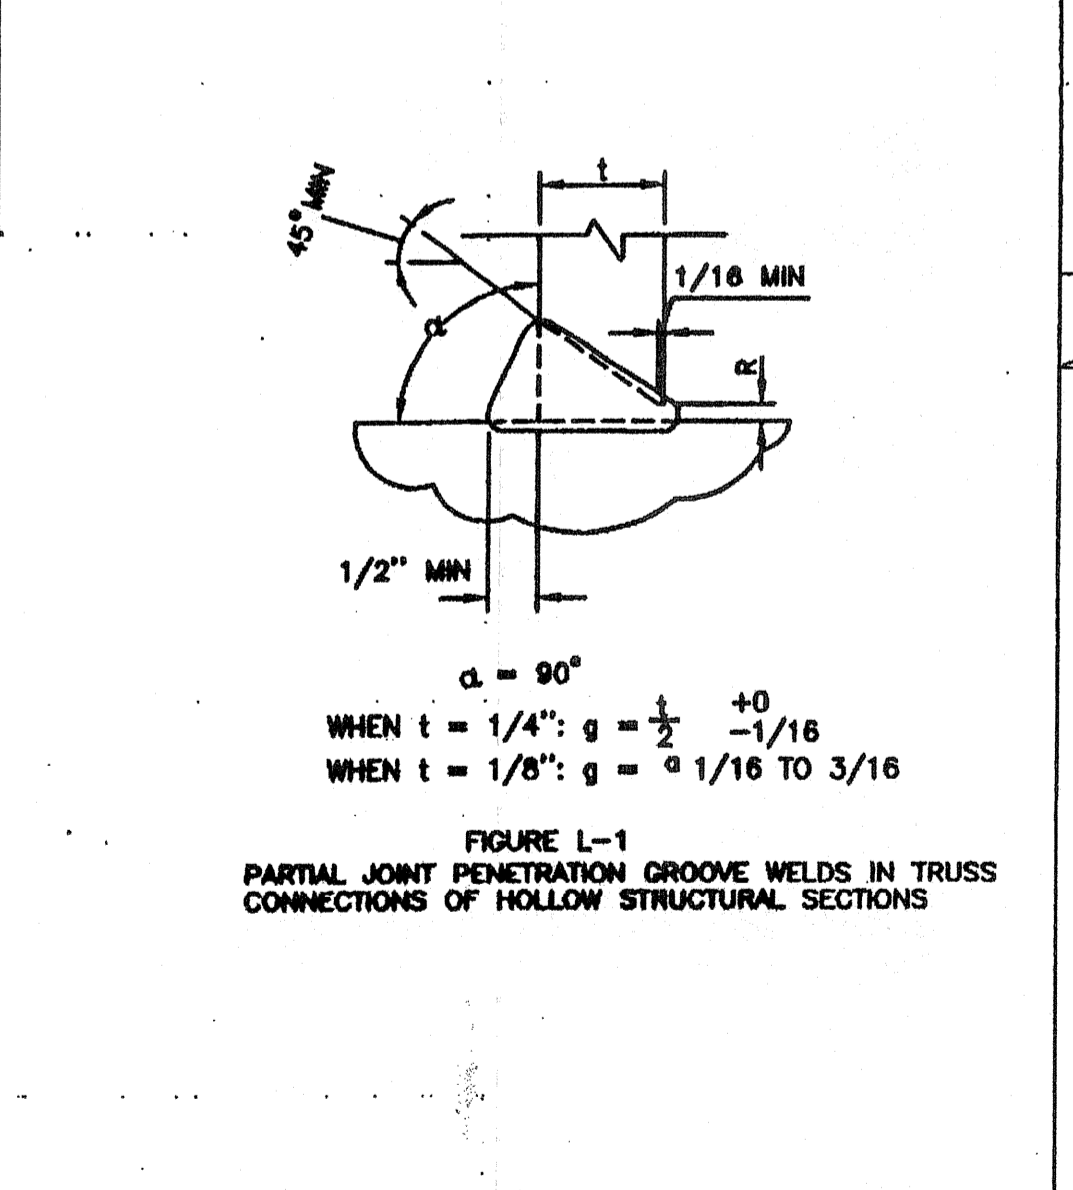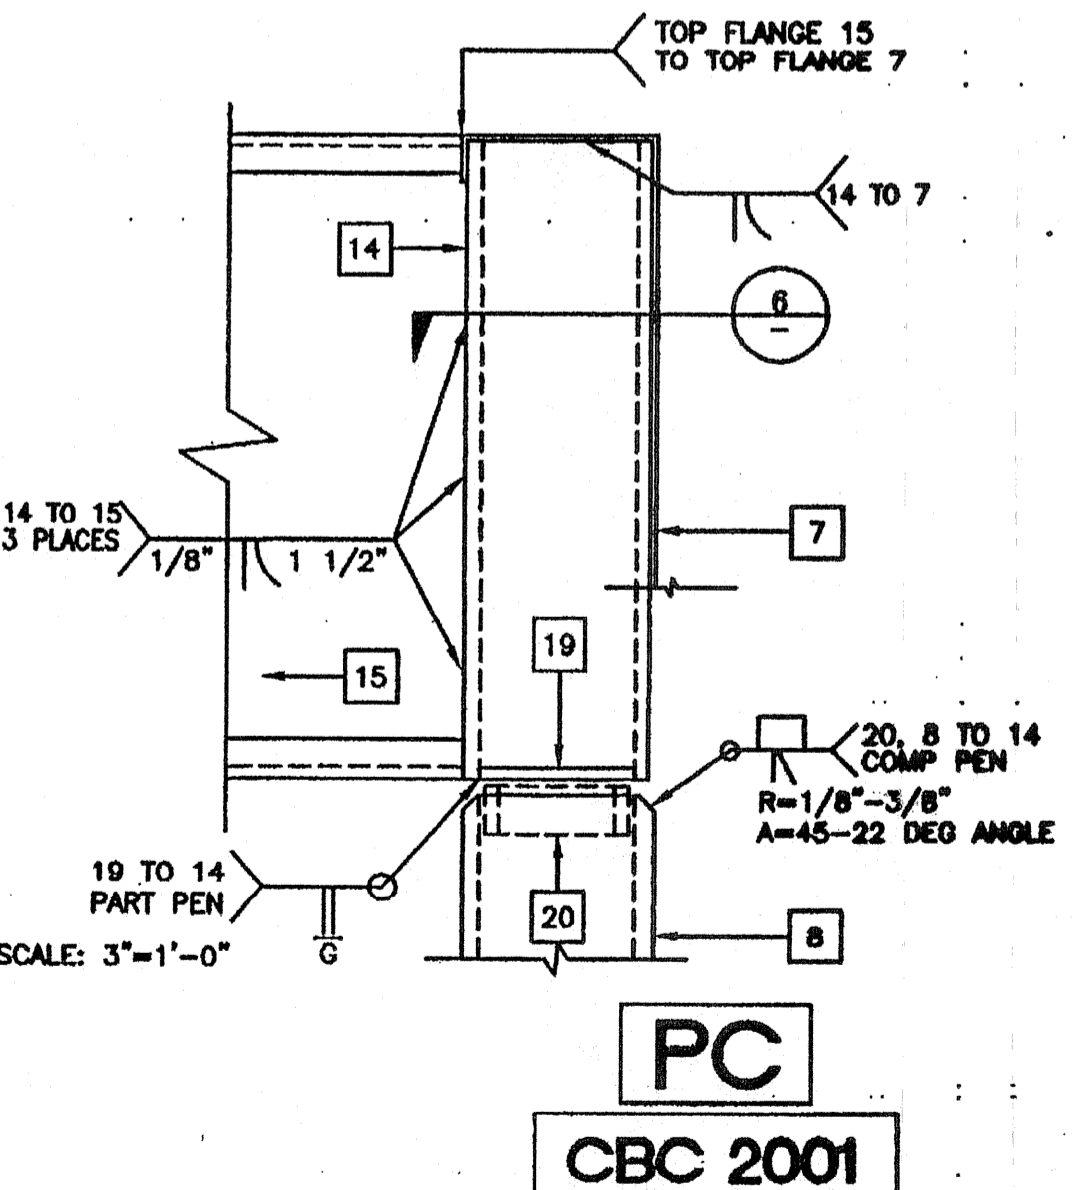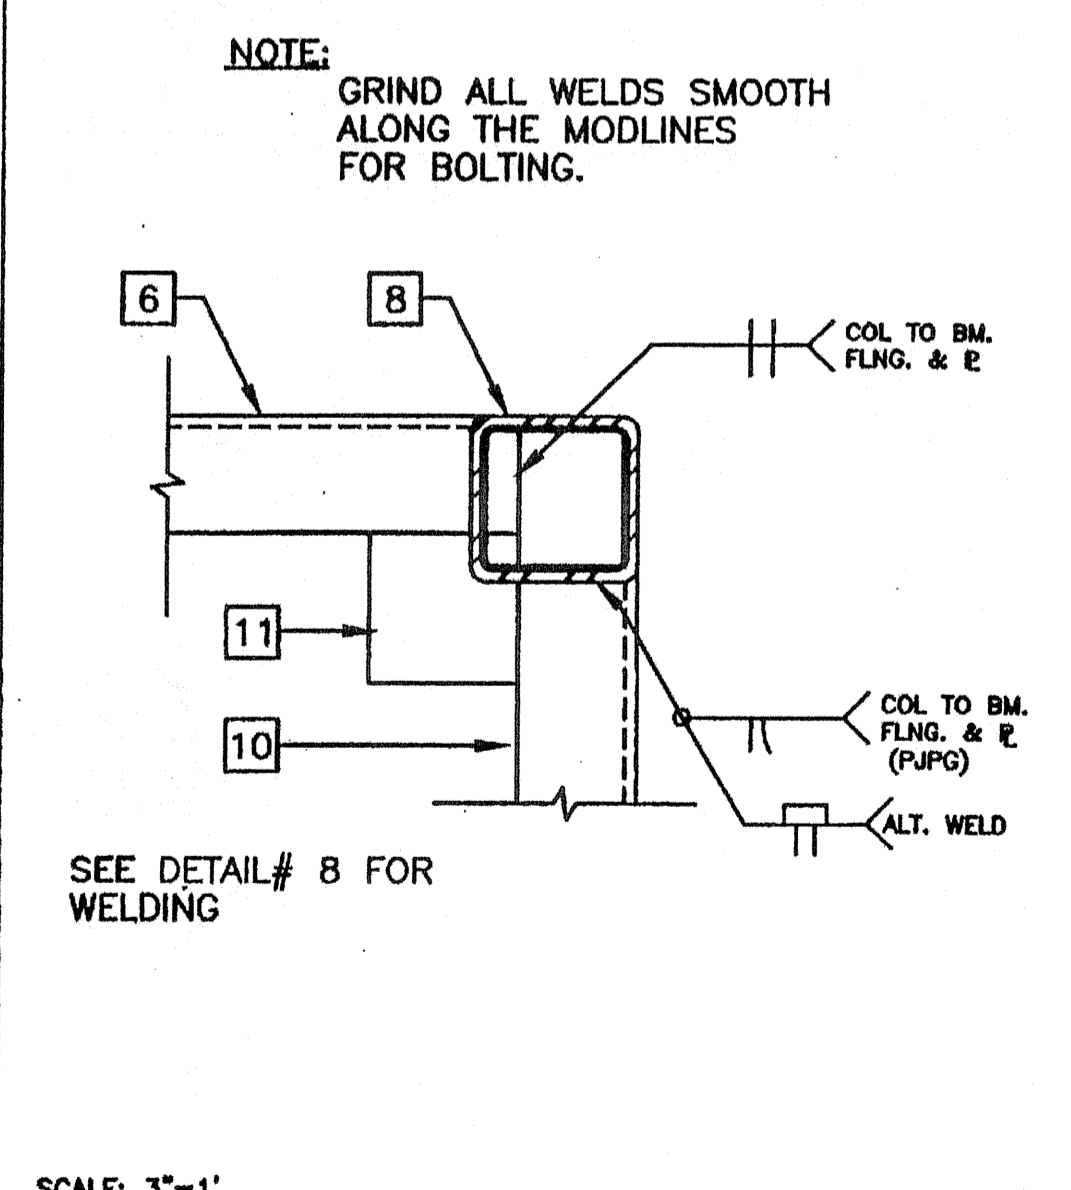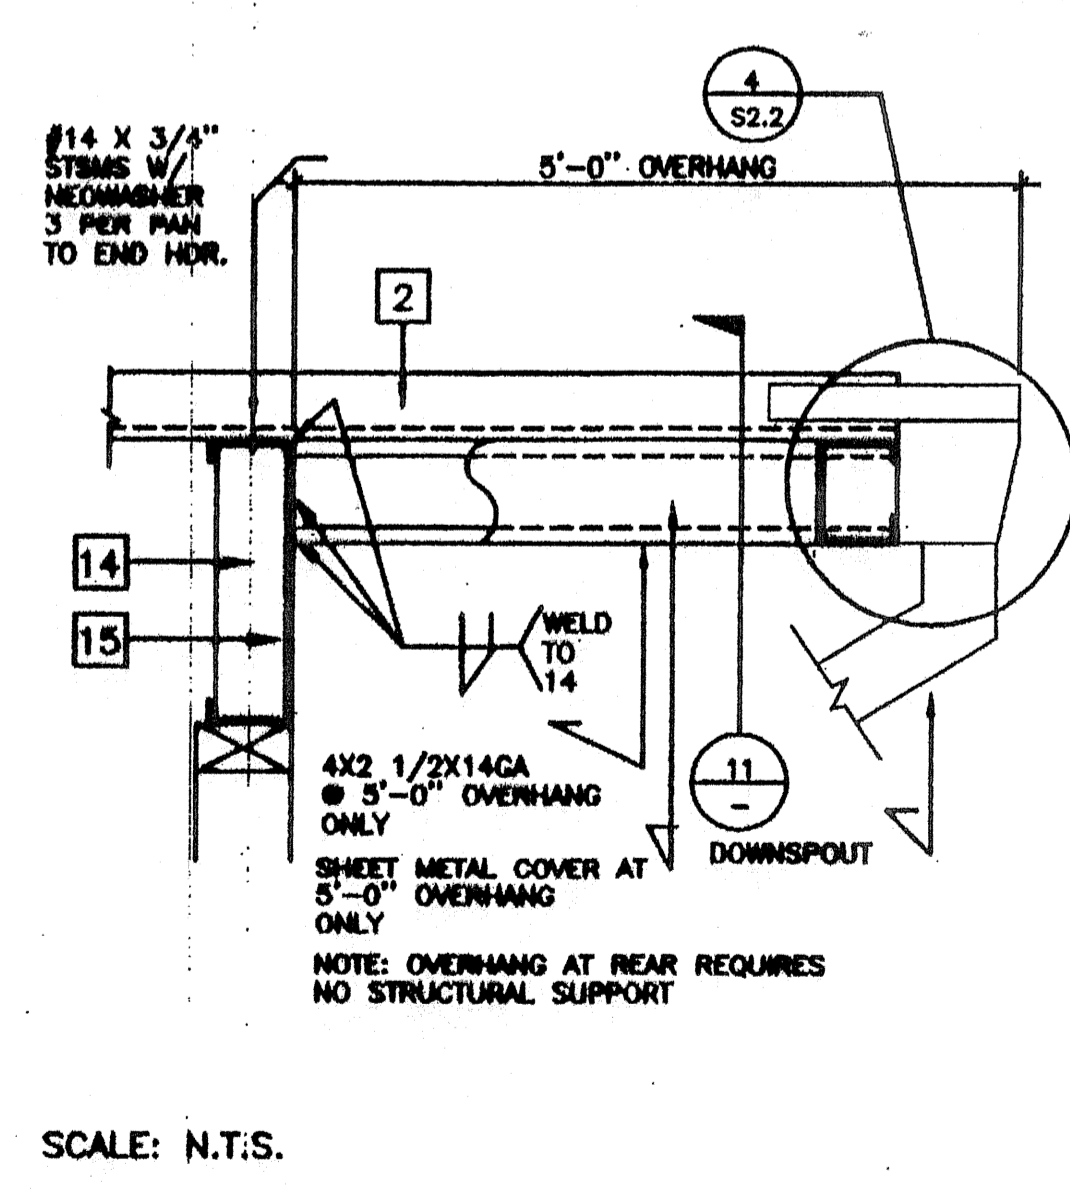

GUTTER AT OVERHANG AT FRONT

12 COLUMN AT FLOOR

9 COLUMN AT ROOF

7 P.J.G.P. WELD DETAIL

5 COLUMN AT ROOF BEAM

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 04 105455
 AC FLS SS
 DATE JUL 17 2003
 04 105455
 DATE JUL 10 2003

REVISIONS	Electrical Engineer's Seal	Mechanical Engineer's Seal	PC Professional of Record Seal	Architect's Seal

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 PC-04
 104796
 AC FLS SS
 DATE 7/5/03

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 PC-04
 104796
 AC FLS SS
 DATE 7/5/03


MODTECHTM
 2830 BARRETT AVENUE PERRIS, CALIF. 92571
 PH (909) 943-4014 FAX (909) 940-0427

PROJECT NUMBER: 4736 © MODTECH, INC. 2002
 WILLIAM SCOTTSMAN
 DRAWN BY: GL DATE: 07/07/03
 CHECKED BY: DATE:
 MODTECH Index No. **S3.0**
STRUCTURAL ELEVATIONS W/ FASCIA


FILE PATH: PROJECT NO. 4736

KEY NOTES


- 1 4 X 4 POST ALT.; USE 2-2X4 W/FACE NAILING
- 2 2X4 TOP PLATE
- 3 FINISH FLOOR
- 4 2X4 FULL HGT. KING STUDS AND 2X4 TRIMMER (SEE SCHEDULE FOR QUANTITY SHT S5.0)
- 5 FULL HEIGHT STUDS AND 1-2X4 TRIMMER (SEE WINDOW SCHEDULE FOR JAMB STUDS REQUIRED. SHEET S5.0.)
- 6 HEADER (SEE SCHEDULE)
- 7 2"x6" LET IN FOR AC SUPPORT
- 8 WINDOW SILL PLATE (SEE SCHEDULE)
- 9 A 34 CLIPS AT HEADER & SILL TO FULL HGT. STUDS AND FULL HGT. STUDS TO TOP AND BOTTOM PLATES. SEE 4/S5.0
- 10 REQUIRED OPENING FOR A 3068 DOOR (SEE DETAIL 7/S5.0)
- 11 REQUIRED OPENING FOR A 8040 WINDOW (SEE DETAIL 6/S5.0)
- 12 2X4 STUD AT 16" O.C. TYPICAL
- 13 2X4 NAILER TYPICAL AT EACH END
- 14 2X4 SILL PLATE
- 15 FRAME FOR ELECTRICAL PANEL
- 16 THERMOSTAT LOCATION 4S BOX
- 17 2"x4" BLOCKING AT EXTERIOR PLYWOOD SIDING JOINT

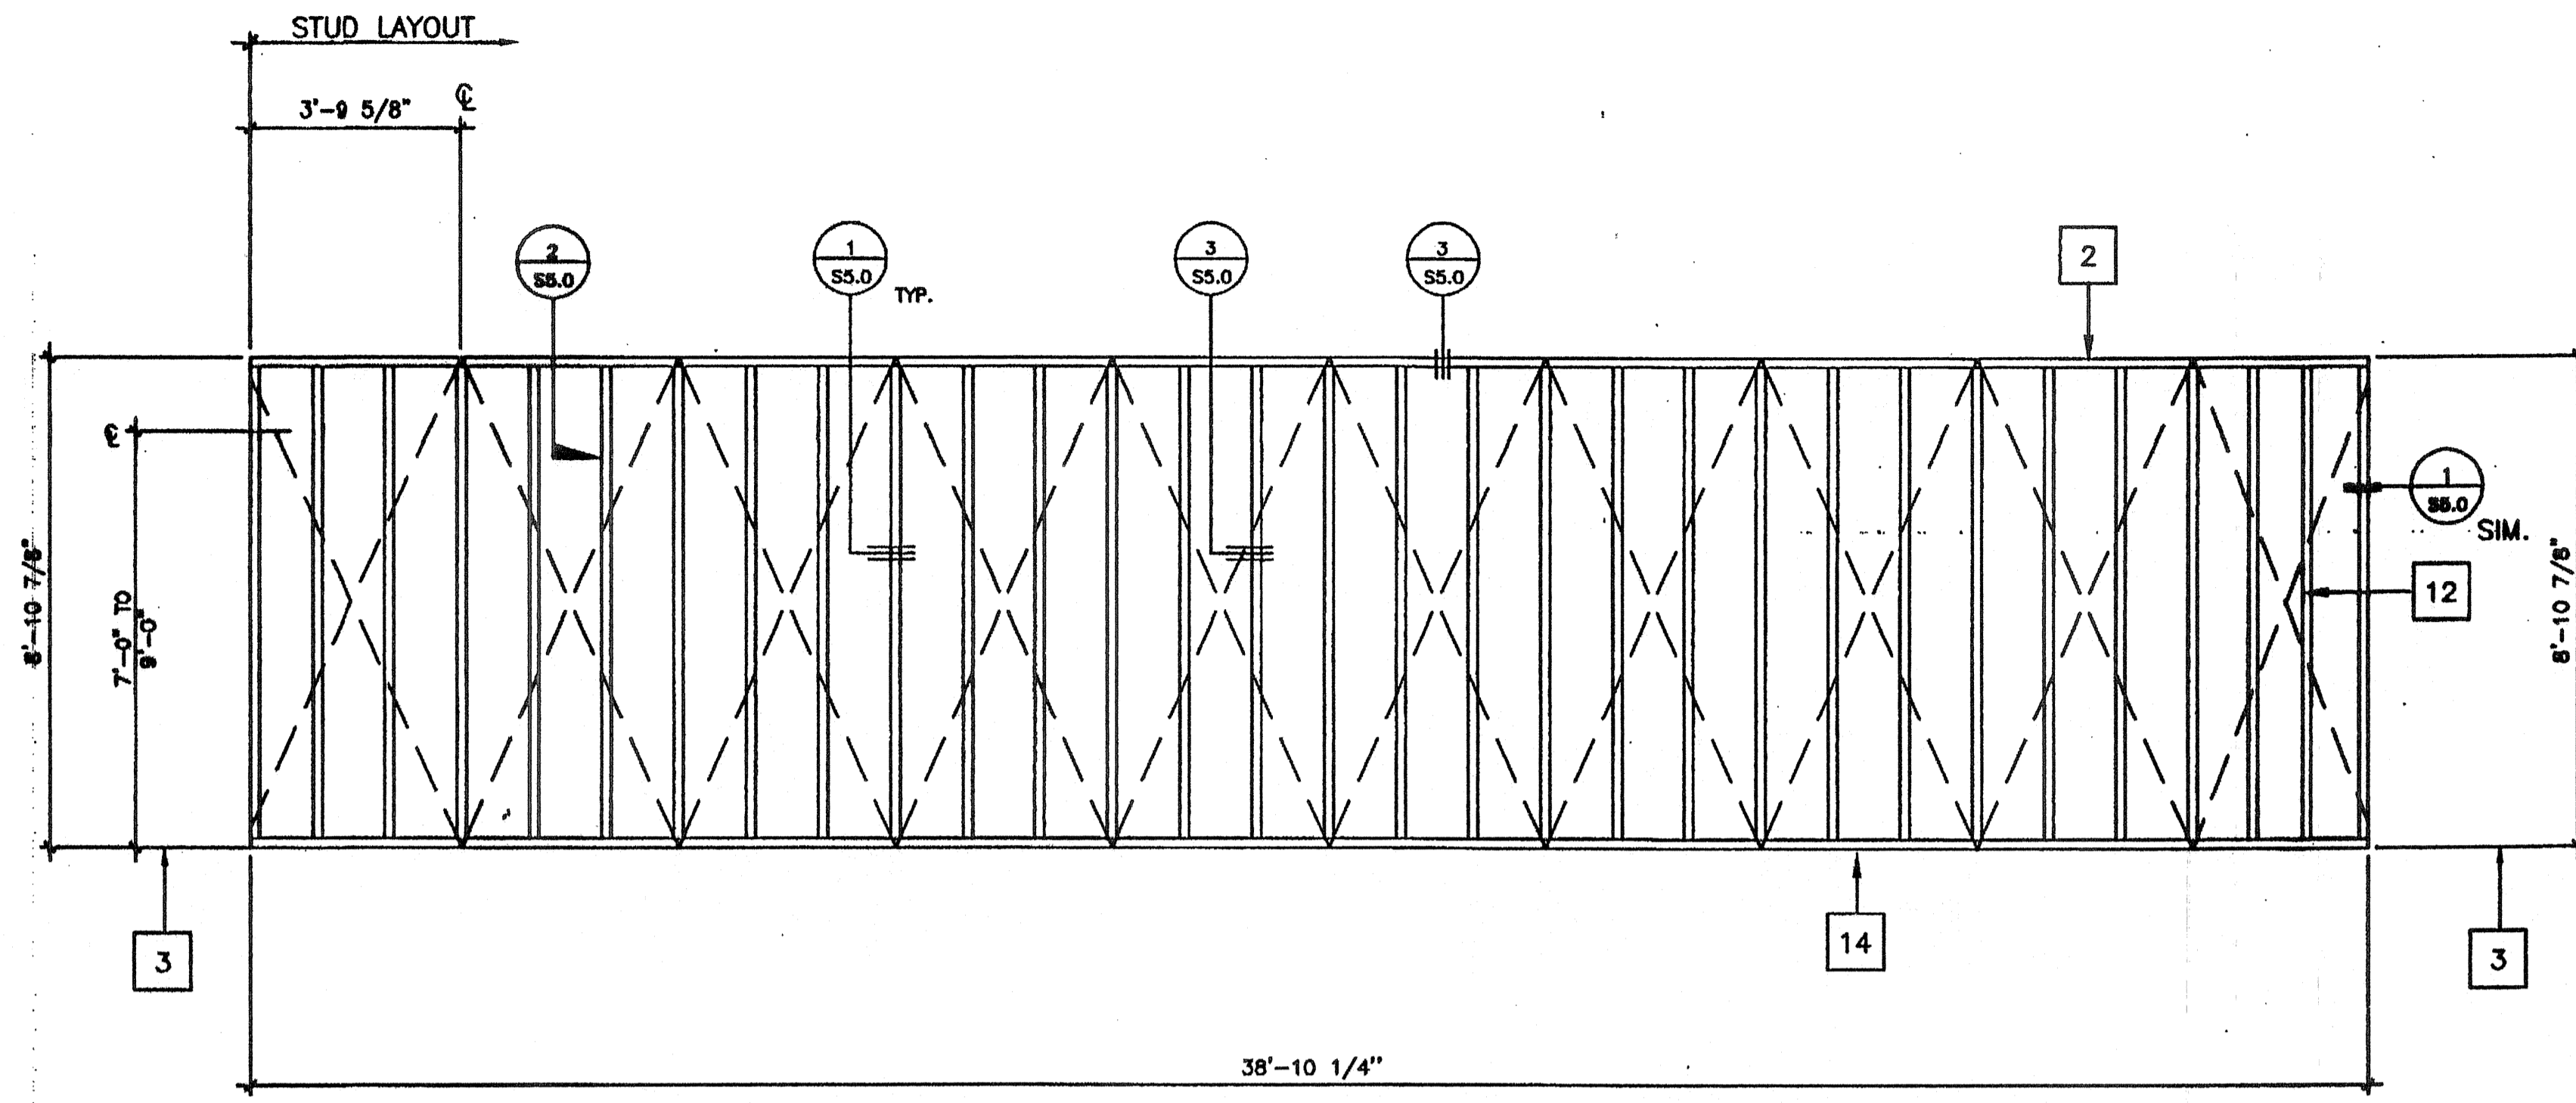


A

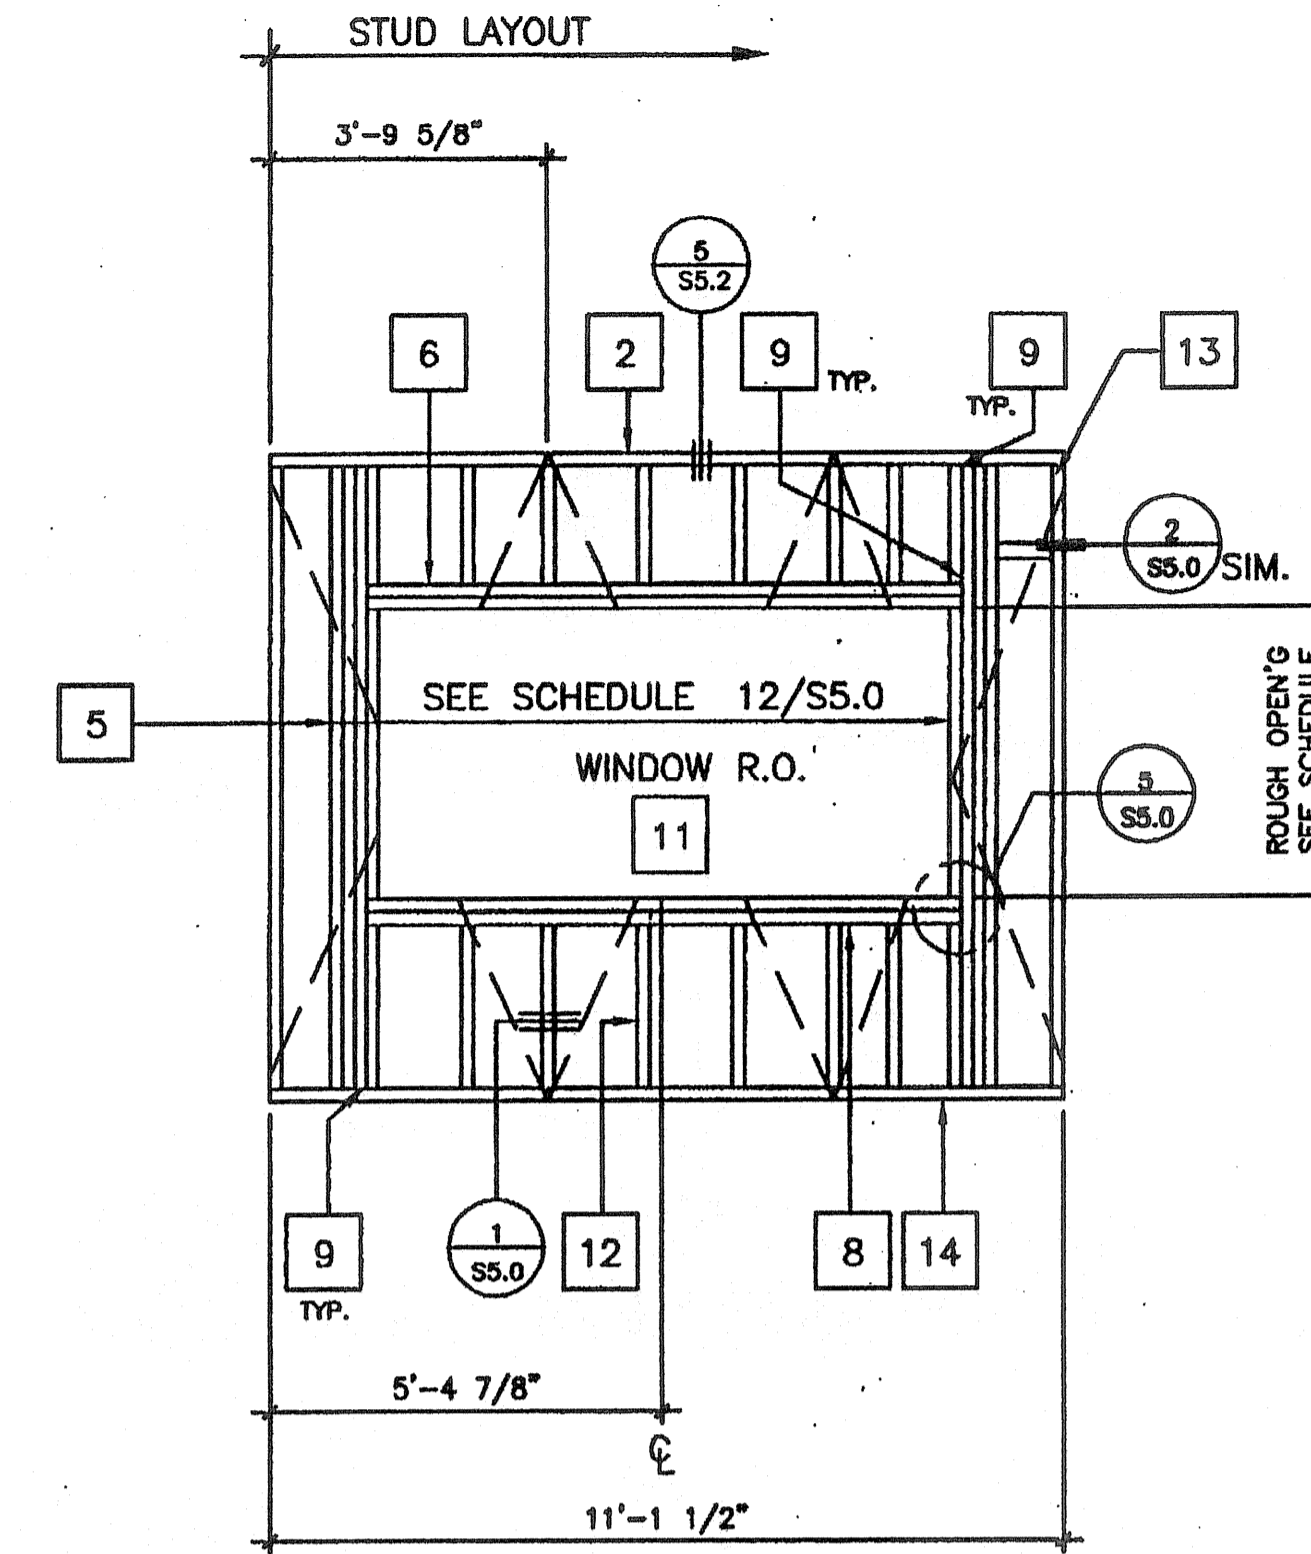


B

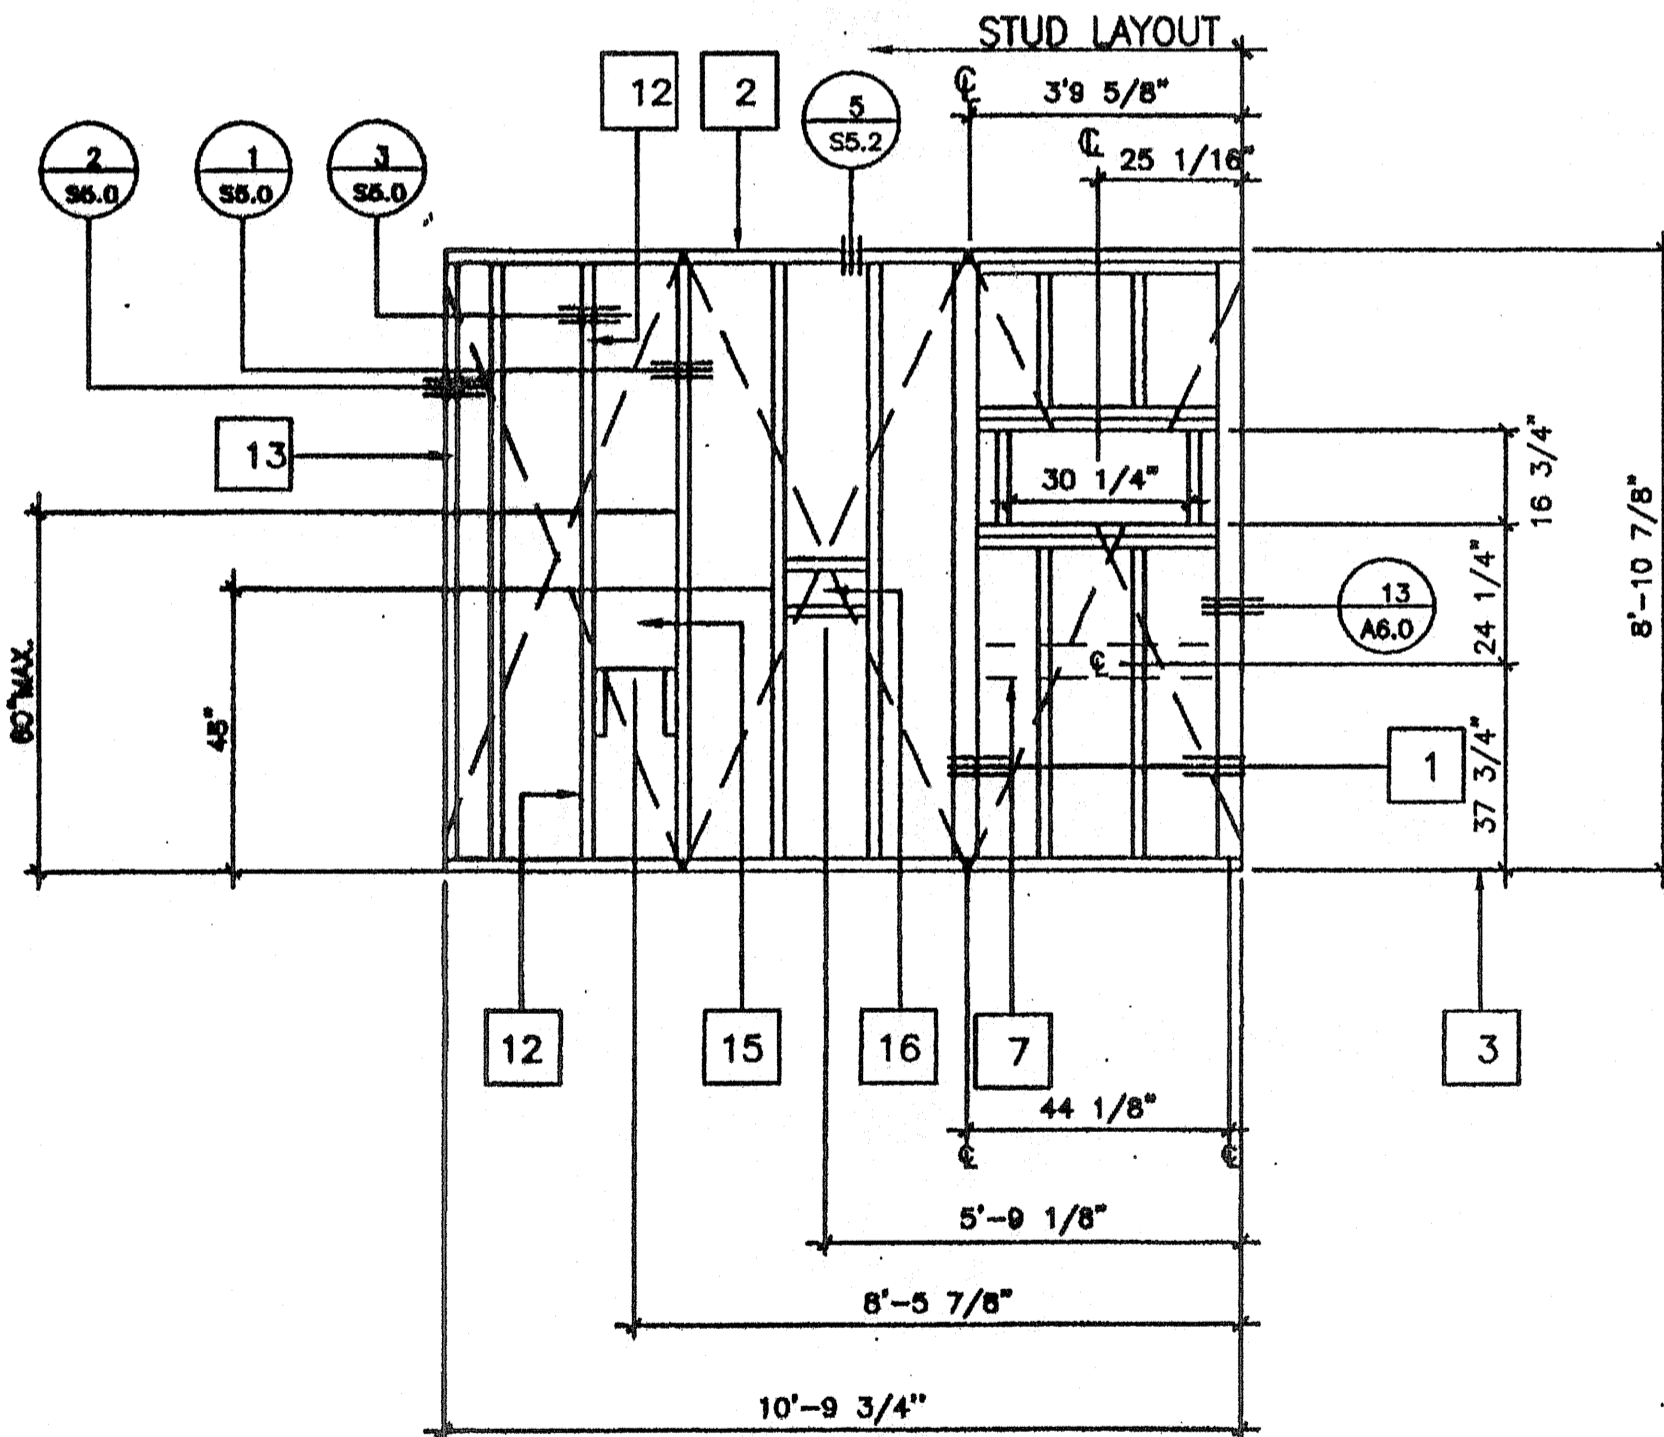

C

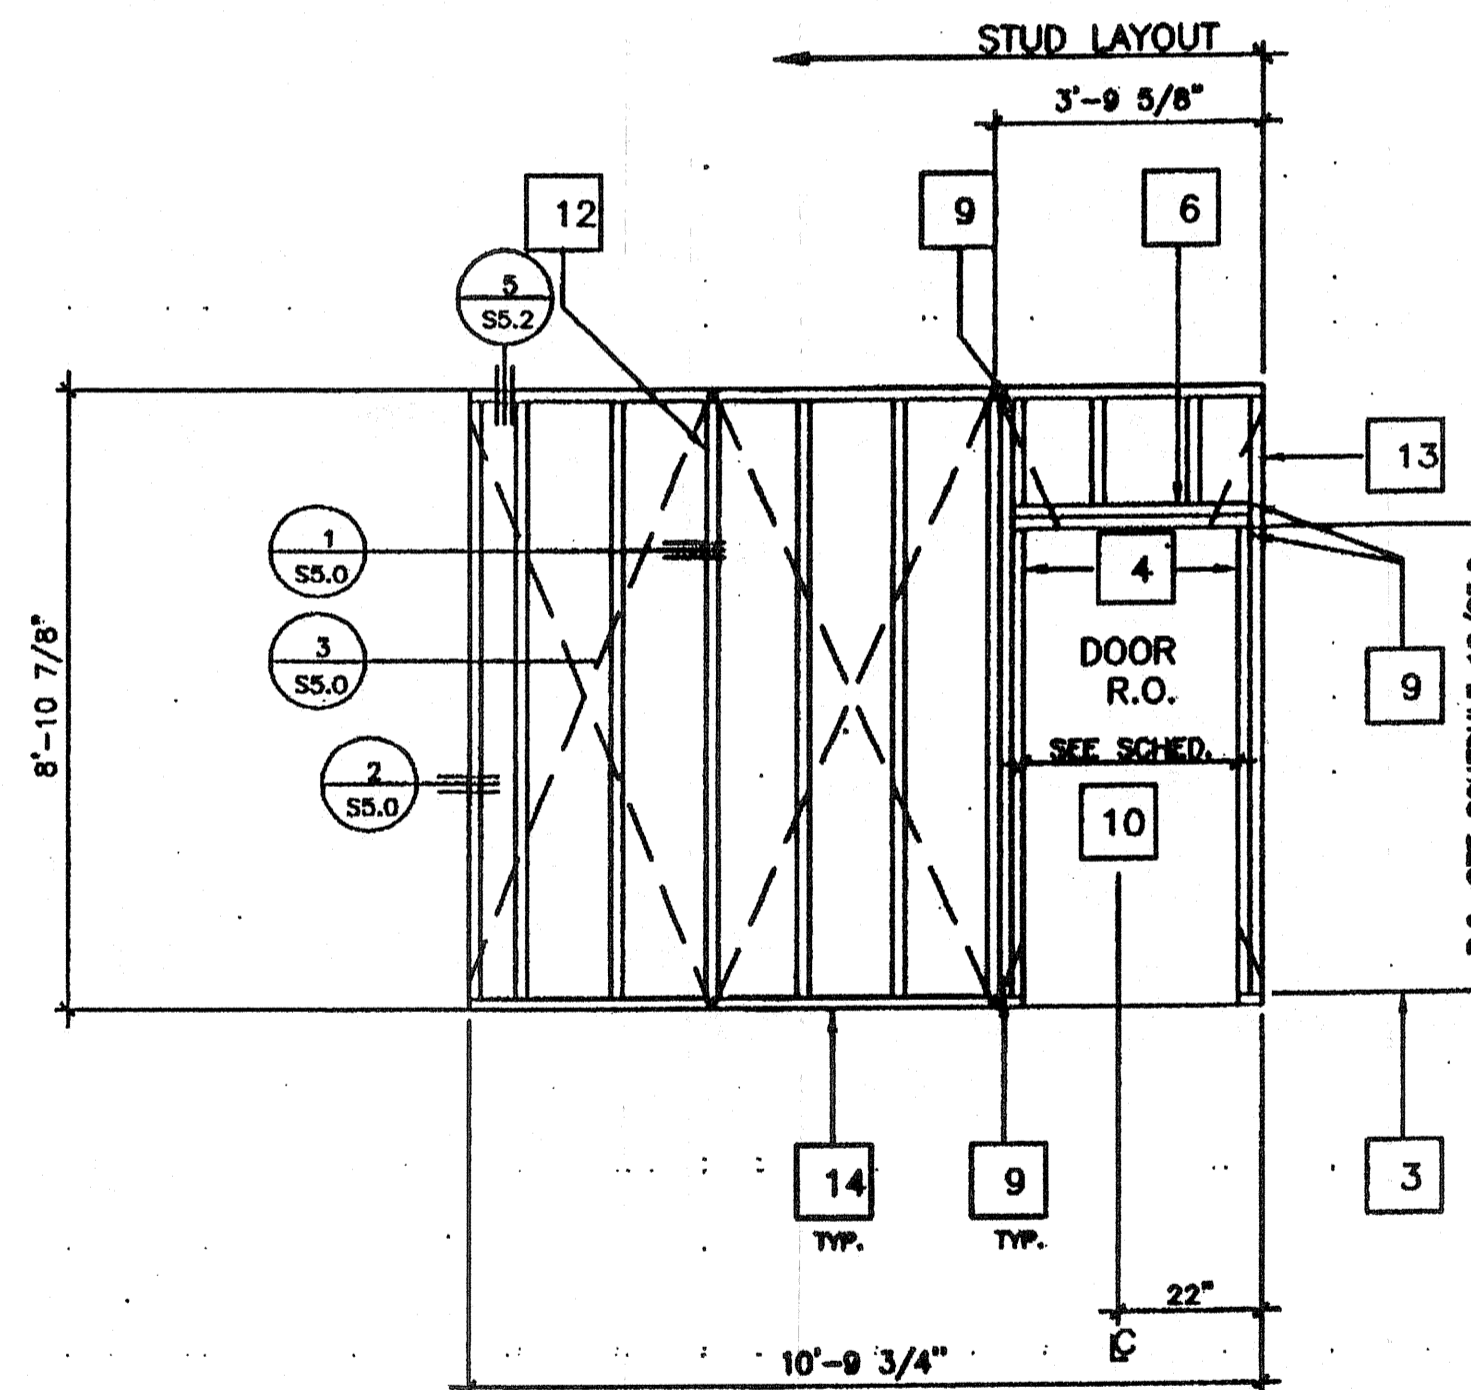

D

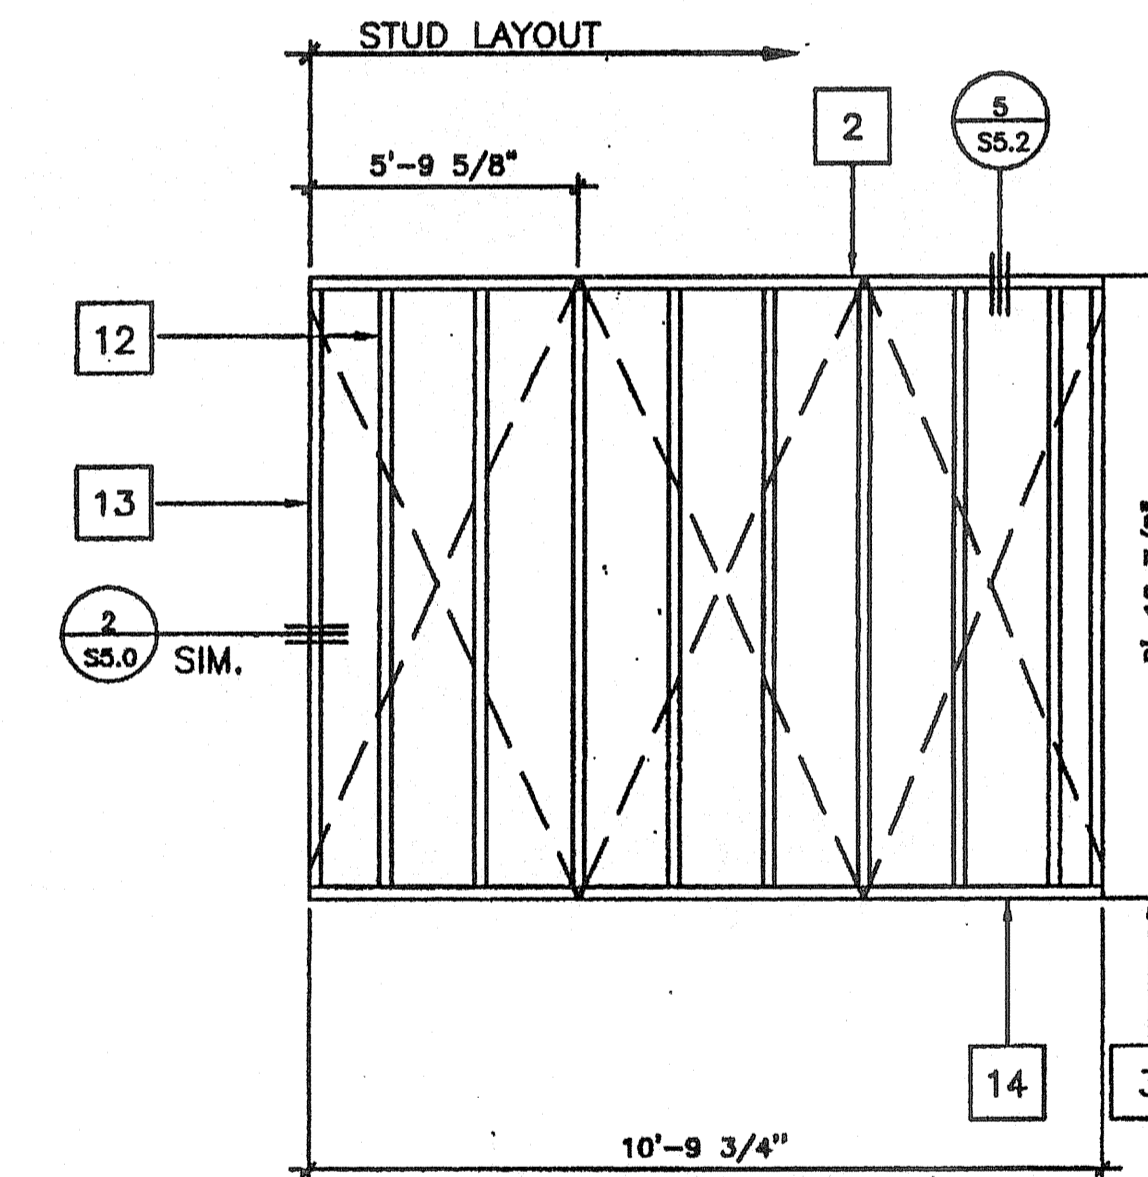

E

SCALE 3/8"=1'

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
04 105455
AC FLS SS
DATE JUL 17 2003

~~04 105455
AC FLS SS
DATE JUL 17 2003~~

REVISIONS	Electrical Engineer's Seal	Mechanical Engineer's Seal	PC Professional of Record Seal	Architect's Seal

Electrical Engineer's Seal
Mechanical Engineer's Seal

PC Professional of Record Seal
Architect's Seal

PC
CBC 2001
IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
PC-04
104796
AC FLS SS
DATE 5/2/03

PC
CBC 2001
IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
PC-04
104796
AC FLS SS
DATE 5/2/03

MODTECH
2830 BARRETT AVENUE FAX (909) 943-4014
PERRIS, CALIF. 92572 FAX (909) 940-0427

PROJECT NUMBER: 4736
WILLIAM SCOTTSMAN
WALL FRAMING

© MODTECH, INC. 2002
ALL RIGHTS RESERVED
WOOD STUDS

DRAWN BY: GL
DATE: 07/07/03
CHECKED BY:
DATE:
MODTECH Index No.
S4.0

FILE PATH:


PROJECT NO. 4736

PC-04-104796

NAILING SCHEDULE	
CONNECTION	NAILING
1. JOIST TO SILL OR GIRDER, TOENAIL	2-10d
2. BRACING TO JOIST, TOENAIL END END	2-8d
3. 1" X 6" (25 mm X 152mm) SUBFLOOR OR LESS TO EACH JOIST, FACE NAIL	2-7d
4. WIDER THAN 1" X 6" (25 mm X 152 mm) SUBFLOOR TO EACH JOIST, FACE NAIL	3-8d
5. 2" (51mm) SUBFLOOR TO JOIST OR GIRDER, BLIND AND FACE NAIL	2-16d
6. SOLE PLATE TO JOIST OR BLOCKING, 16d at 16" (406mm) o.c. TYPICAL FACE NAIL	3-16d per 16" (406mm)
7. TOP PLATE TO STUD, END NAIL	2-16d
8. STUD TO SOLE PLATE	4-8d, toenail or 2-16d, end nail
9. DOUBLE STUDS, FACE NAIL	16d at 24" (610mm) o.c.
10. DOUBLE TOP PLATES, TYPICAL FACE NAIL	8-16d
11. BRACING BETWEEN JOISTS OR RAFTERS TO TOP PLATE, TOENAIL	3-8d
12. RM JOINT TO TOP PLATE, TOENAIL	8d at 6" (152mm) o.c.
13. TOP PLATES, LAP AND INTERSECTIONS, FACE NAIL	2-16d
14. CONTINUOUS HEADER, TWO PIECES, 16d at 16" (406mm) o.c. along each edge	
15. CEILING JOIST TO PLATE, TOENAIL	3-8d
16. CONTINUOUS HEADER TO STUD, TOENAIL	4-8d
17. CEILING JOIST, LAP OVER PARTITIONS, FACE NAIL	3-16d
18. CEILING JOIST TO PARALLEL RAFTERS, FACE NAIL	3-16d
19. RAFTER TO PLATE, TOENAIL	3-8d
20. 1" (25 mm) BRACE TO EACH STUD AND PLATE, FACE NAIL	2-8d
21. 1" X 8" (25 mm X 203 mm) SHEATHING OR LESS TO EACH BEARING, FACE NAIL	2-8d
22. WIDER THAN 1" X 8" (25 mm X 203mm) SHEATHING TO EACH BEARING, FACE NAIL	3-8d
23. BUILT-UP (CORNER STUDS) 16d at 24" (610mm) o.c.	
24. BUILT-UP GIRDER AND BEAMS, 20d at 32" (813 mm) O.C. AT TOP AND BOTTOM AND STAGGERED 2-20d AT ENDS AND AT EACH SPLICE.	
25. 2" (51mm) PLANKS	
26. WOOD STRUCTURAL PANELS AND PARTICLEBOARD: 2 SUPFLOOR, ROOF AND WALL SHEATHING (TO FRAMING): (1 INCH=25.4mm)	
1/2" AND LESS	8d5
15/32" - 3/4"	8d4 OR 8d5
7/8" - 1"	8d3
1 1/8" - 1 1/4"	10d4 OR 8d5
COMMERCIAL SUBFLOOR-UNDERLAYMENT (TO FRAMING): (1 INCH=25.4mm)	
3/4" AND LESS	8d5
7/8" - 1"	8d5
1 1/8" - 1 1/4"	10d4 OR 8d5
27. PANEL SIDING (TO FRAMING):	
1/2" (13 mm) OR LESS	8d6
5/8" (16 mm)	8d5
28. FRAMING SHEATHING	
1/2" (13 mm)	NO. 11 GA. 8d4
	NO. 16 GA. 8d4
25/32" (20 mm)	NO. 11 GA. 8d4
	NO. 16 GA. 8d4
29. INTER PANELING	
1/4" (6.4 mm)	4d 10
3/8" (9.5 mm)	6d 11

NOTE: All nail shall be box nails unless otherwise noted.

1. COMMON OR BOX NAILS MAY BE USED EXCEPT WHERE OTHERWISE STATED.
 2. NAILS SPACED AT 6" (152MM) ON CENTER AT EDGES, 12" (305MM) AT INTERMEDIATE SUPPORTS EXCEPT 6 INCHES (152MM) AT ALL SUPPORTS WHERE SPANS ARE 48" (1219MM) OR MORE. FOR NAILING OF WOOD STRUCTURAL PANEL AND PARTICLE BOARD SHEATHING AND SHEAR WALLS, REFER TO SECTION 2314.3. NAILS FOR WALL SHEATHING MAY BE COMMON, BOX OR CASING.
 3. COMMON OR DEFORMED SHANK
 4. COMMON
 5. DEFORMED SHANK
 6. CORROSION-RESISTANT SIDING OR CASING NAILS CONFORMING TO THE REQUIREMENTS OF SECTION 2325.1.
 7. FASTENERS SPACED 3 INCHES (76MM) ON CENTER AT EXTERIOR EDGES AND 6 INCHES (152MM) ON CENTER AT INTERMEDIATE SUPPORTS.
 8. CORROSION-RESISTANT ROOFING NAILS W/ 7/16" (11MM) HEAD AND 1 1/2 INCH (38MM) LENGTH FOR 1/2 INCH (13MM) SHEATHING AND 1 3/4 INCH (44MM) LENGTH FOR 25/32 INCH (20MM) SHEATHING CONFORMING TO THE REQUIREMENTS OF SECTION 2325.1.
 9. CORROSION-RESISTANT STAPLES WITH NOMINAL 7/16 INCH (11MM) CROWN AND 1 1/8 INCH (20MM) LENGTH FOR 1/2 INCH (13MM) SHEATHING AND 1 1/2 INCH (38MM) LENGTH FOR 25/32 INCH (20MM) SHEATHING CONFORMING TO THE REQUIREMENTS OF SECTION 2325.1.
 10. PANEL SUPPORTS AT 16 INCHES (406MM) 120 INCHES (600MM) IF STRENGTH AXIS IS IN THE LONG DIRECTION OF PANEL UNLESS OTHERWISE MARKED. CASING OR FINISH NAILS SPACED 6 INCHES (152MM) ON PANEL EDGES, 12 INCHES (305MM) AT INTERMEDIATE SUPPORTS.
 11. PANEL SUPPORTS AT 24 INCHES (610MM) CASING OR FINISH NAILS SPACED 6 INCHES (152MM) ON PANEL EDGES.
 12. NAIL DRIVEN INTO PRESSURE TREATED SILL PLATES SHOULD BE GALV.

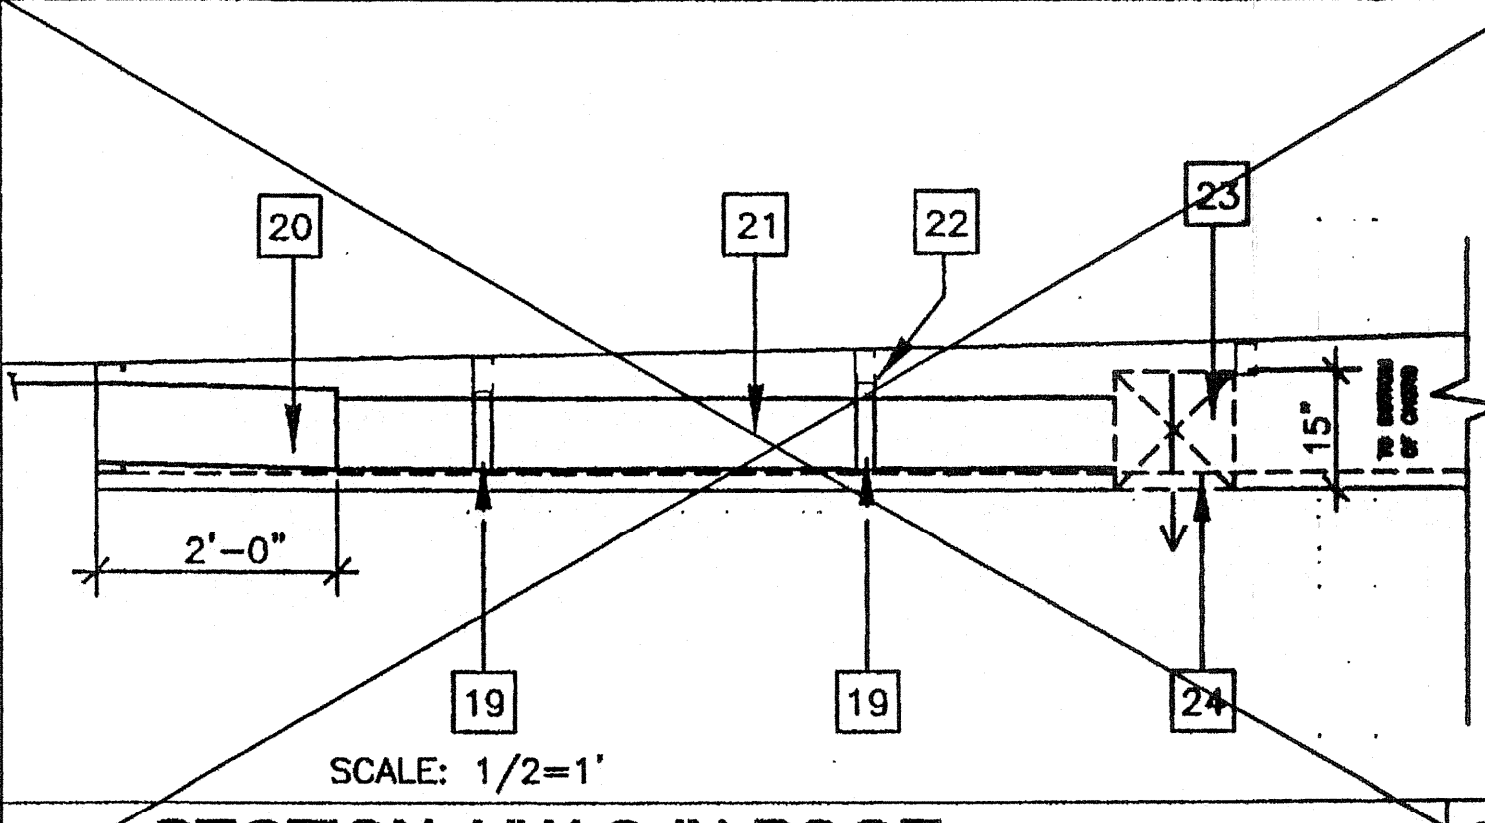


SECTION: HVAC IN ROOF

OPENING	OPENING SCHEDULE		ROUGH OPENING	
	HDR.	SILL	JAMB	HEIGHT WIDTH
3068	(2) 2X4	(2) 2X4	(2) 2X4 *	81 1/4" 38"
8040	(3) 2X4	(2) 2X4	(3) 2X4 *	48 1/8" 96 1/8"


* FULL HEIGHT STUDS

ALTERNATE: METAL STUD 3 1/2 " X 20 GA. IN LIEU OF 2X4 WD. STUDS


ROUGH OPENING SCHEDULE

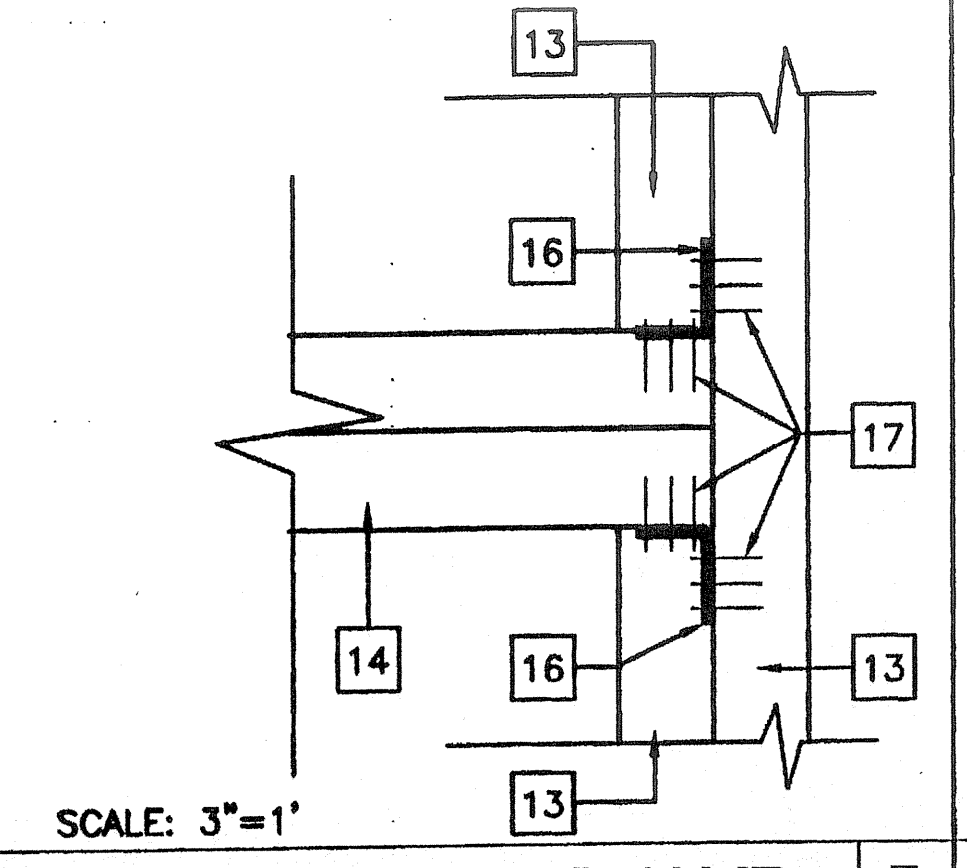


WINDOW SILL AT JAMB

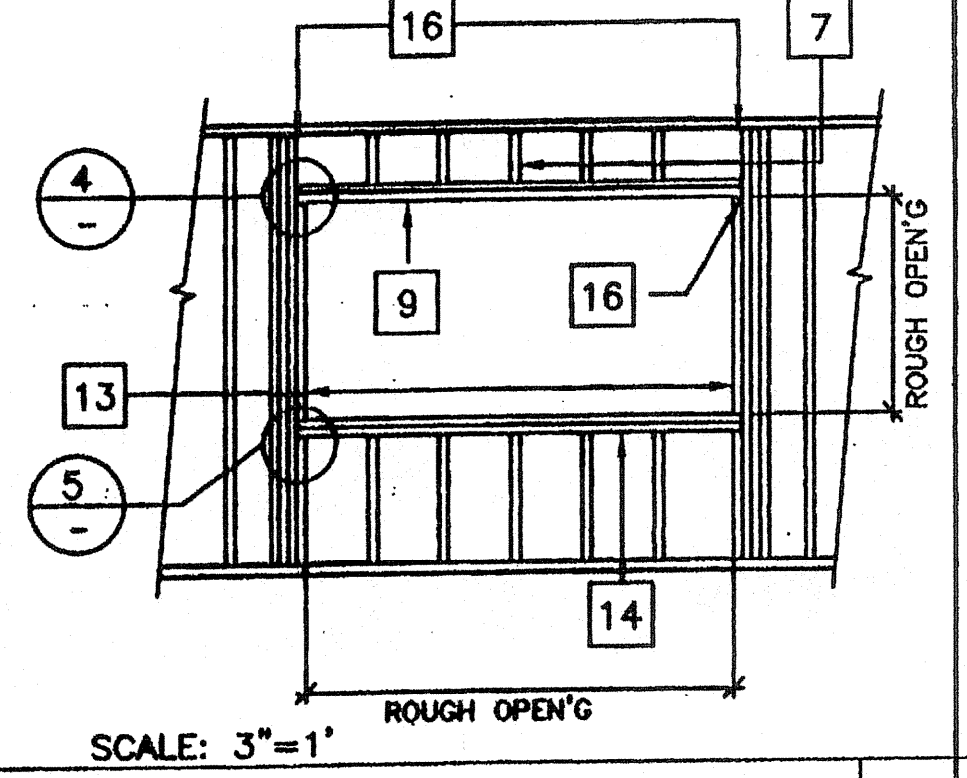


TYP. WINDOW FRAMING

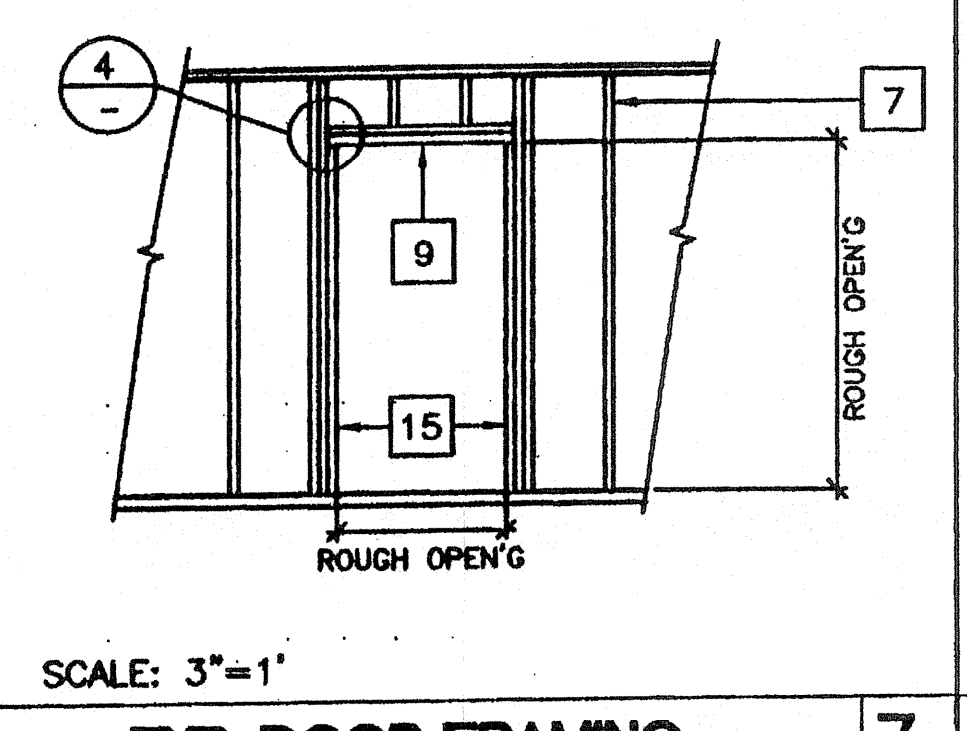


TYP. DOOR FRAMING

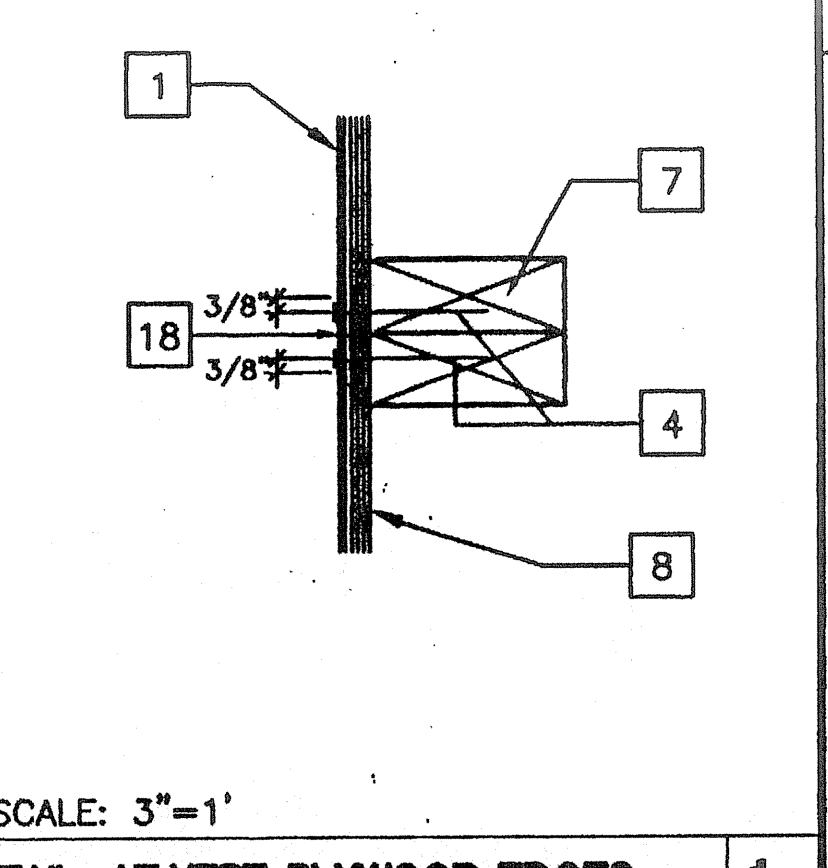


DETAIL AT VERT. PLYWOOD EDGES

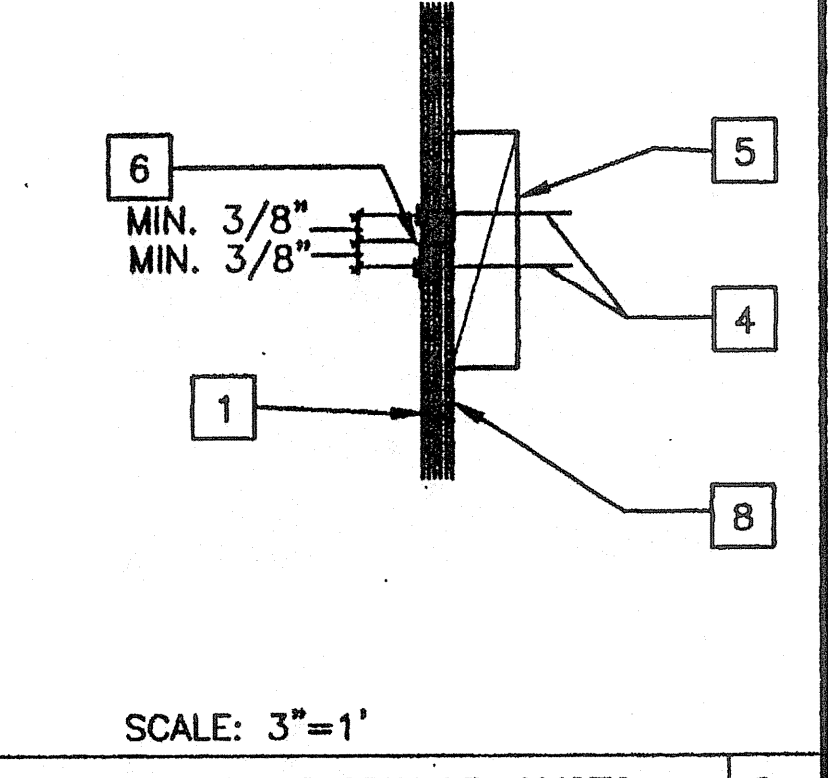

DETAIL AT HORIZ PLYWOOD JOISTS

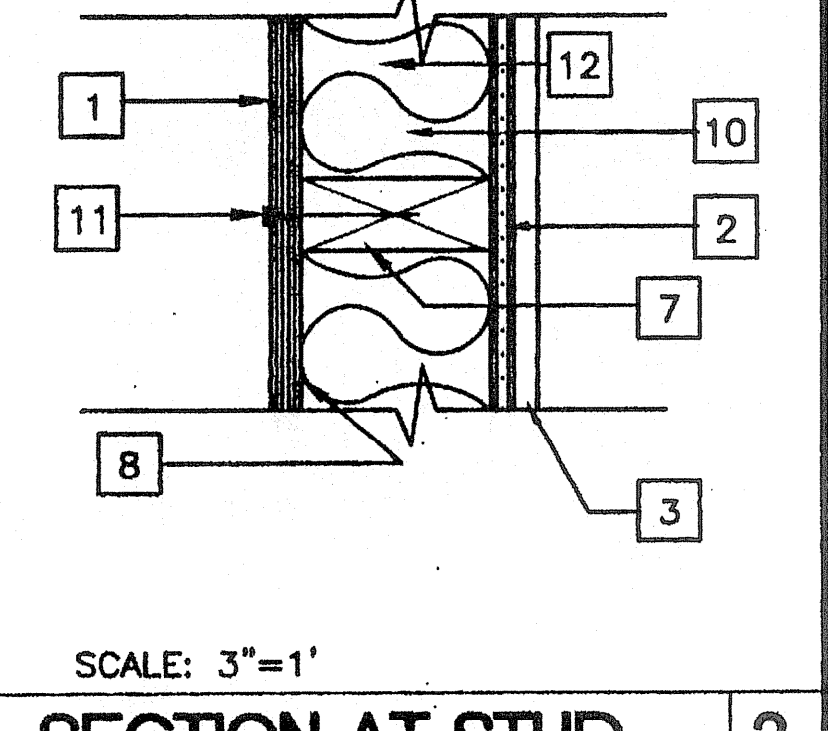


SECTION AT STUD

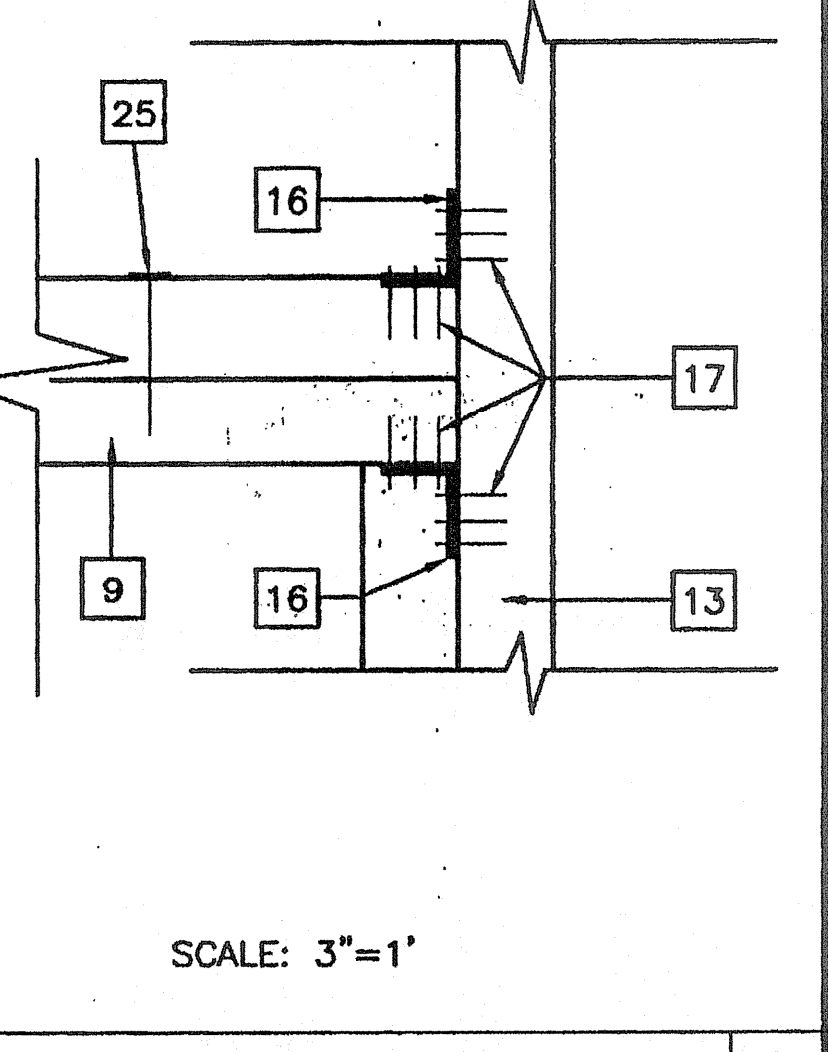

HEADER DETAIL


KEY NOTES

- EXTERIOR PLYWOOD SIDING - SHEATHING NAIL W/GALV. BOX NAILS - 8d at 6" O.C. EDGES, 8d AT 12" O.C. IN FIELD
- GYP. BOARD
- TYP. INTERIOR FINISH-SEE FINISH SCHEDULE
- E.N.
- 2X4 BLK'G
- "Z" FLASHING
- 2X4 AT 16" O.C./DBL. 2X4 AT VERT. SIDING JOINT
- WATERPROOF MEMBRANE
- HEADER (SEE SCHEDULE S5.0)
- INSULATION (SEE SPECIFICATIONS)
- 8d ELECTRO GALV. 12" O.C.FN.
- 2X4 SILL PLATE (BELOW)
- FULL HEIGHT STUDS AND 1-2X4 TRIMMER (SEE OPENING SCHEDULE FOR JAMB STUDS REQ'D FOR DOORS & WINDOWS ONLY)
- SILL PLATE (SEE SCHEDULE)
- 2X4 FULL HEIGHT KING STUDS AND 2X4 TRIMMER (SEE SCHEDULE FOR QUANTITY)
- A 34 CLIPS AT HEADER AND SILL TO FULL HEIGHT STUDS AND FULL HEIGHT STUDS TO TOP AND BOTTOM PLATES
- 9GA. 8d 1 1/2" NAILS
- LAP JOINT
- 2" WIDE DUCT SUPPORT STRAP @ 48" O.C.
- PLENUM
- DUCTWORK
- ROOF PURLINE
- TRANSFER BOX
- ROOF CHANNEL
- 16D @ 16" O.C.

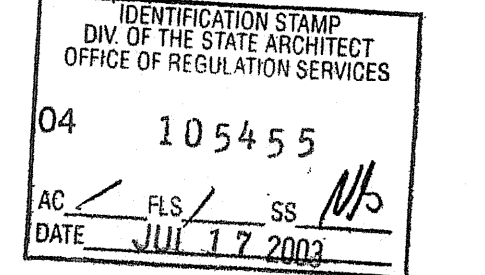

NOTES

1. NAILING:
 -NAILING IN ACCORDANCE W/ T.24 C.A.C TABLE 2-25 P
 -ALL NAILS EXPOSED TO WEATHER SHALL BE GALV.
 -MACHINE APPLIED NAILING SHALL HAVE PRIOR DEMONSTRATION AND APPROVAL BY O.S.A. / DSA FIELD REP. AND THE ARCHITECT.

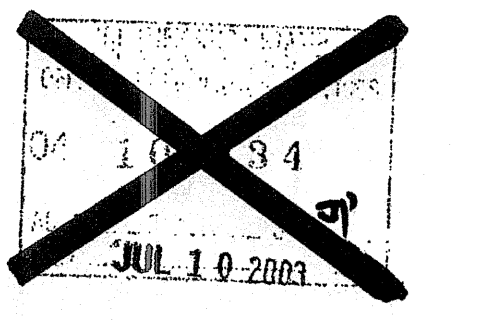

REVISIONS	Electrical Engineer's Seal	Mechanical Engineer's Seal	PC Professional of Record Seal	Architects Seal

PC Professional of Record Seal
 Architects Seal

PC
 CBC 2001
 IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 PC-04
 104796
 AC: FLS: 5/3
 DATE: 8/2/02

PC
 CBC 2001
 IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 PC-04
 104796
 AC: FLS: 5/3
 DATE: 8/2/02

MODTECH
 2830 BARRETT AVENUE FAX (909) 943-4014
 PERRIS, CALIF. 92572 FAX (909) 940-0427

PROJECT NUMBER: 4736
 WILLIAM SCOTTSMAN
FRAMING DETAILS

© MODTECH, INC. 2002
 ALL RIGHTS RESERVED
 DRAWN BY: GL
 DATE: 07/07/03
 CHECKED BY:
 DATE:
 MODTECH Index No.
S5.0

PROJECT NO. 4736