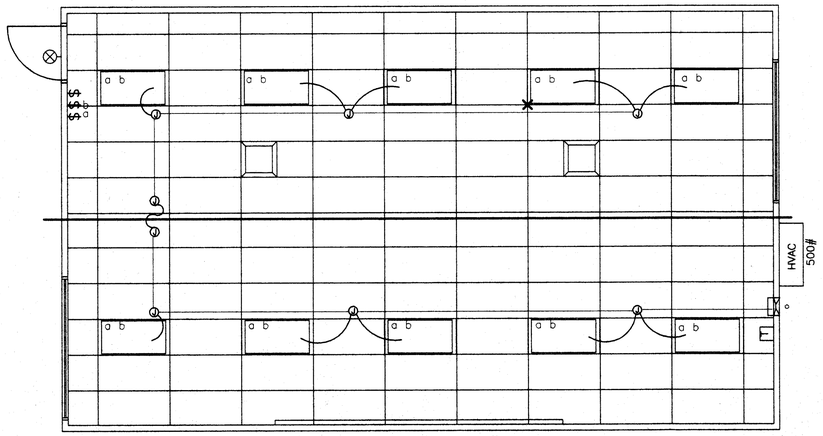

1 / E1 LIGHT FIXTURE PLAN
1/4" = 1'-0"

NOTES:
A. FIRE EXTINGUISHER– INSTALL 30" FROM END WAL AT +48" FROM FLOOR.
B. J-BOX ONLY (INTERCOM) – 3/4" CONDUIT STUBBED ABOVE CEILING. INSTALL 30" FROM DOOR AT +48" FROM FLOOR.
C. FIRE ALARM PULL STATION – INSTALL 42" FROM DOOR AT +48" FROM FLOOR.
D. MINI HORN – INSTALL AT +80" FROM FLOOR.
E. EXTERIOR FIRE HORN – INSTALL AT +90" FROM FLOOR.
F. DUPLEX OUTLET AT 18" BELOW CEILING. 12" FROM WALL.
G. J-BOX ONLY (CABLE TV) – 18" BELOW CEILING AND 20 " FROM WALL – 3/4" CONDUIT.
H. J-BOX ONLY (DATA OUTLET) – 16" FROM WALL AND +24' ABOVE FLOOR.
J. ADD ADDITIONAL DUPLEX OUTLET AT +16" FROM FLOOR CENTERED UNDER MARKER BOARDS.
K. J-BOX ONLY (INTERCOM) – INSTALL 4–11/16" BOX, 2 GANG RING WITH 3/4" CONDUIT STUBBED ABOVE CEILING.
L. J-BOX ONLY (FIRE ALARM) – INSTALL 4/5 BOX, 2 GANG RING WITH 3/4" CONDUIT STUBBED ABOVE CEILING.
M. J-BOX ONLY (FIRE ALARM VISUAL DIVICE) – INSTALL AT 24" FROM DOOR AND +80" ABOVE FLOOR TO CENTER OF J-BOX.
N. INSTALL CAST IRON DRAIN AND VENT PIPE WITHIN WALL – SEE ATTACHED DETAIL.
P. EXCHANGE STANDARD OUTLET FOR G.F.I. RECEPTACLE. MOUNT AT 8'-0" FROM END WALL AND _42" TO CENTER OF OUTLET FROM FLOOR.
R. INSTALL STANDARD HVAC UNIT WITHOUT T-STAT. BCSD WILL PROVIDE.
S. PROVIDE EXPANDED METAL SKIRTING VENTS.
T. STANDARDIZE LOCATION OF ELECTRICAL TIE-IN FOR MAIN POWER TO BUILDING. PROVIDE 48" LONG GROUNDING WIRE.
U. PROVIDE EXTERIOR PAINTING FOR WOOD EXTERIOR FINISH AS NOTED. WATER BASED PRIMER WITH LOW SHEEN ENAMEL FINISH.
W. INSTALL STANDARD HOLLOW METAL EXTERIOR DOOR WITHOUT LOCKSET. BCSD WILL PROVIDE.
X. EXCHANGE DOOR CLOSER. USE NORTON 7500 SERIES IN LIEU OF SPECIFIED
Y. ADD ADDITIONAL DUPLEX OUTLET AT 10'-0" FROM END WALL AND +16"

STANDARD ELECTRICAL SYMBOLS

- FLUORESCENT LIGHTING FIXTURE – SURFACE MOUNTED.
- FLUORESCENT LIGHTING FIXTURE – RESCESSED.
- FLUORESCENT LIGHTING FIXTURE – WALL MOUNTED (EXTERIOR)
- INCANDESCENT LIGHTING FIXTURE – WALL MOUNTED (INTERIOR).
- DUPLEX WALL CONVENIENCE OUTLETS +18".
- SINGLE POLE LIGHT SWITHCES +48", HUBBELL PREMIUM, BRYANT HEAVY DUTY, OR LEVITON SPECIFICATIONS GRADE.
- LECTRICAL CROSSOVER J-BOXES ABOVE T-BAR CEILING #1-4"X1 ",#22 4"X2 "
- WALL CLOCK OUTLET WITH POWER OUTLET +84".
- a SWITCH SUBSCRIPTS – a=DEVICE CONTROLLED.
- 15 AMP DUPLEX RECEPTACLE +18".
- JUNCTION BOX – SIZE AND TYPE AS REQUIRED.
- PANELBOARD – SEE SCHEDULE.
- TERMINAL CABINET – SIZE AND TYPE AS NOTED.
- CONDUIT CONCEALED IN CEILING OR WALL.
- CONDUIT CONCEALED BELOW FLOOR OR GRADE.
- HOMERUN TO RESPECTIVE PANEL TO TERMINAL.
- INDICATES 1#14 (GREEN) GROUND WIRE, OTHER SIZES AS INDICATED.
- NOTE: BRANCH CIRCUIT WITHOUT FURTHER DESIGNATION IS A 2#14 WIRE CIRCUIT, FOR MORE THAN 2#14 WIRES AS FOLLOWS, 3#14, 4#14 ETC. FOR OTHER SIZES AS FOLLOWS, 3#10, 4#6 ETC.
- A FIXTURE IDENTIFICATION – LETTER INDICATES TYPE.
- N.I.E.S. ABBREV. FOR NOT IN ELECTRICAL SECTION OF THESE PLANS AND SPEC'S.
- MT ABBREV. FOR EMPTY CONDUIT WITH POLY PULL CORD.
- FUSED DISCONNECT SWITCH SIZE AS REQUIRED. PROVIDE FUSES AS RECOMMENDED BY EQUIPMENT SUPPLIER.
- [W.E.F.] WALL MOUNTED EXHAUST FAN N.I.E.S. CONNECT AS REQUIRED.
- 50 AMP 250 VOLT RANGE RECEPTACLE.
- F FIRE ALARM STATION – OUTLET ONLY, 4" SQ. BOX W/ SINGLE DEVICE RING AND COVER +48"CENTERLINE
- FIRE ALARM HORN – OULET ONLY – 4" SQ. BOX W/ SINGLE DEVICE RING AND COVER +90" MIN. AND NOT LESS THAN 6" BELOW FINISHED CEILING.
- FIRE ALARM VISUAL ALARM– OUTLET ONLY – 4" SQ. BOX W/ SINGLE DEVICE RING AND COVER BOTTOM +80". A.F.F. BUT NO GREATER THAN +96". IF CEILING MOUNTED PER NFPA72 TABLE 6–4.4.1(b).
- SPEAKER– OUTLET ONLY – 4" SQ. BOX W/ SINGLE DEVICE RING AND COVER +84"
- INTERCOM TELEPHONE– OUTLET ONLY– 4" SQ. BOX W/ SINGLE DEVICE RING AND COVER +48"
- M FIRE ALARM MINI HORN – OULET ONLY – 4" SQ. BOX W/ SINGLE DEVICE RING AND COVER +90" MIN. AND NOT LESS THAN 6" BELOW FINISHED CEILING.

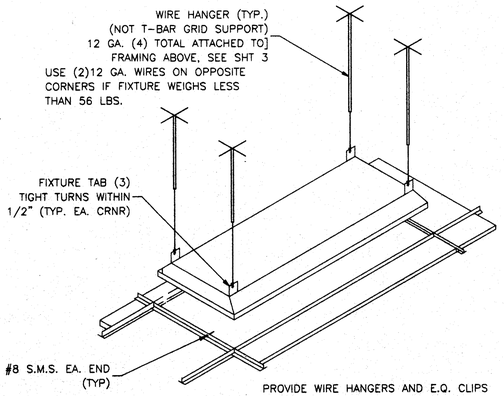

SUPPORT DETAIL

PROVIDE WIRE HANGERS AND E.Q. CLIPS AS REQUIRED BY CALIFORNIA SEISMIC REGULATIONS CBC 2501.A.5 & IR. M-3

SYMBOL	DESCRIPTION	WATTS	MANUFACTURER
	2'X4' FLOURESCENT DROP IN FIXTURE, ACRYLIC PRISMATIC LENS. T-8 ELECTRONIC BALLAST. (4)32 WATT TUBES, WT. 27 LBS.	156 W	CRESCENT 24TF440DLA
	FLOURESCENT SURFACE MOUNTED EXTERIOR LIGHT WITH IMPACT RESISTANT ENCLOSURE. .125 THICK CLEAR PRISMATIC ONE PIECE LENS W/ NEOPRENE GASKET & "POSIGRIP" STAINLESS STEEL SCREWS.	(2) 7W TT 2700 K	KENALL 3714 OR LITHONIA 202 2/7PL LP

SEE TYPICAL CLASSROOM LAYOUT FOR LOCATIONS OF ALL DEVICES.
FIXTURE MOUNTING SHALL COMPLY WITH CALIFORNIA SEISMIC REGULATIONS.

FIRE ALARM SYSTEM

1. THE FIRE ALARM SYSTEM SHALL CONFORM TO THE CALIFORNIA ELECTRICAL CODE, ARTICLE 760 &CA. FIRE CODE ART. 10.
2. INSTALLATION OF THE FIRE ALARM SYSTEM SHALL NOT BE STARTED UNTIL DETAILED PLANS AND SPECIFICATIONS, INCLUDING CALIFORNIA STATE FIRE MARSHAL LISTING NUMBERS FOR EACH COMPONENT OF THE SYSTEM HAVE BEEN APPROVED BY THE DIVISION OF THE STATE ARCHITRCT.
3. UPON COMPLETION OF THE INSTALLATION OF THE FIRE ALARM SYSTEM, A SATISFACTORY TEST OF THE ENTIRE SYSTEM SHALL BE MADE IN THE PRESENCE OF THE ENFORCING AGENCY.

GENERAL NOTES

1. GROUNDING ELECTRODE CONDUCTOR SIZED PER CEC 250-94 & 95.
2. ALLOW FOR 12' MOVEMENT IN ANY DIRECTION IF PAD FOUNDATION IS USED.
3. PROVIDE BONDS TO BLDG. STEEL & PANEL (#8 CU)
4. PANEL TO LISTED FOR USE AS SERVICE EQUIPMENT.

FIXTURE NOTES:
1. ALL FLUORESCENT LIGHT FIXTURES SHALL HAVE ENERGY SAVING LAMPS AND BALLASTS.
2. LUMINATES/BALLASTS SHALL BE CERTIFIED PER CALIFORNIA BUILDING CODE TITLE 24.
3. FLUORESCENT LIGHT FIXTURE TYPE "A" SHALL BE CONTROLLED TO PROVIDE TWO LEVELS OF LIGHTING. SWITCH (SA) SHALL CONTROL THE TWO OUTER LAMPS AND SWITCH (SB) SHALL CONTROL THE TWO INNER LAMPS.

ELECTRICAL
1. Electrical service drop and connections supplied by others.
2. Manufacturer to provide stub-out from back of electrical panel through the exterior wall for receiving either underground or overhead service & fitting for grounding cable.
3. Electrical panel board shall be recess mounted inside the building. Sized to accommodate all connected loads including spaces as shown. Overcurrent protective devices in the panel boards have adequate short circuit interrupting capacity. All buses including bus shall be copper or aluminum.
4. 2x4 Flourescent fixtures shall be steel frame, lens shall be hinged and locked in place by two locking devices. The lens diffusers shall be KHS, Inc. #KSH-12, Caralite, Inc. #C-12 or Plaskolite, Inc. #PL21A. Minimum lens thickness shall be .125 inch.
5. Flourescent ballast shall be energy saver while maintaining full light output, class "P" equipped with thermal protectors, guaranteed against failure for (2) years and be replaced from inside the fixture.

A) Clock – 12" dial clock on clock outlet.
B) Clock shall be General Electric model 2912 129V 60 cycle
C) Clock outlet shall be Bryant #2828 or equal with seperable hanging clip & app'd recept.

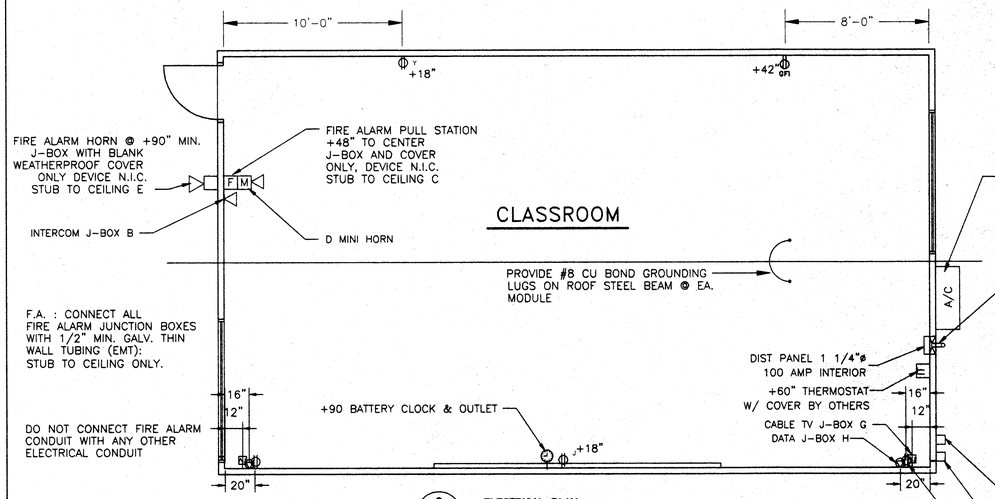

2 / E1 ELECTRICAL PLAN
1/4" = 1'-0"

WALL MOUNTED HEAT PUMP UNIT SEE MECHANICAL (240V,1PH.) W/ DISCONNECT BREAKER MOUNTED IN UNIT.

STUB OUT FITTING AT PANEL FOR GROUNDING BLDG. FRAME & PANEL W/ #8 WIRE SEE GROUNDING DETAIL PER I.R. 8-1

STUB OUT FITTING FOR UNDERGROUND OR OVERHEAD SERVICE BY OTHERS SEE ELECTRICAL NOTE #2.

LOCATION FOR F/A 2 GANG J-BOX @ 18" ABOVE FIN. FLR.

J-BOX FOR INTERCOM

DUPLEX RECEPT. F

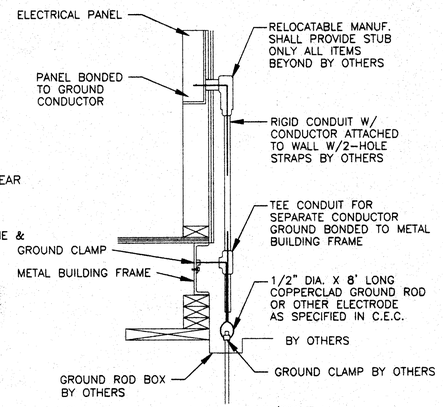

Size of conductors shall comply W/CEC Table
Bond separate conductors from ground rod to electrical panel & metal building from.
In addition to the detail shown above, bond the electrical ground to metal water pipe embedded @ least 10' into the soil if available.
Electrical bond modules together W/#8 CU @ modline. By manufacturer. Check resistance to ground. If resistance exceeds 25 OHMS, install additional ground rods as required. Grounding detail per I-R M-3. INSPECTOR TO WITNESS GROUNDING TEST.

A / E1 BUILDING GROUND DETAIL
N.T.S.

FIRE ALARM
Junction boxes – Galvanized sheet metal, square or rectangular with blank covers. Locate one box at rear of building near main electrical panel at +18- above finish floor for future connection.
Covers – Install gasketed, metal, waterproof, finish covers at exterior locations. Install finish covers at interior locations.

If testing results determine fire alarm audibility does not meet 15db over ambient noise levels, additional fire alarm signaling devices may be required by the enforcing anency

The H.V.A.C. unit feeder circuit – panel circuit breaker,
feeder wire, unit disconnect and fuses (where used) – is to be coordinated with the name plate data at the time ofmanufacture. H.V.A.C. units having KVA ratings larger than that indicated on this panel schedule will not be allowed to be installed on this building. If 60 degrees C. wire is to be used in this installation, calcuations demonstrating ampacity be provided on the drawing.

THESE DRAWINGS AND / OR SPECIFICATIONS AND / OR CALCULATIONS FOR THE ITEMS LISTED BELOW HAVE BEEN PREPARED BY OTHER DESIGN PROFESSIONALS WHO ARE LICENSED AND AUTHORIZED TO PREPARED SUCH DRAWINGS IN THIS STATE. THESE DOCUMENTS HAVE BEEN EXAMINED BY ME AND HAVE BEEN FOUND TO MEET THE APPROPRIATE REQUIREMENTS OF TITLE 24, CALIFORNIA CODE OF REGULATIONS AND THE PROJECT SPECIFICATIONS PREPARED BY ME.
THE ITEMS LISTED BELOW ARE ACCEPTABLE FOR INCORPORATION INTO THE CONSTRUCTION OF THIS PROJECT FOR WHICH I AM THE INDIVIDUAL DESIGNATED TO BE IN GENERAL RESPONSIBLE CHARGE (OR FOR WHICH I HAVE BEEN DELIGATED RESPONSIBILITY FOR THIS PORTION OF THE WORK).
A LIST OF ITEMS HAVE BEEN REVIEWED AND ACCEPTED. (FOR DRAWINGS, A LIST OF ALL ACCEPTED DRAWINGS ARE ATTACHED, SEE SHEET NO.).

LICENSED ARCHITECT STEPHEN J. CORBETT No. C-16788 REN. 11/30/01 STATE OF CALIFORNIA

DATE 8/2/00
LICENSE # C-16788
EXP. DATE 11/30/01

VOLTS: 120/240 SINGLE PHASE				PANEL: A							FEED: EXTERIOR LB			
MAIN: 100 AMP MAIN BKR.				LOCATION: INTERIOR							MOUNTING: FLUSH			
LOAD	WATTS A	WATTS B	BRK. AMP	C P	C R	A	B	C T	R P	BRK. AMP	WATTS A	WATTS B	LOAD
LIGHTS, FLUORESCENT	960		15	1	1			2	2	70	6600		A/C HVAC UNIT
LIGHTS, FLUORESCENT		960	15	1	3			4	2	70		6600	
EXTERIOR LIGHT & CLOCK	100		15	1	5			6					SPACE
DUPLEX RECEPT.		720	15	1	7			8					
DUPLEX RECEPT.	720		15	1	9			10					
SPACE					11			12					
					13			14					
					15			16					
PHASE WATTAGE	1880	1680			17			18			6600	6600	PHASE WATTAGE
TOTAL WATTS "A"LEG: 8480				TOTAL WATTS A+B= 16760							TOTAL WATTS "B" LEG 8280		
TOTAL WATTS: 16760			70	AMPS		120/240V			SINGLE PHASE				100AMP BUS.

FEEDERS: TO BE RUN BY THE DISTRICT EITHER UNDERGROUND OR OVERHEAD, SEE SITE ELEC. PLAN.

3 / E1 ELECTRICAL DISTRIBUTION PLAN
1/4" = 1'-0"

FILE NO. 15-6
IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
APPL. 03-104224
FLS SS
DATE MAR 01 2001

24 X 40
RELOCATABLE
CLASSROOMS

American Modular Systems
333 EAST CARNEGIE CT. MANTECA, CALIFORNIA 95337
PHONE (209) 825-1921 FAX. (209) 825-7018

CUSTOMER: BAKERSFIELD CITY SCHOOL DISTRICT

ELECTRICAL PLAN & NOTES

DATE: 06-08-00
SCALE: NONE
DRAWN BY: R.S.
CHECKED BY:
CHECKED BY:
SERIAL NO.

REVISIONS

NO	DATE	DESCRIPTION	NO	DATE	DESCRIPTION

PROJECT No.

SHEET No. E 1