


48 x 40
RELOCATABLE
CLASSROOM

American Modular Systems

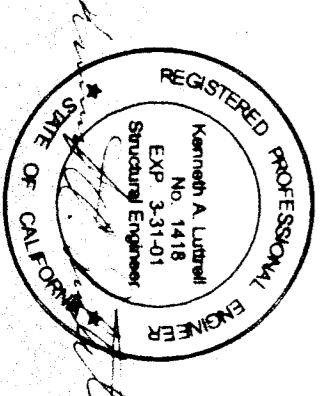

CUSTOMER:	
FOOTINGS, REINFORCING, ETC.	
FOUNDATION PLAN AND DETAILS	

DATE: 12/27/99	
SCALE: AS NOTED	NO. DATE
DRAWN BY: PWD	DESCRIPTION NO.
DESIGNED BY: MBD	DATE
CHECKED BY: KAL	DESCRIPTION
SERIAL NO.	

EX. DATE 1/20/00	
REVISIONS	

FILE NO. PC	
DIV. OF THE STATE ARCHITECT	
OFFICE OF REGULATION SERVICES	
APPLICATION NO. 02-10185	
AC. DATE JAN 12 2000	

PROJECT NO. 99108	
SHEET NO. S1D	

CONCRETE PROPORTIONS ARE PER METHOD A OF TITLE 24.			
PART 2, SECTION 1905A.7.3 AND TABLE 19A-A-7			
MAXIMUM SIZE	MINIMUM SACKS OF CEMENT PER YARD OF CONCRETE	MAXIMUM WATER GALLONS PER 94 LBS SACK OF CEMENT	MINIMUM RATIO IN COMpressive STRENGTH IN PER SQUARE INCH
1 1/2 INCHES	6.6	6.00	

NOTES:

- DO NOT INSTALL BUILDING IN AREAS OF WATER FLOW LINES.
- CONCRETE STRENGTH 3000 PSI MAX.
- REINFORCING STEEL 40,000 FSY MINIMUM PER ASTM A615.
- MINIMUM SOIL BEARING CAPACITY 1000 PSI.
- DESIGN SOIL BEARING CAPACITY 1000 PSI.
- VENT AREA RECD = 19.2 SF (1.1 x 17.2) = 12.8 SF
- VENT AREA PROVIDED = 13.3 SF

125 PSF LINE LOAD (W/O PARTITIONS)
FOUNDATION PLAN

COMBINED
FOUNDATION PLAN

SEE A/S1D FOR REMAINDER
1/4" = 1'-0"

A1
S1D

DATE 5/20/00

EX. DATE 1/20/00

REVISIONS

NO. DATE

DESCRIPTION NO.

DESCRIPTION

NO. DATE

DESCRIPTION

NO. DATE