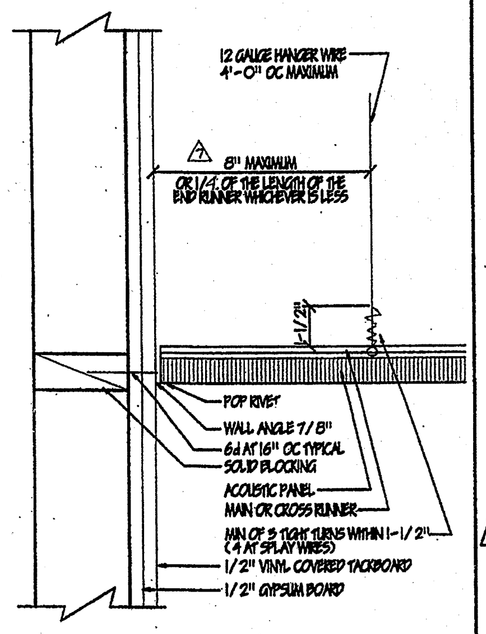

1 TYPICAL FIXED SIDE SCALE: 3/4"=1'-0"

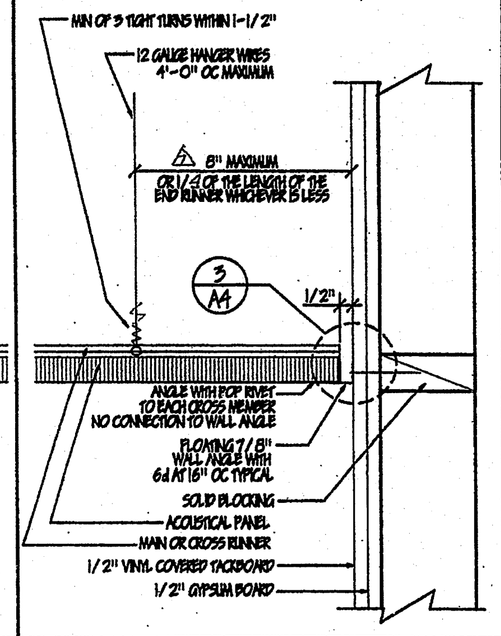

2 TYPICAL FREE SIDE SCALE: 3/4"=1'-0"

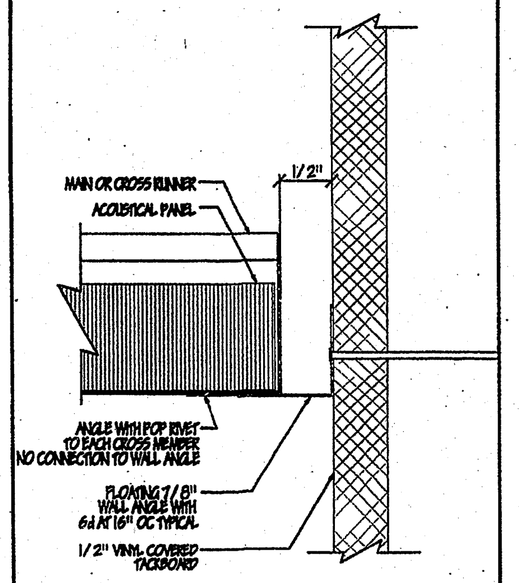

3 TYPICAL FREE CONN. SCALE: 1"=1'

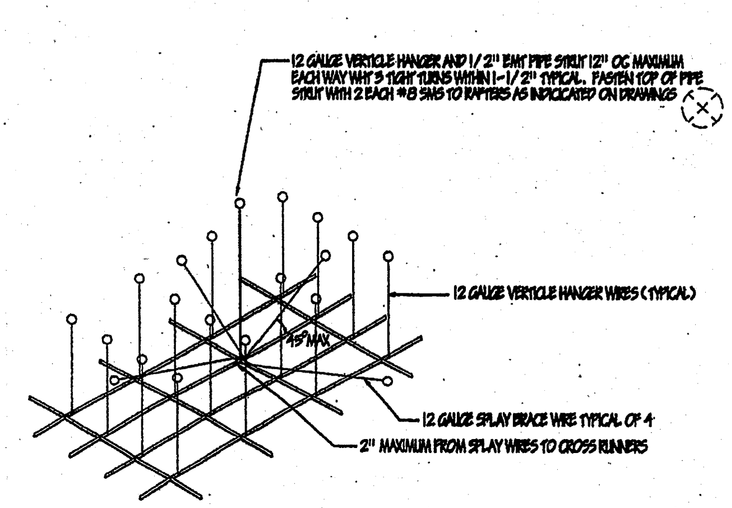

4 ATTACHMENT FOR CEILING GRID NOT TO SCALE

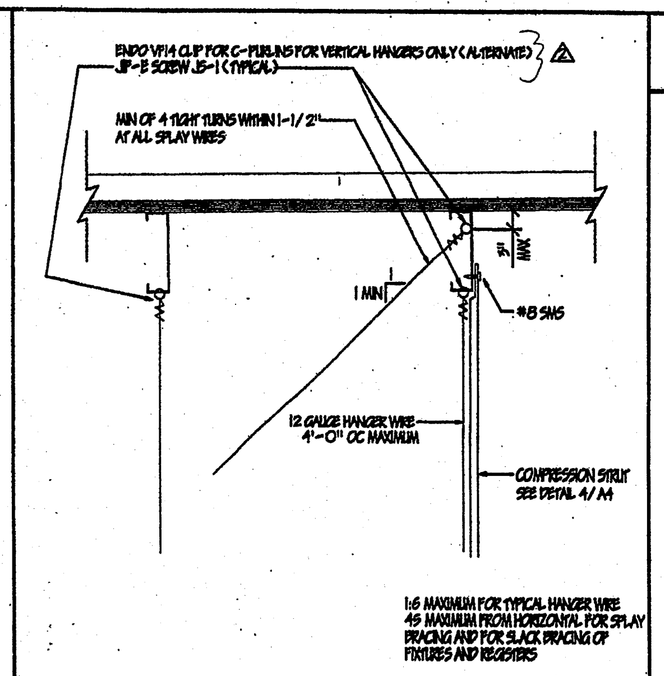

5 ATTACHMENT AT ROOF SCALE: 1-1/2"=1'-0"

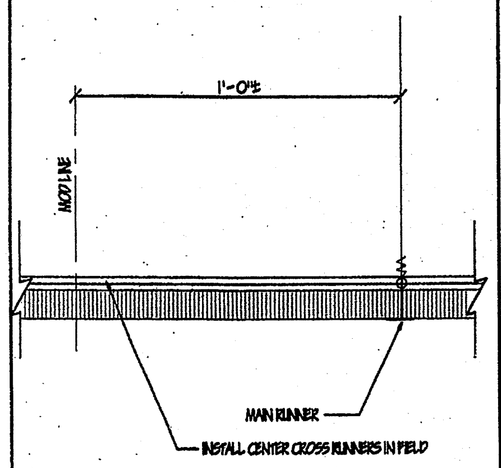

6 GRID AT MOD LINE SCALE: 3/4"=1'-0"

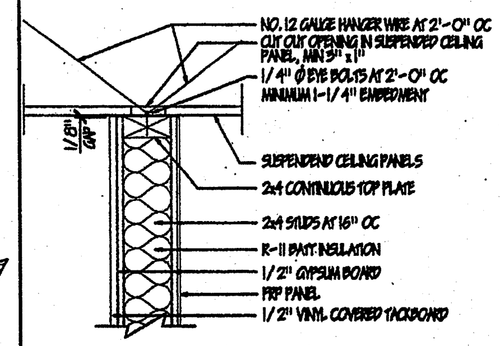

7 INTERIOR WALL SCALE: 1-1/2"=1'-0"

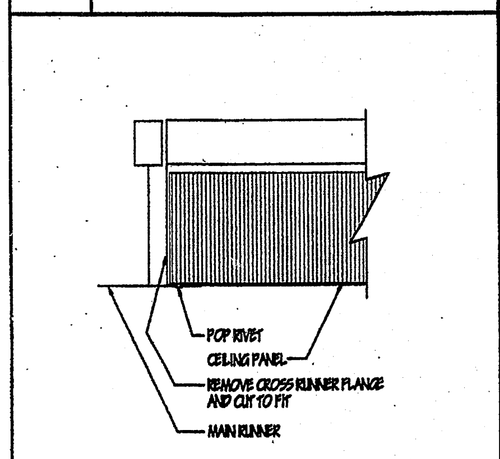

8 GRID AT MOD LINE SCALE: 1"=1'

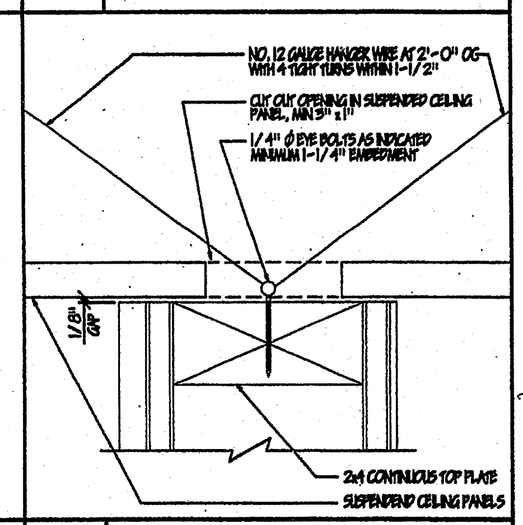

9 WALL CONNECTION SCALE: 6"=1'-0"

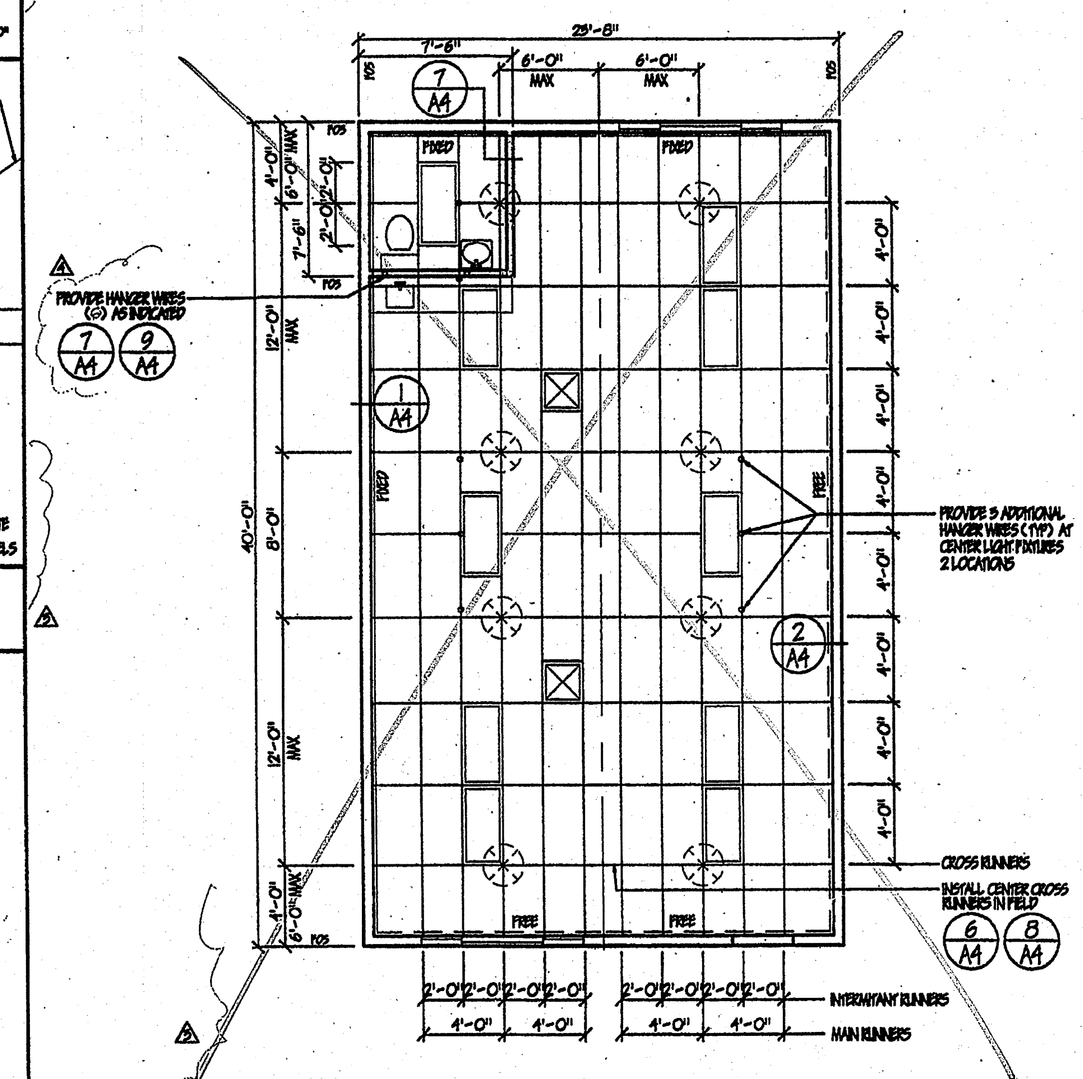

24 X 40 ALT. REFLECTED CEILING PLAN SCALE: 3/16"=1'-0"

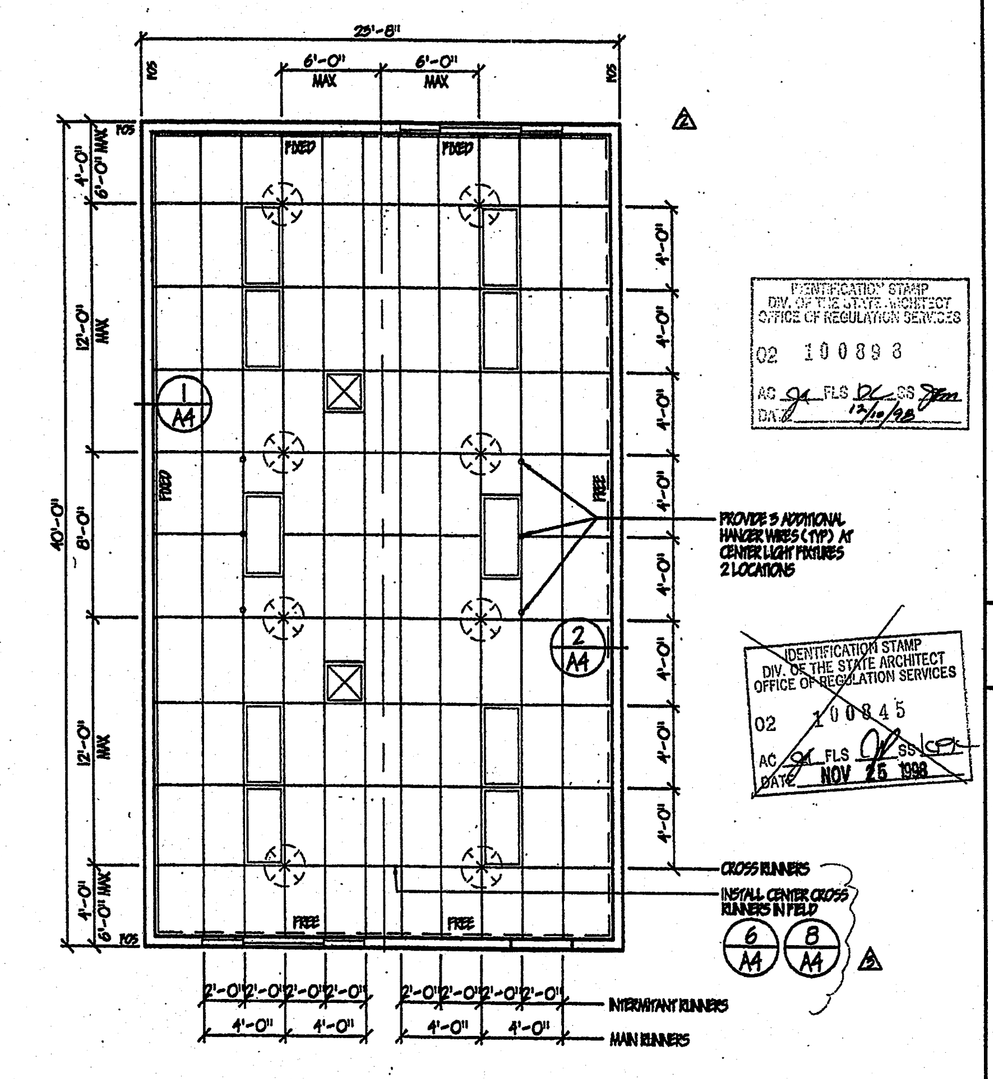

24 X 40 REFLECTED CEILING PLAN SCALE: 3/16"=1'-0"

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITECT OFFICE OF REGULATION SERVICES 02 100893 AC FLS SS DATE 12/10/98

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITECT OFFICE OF REGULATION SERVICES 02 100845 AC FLS SS DATE NOV 25 1998

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITECT OFFICE OF REGULATION SERVICES 02 100587 AC FLS SS DATE 7/1/98

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITECT OFFICE OF REGULATION SERVICES PC 330 AC FLS SS DATE 12/17/97

GENERAL NOTES

MAIN RUNNERS AT 4'-0" ON CENTER WITH 12GA HANGER WIRES AT END OF EACH RUNNER.

AT END OF RUNS OF RUNNERS A 12GA HANGER WIRE SHALL BE ATTACHED WITHIN 8" OF WALL, OR 1/4 LENGTH OF END TEE.

VERTICAL WIRES MORE THAN 1 IN 6 OUT OF PLUMB SHALL HAVE COUNTER BRACING WIRES.

PROVIDE 2-12GA SLACK WIRES TO HOUSING OF ALL LIGHT FIXTURES AT DIAGONAL CORNERS. WIRES SHALL BE ATTACHED TO STRUCTURE. ATTACH WIRES TO LIGHT FIXTURES WITH #8 SHEET METAL SCREW AT EACH CORNER.

RUNNERS MAY BE ATTACHED TO WALLS AT ONLY TWO ADJACENT WALLS. ALL OTHER CONDITIONS MUST PROVIDE A CLEARANCE OF 1/2" BETWEEN END OF RUNNERS AND FACE OF WALL.

CEILING AREAS SHALL HAVE 4-WAY SPLAYS AT LOCATIONS INDICATED. WIRES TO BE TAUT, BUT NO DISTORTION OF GRID.

ALL FINISHES SHALL COMPLY WITH CBC CHAPTERS 5, 6, 7, 8, AND 10

DUCTWORK SHALL BE RIGIDLY ATTACHED TO BUILDING AND SHALL NOT BE CLOSER THAN 6" TO HANGER WIRES.

REGISTERS SHALL BE POSITIVELY ATTACHED WITH 4-10GA SHEET METAL SCREWS TO GRID.

CEILING PANELS: 2'x4' LAY-IN PANELS, ASTM FLAME SPREAD CLASS I (0-25), FLAME SPREAD SMOKE DEVELOPMENT DENSITY LESS THAN 450.

△1 MAIN RUNNERS: ARMSTRONG PRELUDE XL, 7501 HD, OR EQUAL.

△2 INTERMEDIENT RUNNERS: ARMSTRONG PRELUDE XL, XL-7512, OR EQUAL.

△3 CROSS RUNNERS: ARMSTRONG PRELUDE XL, XL-7528, OR EQUAL.

WALL ANGLES: FST 8000/ 8501, CST 8000/ 8501, OR EQUAL.

ABBREVIATIONS:

AFF	ABOVE FINISH FLOOR
AL OR ALUM	ALUMINUM
ALT	ALTERNATE
CONN	CONNECTION
GA	GAUGE
HM	HOLLOW METAL
MAX.	MAXIMUM
MIN.	MINIMUM
NO.	NUMBER
NR	NOT RATED
OVHG	OVERHANG
PR	PAIR
SMS	SHEET METAL SCREW

LEGEND

MAIN RUNNER
CROSS RUNNER
T BAR CEILING
INDICATED FIXED SIDE
INDICATED FREE SIDE
SPLAY WIRE - 4 WAY
2'x4' RECESSED LIGHT FIXTURE
SUPPLY AIR DIFFUSER

APPROVALS

LICENSED ARCHITECT STEVEN K. KNAPP C-17824 REGISTERED PROFESSIONAL ENGINEER CIVIL STATE OF CALIFORNIA

PACESETTER INDUSTRIES, INC.

P.O. BOX 1131, MODESTO, CA 95353 (209) 521-1600

24x40 RELOCATABLE BUILDING

SHEET CONTENTS:

REFLECTED CEILING PLAN
ALT. REFLECTED CEILING PLAN
GENERAL NOTES
LEGEND
DETAILS

DATE:		APRIL 28, 1997
REV. #1	△1	MAY 15, 1997
REV. #2	△2	JUNE 20, 1997
REV. #3	△3	AUGUST 1, 1997
REV. #4	△4	AUGUST 26, 1997
REV. #7	△7	12-17-97
DRAWING SCALE:		AS SHOWN
PROJECT NUMBER:		97-03

SHEET A4