


## SYMBOLS

- CONDUIT ENGINES  
 CONDUIT CONCEALED IN WALL OR CEILING  
 CONDUIT CONCEALED UNDER FLOOR OR BELOW GRADE  
 CONDUIT STRIPPED OUT AND CAPPED  
 CONDUIT TURNED UP  
 CONDUIT TURNED DOWN  
 HATCH MARKS INDICATE NO. OF #s WIRES IN CORE SIZED  
 CONDUIT (3) MAX. IN 1 1/2" C. (5) MAX. IN 3/4" C.  
 (8) MAX. IN 1", NO MARKS = 2 #s  
 HANG RAIL LETTER INDICATES PANEL NUMBER(S) INDICATES  
 CIRCUIT(S).  
 SAWCUT  
 GROUND CONNECTION  
 DISTRIBUTION SWITCHBOARD OR PANEL  
 PANEL, BREAKER CIRCUIT TYPE, SURFACE AND FLUSH  
 SIGNAL TERMINAL, CABINET, SURFACE & FLUSH  
 FLUORESCENT FIXTURE  
 OUTLET DATA, BAR INDICATES WALL MOUNT, LETTER INDICATES  
 SWITCH CONTROL, NO INDICATES CIRCUIT.  
 SURFACE FIXTURE ON FLUSH OUTLET.  
 RECESSED FIXTURE WITH LUMINA FOR FTHU WIRING  
 ENT LIGHT WITH ARROWS AS SHOWN ON PLANS WALL AND  
 CEILING MOUNT  
 CEILING MOUNT  
 LUM LUMEN EXIT SIGN, 4" AFF, 4" FROD DOOR JUMP  
 LIGHT FIXTURE DESIGNATION, LETTER INDICATES TYPE,  
 NO. INDICATES WATTAGE. SEE FIXTURE SCHEDULE.  
 MECHANICAL EQUIPMENT DESIGNATION  
 SEE MECHANICAL DRAWINGS  
 SPECIAL RECEPTACLE - SEE PLAN  
 METER


# TYPICAL PORTABLE GROUNDING

SCALE: NONE

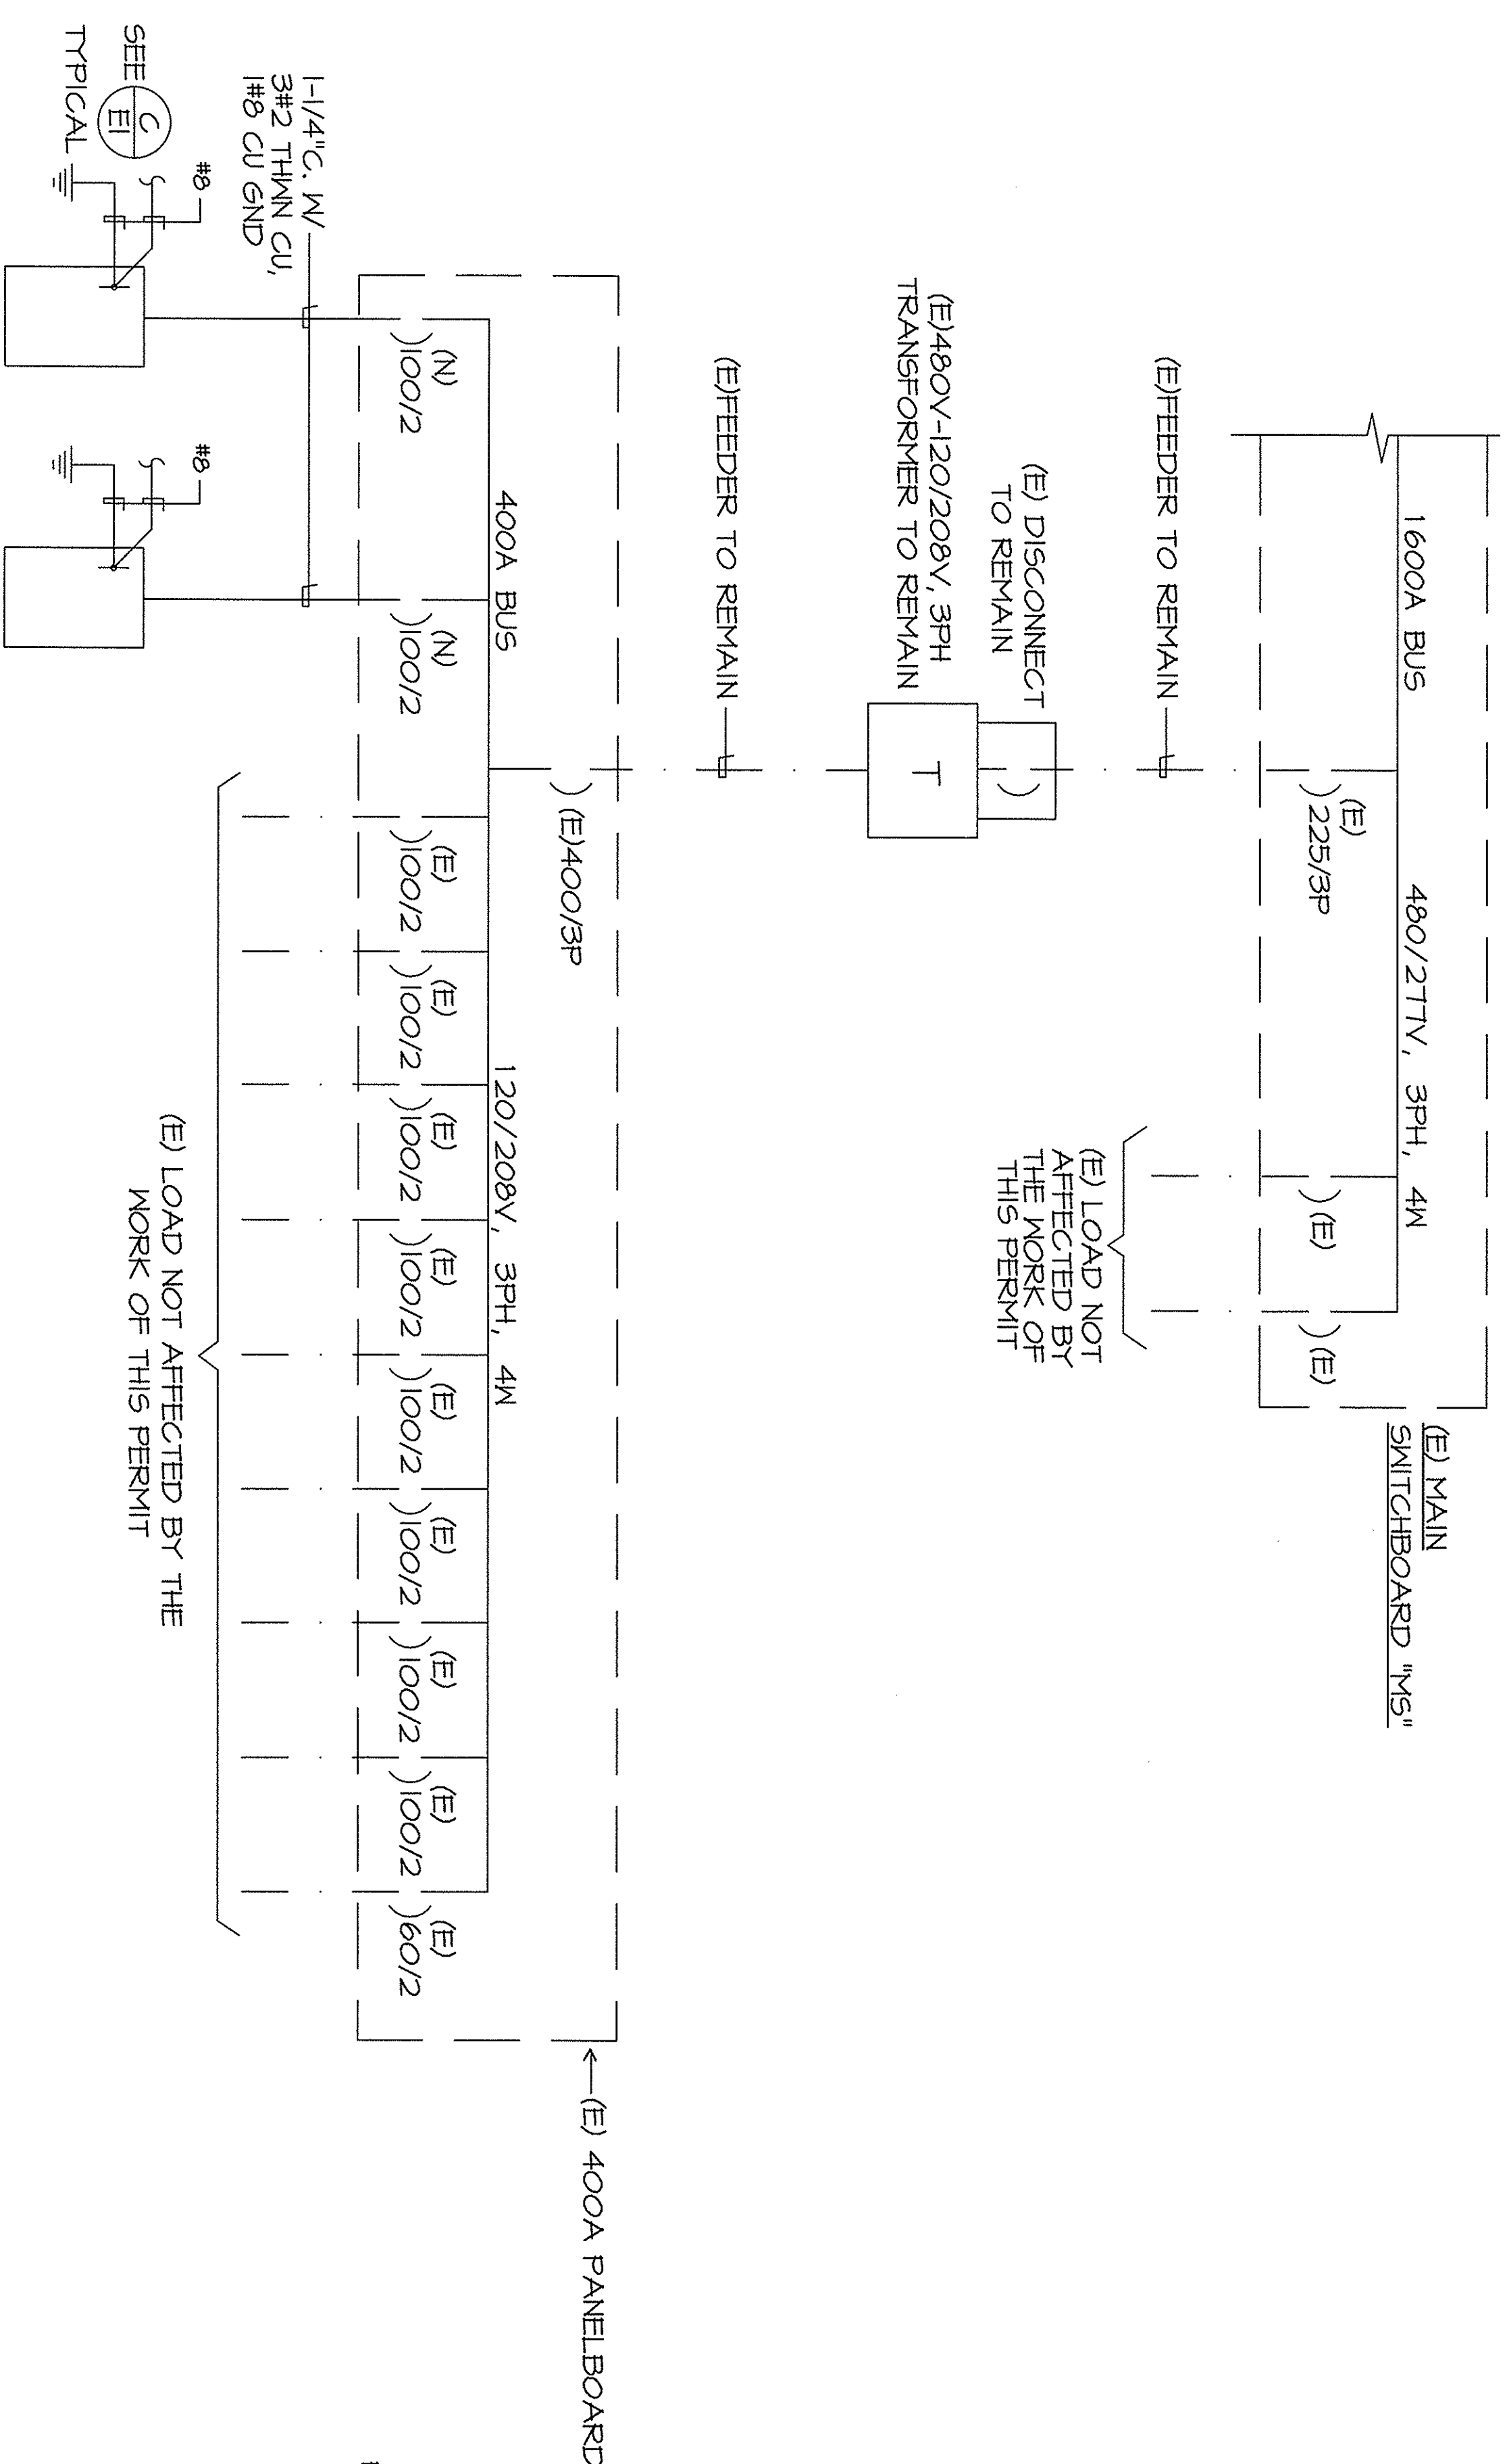

## KHS D PULLBOX DETAIL

SCALE: NONE

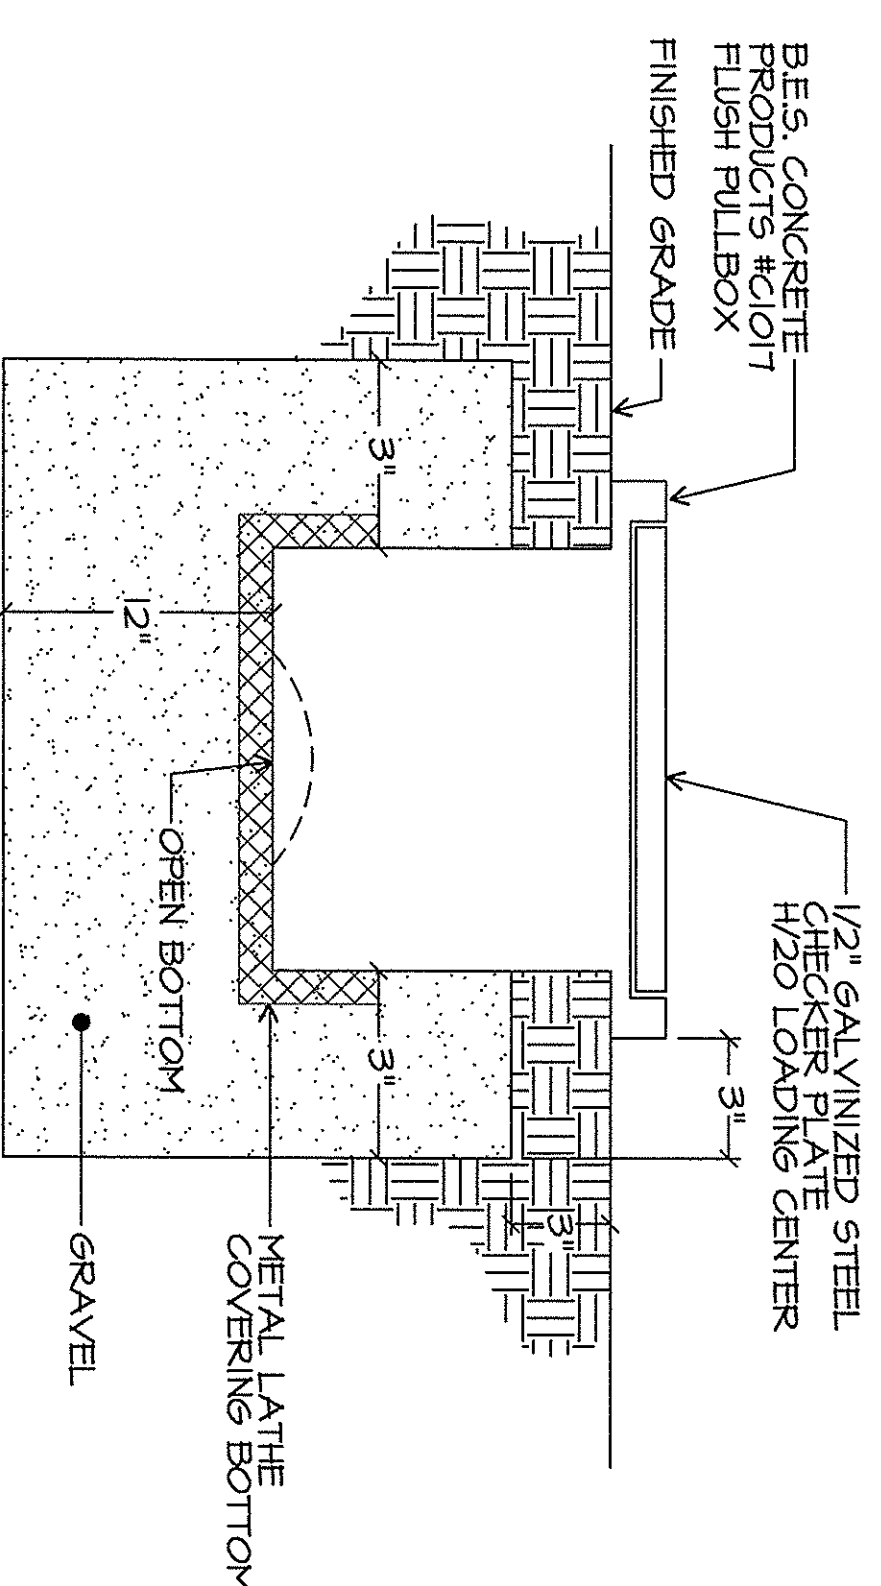


**FLEWELLING**

FLEWELLING  
&  
MOODY  
architects *for* education


**HEADQUARTERS OFFICE:**  
141 South Lake Avenue, 2nd Floor  
Pasadena, California 91101  
626.449.8787 FAX 626.449.8477  
E-Mail: [fm-pasadena@fswelling-moodys.com](mailto:fm-pasadena@fswelling-moodys.com)

**ANTELOPE VALLEY OFFICE:**  
1035 West Lancaster Boulevard  
Lancaster, California 93534  
661.394.0771 FAX 661.394.2843  
E-Mail: [fm-lancaster@flewelling-moody.com](mailto:fm-lancaster@flewelling-moody.com)


**An Employee Owned Corporation**

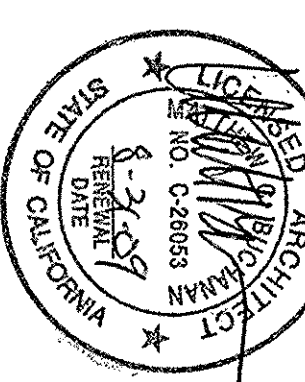

CONSULTANT

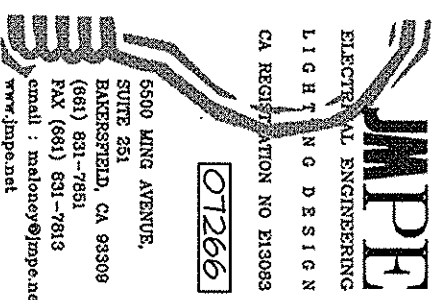

AGENCY

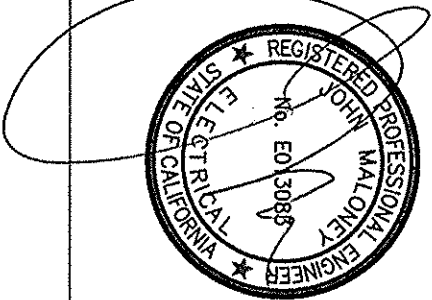

IDENTIFICATION STAMP  
DIV. OF THE STATE ARCHITECT

APP03 111193

ACF FLS 5TH SS *CE*

DATE NOV 01 2007

|            |             |
|------------|-------------|
| Drown by   |             |
| Checked by |             |
| Revisions  |             |
| No.        | Description |

All dimensions must be checked on the job by the contractor accept full responsibility for their accuracy under the contract. These plans & the specifications in connection therewith have been prepared for a specific site. Any and all responsibility for their use in whole or in part on any other site is hereby disclaimed by Planning & Moody.

**2 24'x40' MODULAR BUILDING  
AT CESAR E. CHAVEZ ES.**

BAKERSFIELD CITY SCHOOL DISTRICT

GENERAL NOTES, SYMBOLS  
DETAILS & SCHEDULES

Job No.

237

三