

**Ruben Ruiz**  
 From: Humphrey, Douglas@DGS <Douglas.Humphrey@dgs.ca.gov>  
 Sent: Tuesday, June 07, 2016 6:03 PM  
 To: Carlos Caceres  
 Cc: Rick Mello; Ruben Ruiz  
 Subject: RE: 15209.000 Pauly and 16132.000 Chipman portables - fire authority signature sheets.  
 Categories: Filed by Newforma

Carlos,  
 This email is a confirmation that the current situation in Bakersfield unfortunately makes participation of the LFA problematic and DSA is not requiring the DSA 810 for projects being developed in the City of Bakersfield. This may change in the future, but currently the 810 is not a required document.

Douglas Humphrey, AIA  
 Regional Manager, DSA Los Angeles  
 Division of the State Architect  
 Department of General Services  
 700 N. Alameda St., Suite 5-500  
 Los Angeles, Ca. 90012  
 Phone (213) 897-4092  
 E-mail douglas.humphrey@dgs.ca.gov



From: Carlos Caceres [mailto:carlos.caceres@bigroup.com]  
 Sent: Tuesday, June 07, 2016 1:58 PM  
 To: Humphrey, Douglas@DGS  
 Cc: Rick Mello; Ruben Ruiz  
 Subject: FW: 15209.000 Pauly and 16132.000 Chipman portables - fire authority signature sheets.

Hi Mr. Humphrey  
 As stated in our previous Email to you, our DSA appointment is the 22<sup>nd</sup> of this month. We need to know that it will be fine to submit the Bakersfield city school district projects, without the local fire authority signature.  
 (Please refer to previous email text below)  
 We do not want to risk jeopardizing the OTC plan check appointment, because we do not have the local fire authority signature requirement.

Page 1 of 1

**California Water Service Company  
Fire Flow Test**


Test Date: 6/5/2017      Test Time: 9:45      Approved Date:  
 District: BAKERSFIELD      Zone: 540      Plat: 32-38  
 General Location:  
 Address: 815 EUREKA ST  
 Cross Street: DOLORES ST  
 Requested By: BAKERSFIELD CITY SCHOOL DISTRICT  
 Purpose Of Test: FIRE FLOW  
 Conducted By: R BROWN - H MOORE  
 Witnessed By: C.W.S. Co.  
 Others: D PEREZ

Outlet No.	Size	PITOT	Observed	Static Pressure	Residual Pressure	Flow Observed	Flow Avail. @20
Location 1	Hydrant #	8381	Address: 400 KING ST				
1	4	20	1921	51	46	1921	5145
2	0	0	0	0			
3	0	0	0	0			
4	0	0	0	0			
Total Flow Observed Available @20:						1921	5145


Remarks: 1920 GPM  
 Static/Residual Location: CHICO/KING FH # 2854

Note:  
 Regardless of the results of this test, California Water Service Company assumes no liability beyond that stated in the following excerpt from the P.U.C. Tariff Schedule: "The utility (California Water Service Company) will supply only such water at such pressure as may be available from time to time as a result of its normal operation of the system."

http://engwebservice/fireflow/QRYPFIREFLOWDETAILS.ASP?ID=18065      6/5/2017

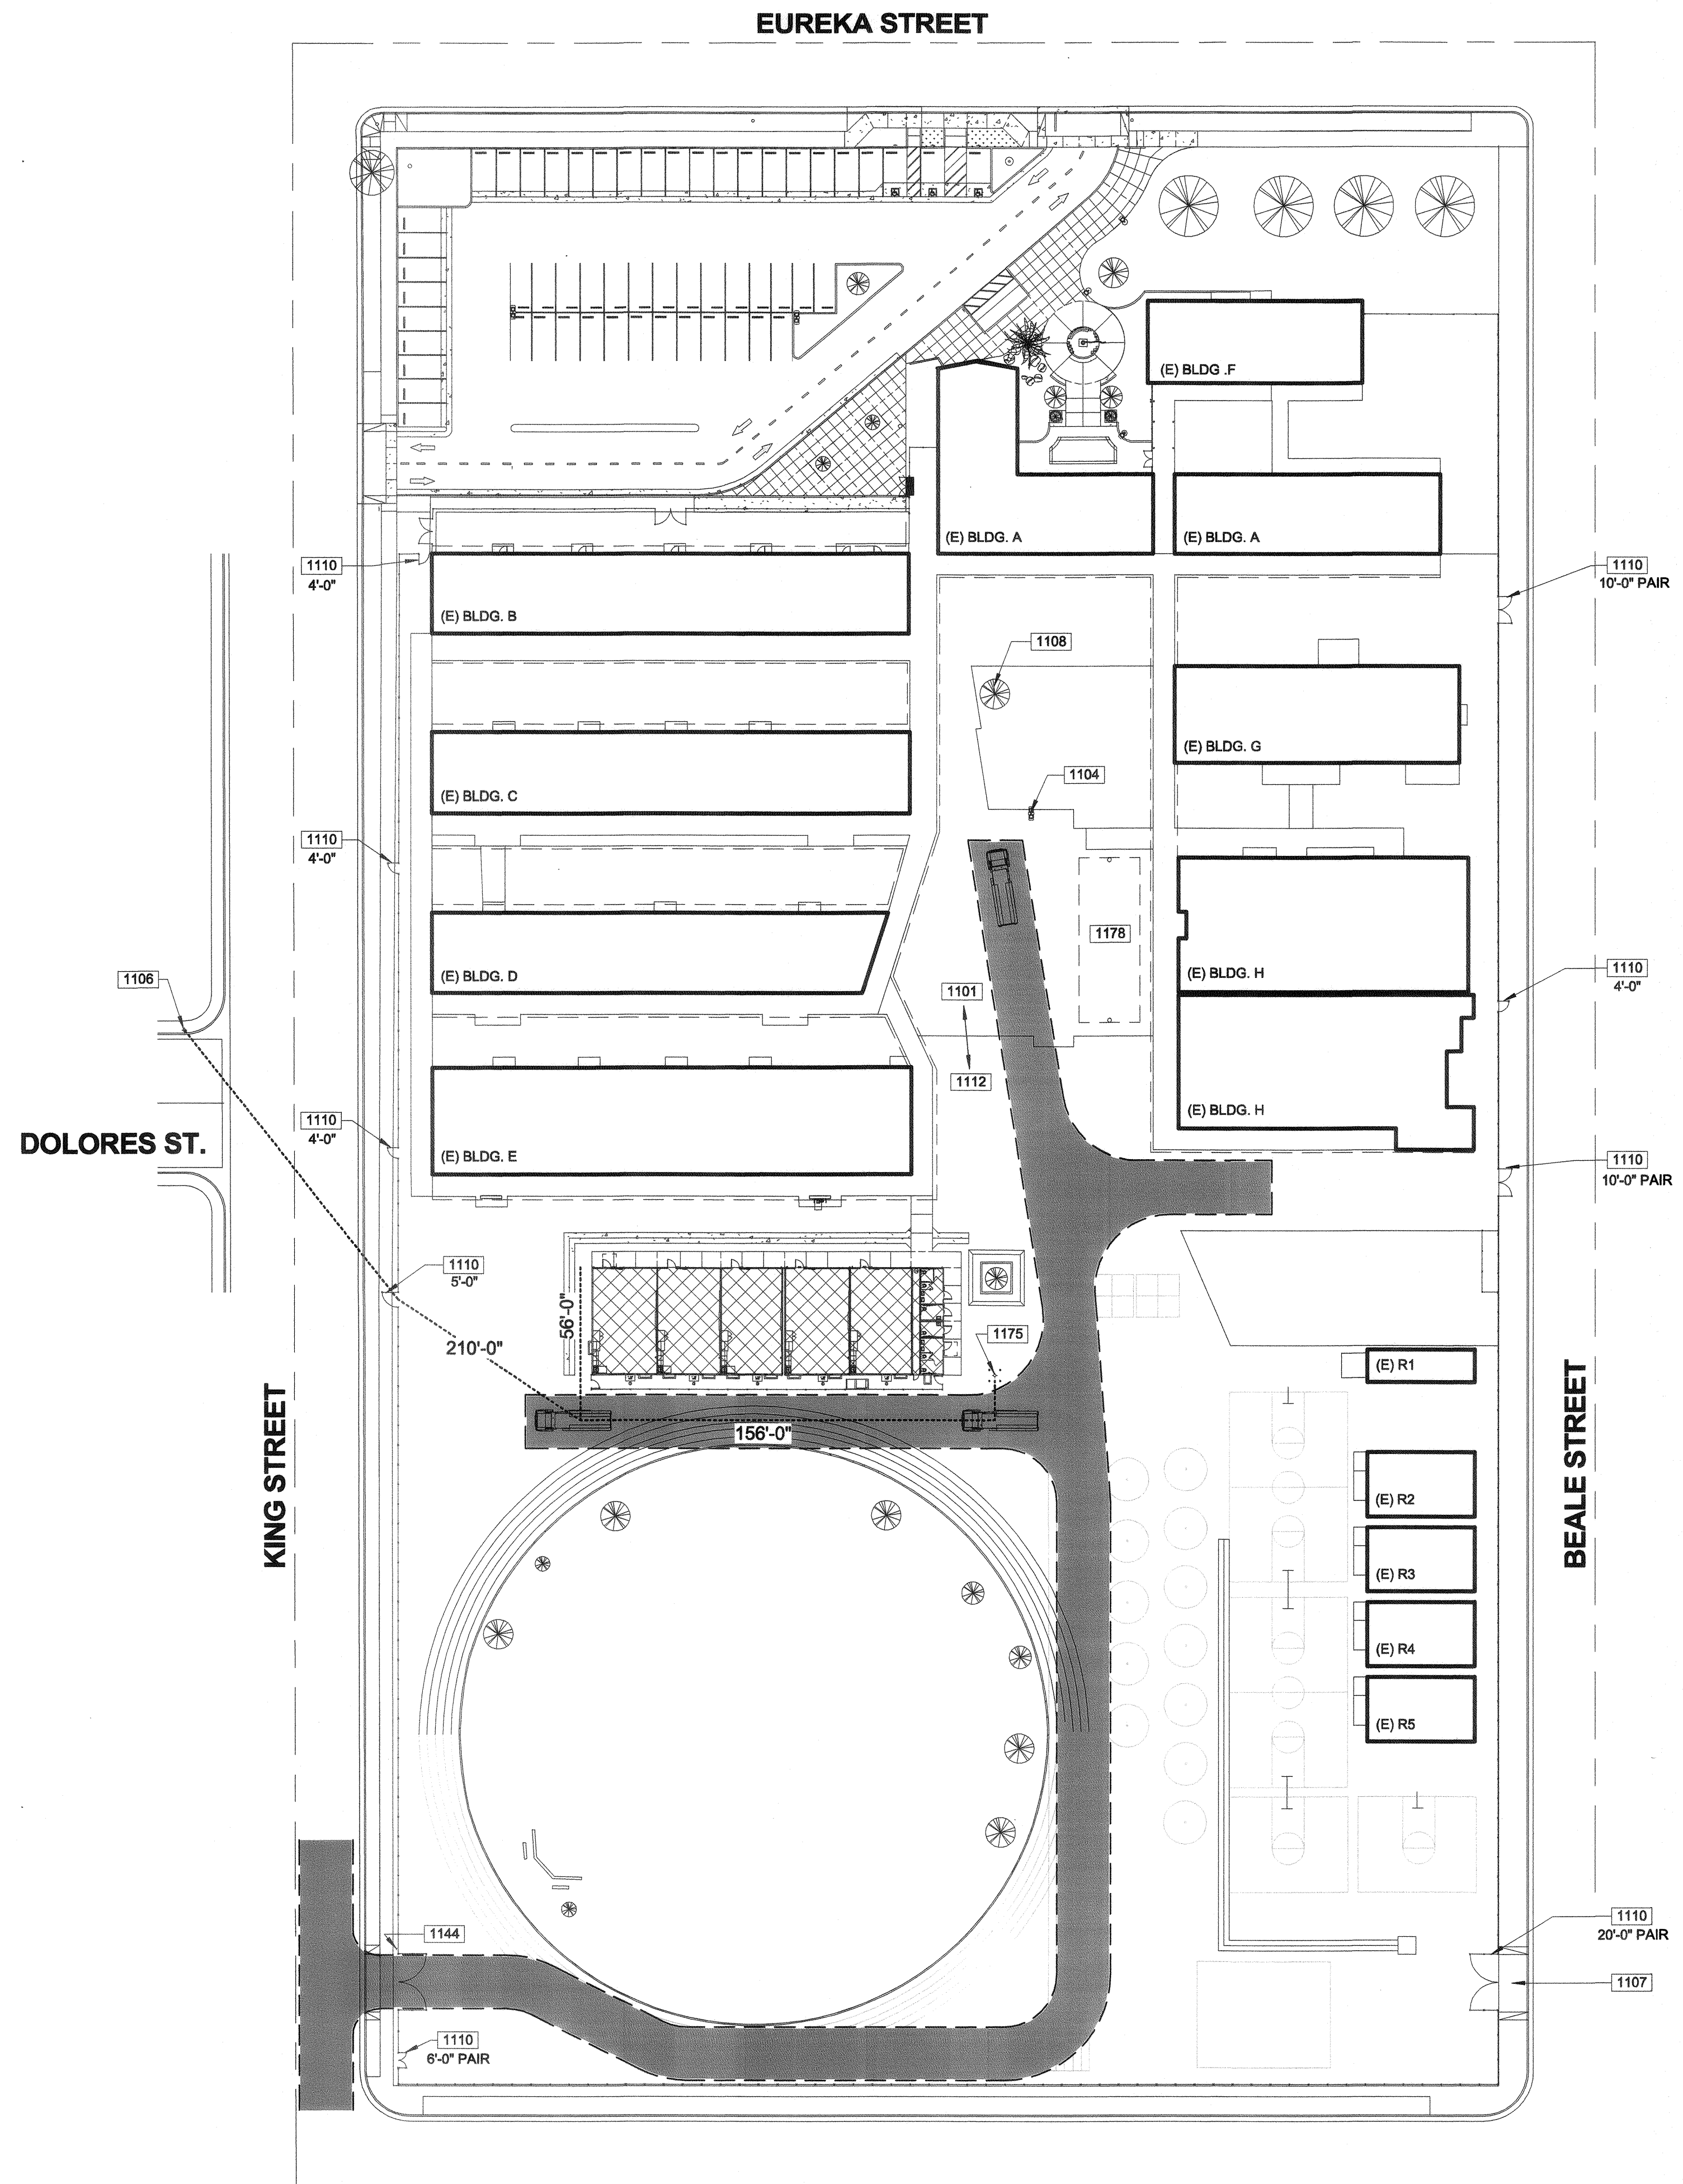

**1 FIRE ACCESS PLAN**

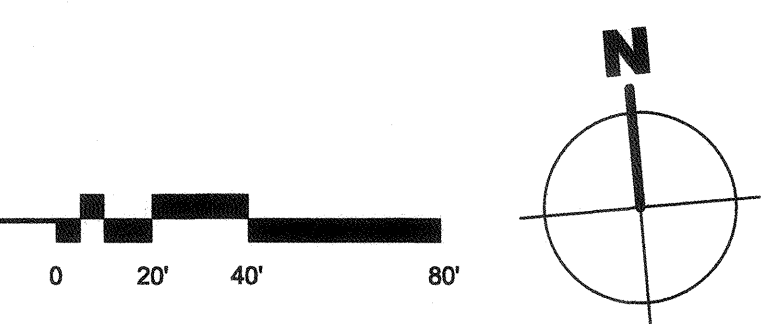

**100-GENERAL NOTES**

- THESE DRAWINGS INDICATE THE APPROXIMATE EXTENT OF DEMOLITION WORK. CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE EXTENT OF DEMOLITION REQUIRED TO INSTALL IMPROVEMENTS INDICATED ON THE CONSTRUCTION DOCUMENTS.
- ALL MATERIAL INDICATED TO BE REMOVED IS TO BE DISPOSED OF OFF-SITE IN A LEGAL MANNER, UNLESS INDICATED TO BE SALVAGED OR REINSTALLED.
- PRIOR TO ANY UNDERGROUND SITE WORK, VERIFY LOCATION OF ALL EXISTING UTILITIES WITH UNDERGROUND SERVICE ALERT (U.S.A.).
- CONTRACTOR SHALL REPLACE IN KIND ANY EXISTING IMPROVEMENTS DAMAGED BY DEMOLITION OR CONSTRUCTION ACTIVITIES.

**1000 - KEYNOTES**

- 1101 (E) CONCRETE WALK TO REMAIN.
- 1104 (E) UTILITY POST TO REMAIN.
- 1106 (E) FIRE HYDRANT TO REMAIN.
- 1107 (E) FIRE TRUCK ENTRANCE TO REMAIN.
- 1108 (E) TREE TO REMAIN.
- 1110 (E) CHAIN LINK GATE TO REMAIN, SIZE AS SPECIFIED.
- 1112 (E) A.C. PAVING TO REMAIN.
- 1144 PROVIDE KNOXBOX OUTSIDE OF GATE, PER DETAIL 20/A8021.
- 1175 NEW FIRE HYDRANT, PER CIVIL DRAWINGS.
- 1178 (E) COVERED CANOPY TO REMAIN.

**LEGEND**

- PROPERTY LINE
- x-x-x- EXISTING CHAIN LINK FENCE TO REMAIN.
- ..... FIRE HOSE PATH. LENGTH AS SPECIFIED
- [Cross-hatched box] NEW RELOCATABLE BUILDING TO BE CONSTRUCTED AS PART OF DSA APPLICATION NUMBER AND CONTRACT
- [Solid grey box] INDICATES FIRE LANE ROUTE. 20'-0" WIDE MIN.

PRIME CONSULTANT

**IBI** ARCHITECTURE PLANNING  
 San Luis Obispo  
 4119 Broad Street, Suite 210  
 San Luis Obispo, CA 93401  
 805.546.0433 fax: 805.546.0504  
 ibigroup.com

SEAL



**COPYRIGHT:**  
 Any reproduction or distribution for any purpose other than authorized by IBI Group is forbidden.

COPYRIGHT 2017 IBI GROUP

REVISIONS


NO.	DATE	APPRD.	DESCRIPTION

CONSULTANT

AGENCY INFORMATION:

AGENCY TRACKING NO. 63321-241  
 FILE NO. 15-6  
 IDENTIFICATION STAMP  
 DIV. OF THE STATE ARCHITECT  
 OFFICE OF REGULATION SERVICES  
 03-118380  
 AC [Signature] FLS [Signature] SS [Signature] CE  
 DATE OCT 25 2017

**BAKERSFIELD CITY SCHOOL DISTRICT**

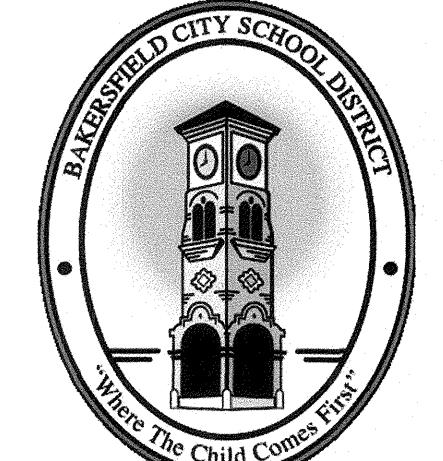

**BESSIE OWENS INTERMEDIATE RELOCATABLES A101 - A106**

815 EUREKA ST. BAKERSFIELD CA, 93305

OPSC or OSHPD PROJ. NO:

PROJECT NO: 16241.000

DRAWN BY: rRr

CHKD BY: RM

ISSUE DATE: 10/25/2017

SHEET TITLE

**FIRE ACCESS**

SHEET NUMBER

**G1200**

CONSTRUCTION DOCUMENTS

PLOT DATE: 10/24/2017 11:01:33 AM J:\16241\_BC\_BessieOwens\6.9 Drawings\69Arch\current\ATW-16241-Site\_Bessie-2017-01-04-V2016\_DSA Submittal Arch\Arch.dwg