
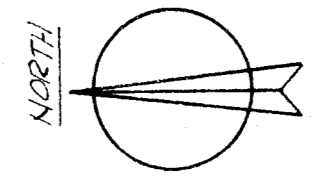


NOTE

1. ALL PIPE SHALL BE SCHEDULE 40 PIPE UNLESS OTHERWISE SPECIFIED IN/150 BLACK MALLEABLE OR ALL WELDED FITTINGS. UNLESS OTHERWISE SPECIFIED, ALL WELDED FITTINGS SHALL BE "EXTRUDAT" AND HOLIDAY TESTED.
2. TEST SHALL BE PER JFC
3. REPEAT EXISTING 2 1/2" UNDERGROUND LINE EXISTING REMAINS
4. COATING, TRENCHING & BACKFILL (90% GRAVEL) SHALL BE BY CONTRACTOR. PATCHING & PAINTING SHALL BE BY OWNER

BOON PORTABLE	BOON PORTABLE
---------------	---------------

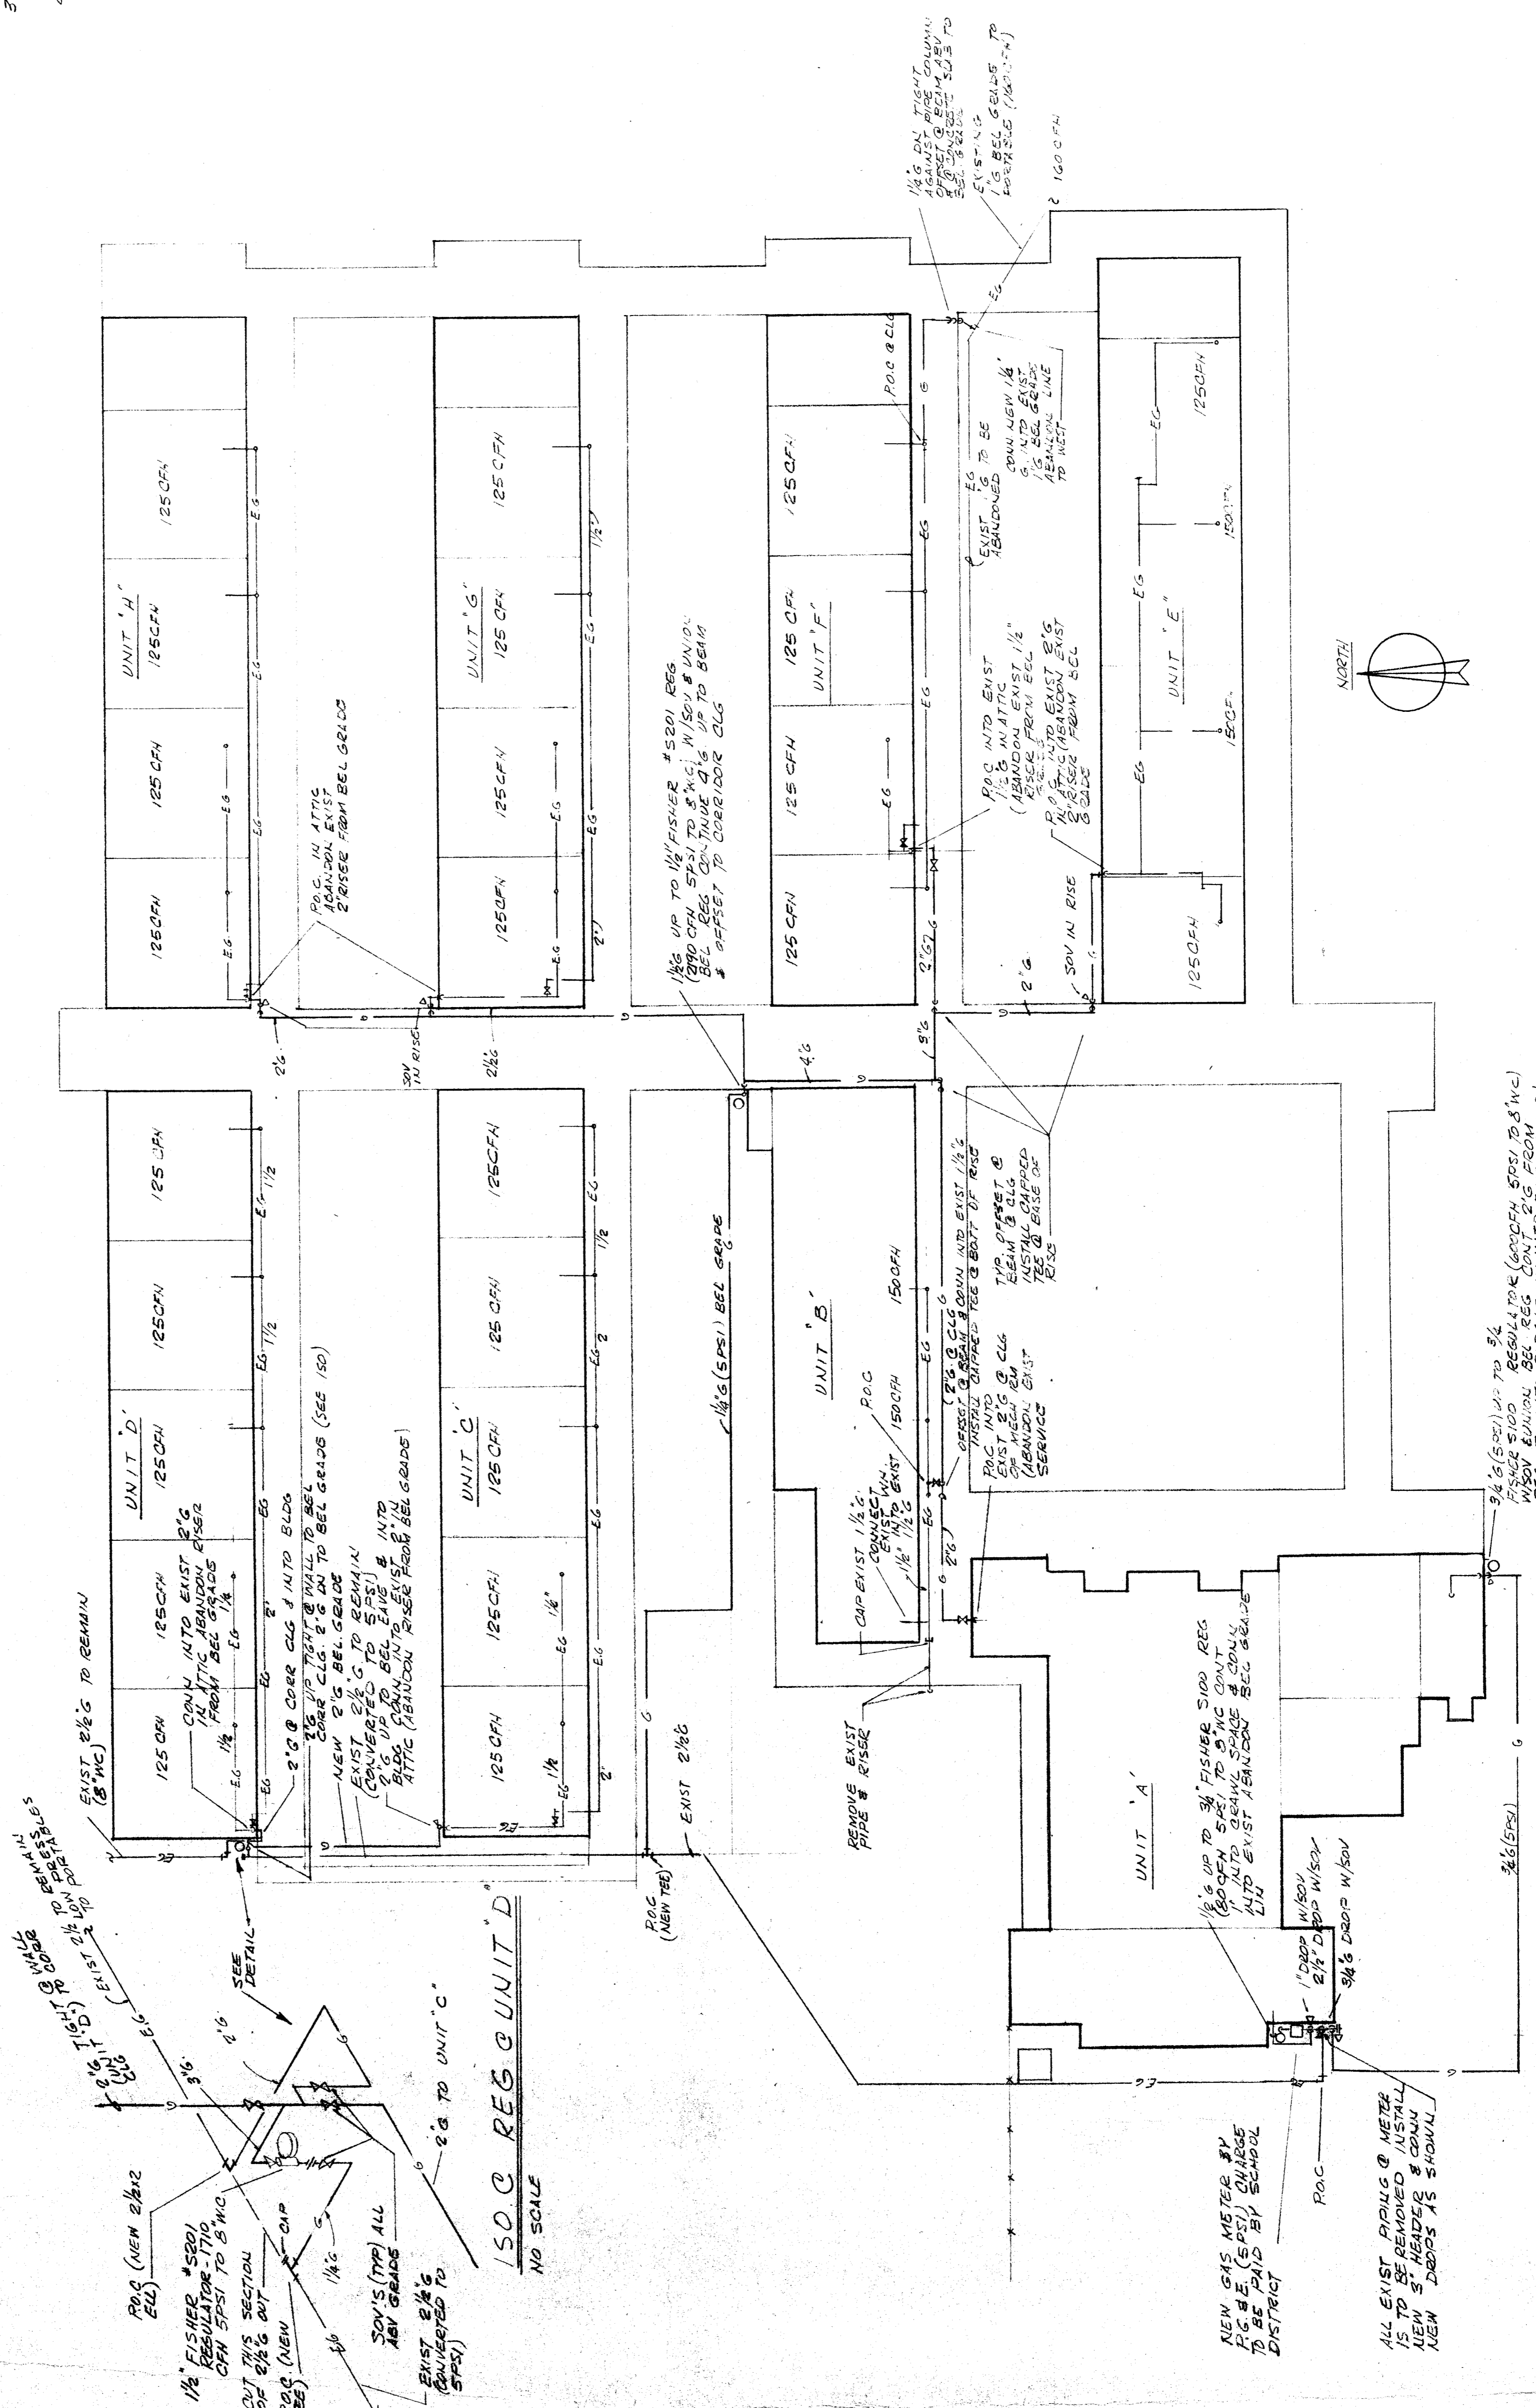

PLOT PLAN SCALE 1" = 20'-0"

REPLACEMENT OF MAIN GAS LINES	APPROVED	DATE	7-15-80
BAKERSFIELD DISTRICT	DRAWN BY	SVAC	
BAKERSFIELD DISTRICT	REVISED		
BAKERSFIELD DISTRICT	DATE	7-15-80	
BAKERSFIELD DISTRICT	DRAWING NUMBER	M 1	03804