



SITE ELECTRICAL PLAN



1/16" = 1'-0"

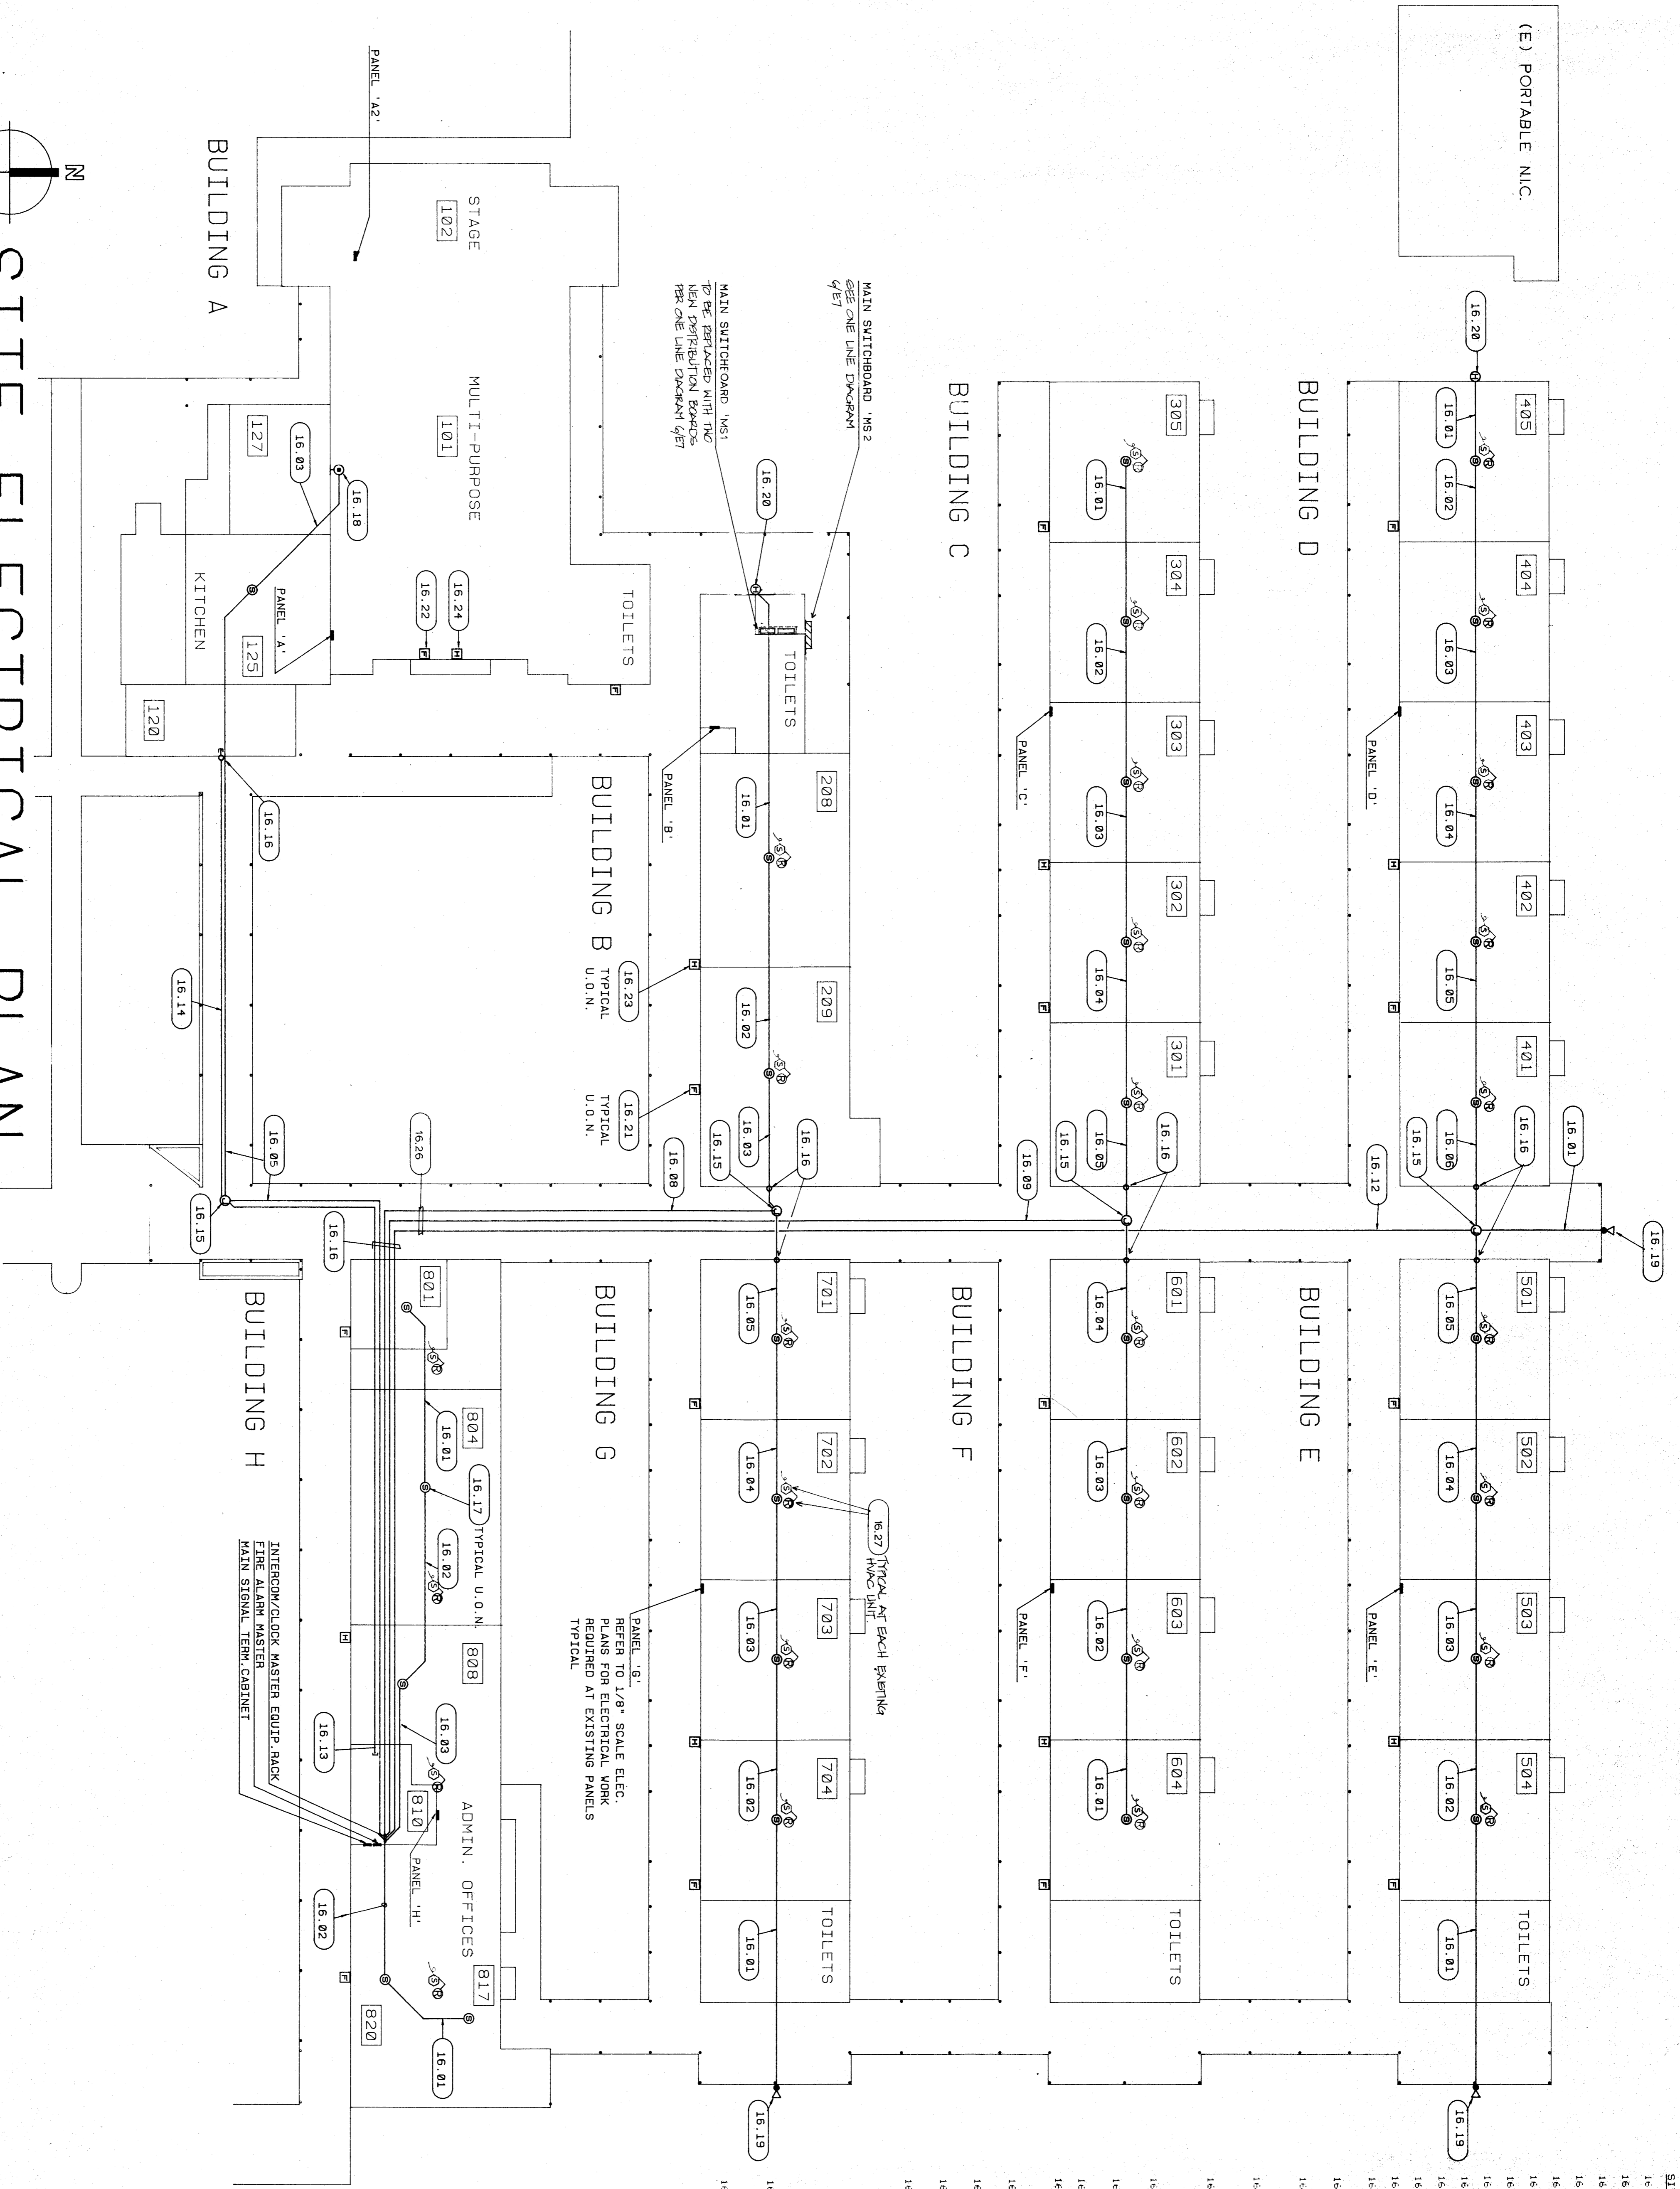

- 16.01 1/2" x 1/2" IC CABLE.
- 16.02 1/2" x 1/2" x TWO IC CABLES.
- 16.03 3/4" x 1/2" x THREE IC CABLES.
- 16.04 3/4" x 1/2" x FOUR IC CABLES.
- 16.05 1" x 1/2" x FIVE IC CABLES.
- 16.06 1" x 1/2" x SIX IC CABLES.
- 16.07 NOT USED.
- 16.08 1 1/4" x 1/2" x EIGHT IC CABLES.
- 16.09 1 1/2" x 1/2" x NINE IC CABLES.
- 16.10 NOT USED.
- 16.11 NOT USED.
- 16.12 1 1/2" x 1/2" x TWELVE IC CABLES.
- 16.13 TWO 1 1/2" x 1/2" STUBS. (STUB TO ATTIC SPACE ABOVE ROOM 810).
- 16.14 TWO 1 1/2" x 1/2" STUBS. (STUB INTO ATTIC SPACE ABOVE ROOM 120).
- 16.15 PROVIDE 18" x 18" x 4" W.P. FULL COV. WITH SIREN COVER. LOCATE UNDER MAINWAY COVER AS DIRECTED BY ARCHITECT.
- 16.16 RANCH INTO ACCESSIBLE ATTIC SPACE OF BUILDING AS REQUIRED. CALL OUT AROUND PENETRATIONS.
- 16.17 RUSH GETTING SPEAKERS. REFER TO 1/8" SCALE ELECTRICAL PLAN FOR LOCATIONS AND ARCHITECTURAL REFLECTED CEILING PLANS FOR LOCATIONS.
- 16.18 WALL MOUNTED SPEAKER. SEE SHEET EE FOR LOCATION.
- 16.19 YARD I.C./F.A. SPEAKER HORN. LOCATE ON EDGE OF ROOF.
- 16.20 WALL MOUNTED W.P. I.C./F.A. SPEAKER.
- 16.21 EXISTING EXTERIOR F.A. MANUAL FULL STATION TO BE REPLACED WITH NEW W.P. STATION.
- 16.22 EXISTING INDOOR MANUAL FULL STATION TO BE REPLACED WITH NEW.
- 16.23 EXISTING EXTERIOR F.A. HORN/BELL TO BE REPLACED WITH NEW W.P. HORN.
- 16.24 EXISTING INDOOR F.A. HORN TO BE REPLACED WITH NEW.
- 16.25 REPLACE ALL EXISTING F.A. WIRING WITH NEW. WIRING TO ALL F.A. HORN/BELLS AND FULL STATIONS TO NEW F.A. MASTER EQUIPMENT. REFER TO RETAIL 5-47. CONTRACTOR TO UTILIZE EXISTING F.A. PULL OUT ANY TIE WIRING. PROVIDE NEW CONDUIT WHERE EXISTING NOT AVAILABLE. VERIFY ALL CONDITIONS IN FIELD PRIOR TO BIDDING.
- 16.26 RUN ALL NEW FEEDERS TO BUILDING UNDER MAINWAY COVER. VERIFY ROUTING WITH ARCHITECT AND SCHOOL DISTRICT REP.
- 16.27 PROVIDE 120V SWITCHER CONNECTION TO HAVE DUCT SMOKE DETECTOR AND TO 120V CONTROL RELAY. ELECTRICAL CONTRACTOR TO VERIFY ALL CONDITIONS IN FIELD PRIOR TO BIDDING. VERIFY REQUIREMENTS WITH MECH. ENGINEER.

CORNELIUS ENGINEERING, INC.
 Consulting Electrical Engineer
 918 W. Main St. - Rm. 233-2671
 Visalia, California 93271
 Phone - 929-2939
 Fax - 929-2939
 451498
 1/16" = 1'-0"

pechin associates architects aia
 1400 easton drive suite 138
 bakersfield, ca 93309 (805)322-2021

Sarrah E. Pechin C-8366

Project Number 438-0788
 Revision Date 1-16-89

Bessie E. Owens Elementary
 School Modernization
 Bakersfield City School District

DATE	ISSUE FOR
DATE	REVISION

THESE DRAWINGS, RELATED SPECIFICATIONS, IDEAS, DESIGNS, AND ARRANGEMENTS REPRESENTED THEREBY ARE AND SHALL REMAIN THE PROPERTY OF THE ARCHITECT; AND NO PART THEREOF SHALL BE COPIED, DISCLOSED TO OTHERS OR USED IN CONNECTION WITH ANY WORK OR PROJECT OTHER THAN THE SPECIFIC PROJECT FOR WHICH THEY HAVE BEEN PREPARED AND DEVELOPED WITHOUT THE WRITTEN CONSENT OF THE ARCHITECT. VISUAL CONTACT WITH THESE DRAWINGS OR SPECIFICATIONS SHALL CONSTITUTE CONCLUSIVE EVIDENCE OF ACCEPTANCE OF THESE RESTRICTIONS.

WRITTEN DIMENSIONS ON THESE DRAWINGS SHALL HAVE PRECEDENCE OVER SCALED DIMENSIONS. CONTRACTORS SHALL VERIFY ALL DIMENSIONS AND BE RESPONSIBLE FOR ALL DIMENSIONS AND CONDITIONS ON THE JOB AND THIS OFFICE MUST BE NOTIFIED OF ANY VARIATIONS FROM THE DIMENSIONS AND CONDITIONS SHOWN BY THESE DRAWINGS.

DETAILED SHOP DRAWINGS MUST BE SUBMITTED TO THIS OFFICE FOR REVIEW BEFORE PROCEEDING WITH THE FABRICATION OF ANY PRODUCT TO BE INCLUDED IN THIS PROJECT.