


781-9341

1/2" THICK INSULATED CEILING PANELS
IN EXPOSED "T" GRID - ALL PANELS
TO BE 24" X 48" UNLESS STATED
LIGHTS ARE SURFACE MOUNTED AFTER
CEILING INSTALLATION

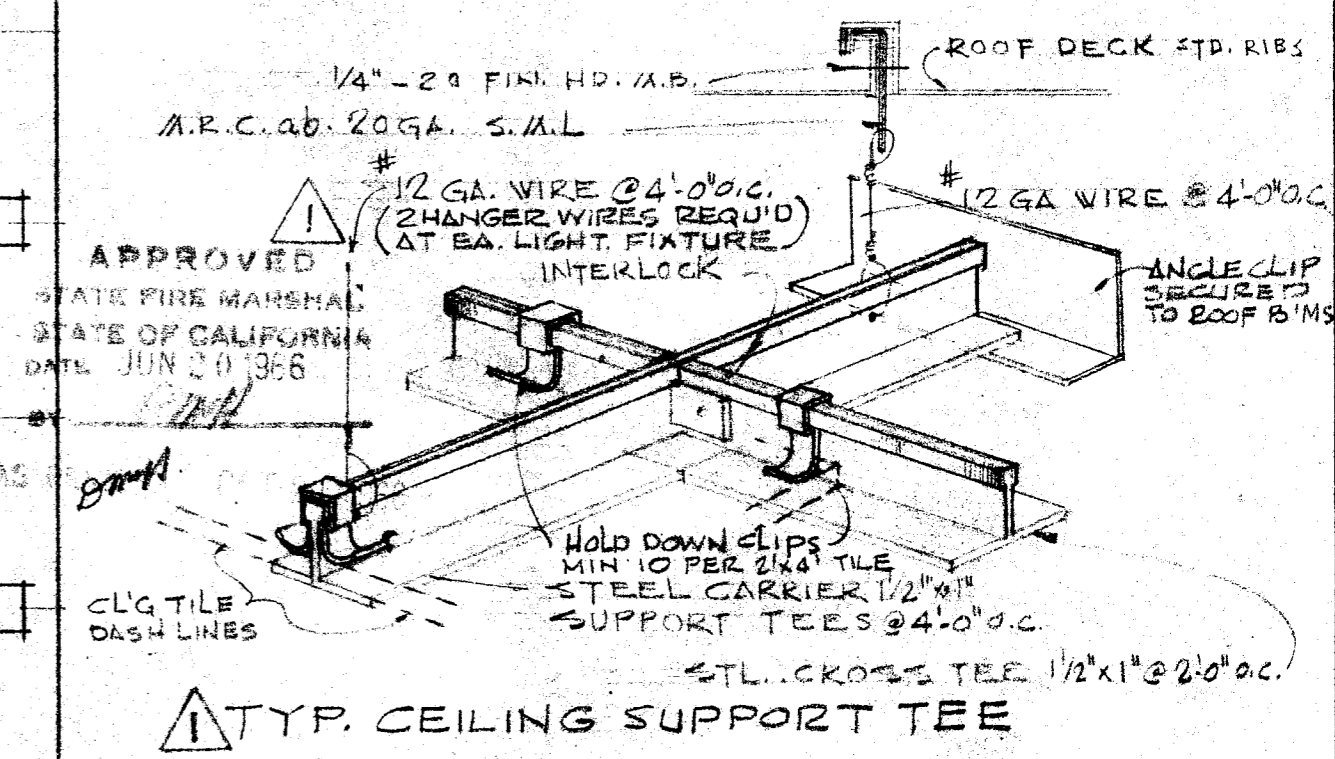


APPROVED
STATE FIRE MARSHAL
STATE OF CALIFORNIA
DATE JUN 20 1966

△ TYP. CEILING SUPPORT TEE

STATE OF CALIFORNIA - DEPARTMENT OF GENERAL SERVICES
OFFICE OF ARCHITECTURE AND CONSTRUCTION
AS REVISED 06/21/66
27755 APPROVED JUN 20 1966

NOTE: ALL DIFFUSERS PER DETAIL SHEET FD-1

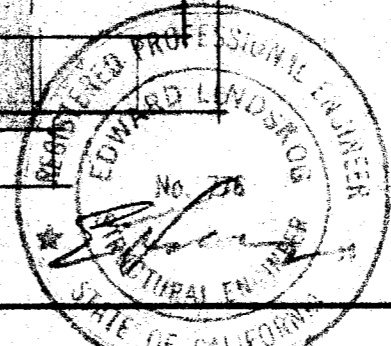

△ ADDED HANGER WIRE NOTE & CLG TILE HOLD DOWN CLIPS, INDICATED DIMS OF GRID MEMBERS 1/2" x 1/2" x 1/2"	
BAKERSFIELD CITY U.S.D. ED CNTR 1300 BAKER, BAKERSFIELD, CALIF	Job No 753
SCALE: 1/4" = 1'-0" DATE:	APPROVED BY: DRAWN BY: J. HAVILLIS REVISED 6/16/66
MOBILE RENTALS CORPORATION 9240 NORTH DURFEE AVE. EL MONTE, CALIF.	
REFLECTED CEILING PLAN	DRAWING NUMBER A-40FB