


- KEY NOTES**
- [10 GA. TAPERED ROOF BEAM (SEE STRUC.) 33 KSI MATERIAL
 - BACK-UP PLATE MIN. 10 GA.
 - 3 1/2"x3 1/2"x1/4" COLUMN
 - [10GA.X 24" HEADER SEE 1/S3.1
 - SECTION OF 3 1/2"x3 1/2"x1/4" TUBE STEEL COPE TO FIT ROOF BEAM
 - 6 3/8"x2 1/2"x12GA. FLOOR JOIST
 - 10GA. BENT PLATE BACK-UP
 - 1/4" STIFFENER
 - #10 S.T.S.M.S 6" O.C. (SEE S1.0)
 - PLYWOOD FLOOR SHEATHING
 - FLOOR BEAM (SEE STRUCTURAL) SEE 5/S3.1
 - 5"x8"x1/4" IP
 - ROOF OVERHANG BEAM 8"x3 1/2" x4 GA.
 - ADDITIONAL SPLICE LOCATION (OPTIONAL)

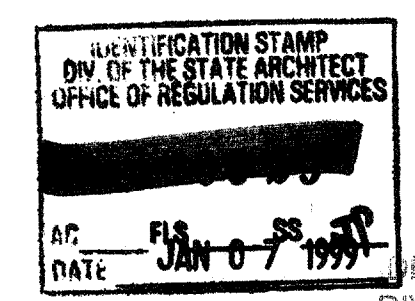

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 APP#3 117168
 AC FLS ✓ SS TV
 Date JAN 07 1999

(MONO SLOPE)
 STKP-42 M 4/24/99

REVISIONS

1		
2		
3		
4		
5		

Electrical Engineer's Seal
 Mechanical Engineer's Seal
 Structural Engineer's Seal

Architect's Seal
 LICENSED ARCHITECT
 GEORGE C. EDWARDS
 DIVISION OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 PC-266
 DATE: JAN 25 1999

MODTECH INC.
 2830 BARRETT AVENUE
 PERRIS, CALIF. 92572
 PH (909) 943-4014
 FAX (909) 940-0427

PROJECT NUMBER: 2986 © MODTECH, INC. 1997
 drawn by: 4012-088
 checked by: 05 JAN 99
 Modtech project no:
 MODTECH Index No.
STRUCTURAL DETAILS

SA3.1
 PROJECT NO. 2986
 FILE # P266 SAST.DWG