


WINDOW SCHEDULE									
WINDOW NO.	QTY	TYPE	WIDTH	HEIGHT	FUNCTION	FRAME MATERIAL	GLASS MATERIAL	WALL THICKNESS	NOTES
A	1	1	8'-0"	4'-0"	XOK	ANOD	DP		
B	2	2	4'-0"	4'-0"	XO	ANOD	DP		

WINDOW FINISH


ANOD: CLEAR ANODIZED ALUMINUM FRAME
 BRONZ: BRONZE ANODIZED ALUMINUM FRAME
 PAINT: PAINTED FRAME
 WFL: WFL WELDED FRAME
 FRW: FIRE RATED WINDOW FRAME
 FRG: FIRE RATED GLAZING 1/2" WIPED GLASS LAMBL TO MEET THE REQUIREMENTS FOR A 30 HOUR FIRE WINDOW ASSEMBLY PER CBC SECTION TABLE 716.3

DP: 3/16" MINIMUM DUAL PANE TEMPERED GLASS OF SOLAR CONTROL - 3/16" MINIMUM WIPED WITH A LIGHT TRANSMISSION FACTOR OF 0.60. ALL OPERABLE SASH SHALL HAVE SCREENS.

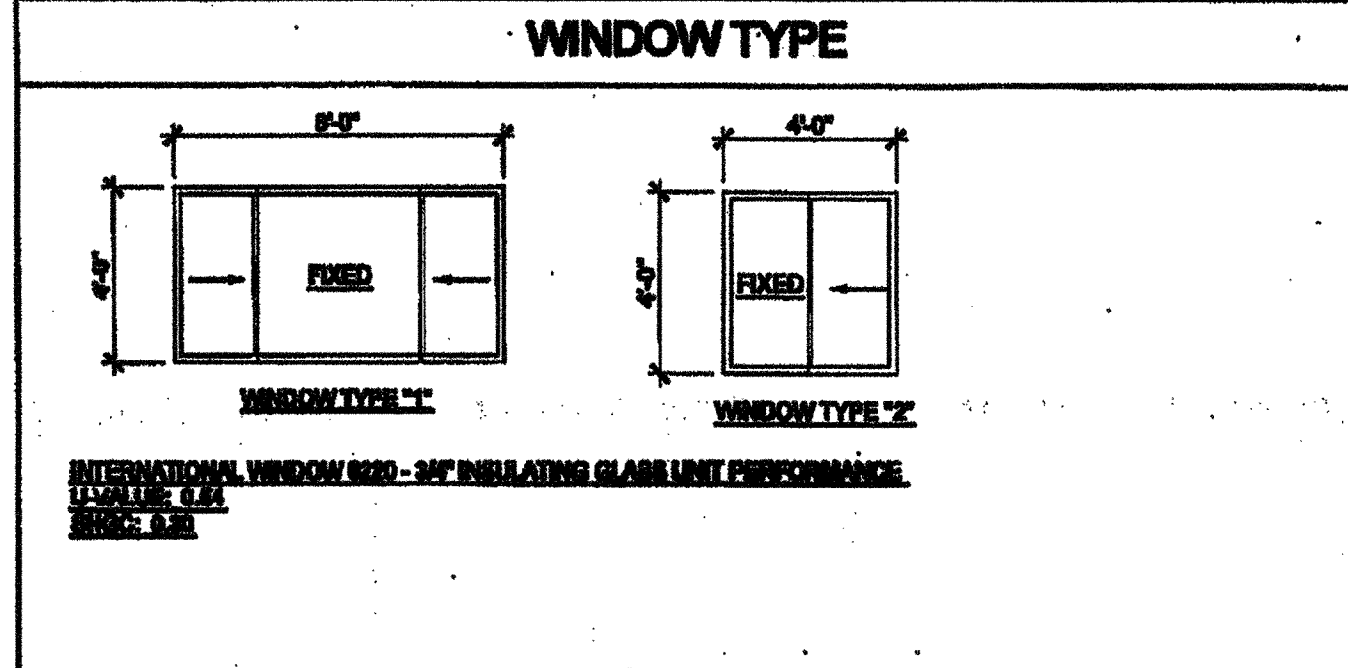

DOOR SCHEDULE								
DOOR NO.	WIDTH	HEIGHT	DOOR TYPE	QTY	FRAME MATERIAL	HARDWARE SET	WALL THICKNESS	NOTES
1	3'-0"	7'-0"	A	1	HM	ND HW-1	5 1/2"	2x6 WALL
2	3'-0"	7'-0"	A1	1	HM	ND HW-2	5 1/2"	2x6 WALL
3	3'-0"	7'-0"	A	1	HM	ND HW-3	5 1/2"	
4	3'-0"	7'-0"	A	1	HM	ND HW-4	5 1/2"	
5	3'-0"	7'-0"	A	1	HM	ND HW-5	5 1/2"	NO GLASS HERE
6	3'-0"	7'-0"	A	1	HM	ND HW-6	5 1/2"	

DOOR MATERIAL AND FINISH ABBREVIATIONS			
HM:	198A HOLLOW METAL	ND:	KNOCK DOWN FRAME
WF:	198A WELDED FRAME	SC:	SOLID CORE WOOD LERACY
AL:	ALUMINUM	HC:	HOLLOW CORE WOOD
ST:	STAINLESS STEEL	PT:	PAINTED

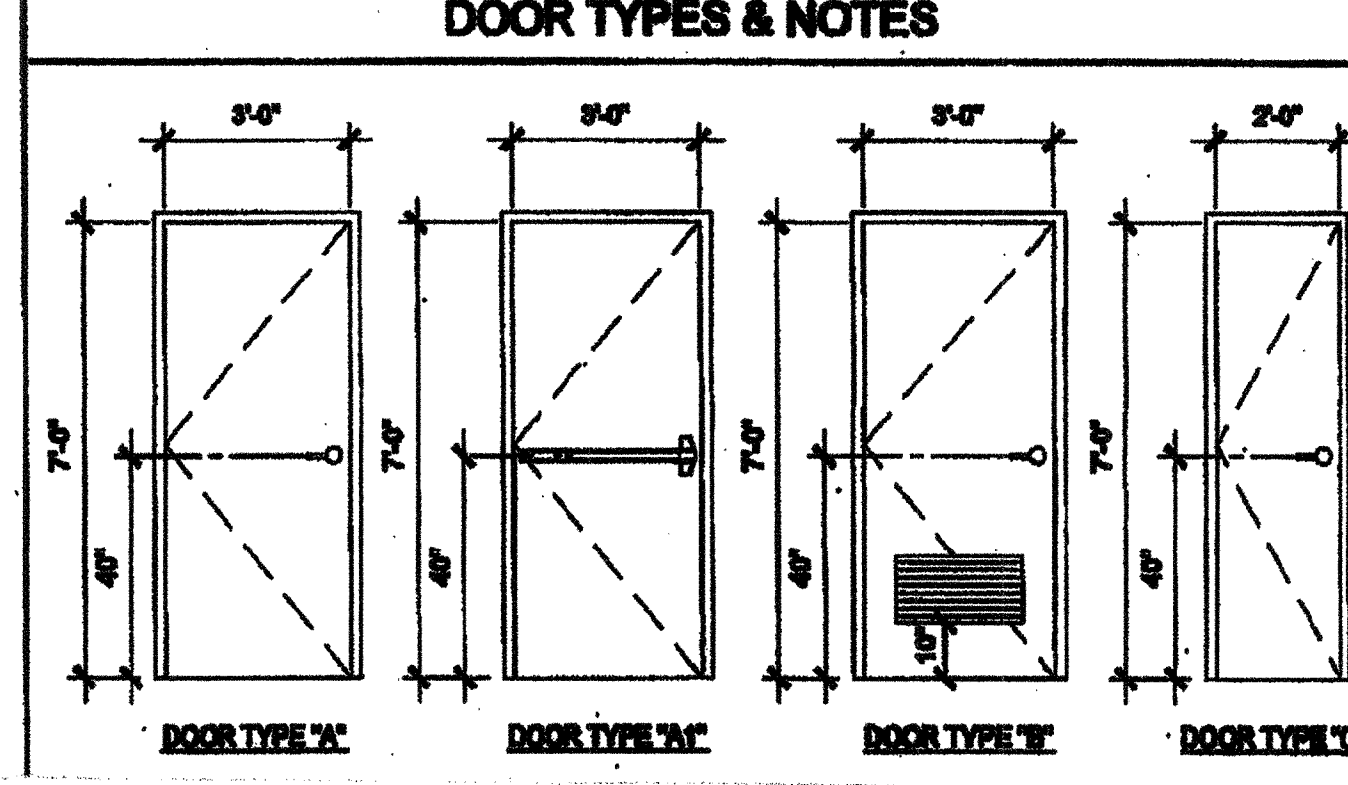

- DOOR HANDLE FOR LOCKSETS AND PANIC HARDWARE TO BE CENTERED AT 40" AFF. HARDWARE TO BE OPENED FROM THE INSIDE WITHOUT THE USE OF A KEY OR SPECIAL KNOWLEDGE OR EFFORT. LEVERS TO RETURN TO WITHIN 1/2" OF DOOR.
- ALL DOORS SHALL BE 1 3/4" THICK U.N.O.
- CLOSER SHALL BE SET FOR MAXIMUM OPENING PRESSURE OF 5 LBS AT EXTERIOR AND INTERIOR DOORS.
- PANIC HARDWARE IS REQUIRED TO BE INSTALLED WHEN THE CONFIGURATION OF ANY ROOM PROVIDES AN OCCUPANT LOAD OF 50 OR GREATER. CBC 1008.1.10
- ALL HARDWARE SHALL COMPLY WITH SILVER CREEK'S SPEC'S ON THIS SHEET AND CBC SECTIONS 11B-208.5, 11B-404.1 AND 1008.
- DOOR CLOSER SHALL BE ADJUSTED TO SO THAT FROM AN OPEN POSITION OF 70°, THE DOOR WILL TAKE AT LEAST 3 SECONDS TO MOVE TO A POINT 3" FROM THE LATCH, MEASURED TO THE LANDING SIDE OF THE DOOR
- PANIC AND FIRE EXIT HARDWARE WHERE THIS TYPE HARDWARE IS INSTALLED, IT SHALL COMPLY WITH THE FOLLOWING:
 - THE ACTUATING PORTION OF THE RELEASING DEVICE SHALL EXTEND AT LEAST ONE-HALF OF THE DOOR LEAF WIDTH.
 - THE MAXIMUM UNLATCHING FORCE SHALL NOT EXCEED 60 LBS PER THE 2013 CBC APPROVED BY AUTHORITY IN JURISDICTION, PANIC HARDWARE SHALL COMPLY WITH CBC SECTION 1008.1.10
- THE FIRE PROTECTION FOR EXTERIOR WALL IS DETERMINED BASED UPON THE FIRE SEPARATION DISTANCE IN WHICH THE WALL IS LOCATED. SEE CBC TABLE 705.8 OR TABLE 602

FINISH SCHEDULE									
ROOM NAME	FLOORING	WALL FINISH				CEILING		NOTES	
		FRONT	LEFT	RIGHT	CEILING HT				
CLASSROOM	010	TACK	TACK	TACK	OP	8'-0"			
GLASSWALL	010	TACK	TACK	TACK	OP	8'-0"			
WALL	010	TACK	TACK	TACK	OP	8'-0"			
CEILING	010	TACK	TACK	TACK	OP	8'-0"			
PLUMBING CHASE									

FLOOR, WALL, CEILING MATERIALS

FLOORING:
 010: CARPET PER STATE OF CALIFORNIA SPECIFICATIONS COMPLYING WITH GROUP 1, TYPE 'W' OR TYPE 'N'; CLASS 2; DENSITY 400; DIRECT GLUE DOWN
 020: 1/2" VITRIFIED CERAMIC TILE
 030: 1/2" VITRIFIED CERAMIC TILE
 040: 1/2" VITRIFIED CERAMIC TILE
 050: 1/2" VITRIFIED CERAMIC TILE
 060: 1/2" VITRIFIED CERAMIC TILE
 070: 1/2" VITRIFIED CERAMIC TILE
 080: 1/2" VITRIFIED CERAMIC TILE
 090: 1/2" VITRIFIED CERAMIC TILE
 100: 1/2" VITRIFIED CERAMIC TILE

WALL:
 TACK: 1/2" VINYL TACKBOARD CLASS 1 OVER 1/2" GYP/DM BOARD BACKING
 FRP: 1/2" FIBER REINFORCED PANEL OVER 1/2" WATER RESISTANT GYP/DM BOARD
 GYP: 1/2" GYP/DM BOARD; TAPE; TEXTURE; PAINTED FINISH
 PLV: 1/2" PLYWOOD FINISH
 NP: NO FINISH

CEILING:
 OP: ACoustICAL LAY IN GRID CEILING PANELS (SEE SPECIFICATION NOTES ON REFLECTED CEILING PLAN)
 HC: 5/8" GYP/DM BOARD; TAPE; TEXTURE; PAINTED FINISH (HARD LED CEILING)
 GP: 1/2" GYP/DM BOARD VISIBLE PANELS (PAINTED)

- FINISH NOTES**
- ALL FINISHES SHALL COMPLY WITH CBC, CFC AND TITLE 19 COR.
 - PREPARATION FOR SUB-FLOOR TO ACCEPT FINISH FLOORING IS BY FLOORING CONTRACTOR. FLYWOOD SUB-FLOOR IS 2x4 PLYWOOD. OUTER PLYWOOD IS FLUSHED AND TOUCH BANDED. ANY DEPOSITED JOINT TO STANDARD CONSTRUCTION PRACTICES SHALL BE FILLED AND BANDED BY FLOORING CONTRACTOR. THE JOINT AT THE MOULDING SHALL NOT BE LARGER THAN 1/8" AND SHALL BE FILLED AND BANDED BY FLOORING CONTRACTOR.
 - RESILIENT FLOORING DEMONSTRATING A COEFFICIENT OF FRICTION OF AT LEAST 0.8 PER ASTM D2047, WILL BE ACCEPTED AS MEETING THE INTENT OF SLIP RESISTANCE.
 - CARPET SHALL HAVE A LEVEL LOOP, TEXTURED LOOP, LEVEL OUT, OR LEVEL OUT / UNCLUT FILE TEXTURE AND MAXIMUM PILE HEIGHT OF 1/8" PER CBC SECTION 11B28.3. CARPET EDGED SHALL COMPLY WITH CBC SECTION 11B28.2

DOOR HARDWARE			
CLASSROOM -		EXTERIOR DOOR HW-1	
LOCKSET	SCHLAGE NORTON FOR HOSS (with dead)	Finish 25D	or equal
BUTTS	HAGER 881101 4 1/2" x 4 1/2" NRP	Finish 25D	or equal
CLOSER	FALCON 689	Finish 689	or equal
WEATHER STRIP	HAGER 4288A 36	Finish Alum	or equal
THRESHOLD	HAGER 4288A 36	Finish Alum	or equal
DOOR BOTTOM	HAGER 788AV 36H	Finish Alum	or equal
DOOR HW FINISH ABBREVIATIONS -		EXTERIOR DOOR HW-2	
DOOR TYPE	VON DUFEIN 99LZ-FA	Finish Alum	or equal
BUTTS	HAGER 881101 4 1/2" x 4 1/2" NRP	Finish 25D	or equal
CLOSER	FALCON 689	Finish 689	or equal
WEATHER STRIP	HAGER 4288A 36	Finish Alum	or equal
THRESHOLD	HAGER 4288A 36	Finish Alum	or equal
DOOR BOTTOM	HAGER 788AV 36H	Finish Alum	or equal
STAFF RESTROOM / SINGLE OCCUPANCY -		INTERIOR DOOR HW-3	
LOCKSET	SCHLAGE NORTON FOR HOSS (with dead)	Finish 25D	or equal
BUTTS	HAGER 1279 4 1/2" x 4 1/2"	Finish 25D	or equal
BOYS & GIRLS RESTROOM -		EXTERIOR DOOR HW-4	
LOCKSET	SCHLAGE NORTON FOR HOSS (with dead)	Finish 25D	or equal
BUTTS	HAGER 881101 4 1/2" x 4 1/2" NRP	Finish 25D	or equal
CLOSER	FALCON 689	Finish 689	or equal
WEATHER STRIP	HAGER 4288A 36	Finish Alum	or equal
THRESHOLD	HAGER 4288A 36	Finish Alum	or equal
DOOR BOTTOM	HAGER 788AV 36H	Finish Alum	or equal
LOUVER	ALUMO 26 x 12	Finish Bronze	or equal
STAFF RESTROOM -		EXTERIOR DOOR HW-5	
LOCKSET	SCHLAGE NORTON FOR HOSS (with dead)	Finish 25D	or equal
BUTTS	HAGER 881101 4 1/2" x 4 1/2" NRP	Finish 25D	or equal
WEATHER STRIP	HAGER 4288A 36	Finish Alum	or equal
THRESHOLD	HAGER 4288A 36	Finish Alum	or equal
DOOR BOTTOM	HAGER 788AV 36H	Finish Alum	or equal
LOUVER	ALUMO 26 x 12	Finish Bronze	or equal
PLUMBING CHASE DOOR -		INTERIOR DOOR HW-6	
LOCKSET	SCHLAGE NORTON FOR HOSS (with dead)	Finish 25D	or equal
BUTTS	HAGER 881101 4 1/2" x 4 1/2" NRP	Finish 25D	or equal

INSULATION SPECIFICATIONS

MOISTURE PROTECTION INSULATION:
 DESCRIPTION OF WORK: THE FLOORING AND INSTALLING OF ALL INSULATION FOR ALL CEILING, FLOOR AREAS, AND EXTERIOR WALLS. CLASS 1 (4-8) FLOOR (SPACING) (GRADE DEVELOPMENT DENSITY LESS THAN 400).

MATERIAL: INSULATING MATERIAL FOR WALLS, CEILING, AND FLOORS SHALL BE FIBERGLASS BATT (UNFACED) AND SHALL COMPLY WITH CBC 718.2-718.3. INSULATION SHALL BE AS MANUFACTURED BY OWENS-CORNING FIBERGLASS CORPORATION, JOHNS MANVILLE, CERTANTIERE, OR EQUAL.

INSULATION VALUES:
 SEE SHEETS A-0.1, A-0.2, A-0.3 FOR REQUIRED INSULATION VALUES PER CLIMATE ZONE

EXTERIOR WALL INSULATION (MIN):
 R-13 (2x4)
 R-10 (2x6)
 R-10 (2x8)

INTERIOR WALL INSULATION (MIN):
 R-5

FLOOR INSULATION (MIN):
 NONE
 R-5
 R-10

ROOF INSULATION (MIN):
 R-30
 R-36
 R-49 BETWEEN JOISTS AND R-10 BELOW JOISTS

THESE DRAWINGS AND ALL MATERIAL CONTAINED HEREIN ARE THE PROPERTY OF SILVER CREEK INDUSTRIES, INC. (SOCIETY) AND SHALL BE KEPT IN CONFIDENCE, COPIED OR OTHERWISE REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN CONSENT OF SILVER CREEK INDUSTRIES, INC. ALL INFORMATION CONTAINED HEREIN AND OPERATING WITH HEREIN SHALL BE THE PROPERTY OF SILVER CREEK INDUSTRIES, INC.

SILVER CREEK INDUSTRIES, INC.
 BUILDING FOR THE NEXT GENERATION
SILVER CREEK
 170 EAST MORGAN AVENUE, CALIFORNIA 92571
 PHONE: 951-943-8218 FAX: 951-943-8211

PROJECT NAME:
CLASS LEASING CLASSROOM BLDG'S

SHEET TITLE:
SCHEDULES

STAVARE
 ARCHITECTURE & INTERIOR DESIGN
 1222/2011

REVISIONS

NO. 04
 DATE: FEB 26 2015

NO. 04
 DATE: APR 08 2015

NO. 04
 DATE: APR 23 2015

NO. 04
 DATE: FEB 26 2015

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 04 11 2015

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 04 11 2015

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 04 11 2015

PROJECT NO.:
 DRAWN BY:
 SCALE: AS NOTED
 DATE: 03-25-11

SILVER CREEK INDUSTRIES
 87 x 49 PG

PROJECT NO.:
 DRAWN BY:
 SCALE: AS NOTED
 DATE: 03-25-11

P.C. SHEET NUMBER
A-0.2

STKPI40