

1 SINGLE LINE DIAGRAM
SCALE: NOT TO SCALE

(E) PANEL

PANEL C		VOLTAGE	208Y/ 120V	PHASE	3	WIRE	4	MAIN	200A MCB						
SOURCE		A.I.C.	10,000					ENCLOSURE	NEMA 3R						
PANEL LOCATION		BUS AMPERE RATING:	225					MOUNTING	FLUSH						
C K T	VA LOAD			L C L	OUTLETS	CIRCUIT BREAKER	BUS	CIRCUIT BREAKER	OUTLETS	L C L	LOAD DESCRIPTION	VA LOAD			C K T
	LINE A	LINE B	LINE C									LINE A	LINE B	LINE C	
1					MIS/REC/LTS	1 20									2
3															4
5															6
7															8
9															10
11															12
13															14
15															16
17															18
19															20
21															22
23															24
25															26
27															28
29															30
31															32
33															34
35															36
37															38
39															40
41															42
SUBTOTALS											1200	1200			
NOTES:											LINE TOTALS	1,200	1,200		
											LCL ADDER				
											TOTAL VA/PH	1,200	1,200		
											LINE AMPS	11	11		

EXISTING PANEL GENERAL NOTES:
1. UON, ALL LOAD DESCRIPTIONS ARE EXISTING.
2. UON, ALL CIRCUIT BREAKERS DESIGNATED IN PANEL SCHEDULE ARE EXISTING.

SHEET NOTES

- VERIFY LOCATION OF ALL BUILDINGS AND APPENDICES ON ARCHITECTURAL AND CIVIL PLANS.
- CONTRACTOR SHALL VERIFY LOCATION & REQUIREMENTS OF ALL DEVICES/EQUIPMENT REQUIRING ELECTRICAL CONNECTION PRIOR TO BID PROPOSAL, ROUGH-IN, AND FINISH.
- CONTRACTOR SHALL, IN ROUTING ALL CIRCUITS, INCREASE CONDUCTOR & CONDUIT SIZE TO ALLOW FOR VOLTAGE DROP SHOULD THE CONTRACTOR EXCEED ROUTING INDICATED ON DRAWINGS. ENGINEER OF RECORD MUST BE NOTIFIED PRIOR TO ANY DEVIATIONS FROM APPROVED PLAN CHECK (PERMIT SET) DRAWINGS.
- ALL 90 DEGREE CONDUIT BENDS AND RISERS SHALL BE PVC COATED RIGID STEEL.
- VERIFY LOCATION OF ALL EQUIPMENT ON ARCHITECTURAL AND CIVIL PLANS.
- PROVIDE CODE SIZED EQUIPMENT GROUNDING CONDUCTORS IN ALL OCCUPIED CONDUITS.
- 1" CONDUIT MINIMUM UNDERGROUND.
- COORDINATE WORK WITH OTHER TRADES. OBTAIN ALL DRAWINGS THAT WILL REQUIRE COORDINATION AND PROVIDE ALL ELECTRICAL CONNECTIONS, DEVICES, AND WIRING REQUIRED, WHETHER SHOWN ON THE ELECTRICAL DRAWINGS OR NOT.
- CONTRACTOR SHALL FURNISH AND INSTALL PULL BOXES AS REQUIRED TO INSTALL CONDUCTORS PER CONDUCTOR MANUFACTURERS RECOMMENDATIONS, PER THE NATIONAL ELECTRICAL CODE, AND PER LOCAL AUTHORITIES HAVING JURISDICTION.
- FIELD CONDITIONS GOVERN DEMOLITION AND NEW CONSTRUCTION. CONTRACTOR SHALL VERIFY ACTUAL CONDITIONS PRIOR TO START OF WORK. THE ARCHITECT/ENGINEER SHALL BE NOTIFIED OF POSSIBLE FIELD PROBLEMS PRIOR TO DEMOLITION.
- ALL EMPTY CONDUITS SHALL BE PROVIDED WITH DIMENSIONED NYLON PULL STRING.
- CONTRACTOR SHALL FIELD VERIFY LOCATION OF ALL UNDERGROUND UTILITIES PRIOR TO ANY EXCAVATION OR TRENCHING. CONTRACTOR SHALL PROTECT ALL EXISTING/REMAINING UTILITIES IN PLACE. CONTRACTOR, AT HIS SOLE EXPENSE, SHALL REPAIR ANY UTILITY SYSTEMS DAMAGED DURING CONSTRUCTION.
- UNLESS NOTED OTHERWISE, ALL DEVICES AND TERMINATIONS SHALL BE RATED FOR 75 DEGREES CELSIUS.
- ALL CONDUCTORS #8 AND SMALLER SHALL BE THIN/THIN CU. ALL CONDUCTORS #6 AND LARGER SHALL BE XHHW-2 CU.
- PER CEC 110.24, SERVICE EQUIPMENT SHALL BE LEGIBLY MARKED IN THE FIELD WITH THE MAXIMUM AVAILABLE FAULT CURRENT. THE FIELD MARKING(S) SHALL INCLUDE THE DATE THE FAULT CURRENT CALCULATION WAS PERFORMED AND BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED.
- PER CEC 110.16, ELECTRICAL EQUIPMENT, SUCH AS SWITCHBOARDS, PANELBOARDS, INDUSTRIAL CONTROL PANELS, METER SOCKET ENCLOSURES, AND MOTOR CONTROL CENTERS SHALL BE FIELD MARKED TO WARN QUALIFIED PERSONS OF POTENTIAL ELECTRIC ARC FLASH HAZARDS. THE MARKING SHALL BE LOCATED SO AS TO BE CLEARLY VISIBLE TO QUALIFIED PERSONS BEFORE EXAMINATION, ADJUSTMENT, SERVICING, OR MAINTENANCE OF THE EQUIPMENT.

KEY NOTES


(NOTE: THESE NOTES MAY NOT APPEAR ON ALL SHEETS)

- 1 EXISTING FEEDER PROTECT IN PLACE.

PRIME CONSULTANT

ARCHITECTURE PLANNING
IBI San Luis Obispo
4119 Broad Street, Suite 210
San Luis Obispo, CA 93401
805.546.0433 fax: 805.546.0504

SEAL




COPYRIGHT: Any reproduction or distribution for any purpose other than authorized by IBI Group is forbidden.

COPYRIGHT 2017 IBI GROUP

REVISIONS

NO.	DATE	APPRD.	DESCRIPTION
-----	------	--------	-------------


CONSULTANT

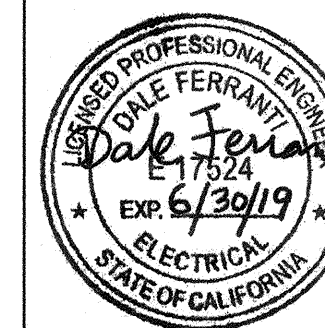


FERRANTI ENGINEERING
CONSULTING
ELECTRICAL ENGINEERS
1211 MARICOPA HWY,
SUITE 250
OJAI, CA 93023
(805) 705-4772
DALEFERRANTI@LIVE.COM

AGENCY INFORMATION:

AGENCY TRACKING NO. 53321-271
FILE NO. 15-6

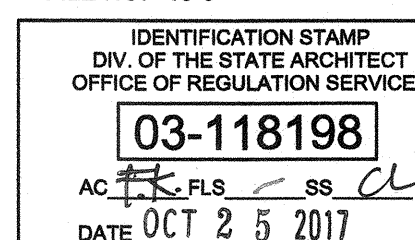

BAKERSFIELD CITY SCHOOL DISTRICT

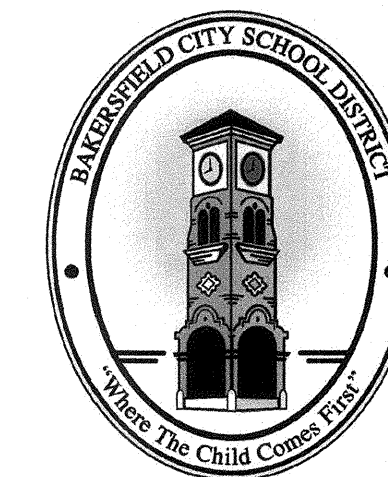

ROOSEVELT E.S. - MARQUEE SIGN
2324 VERDE ST., BAKERSFIELD, CA 93304

OPSC or OSHPD PROJ. NO:

PROJECT NO:

DRAWN BY: VZ

CHK'D BY: DF

ISSUE DATE: 10/19/2017

SHEET TITLE

SINGLE LINE DIAGRAM

SHEET NUMBER

E2.1

CONSTRUCTION DOCUMENTS