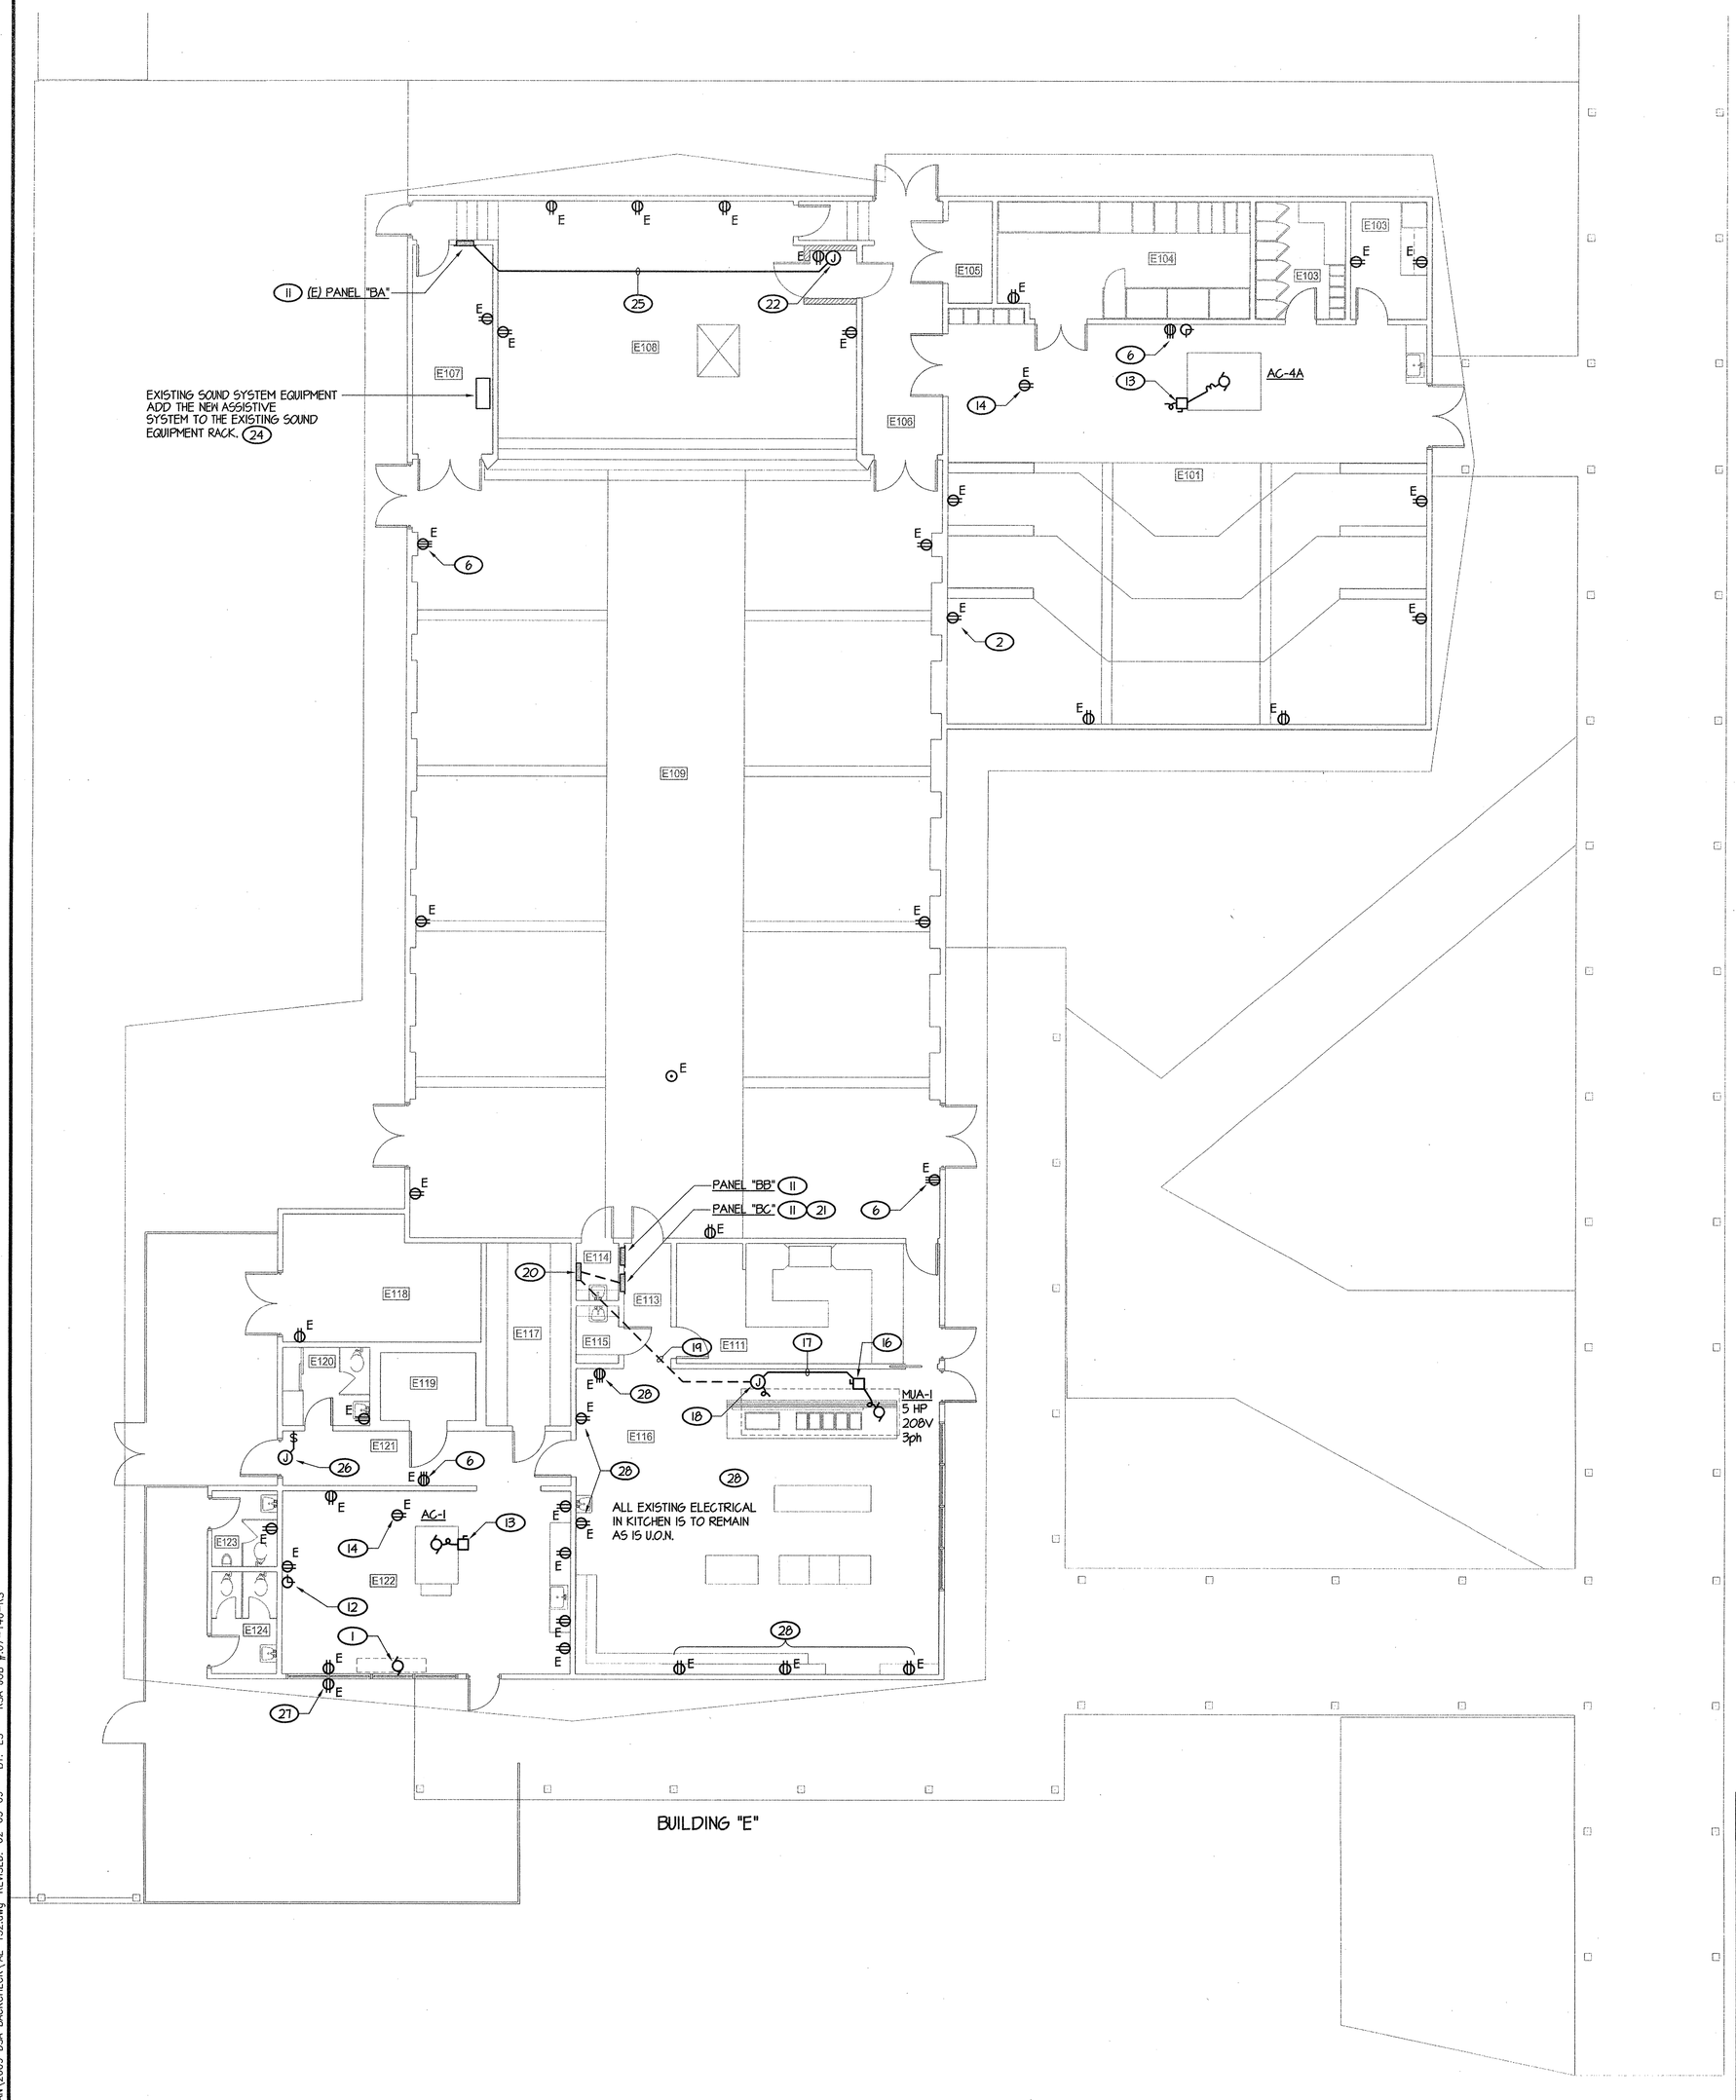

BUILDING "E"

NOTES (THIS SHEET ONLY):

1. REMOVE ALL ELECTRICAL CONNECTIONS TO THE EXISTING UNIT HEATER BEING REMOVED. CUTOFF EXISTING CONDUIT THRU FLOOR FLUSH WITH FINISH FLOOR. PULL OUT ALL EXISTING WIRE BACK TO THE ELECTRICAL PANEL.
2. DENOTES EXISTING RECEPTACLE TO REMAIN IN SERVICE. VERIFY AND KEEP IN SERVICE. WHERE RECEPTACLE IS IN WAY OF ANY NEW CONSTRUCTION, REMOVE DEVICE, PULL OUT IDLE WIRING OR RE-ROUTE AND RECONNECT TO KEEP ANY EXISTING DEVICES "DOWNSTREAM" IN SERVICE REPLACE EXISTING DEVICE WITH NEW AND RECONNECT. WHERE OUTLET BOX HAS AN EXTENSION, REMOVE AND REINSTALL FLUSH INTO EXISTING WALL. PROVIDE NEW STEEL COVER PLATE AT ALL EXISTING RECEPTACLES.
3. PROVIDE DUPLEX RECEPTACLE AT CEILING DIRECTLY ABOVE VIDEO PROJECTOR SHELF. CONNECT TO 120V CIRCUIT AS SHOWN.
4. PROVIDE LOW VOLTAGE DEVICE MOUNTING BRACKET AT CEILING DIRECTLY ABOVE VIDEO ABOVE VIDEO PROJECTOR SHELF. (ARLINGTON INDUSTRIES #LV2 OR EQUAL) PROVIDE A 2 GANG 2 GANG NON-MAGNETIC 5/5 COVERPLATE WITH A SINGLE DECORATOR DEVICE OPENING.
5. RUN HOMERUN TO PANEL CONCEAL ABOVE CEILING. CONNECT TO TWO 20A 1 POLE CIRCUIT BREAKERS.
6. REPLACE EXISTING 120/208 RECEPTACLE WITH TWO DUPLEX RECEPTACLES AND RECONNECT TO EXISTING 2 #12 + 1 #12 GND WIRING. PULL OUT ANY ADDITIONAL EXISTING WIRING NOT USE. RECONNECT CIRCUIT AT EXISTING PANEL TO A 120V 20A 1 POLE CIRCUIT BREAKER. PROVIDE NEW STEEL FACEPLATE.
7. PROVIDE A TV OUTLET IN WALL AT LOCATION DIRECTLY BEHIND THE EXISTING TV UNIT. VERIFY EXACT LOCATION WITH OWNER. STUB 1"C UP INTO ACCESSIBLE ATTIC SPACE. PROVIDE INSULATING BUSHING AT END OF CONDUIT STUB.
8. PROVIDE DUPLEX RECEPTACLE IN WALL BEHIND EXISTING TV UNIT. VERIFY EXACT LOCATION WITH OWNER PRIOR TO ANY WORK.
9. PICK UP THE EXISTING EXPOSED TV COAX CABLE AND REINSTALL CONCEAL ABOVE IN ACCESSIBLE ATTIC SPACE. RUN BACK TO THE EXISTING TV. RUN COAX CABLE DOWN TO TV OUTLET IN THE 1"C PER NOTE #7.
10. PROVIDE NEW DUPLEX RECEPTACLE OUTLET. CONNECT TO NEAREST EXISTING RECEPTACLE CIRCUIT OR PROVIDE NEW HOMERUN AS SHOWN. RUN NEW FEED CONCEALED IN EXISTING WALL.
11. REPLACE EXISTING PANEL PER "PANEL REPLACEMENT SCHEDULE" ON SHEET #E-110.
12. ALL EXISTING CLOCK, BELL, INTERCOM, P.A., TELEPHONE SYSTEMS TO REMAIN. VERIFY ALL LOCATIONS AND KEEP IN SERVICE DURING AND AFTER CONSTRUCTION. TYPICAL (NOT ALL SIGNAL DEVICES ARE SHOWN ON ELECTRICAL DRAWINGS).
13. DISCONNECT AND REMOVE ALL CONNECTIONS TO THE EXISTING H.V.A.C. UNIT BEING REMOVED. SALVAGE EXISTING POWER CONDUCTOR AND RECONNECT SAME TO THE NEW H.V.A.C. UNIT BEING INSTALLED.
14. REPLACE EXISTING ROOF RECEPTACLE WITH NEW G.F.C.I. DEVICE AND NEW "WHILE-IN-USE" COVER, RED DOT #CK56V OR EQUAL. VERIFY LOCATIONS OF ALL ROOF RECEPTACLES AND REPLACE ALL.
15. REMOVE EXISTING RECEPTACLES PER GENERAL NOTE "D" ON SHEET #AE-110
16. CONNECT NEW MUA-1 UNIT. VERIFY ALL CONNECTION REQUIREMENTS WITH MECHANICAL CONTRACTOR.
17. 3/4"C - 3 #10 + 1 #10 GND.
18. CONNECT ALL ELECTRICAL TO EXISTING EVAP. COOLER UNIT BEING REMOVED. PULL OUT WIRING ALL THE WAY BACK TO EXISTING PANEL. SALVAGE EXISTING CONDUIT AND REUSE TO PULL IN NEW WIRING TO NEW MUA-1 UNIT.
19. EXISTING 3/4"C. PULL IN 3 #10 + 1 #10 GND ALL THE WAY TO EXISTING PANEL "BC".
20. EXISTING STARTER CABINET. REMOVE IDLE STARTERS FOR UNITS BEING REMOVED. RECONNECT FEED THRU WIRING AS REQUIRED.
21. PROVIDE 35A 3 POLE CIRCUIT BREAKER FOR NEW MUA-1 UNIT.
22. PROVIDE ALL CONNECTIONS TO THE HANDICAP LIFT. COORDINATE WITH LIFT SUPPLIER PRIOR TO ANY WORK.
23. REMOVE EXISTING RECEPTACLES. RECONNECT FEED THRU WIRING TO EXISTING RECEPTACLE UPSTREAM. PROVIDE BLANK COVER PLATE.
24. EXISTING SOUND SYSTEM EQUIPMENT. PROVIDE AND CONNECT THE NEW ASSISTIVE SYSTEM AS REQUIRED. REFER TO DETAIL #1/E-132.
25. RUN 3/4"C - 2 #12 + 1 #12 GND FROM THE HANDICAP LIFT TO THE EXISTING PANEL "BA". CONNECT TO 30A CIRCUIT. PROVIDE 30A CIRCUIT BREAKER AS REQUIRED. VERIFY EXPOSED ROUTING WITH ARCHITECT PRIOR TO INSTALLATION.
26. EXISTING INSECT CURTAIN TO REMAIN.
27. REPLACE EXISTING RECEPTACLE WITH NEW G.F.C.I. DUPLEX RECEPTACLE EQUIPPED WITH A WLP, "WHILE-IN-USE" COVER, RED DOT #CK56 OR EQUAL.
28. REPLACE ALL EXISTING 20A 125V DUPLEX RECEPTACLES IN KITCHEN AREA WITH NEW G.F.C.I. DUPLEX RECEPTACLE AND STAINLESS STEEL WALLPLATE.

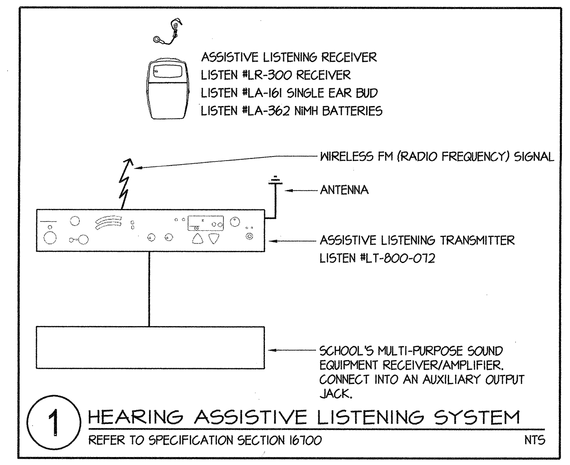

1 HEARING ASSISTIVE LISTENING SYSTEM
REFER TO SPECIFICATION SECTION 16700 NTS

APPROVED
DIV. OF THE STATE ARCHITECT
LOS ANGELES BASIN REGIONAL OFFICE
AC. ___ FLS. EV SS KO
APPL NO. 3 107003 DATE FEB 10 2010

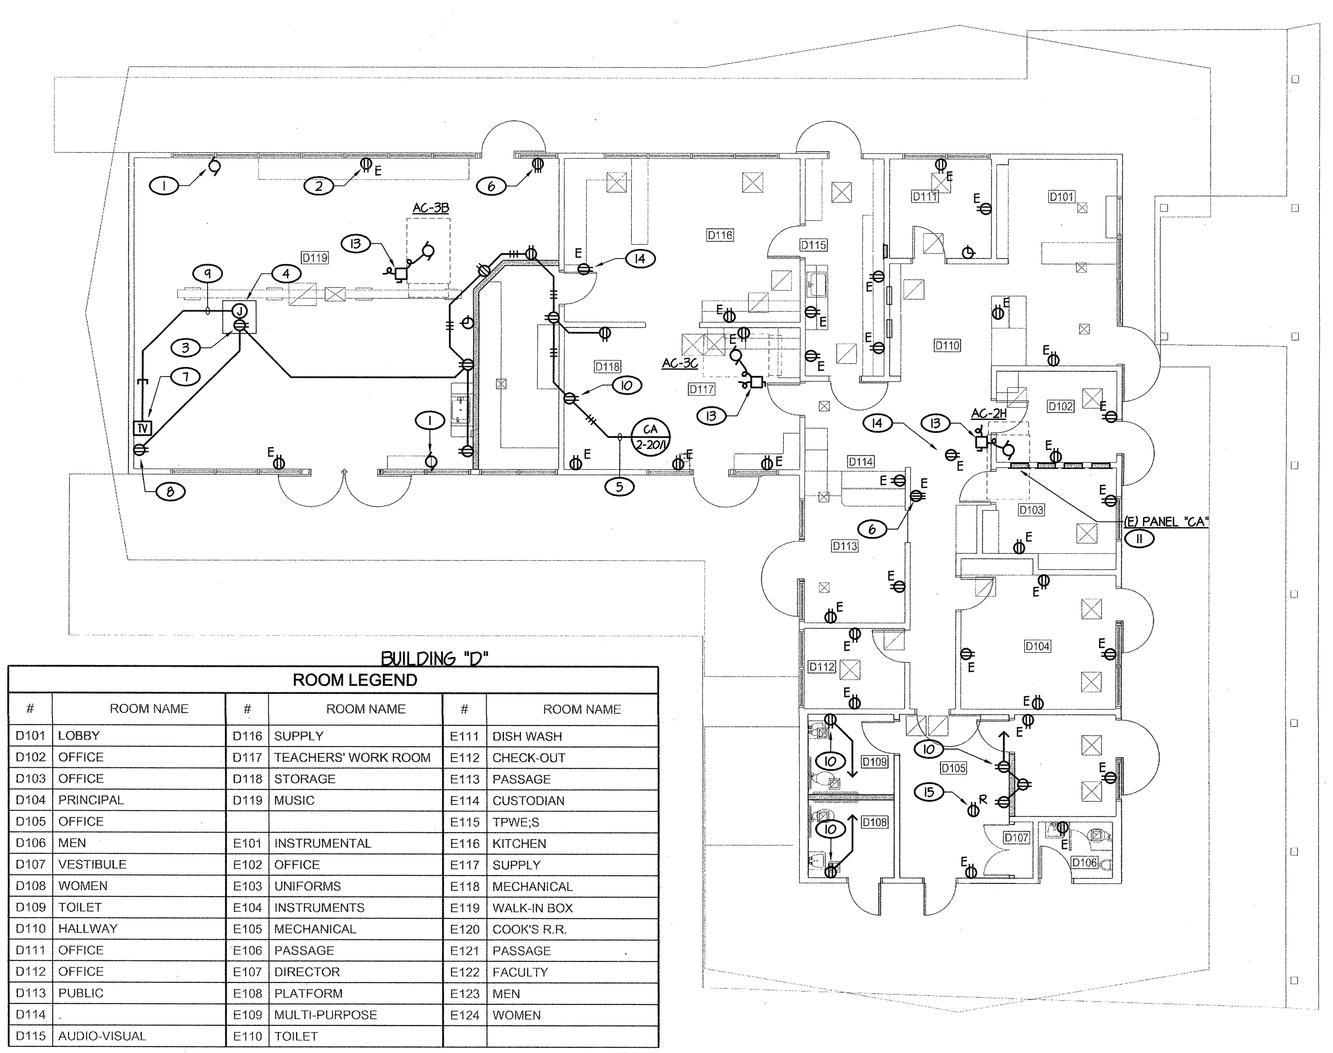

BUILDING "D"

ROOM LEGEND

#	ROOM NAME	#	ROOM NAME	#	ROOM NAME
D101	LOBBY	D116	SUPPLY	E111	DISH WASH
D102	OFFICE	D117	TEACHERS' WORK ROOM	E112	CHECK-OUT
D103	OFFICE	D118	STORAGE	E113	PASSAGE
D104	PRINCIPAL	D119	MUSIC	E114	CUSTODIAN
D105	OFFICE			E115	TPWE;S
D106	MEN	E101	INSTRUMENTAL	E116	KITCHEN
D107	VESTIBULE	E102	OFFICE	E117	SUPPLY
D108	WOMEN	E103	UNIFORMS	E118	MECHANICAL
D109	TOILET	E104	INSTRUMENTS	E119	WALK-IN BOX
D110	HALLWAY	E105	MECHANICAL	E120	COOK'S R.R.
D111	OFFICE	E106	PASSAGE	E121	PASSAGE
D112	OFFICE	E107	DIRECTOR	E122	FACULTY
D113	PUBLIC	E108	PLATFORM	E123	MEN
D114	.	E109	MULTI-PURPOSE	E124	WOMEN
D115	AUDIO-VISUAL	E110	TOILET		

NORTH

POWER PLAN - BLDGS D AND E

1/8" = 1'-0"

0' 4' 8' 16'

RSA \SCHOOLS\BFIELD\BCSD\CURRAN\2009 DSA BACKCHECK_AE-132.dwg REVISED: 02-05-09 BY: ES RSA #08 #07-140-RS

ORDIZ MELBY
ARCHITECTS, INC.
5500 MING AVENUE SUITE 280
BAKERSFIELD, CALIFORNIA 93309
TELEPHONE (661) 832-5258
FACSIMILE (661) 832-4291

LICENSED ARCHITECT DANNY E. ORDIZ No. C-14728 5-31-2011 RENEWAL DATE STATE OF CALIFORNIA

LICENSED ARCHITECT WILLIAM JOHN MELBY No. C-16835 DEC. 31, 2007 RENEWAL DATE STATE OF CALIFORNIA

DANNY E. ORDIZ, AIA
ARCHITECT C-14,728

WILLIAM J. MELBY, AIA
ARCHITECT C-16,835

CONSULTANT

REGISTERED PROFESSIONAL ENGINEER ANDREW W. NOH No. E14502 Exp. 6/30/11 ELECTRICAL STATE OF CALIFORNIA

Rose Sing and Associates, Inc.
Electrical Consultants
131 S. Dunworth – (559)733-2671
Visalia, California 93292-6705

IDENTIFICATION STAMP
DIVISION OF STATE ARCHITECT
OFFICE OF REGULATION SERVICES
APPL. 03-107003
FILE # 15-6
AC ___ FLS ___ SS ___
DATE ___

MODERNIZATION AT CURRAN MIDDLE SCHOOL FOR:

BAKERSFIELD CITY SCHOOL DISTRICT

1116 LYMRIC WAY
BAKERSFIELD
CALIFORNIA
93309

BUILDING KEY PLAN

MARK	DATE	DESCRIPTION

JOB NUMBER:
2002480
CAD DRAWING FILE:

DRAWN BY:
ES
CHECKED BY:
TWR

CHECK AND VERIFY ALL DIMENSIONS BEFORE PROCEEDING WITH THE WORK. REPORT DESCREPANCIES TO THE ARCHITECT.

THE DRAWINGS, IDEAS, AND DESIGNS REPRESENTED ON THIS SHEET ARE THE PROPERTY OF THE ARCHITECT.

COPYRIGHT
ORDIZ-MELBY ARCHITECTS, INC. 2004

SHEET TITLE

POWER PLAN - BLDGS D AND E

SHEET IDENTIFICATION NUMBER

AE-132

SHEET OF