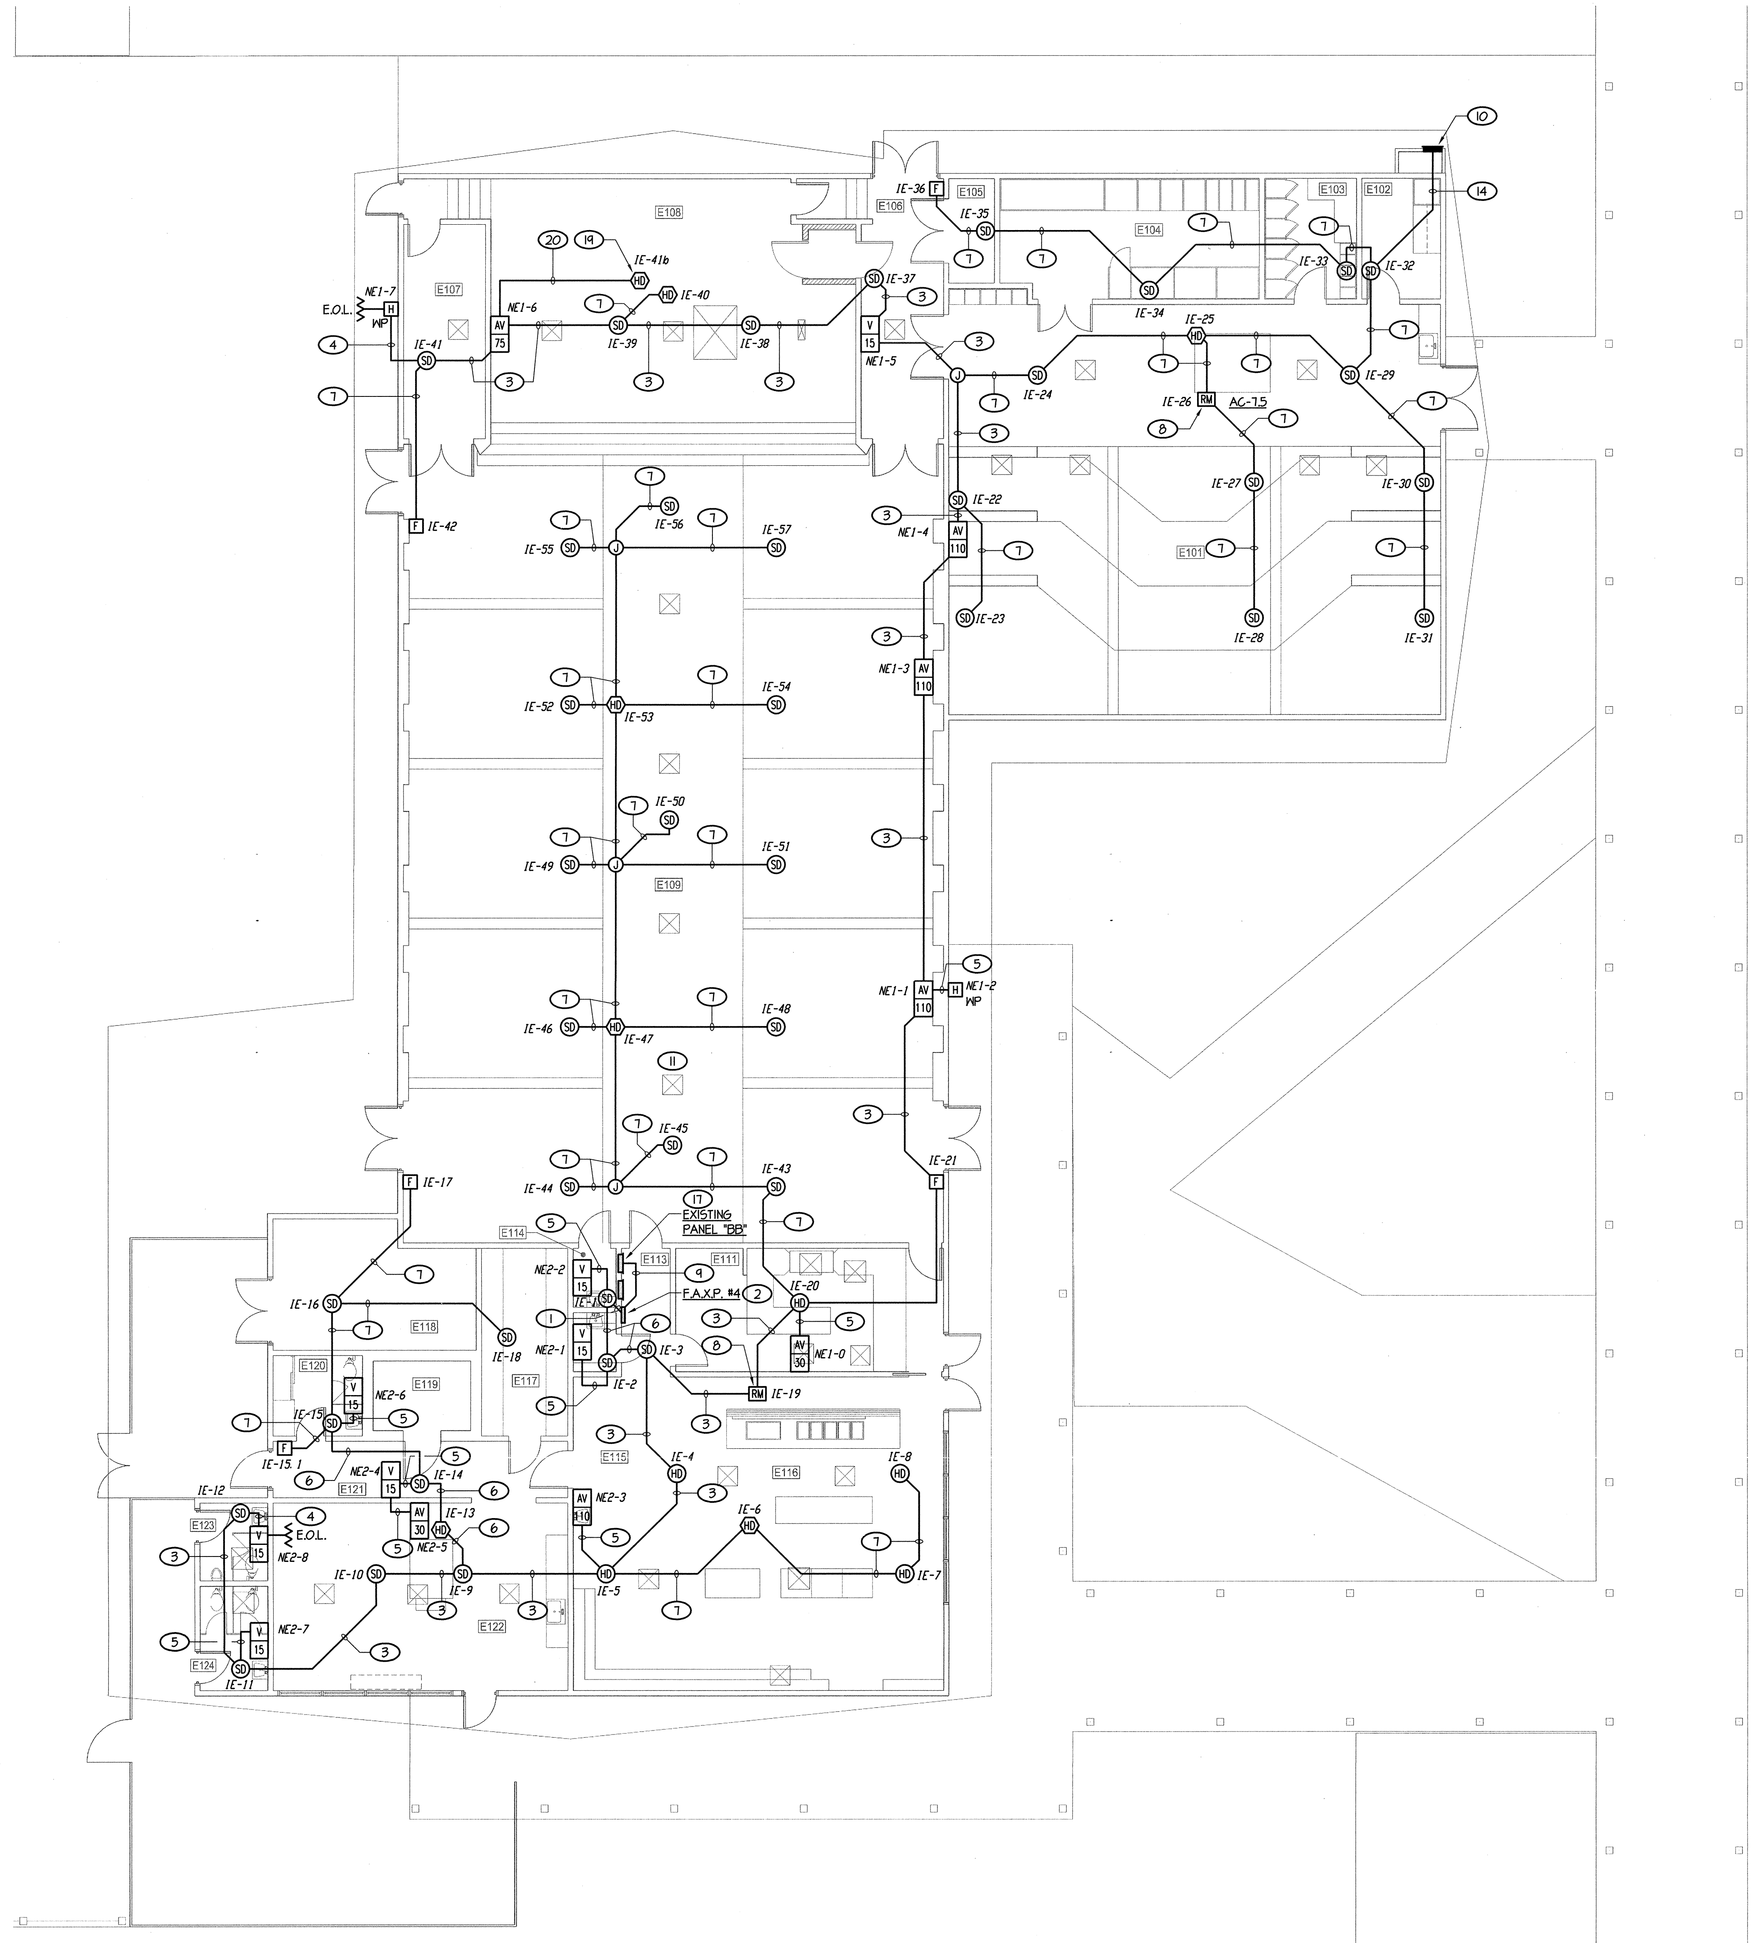

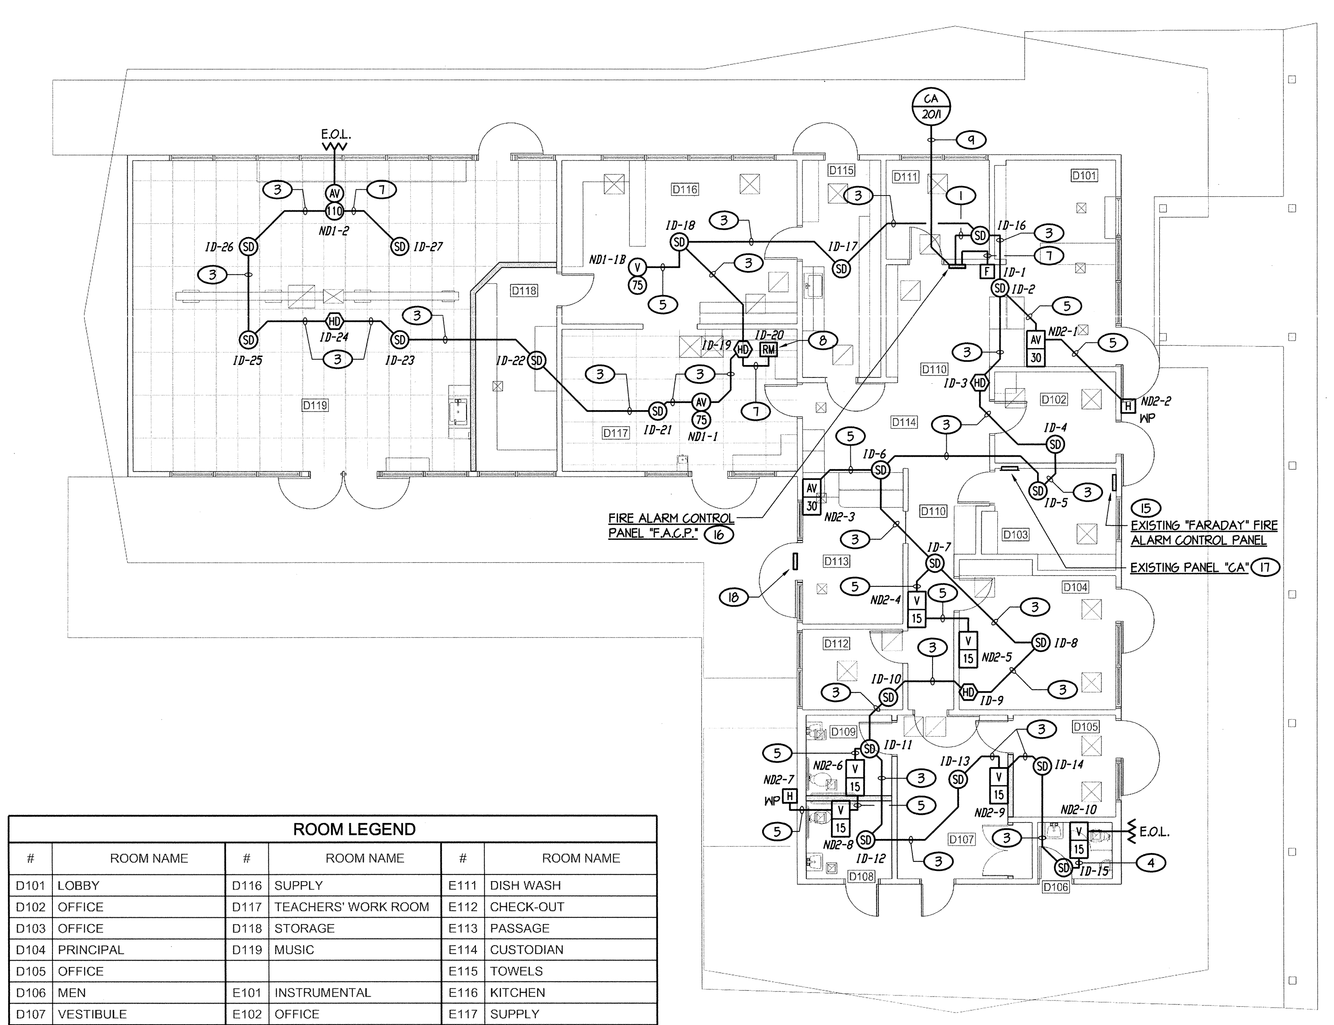

NOTES (THIS SHEET ONLY):

1. RUN 1"C - ONE "FA" CABLE, 4 #12 TO F.A.X.P. #4 OR F.A.C.P..
2. PROVIDE NEW FIRE ALARM EXPANDER PANEL "F.A.X.P. #4". MOUNT HIGH ON WALL JUST BELOW CEILING LEVEL. PROVIDE MODULES AND CONNECT PER DETAIL #2/E-146. INSTALL PER DETAIL #12/E-150.
3. 3/4"C - ONE "FA" CABLE, 2 #12.
4. 1/2"C - 2 #12.
5. 1/2"C - 4 #12
6. 3/4"C - ONE "FA" CABLE, 4 #12.
7. 3/4"C - ONE "FA" CABLE.
8. PROVIDE A RELAY MODULE FOR "UNIT SHUTDOWN" OF AC UNIT. FLUSH MOUNT IN CEILING. COORDINATE WITH MECHANICAL CONTRACTOR FOR ALL REQUIREMENTS AND INTERCONNECT. PROVIDE ENGRAVED NAMEPLATE AT RELAY MODULE: "AC UNIT SHUTDOWN".
9. 1/2"C - 2 #12 + 1 #12 GND. RUN CONCEALED TO (E) PANEL NOTED. FISH DOWN WALL TO PANEL AS REQUIRED.
10. SIGNAL CABINET PER SHEET #ADD-007, E-114.
11. RUN ALL FEEDERS CONCEALED WHEREVER POSSIBLE. CONTRACTOR TO VERIFY ANY EXPOSED CONDUIT ROUTING WITH OWNER PRIOR TO ANY WORK.
12. SAME AS NOTE (9) EXCEPT TO EXISTING PANEL "CA".
13. REFER TO SITE ELECTRICAL PLAN, SHEET #E-111 FOR SITE CONTINUATION OF FIRE ALARM FEEDER.
14. FEEDER PER SHEET #ADD-007, E-114.
15. REFER TO "SCOPE OF WORK" NOTE #3 ON SHEET #E-141 FOR EXISTING FIRE ALARM WORK.
16. INSTALL PER DETAIL #12/E-150.
17. PROVIDE DEDICATED 20A 1-POLE CIRCUIT BREAKER IN (E) PANEL NOTED AND LABEL "FIRE ALARM - LEAVE ON". PROVIDE CIRCUIT BREAKER HANDLE "LOCK-ON" ACCESSORY.
18. PROVIDE SIGN ON DOOR "FIRE ALARM CONTROL PANEL INSIDE". VERIFY SIGNAGE REQUIREMENTS WITH ARCHITECT.
19. LOCATE HEAT DETECTOR IN OPEN SPACE BELOW PLATFORM FLOOR.
20. 3/4"C - ONE "FA" CABLE. RUN BELOW PLATFORM FLOOR.

APPROVED
DIV. OF THE STATE ARCHITECT
LOS ANGELES BASIN REGIONAL OFFICE
AC — FLS EV SS RC
APPL.NO. B 107003 DATE FEB 10 2010

ROOM LEGEND					
#	ROOM NAME	#	ROOM NAME	#	ROOM NAME
D101	LOBBY	D116	SUPPLY	E111	DISH WASH
D102	OFFICE	D117	TEACHERS' WORK ROOM	E112	CHECK-OUT
D103	OFFICE	D118	STORAGE	E113	PASSAGE
D104	PRINCIPAL	D119	MUSIC	E114	CUSTODIAN
D105	OFFICE			E115	TOWELS
D106	MEN	E101	INSTRUMENTAL	E116	KITCHEN
D107	VESTIBULE	E102	OFFICE	E117	SUPPLY
D108	WOMEN	E103	UNIFORMS	E118	MECHANICAL
D109	TOILET	E104	INSTRUMENTS	E119	WALK-IN BOX
D110	HALLWAY	E105	MECHANICAL	E120	COOK'S R.R.
D111	OFFICE	E106	PASSAGE	E121	PASSAGE
D112	OFFICE	E107	DIRECTOR	E122	FACULTY
D113	PUBLIC	E108	PLATFORM	E123	MEN
D114	.	E109	MULTI-PURPOSE	E124	WOMEN
D115	AUDIO-VISUAL	E110	TOILET		

NORTH

FIRE ALARM PLAN - BLDGS D AND E

1/8" = 1'-0"

0' 4' 8' 16'

COMPLETE AUTOMATIC FIRE ALARM PLAN SUBMITTAL

THE FIRE ALARM SYSTEM SHOWN ON THESE PLANS HAS BEEN SUBMITTED AND APPROVED BY THE DIVISION OF THE STATE ARCHITECT. ANY SUBSTITUTION OF THE FIRE ALARM SYSTEM SHALL BE RESUBMITTED TO THE ARCHITECT FOR REVIEW AND APPROVAL. THE CONTRACTOR SHALL PAY ANY ADDITIONAL FEES THAT ARE INCURRED DUE TO THIS SUBSTITUTION.

THE AUTOMATIC FIRE ALARM SYSTEM SHALL COVER ALL ROOMS AND AREAS AND UPON ACTIVATION OF AN INITIATING DEVICE ALERT ALL OCCUPANTS AND TRANSMIT THE ALARM, SUPERVISORY, AND TROUBLE SIGNALS TO AN APPROVED SUPERVISING STATION. EXCEPTION: SMOKE DETECTORS ARE NOT REQUIRED IN NON-ACCESSIBLE AREAS AS DEFINED IN EMERGENCY EXPRESS TERMS OF PROPOSED S.F.M. AMENDMENTS TO 2001 C.F.C. SECTION 210 (C.F.C. SECTIONS 1006.2.4.2.2.1.1 AND 1006.2.4.2.2.1.5)

ORDIZ MELBY
ARCHITECTS, INC.
5500 MING AVENUE SUITE 280
BAKERSFIELD, CALIFORNIA 93309
TELEPHONE (661) 832-5258
FACSIMILE (661) 832-4291

DANNY E. ORDIZ, AIA
ARCHITECT C-14,728
WILLIAM J. MELBY, AIA
ARCHITECT C-16,835

CONSULTANT
Rose Sing and Associates, Inc.
Electrical Consultants
131 S. Dunworth – (559)733-2671
Visalia, California 93292-6705

IDENTIFICATION STAMP
DIVISION OF STATE ARCHITECT
OFFICE OF REGULATION SERVICES
APPL. 03-107003
FILE # 15-6
AC — FLS — SS —
DATE —

MODERNIZATION AT CURRAN MIDDLE SCHOOL FOR:

BAKERSFIELD CITY SCHOOL DISTRICT

1116 LYMRIC WAY BAKERSFIELD CALIFORNIA 93309

BUILDING KEY PLAN

MARK	DATE	DESCRIPTION

JOB NUMBER: 2002480
CAD DRAWING FILE: -
DRAWN BY: ES
CHECKED BY: TWR

CHECK AND VERIFY ALL DIMENSIONS BEFORE PROCEEDING WITH THE WORK. REPORT DESCREPANCIES TO THE ARCHITECT.

THE DRAWINGS, IDEAS, AND DESIGNS REPRESENTED ON THIS SHEET ARE THE PROPERTY OF THE ARCHITECT.

COPYRIGHT ORDIZ-MELBY ARCHITECTS, INC. 2004

SHEET TITLE
FIRE ALARM PLANS - BLDGS D AND E

SHEET IDENTIFICATION NUMBER
AE-142

SHEET — OF —

RSA\SCHOOLS\BFIELD\BCSD\CURRAN\2009 DSA BACKCHECK\AE-142.dwg REVISED: 02-03-10 BY: ES RSA JOB #07-140-RS