


MULTI-PURPOSE BLDG UNIT "B"

TYPICAL CLASSROOM BUILDING UNITS "E", "F", "G" AND "H"

EQUIPMENT SCHEDULE

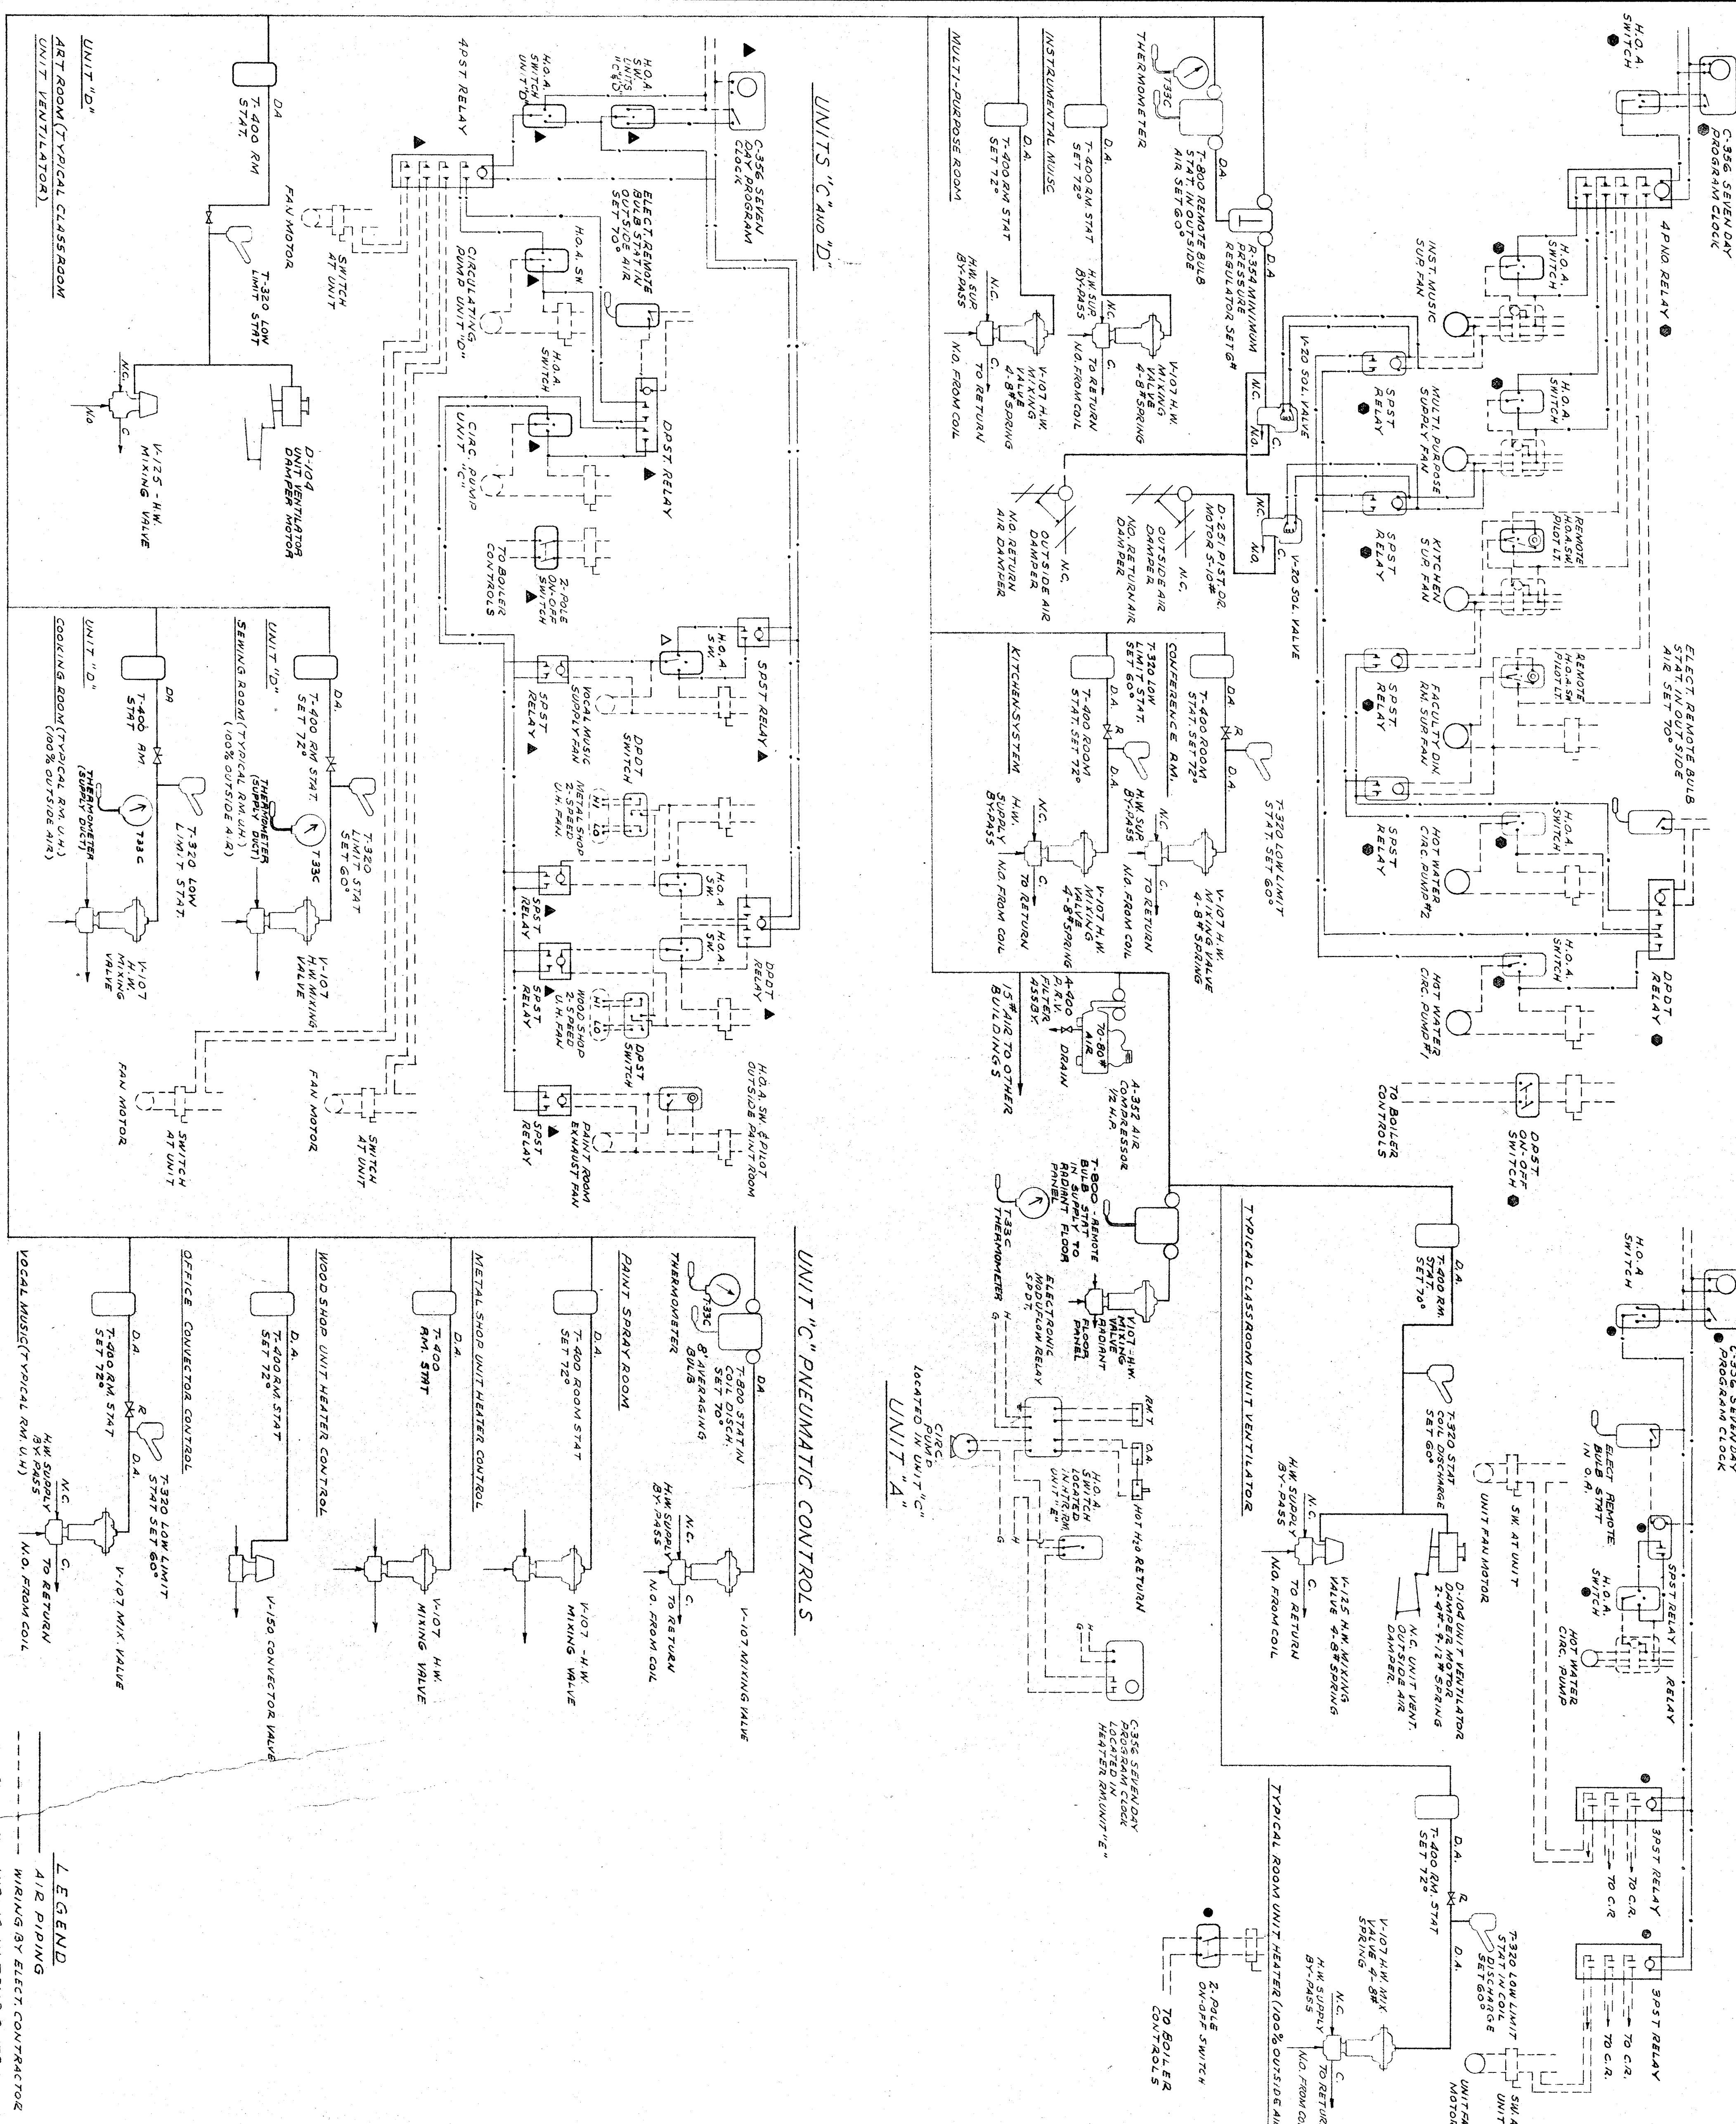

TEMPERATURE CONTROL SYSTEM

NOTE: JOHNSON SERVICE NUMBERS FOR REFERENCE ONLY

J. S. HAWELL  
 OFFICE OF SUPERINTENDENT OF SCHOOLS  
 STATE OF CALIFORNIA  
 DEPARTMENT OF PUBLIC WORKS  
 DIVISION OF ARCHITECTURE

STATE OF CALIFORNIA - DEPARTMENT OF PUBLIC WORKS  
 DIVISION OF ARCHITECTURE  
 PROJECT NO. 11300  
 BAKERSFIELD CITY SCHOOLS  
 EMERSON JUNIOR HIGH SCHOOL  
 1600 "X" ST. BAKERSFIELD CALIFORNIA

APPROVED: DATE NOV 5, 1953  
 ERNEST L. MCCOY A. A. ARCHITECT  
 8011 H STREET BAKERSFIELD CALIFORNIA

\* DENOTES EQUIPMENT TO BE SUPPLIED BY PLUMBING CONTRACTOR

EQUIP. NO.	QUANTITY	NAME	LOCATION	NOTES	DESCRIPTION
(1)	1	RANGE EXHAUST FAN	KITCHEN UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(2)	1	DISHWASHER EXHAUST FAN	KITCHEN UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(3)	1	VENTILATION UNIT	KITCHEN UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(4)	1	VENTILATION UNIT	KITCHEN UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(5)	1	HORIZONTAL UNIT VENTILATOR	KITCHEN UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(6)	1	BOILER	UNIT B	3 3/4	3 3/4" x 20" WATER HEATER
(7)	1	EXHAUST FAN	UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(8)	2	EXHAUST FAN	UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(9)	2	UNIT HEATER	UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(10)	2	CLASSROOM UNIT VENTILATOR	UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(11)	20	CLASSROOM UNIT VENTILATOR	UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(12)	3	EXHAUST FAN	UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(13)	1	EXHAUST FAN	UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(14)	1	HEATING COIL	UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(15)	1	CONVECTOR	UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(16)	1	CONVECTOR	UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(17)	1	EXHAUST FAN	UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(18)	1	EXHAUST FAN	UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(19)	1	EXHAUST FAN	UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(20)	3	BOILER	UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(21)	2	CLASSROOM UNIT VENTILATOR	UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(22)	1	CIRCULATOR	UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(23)	5	CIRCULATOR	UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(24)	2	PUMP	UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(25)	1	MAKING BOX	UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP
(26)	1	UNIT COOLER (VENTILATOR)	UNIT B	1/20	1/2" x 24" x 24" 1/2" MOTOR 1/20 HP

GENERAL NOTES

1. WHERE A PIPE SIZE IS OMITTED, IT SHALL BE SIZED FOR SERVICE INTENDED.
2. ALL TOILET EXHAUST FANS SHALL OPERATE FROM LIGHT SWITCHES.
3. ALL CLASSROOM UNIT VENTILATOR VALVES SHALL BE 1/2"

LEGEND

- AIR PIPING
- WIRING BY ELECTRIC CONTRACTOR
- WIRING IN TEMP. CONTROL PANEL
- LOCATED IN TEMPERATURE UNIT "A"
- LOCATED IN TEMPERATURE UNIT "B"
- LOCATED IN TEMPERATURE UNIT "C"
- LOCATED IN TEMPERATURE UNIT "D"
- LOCATED IN TEMPERATURE UNIT "E"
- LOCATED IN TEMPERATURE UNIT "F"
- LOCATED IN TEMPERATURE UNIT "G"
- LOCATED IN TEMPERATURE UNIT "H"