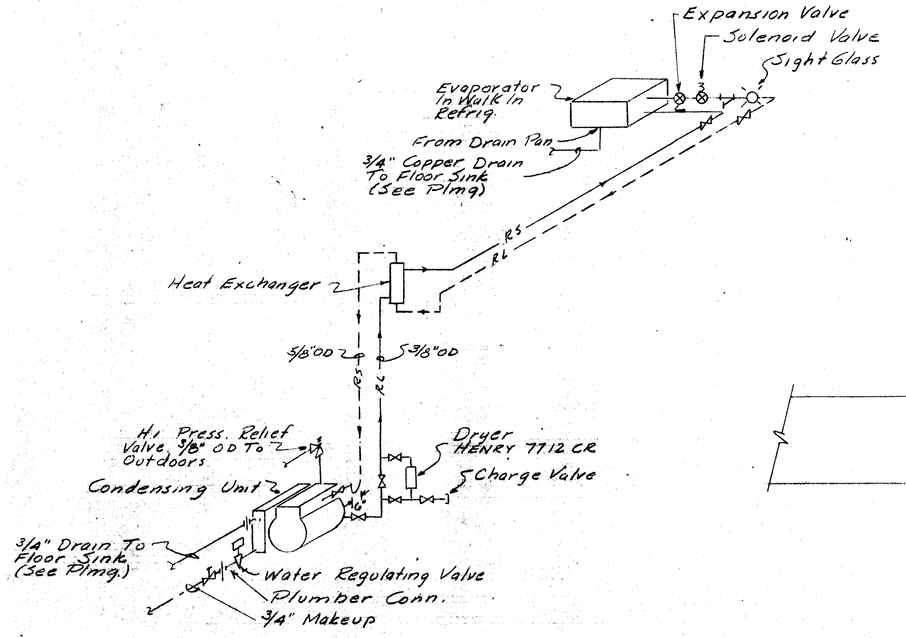

SCHEMATIC DIAGRAM - REFRIG. PIPING (B/H-3)

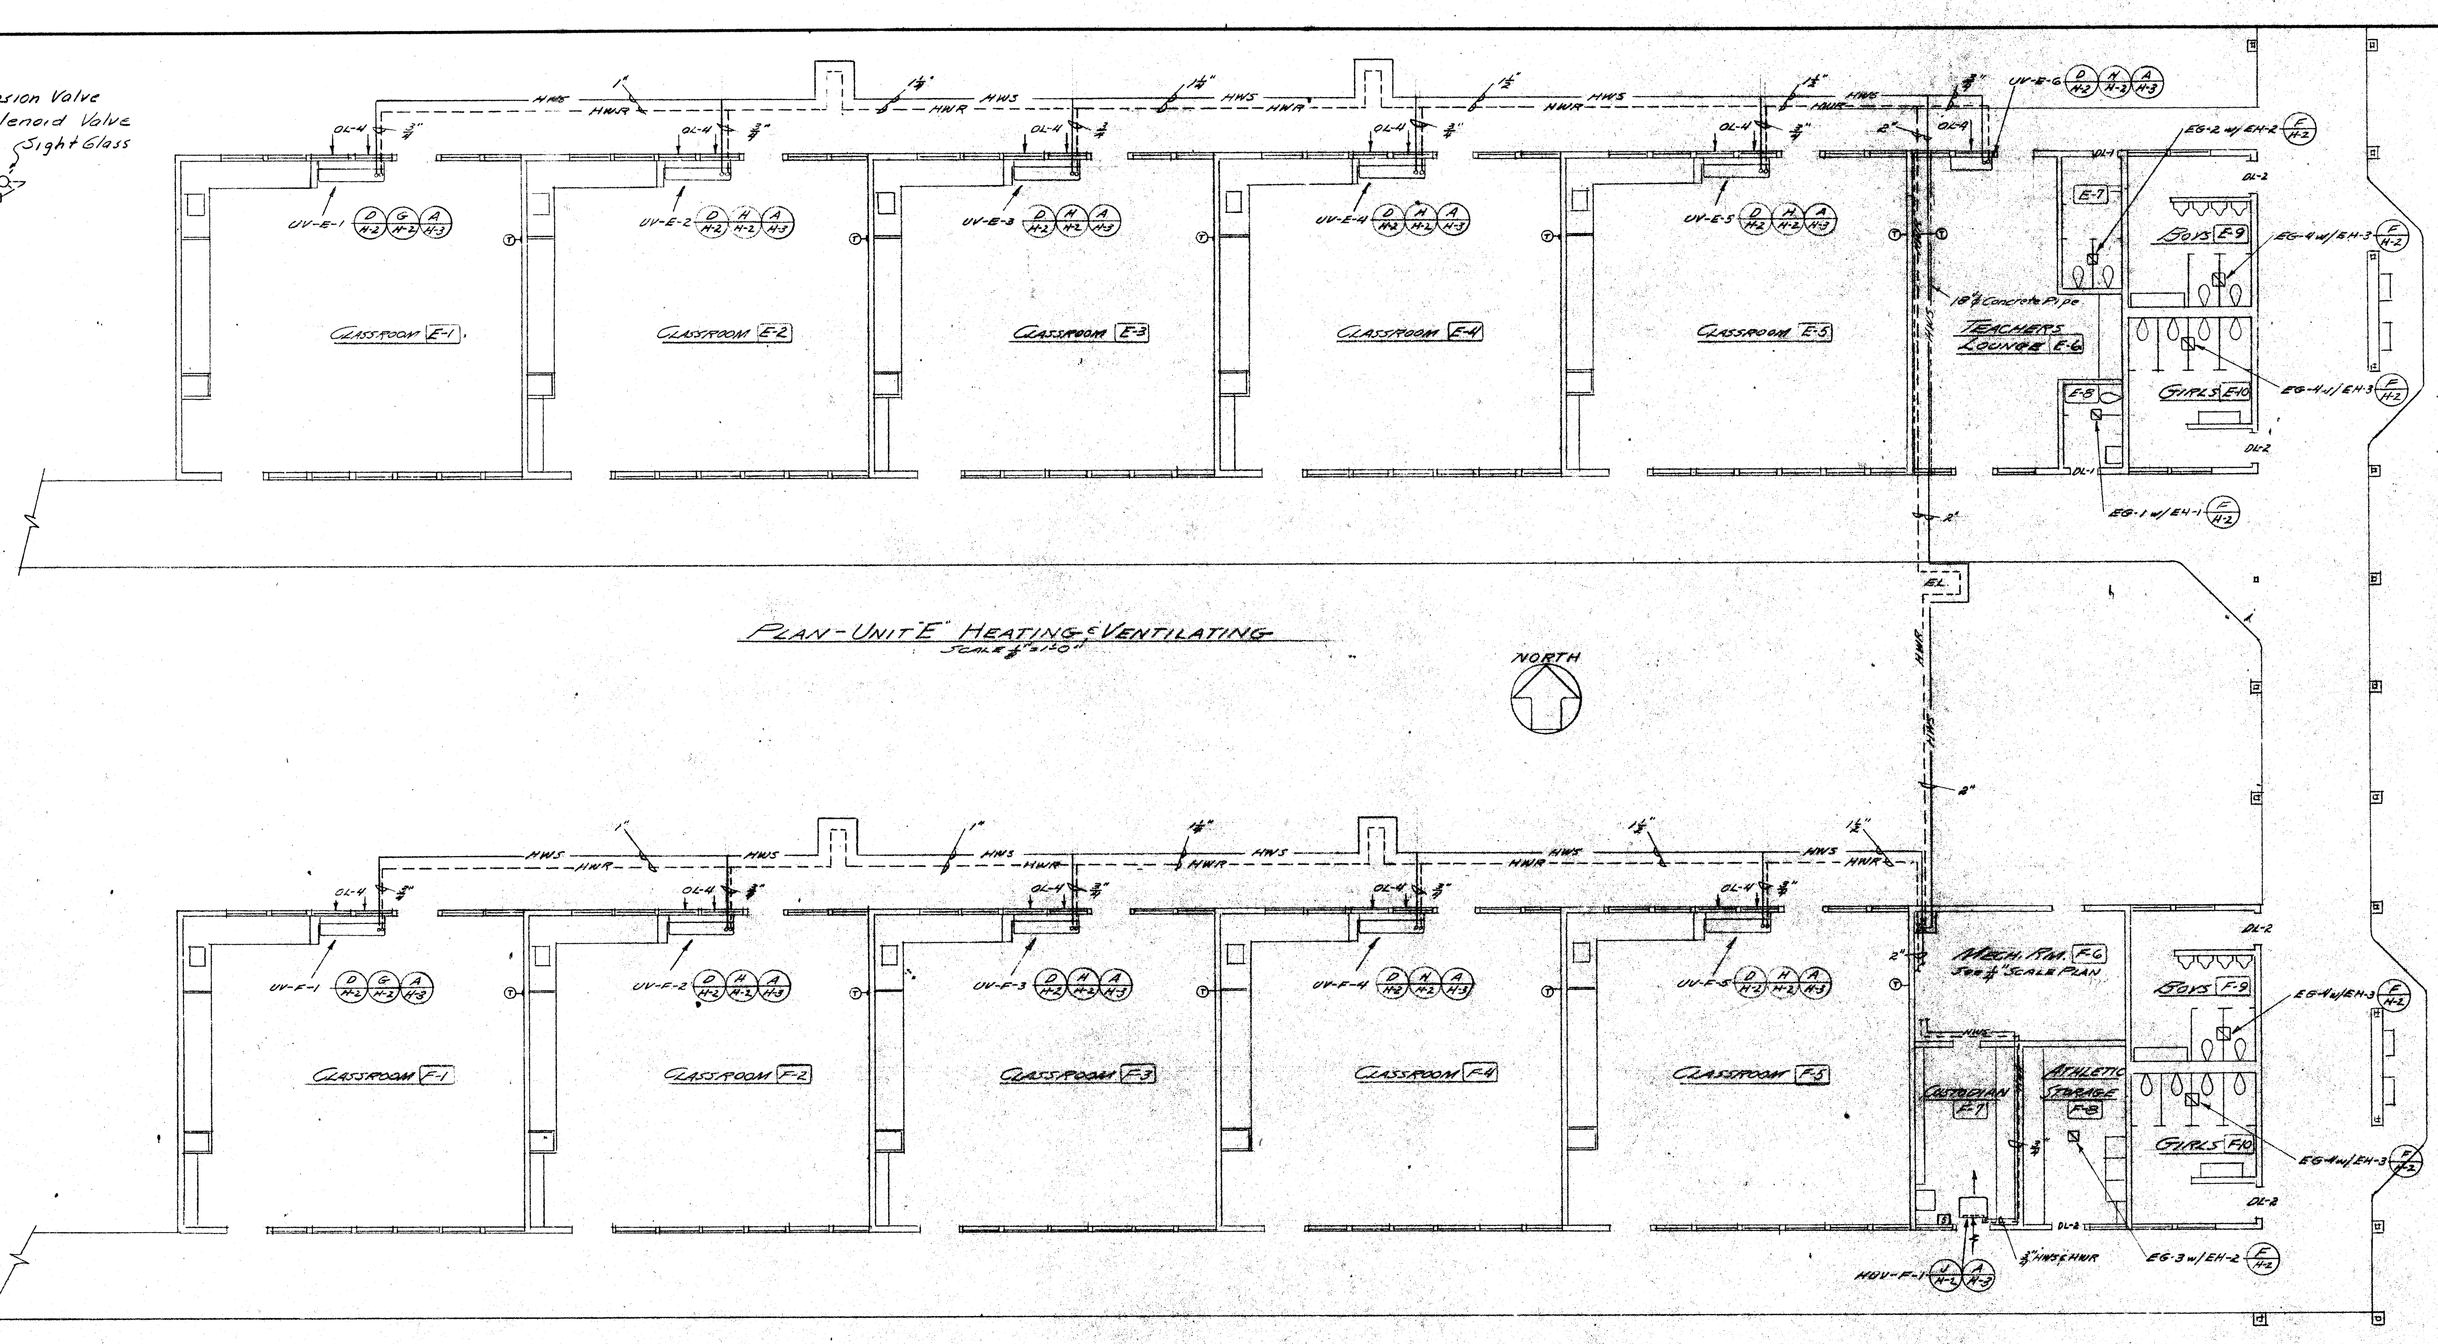

PLAN - UNIT "E" HEATING & VENTILATING
Scale 1/8" = 1'-0"

PLAN - UNIT "F" HEATING & VENTILATING
Scale 1/8" = 1'-0"

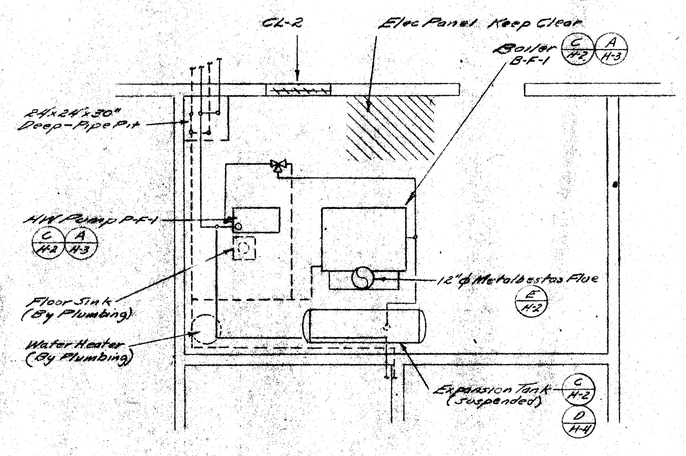

PART PLAN UNIT "F" - BOILER ROOM
Scale 1/4" = 1'-0"

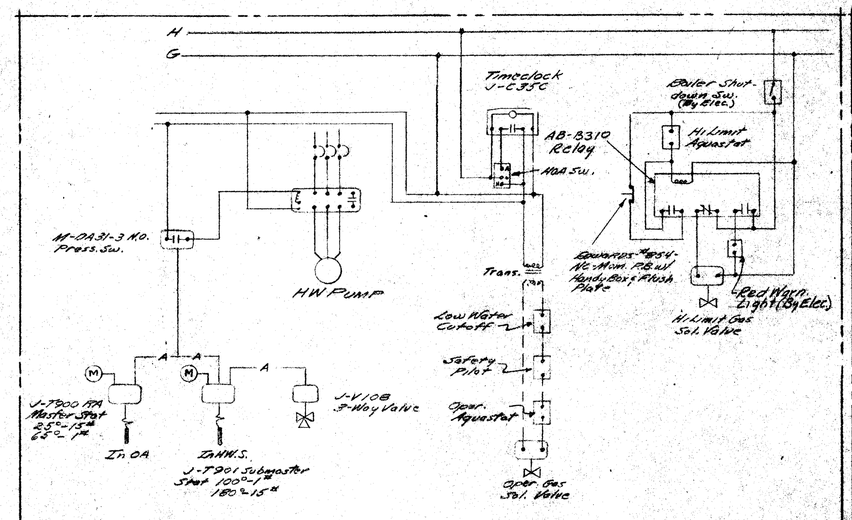

TYPICAL BOILER & H.W. TEMPERATURA CONTROL
Unit A
Unit B, C, D, E, F
Unit G 3 Req'd.

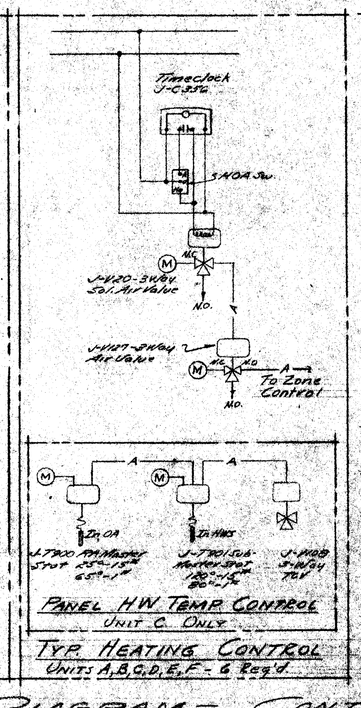

TYP. HEATING CONTROL
Units A, B, C, D, E, F - 6 Req'd.

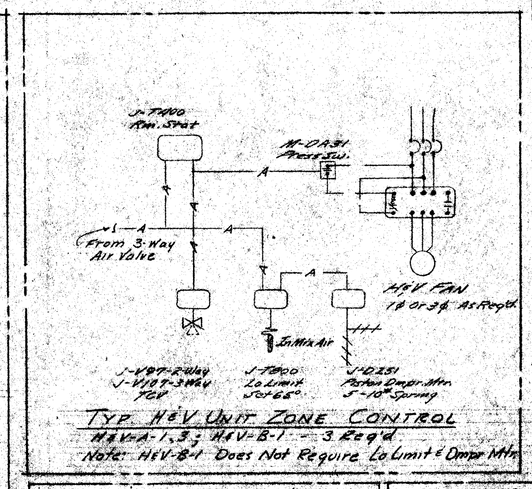

TYP. H&V UNIT ZONE CONTROL
H&V-A-1, 3; H&V-B-1 - 3 Req'd.
Note: H&V-B-1 Does Not Require Lo Limit & Damp. Mtr.

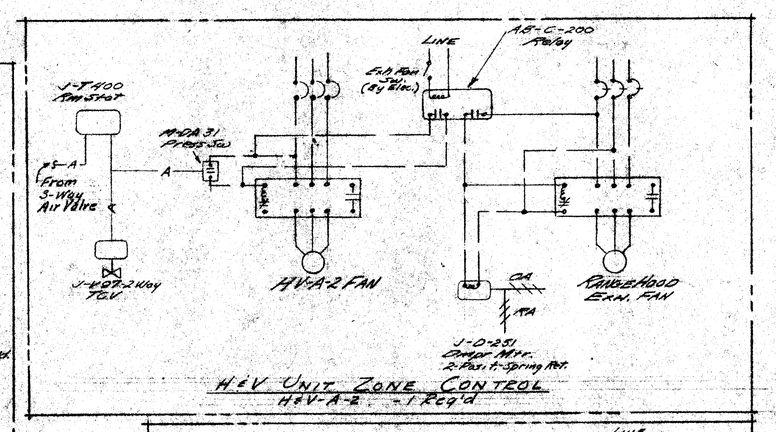

H&V UNIT ZONE CONTROL
H&V-A-2 - 1 Req'd.

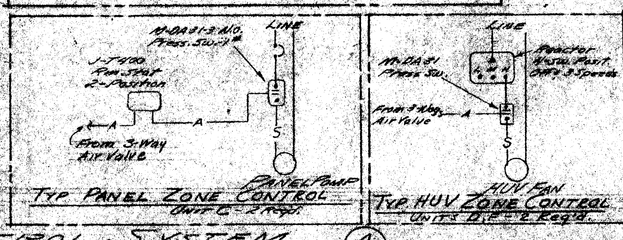

TYP. PANEL ZONE CONTROL
UNIT C - 3 Req'd.

TYP. H.V.U. ZONE CONTROL
UNITS D, E, F - 2 Req'd.

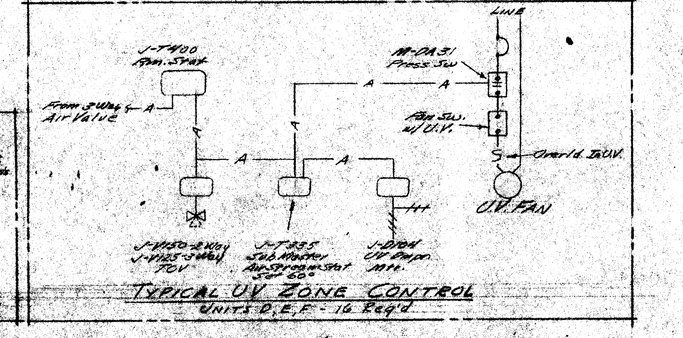

TYPICAL U.V. ZONE CONTROL
UNITS D, E, F - 16 Req'd.

SCHEMATIC DIAGRAM - CONTROL SYSTEM (A/H-3)

PLAN HEATING & VENTILATING UNITS E & F, SCHEDULES & CONTROL SYSTEM

CHECK AND VERIFY ALL DIMENSIONS AND CONDITIONS AT JOB SITE BEFORE PROCEEDING WITH THE WORK. REPORT ANY DISCREPANCIES TO THE ARCHITECT.

OFFICE OF SUPERINTENDENT OF SCHOOLS
APPROVED
DATE

STATE OF CALIFORNIA
DEPARTMENT OF PUBLIC WORKS
DIVISION OF ARCHITECTURE

BAKERSFIELD CITY SCHOOL DIST.
BAKERSFIELD, CALIFORNIA
BOARD OF EDUCATION

APPROVED DATE

MARK	DATE	REVISIONS
1		
2		
3		
4		
5		

McCANDLESS & WILLIAMS
CONSULT. MECH. ENGINEERS
DATE

DRAWN
CHECKED

Ernest L. McCoy A.I.A. ARCHITECT
C-3231 JOB NO.
1611 H STREET PHONE FA 4-8888
BAKERSFIELD CALIFORNIA

BENTON PARK SCHOOL
WILSON ROAD & BENTON STREET
BAKERSFIELD, CALIFORNIA

SHEET NO. H-3
OF 4 SHTS.