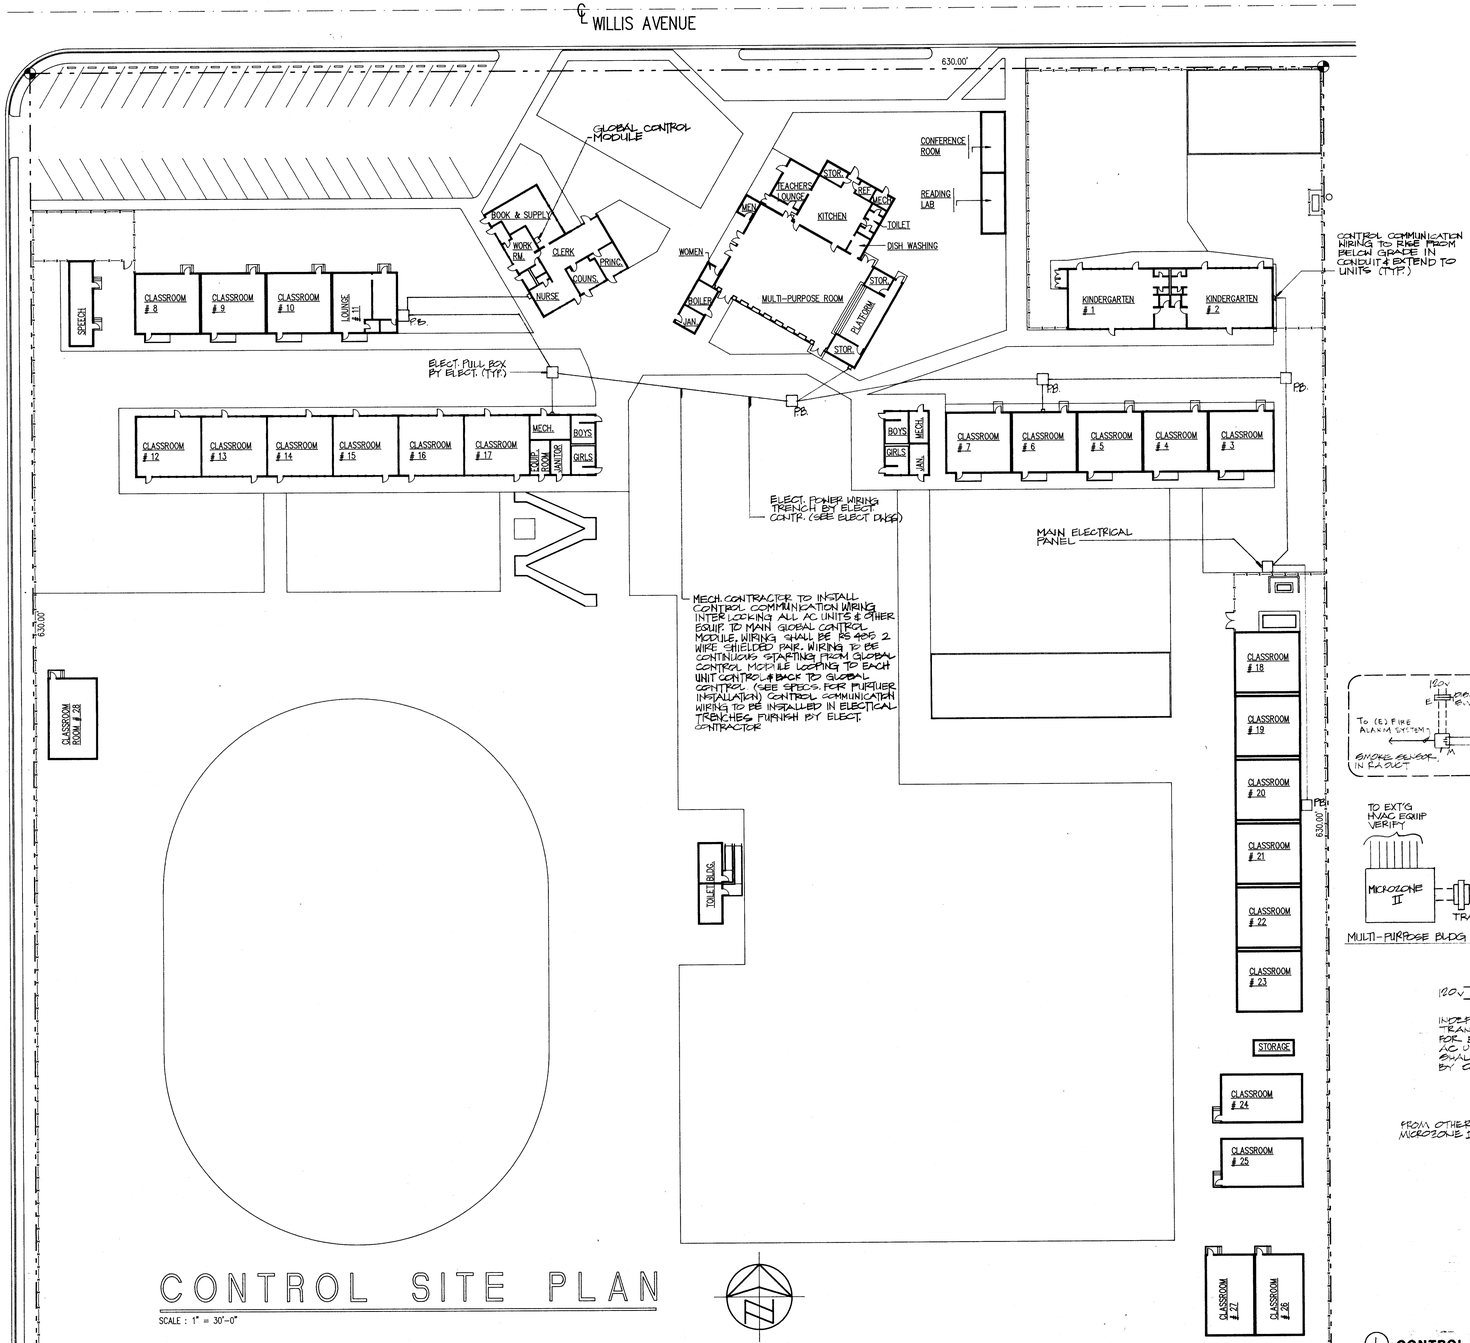

CONTROL SITE PLAN

SCALE : 1" = 30'-0"

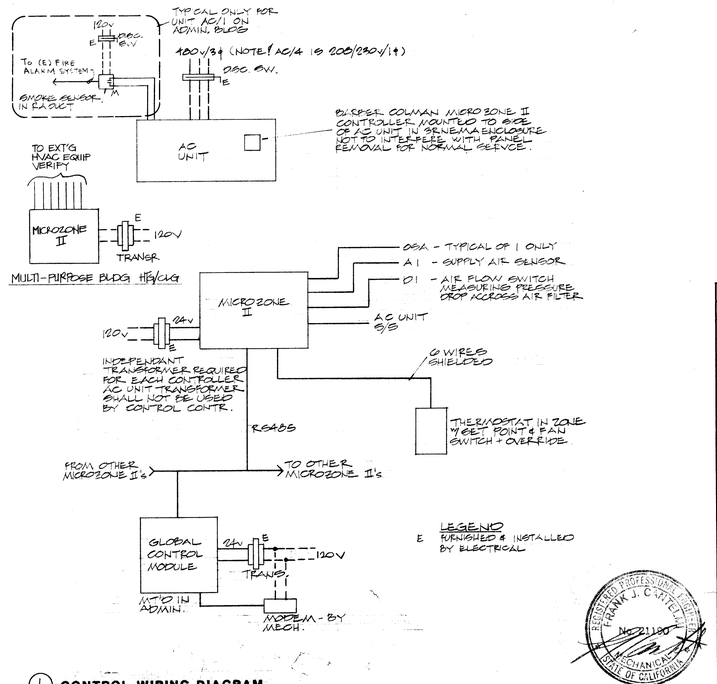

① CONTROL WIRING DIAGRAM

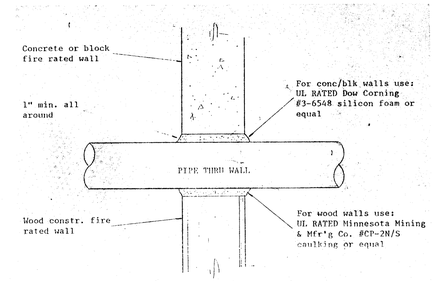

FIRE STOPPING REQUIREMENT

Penetrations thru rated walls and floors shall be sealed with a material capable of preventing the passage of flames and hot gasses when subjected to the requirements of the Test Standard specific for Fire Stops ASTM-E-814.

② PIPE PENETRATION THRU WALL

NO.	REVISION	DATE	BY

APPROVED FIRE AND PANIC ONLY
APR 4 1991
STATE FIRE MARSHAL SOUTHERN REGION

FIRE MARSHAL
TITLE 24 & 1988 UBC

IDENTIFICATION STAMP
Department of General Services
Office of the State Architect
APR 4 1991
Structural Safety Sec.
A 5260

REGISTERED PROFESSIONAL ENGINEER FRANK J. CATTELL No. 21180 MECHANICAL STATE OF CALIFORNIA

J.D. H.A.

O.S.A.

LICENSED ARCHITECT CLAUDE E. HARTZELL No. C-10298 OCT 31 1991 RENEWAL DATE STATE OF CALIFORNIA

Glenn Hartzell A.I.A.
ARCHITECT C-10298
26 'H' STREET 93304 (805) 324-6416
P.O. BOX 2344 , 93303 , BAKERSFIELD , CALIFORNIA

DATE 10/21/91

BAKERSFIELD CITY SCHOOL DISTRICT
BY RESOLUTION OF THE BOARD OF TRUSTEES
APPROVED:
DATE

CONTROL SITE PLAN ~ CONTROL WIRING DIAGRAM

(AIR CONDITIONING)
HORT SCHOOL
BAKERSFIELD CITY SCHOOL DISTRICT
2301 PARK DRIVE , BAKERSFIELD , CALIFORNIA

DATE 1-11-91
DRAWN GS

JOB NO. 142
SHEET NO. MP5
SHEET 5 OF 6