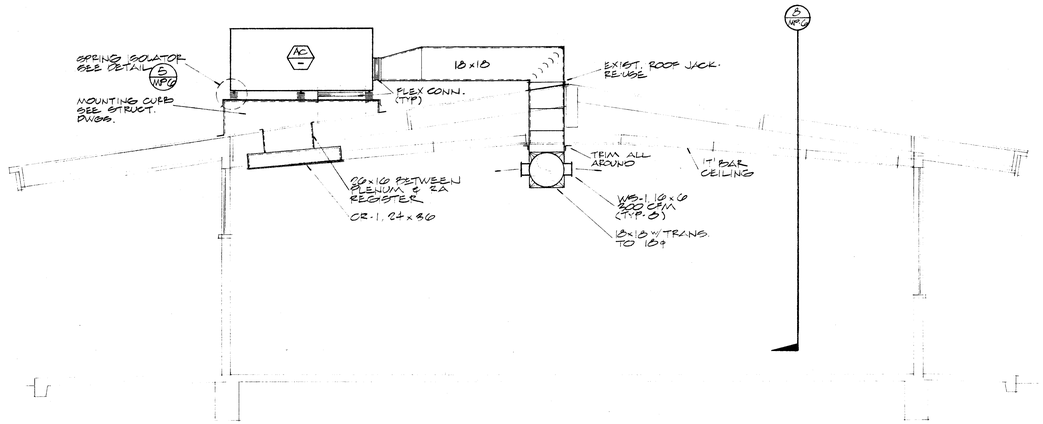

(1) SECTION AT KINDERGARTEN (SIMILAR FOR CLASSROOMS 12 THRU 17)

3/8"

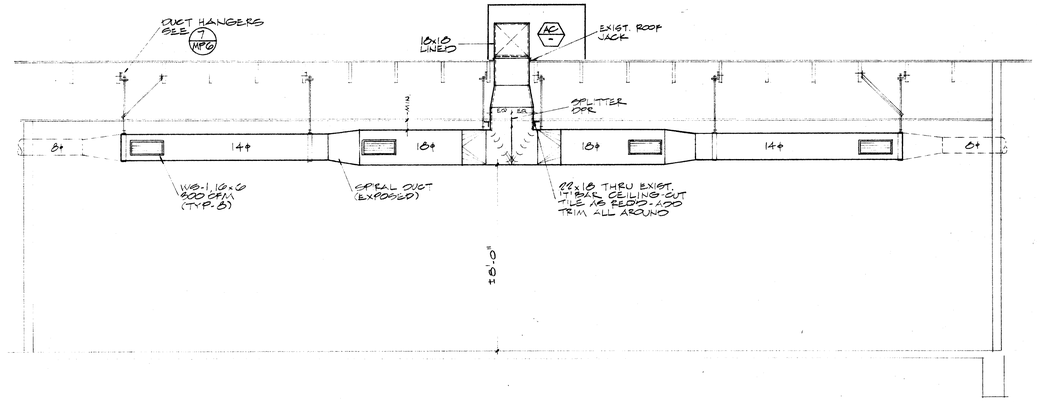

(2) SECTION AT KINDERGARTEN

3/8"

MARK	MAKE	TYPE	SIZE	DEFL.	STEEL FRAME
AC-1-4	B/A/P	SRD II	48-72	1.0"	C4 X 5.4

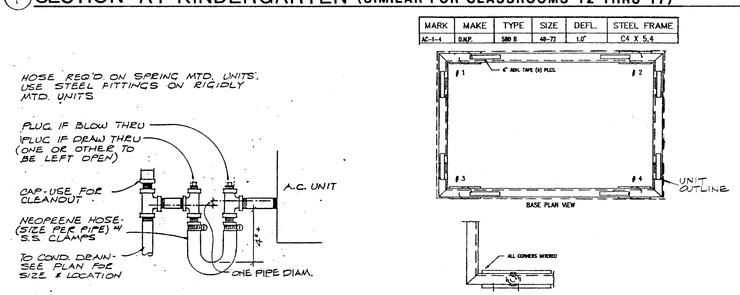

(3) CONDENSATE TRAP AT AC UNIT



(4) PIPE/VENT THRU ROOF

(5) AC UNIT MOUNTING

NOTE! ALL CLASSROOMS & KINDERGARTEN UNITS TO BE MOUNTED ON METAL CURBS - ADMIN. & MULTI-PURPOSE UNITS TO BE MOUNTED ON WOOD CURBS - SEE STRUCT. DWGS. WOOD CURBS BY GEN. CONTR. - METAL CURBS BY HVAC CONTR.

NOTE! FOR TORQUE ANALYSIS SEE ATTACHED STRUCT. CALCS.

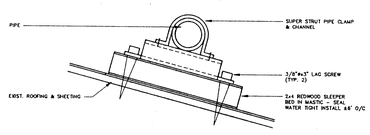

(6) PIPE SUPPORT AT ROOF

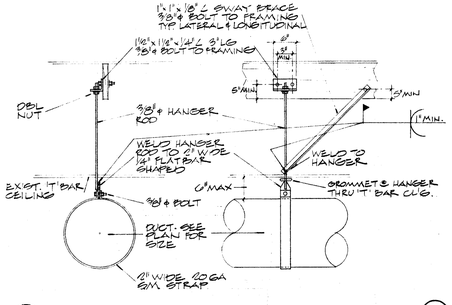

(7) DUCT HANGER

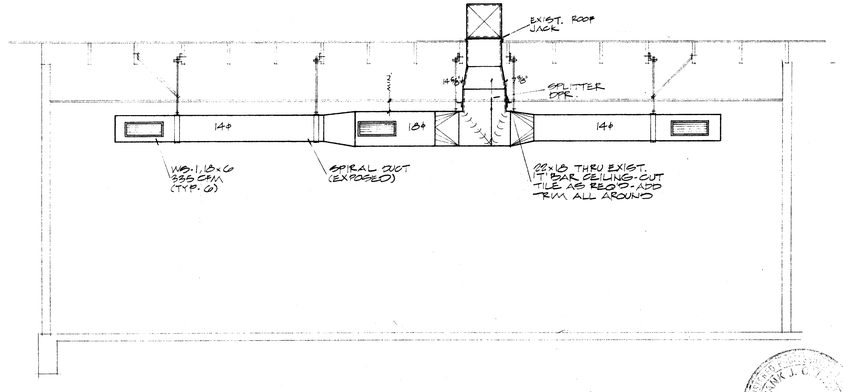

(8) SECTION AT CLASSROOM

3/8"

NO.	REVISION	DATE	BY

APPROVED FIRE AND PANIC ONLY
APR 4 1991
STATE FIRE MARSHAL SOUTHERN REGION

FIRE MARSHAL
TITLE 24 & 1388 USC

IDENTIFICATION STAMP
Department of General Services
Office of the State Architect
APR 4 1991
Structural Safety Section
Job # 18 2555
Checked By J.P.L.A.

O.S.A.

Glenn Hartzell A.I.A.
26 'H' STREET, 93304 (805) 324-6416
P.O. BOX 2344, 93303, BAKERSFIELD, CALIFORNIA
ARCHITECT C-10298
DATE

LICENSED ARCHITECT GLENN E. HARTZELL No. C-10298 OCT 31 1991 REN. DATE STATE OF CALIFORNIA

BAKERSFIELD CITY SCHOOL DISTRICT
BY RESOLUTION OF THE BOARD OF TRUSTEES
APPROVED:
DATE

SECTIONS ~ DETAILS

(AIR CONDITIONING)
HORT SCHOOL
BAKERSFIELD CITY SCHOOL DISTRICT
2301 PARK DRIVE, BAKERSFIELD, CALIFORNIA

DATE 1-11-91
DRAWN GS

JOB NO. 142

SHEET NO. MP6

SHEET 6 OF 6