




OSA INTAKE (BAC-4)
NTS

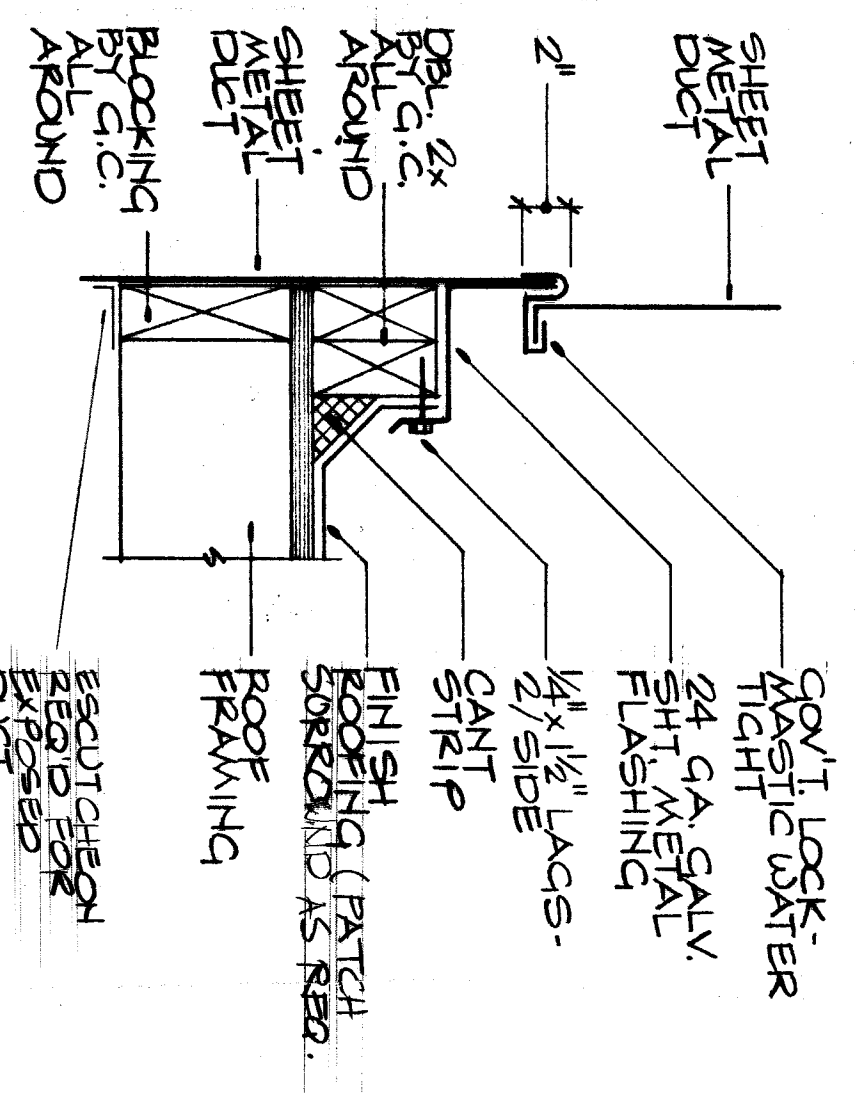


DUCT THRU ROOF DETAIL
NTS

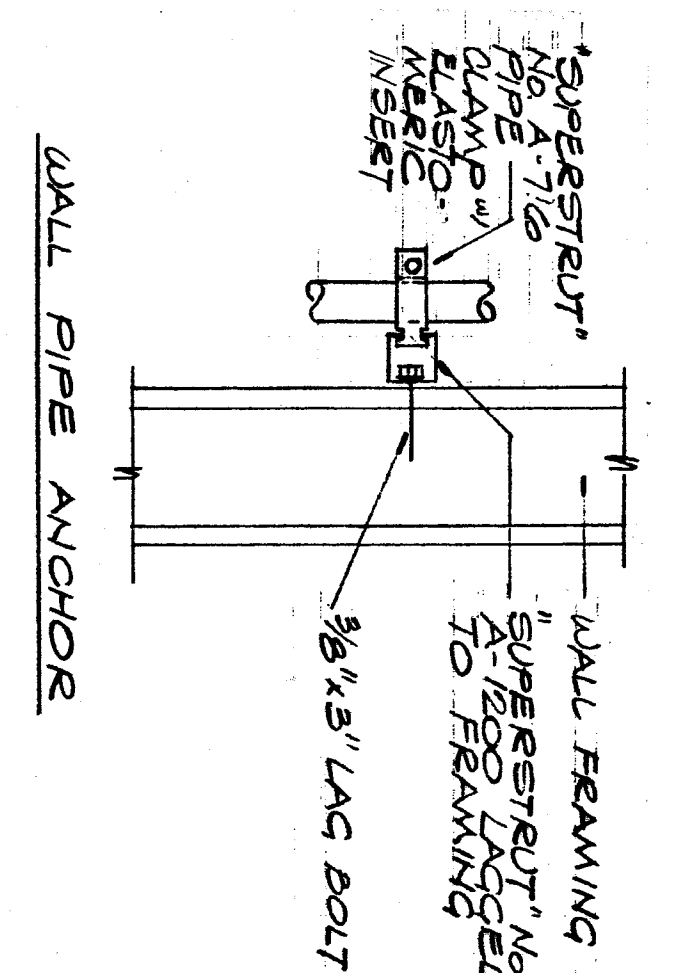


GAS RISER / COND PROP
NTS

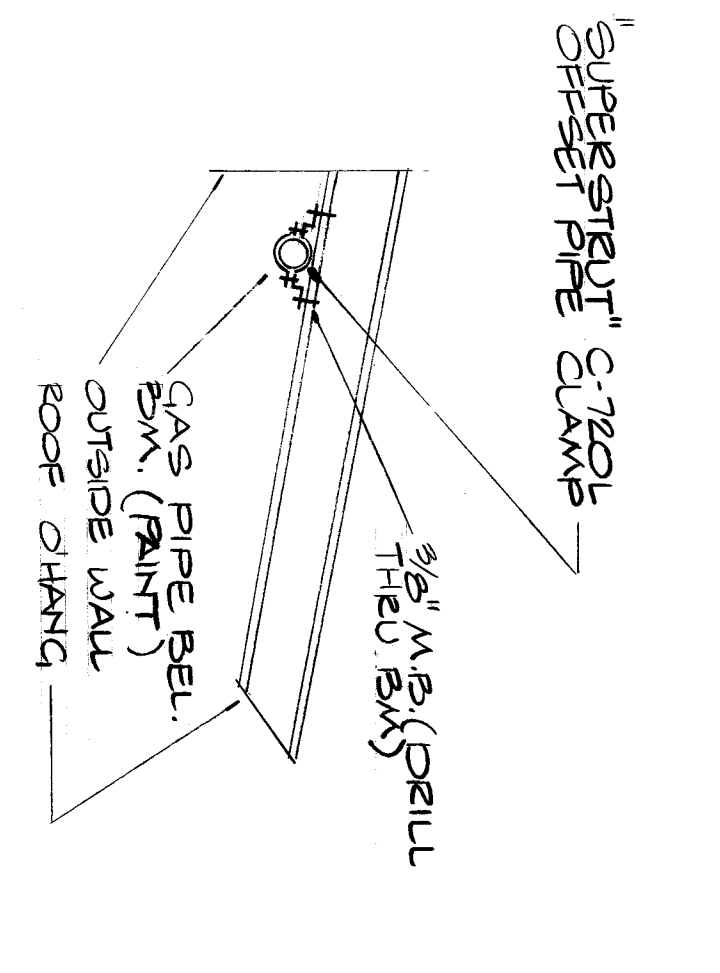


PIPE HCR & STEEL BEAM
NTS

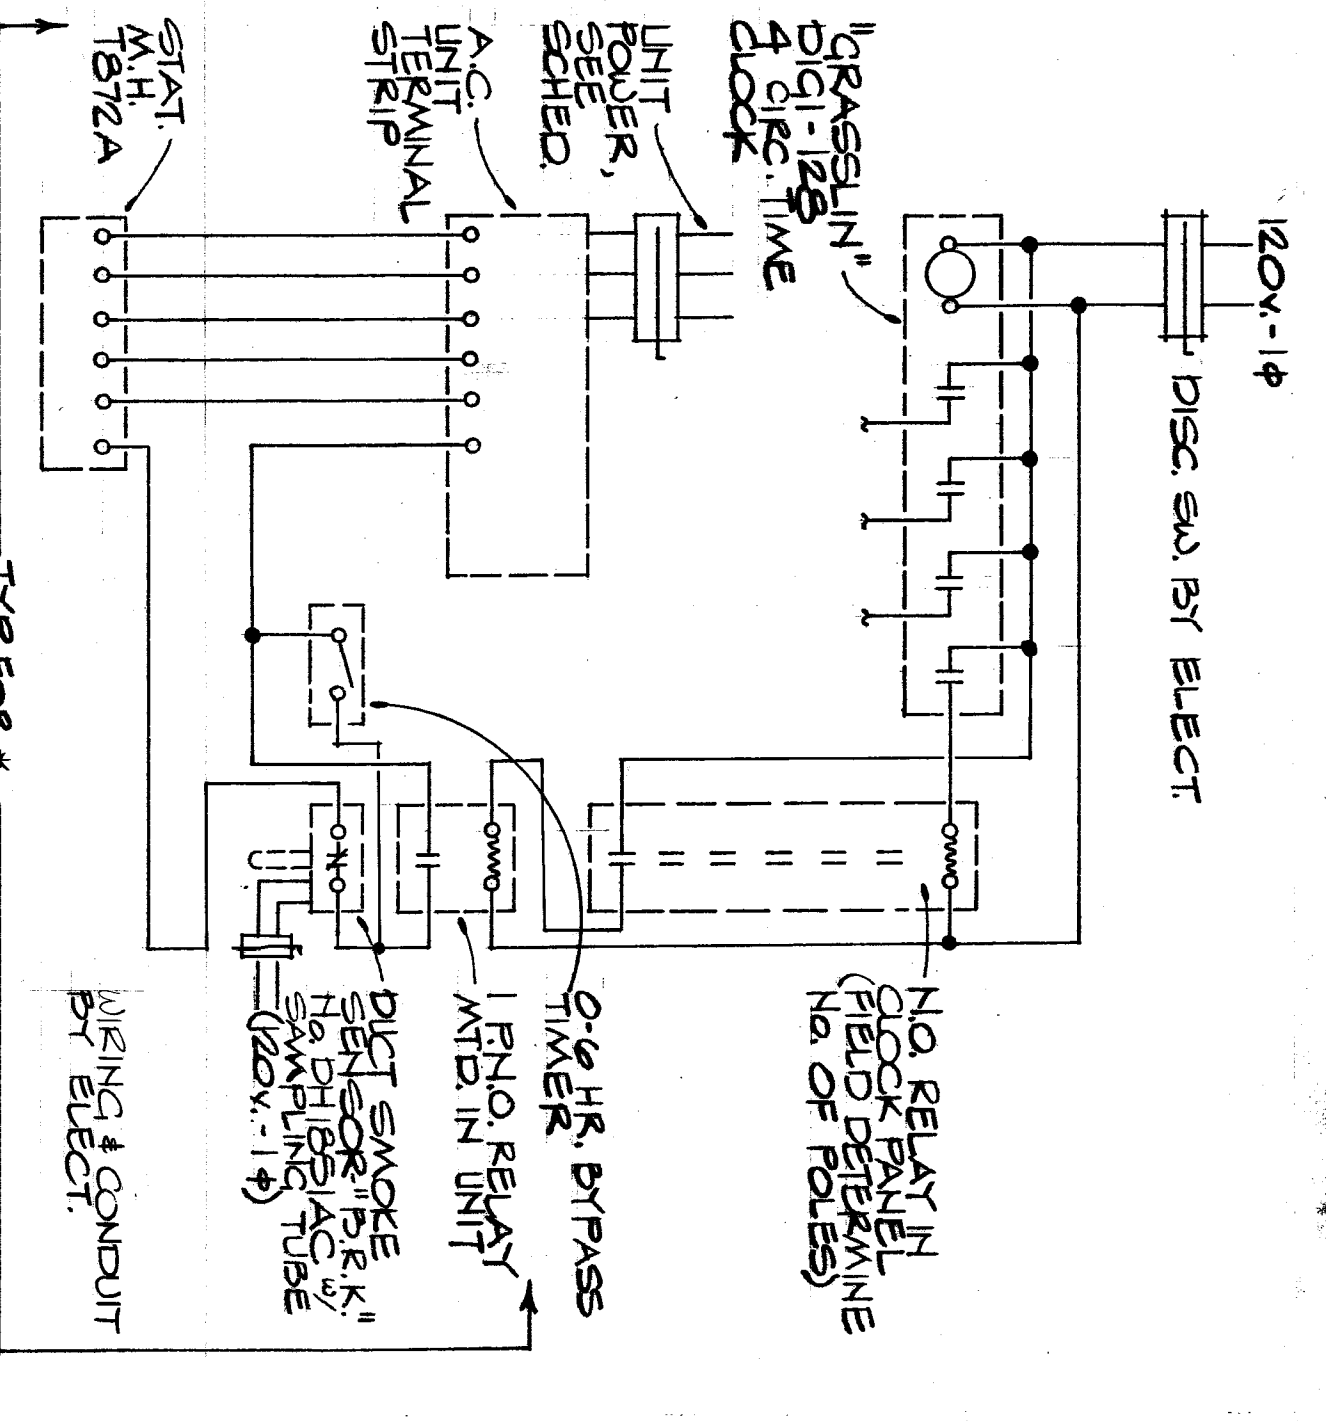


CONTROL DIAGRAM
DIAGRAM/NTS

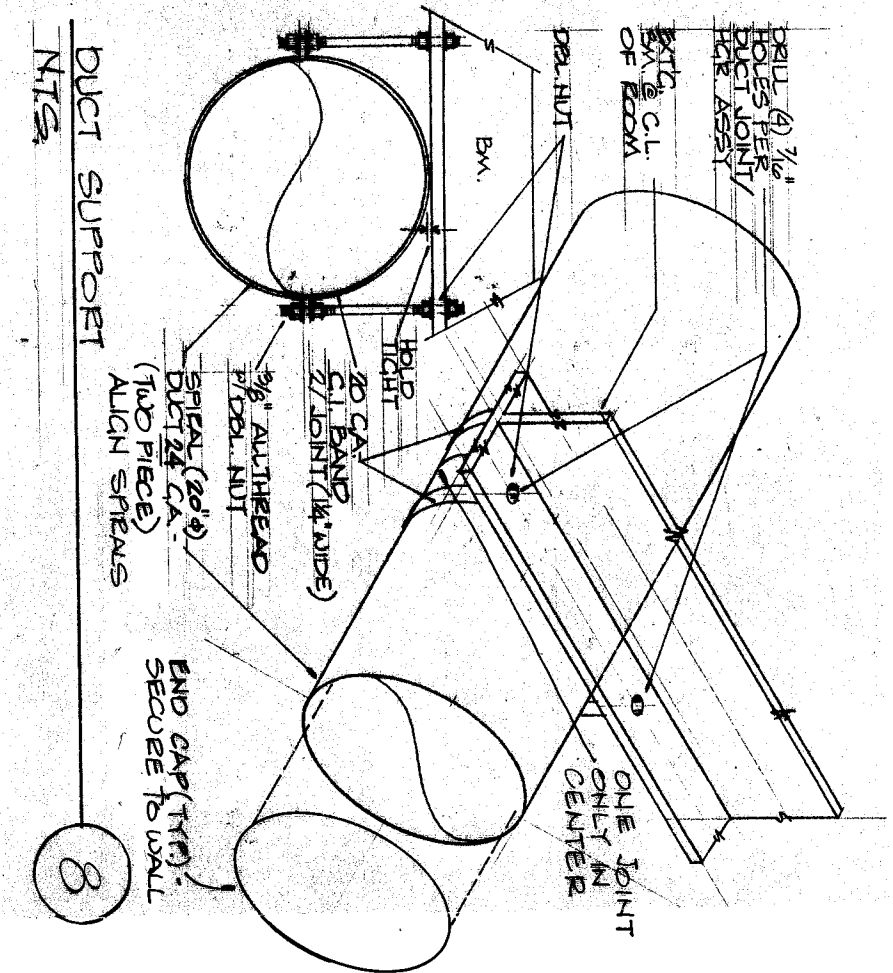

DUCT SUPPORT
NTS


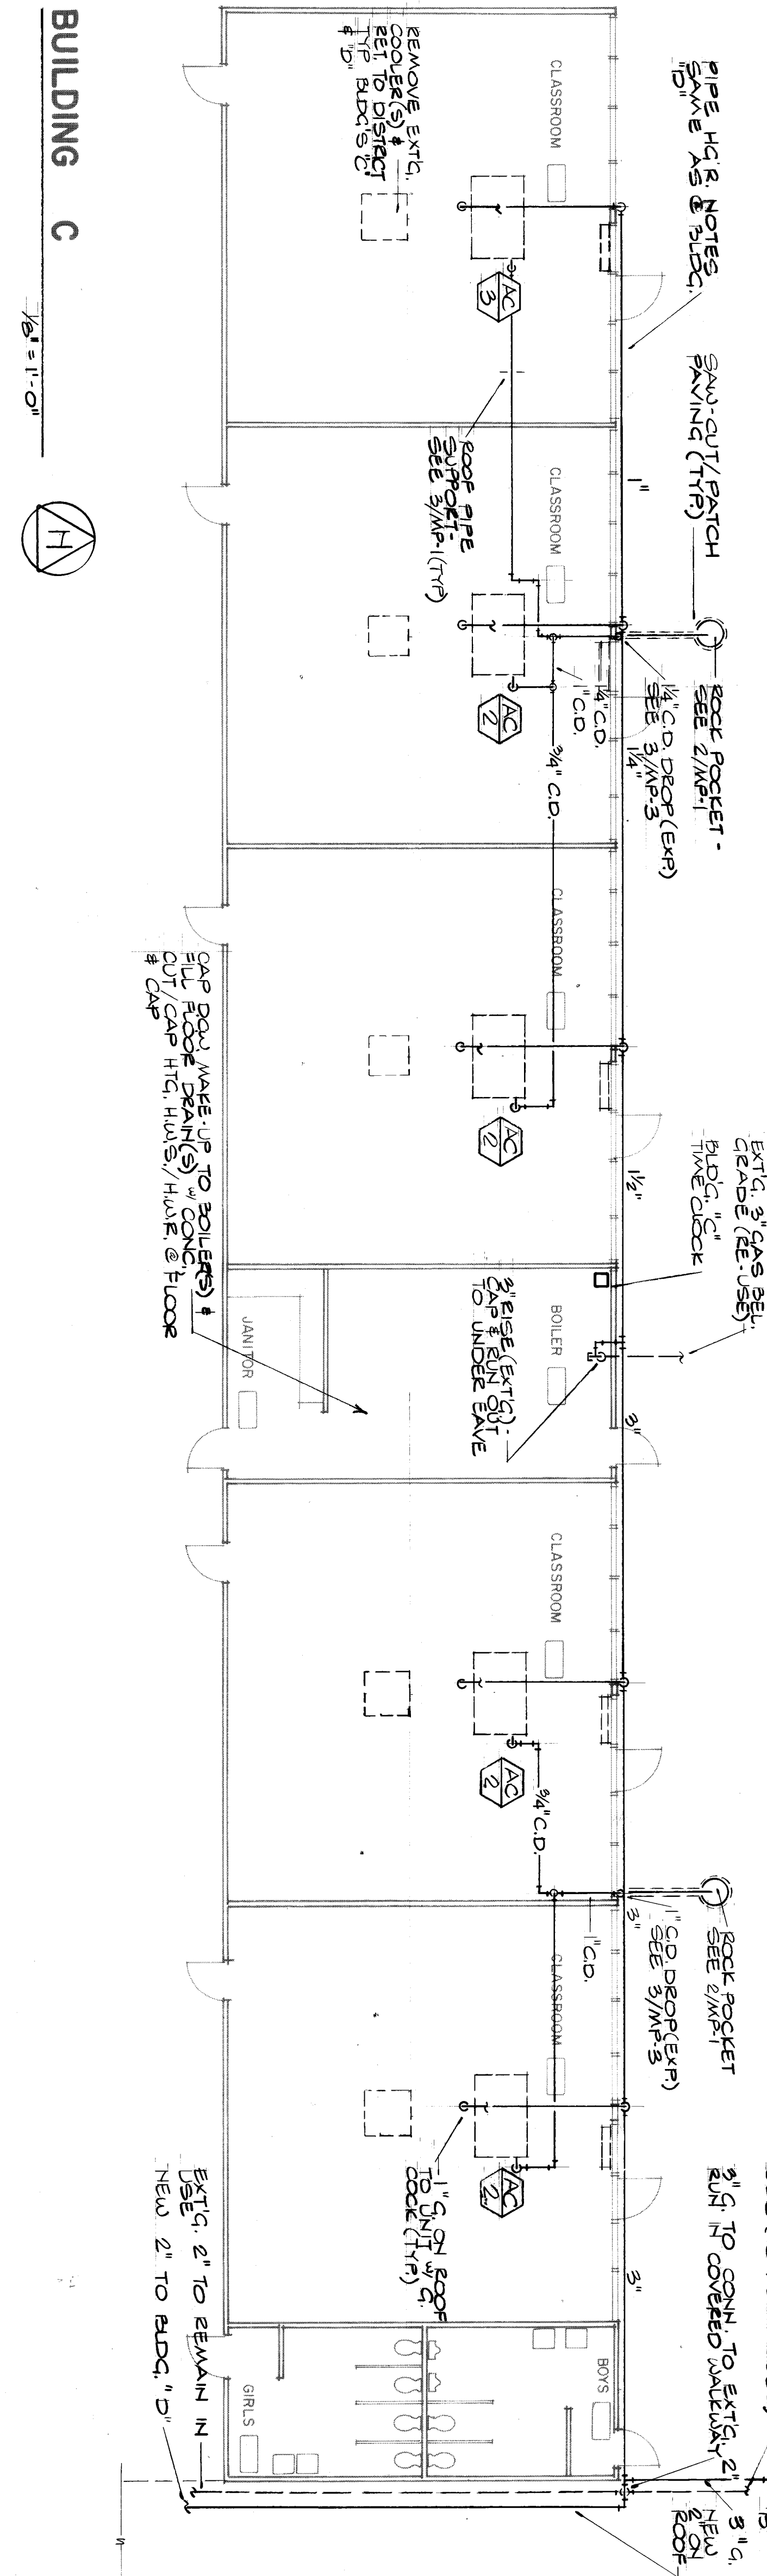


BUILDING C
1/8" = 1'-0"

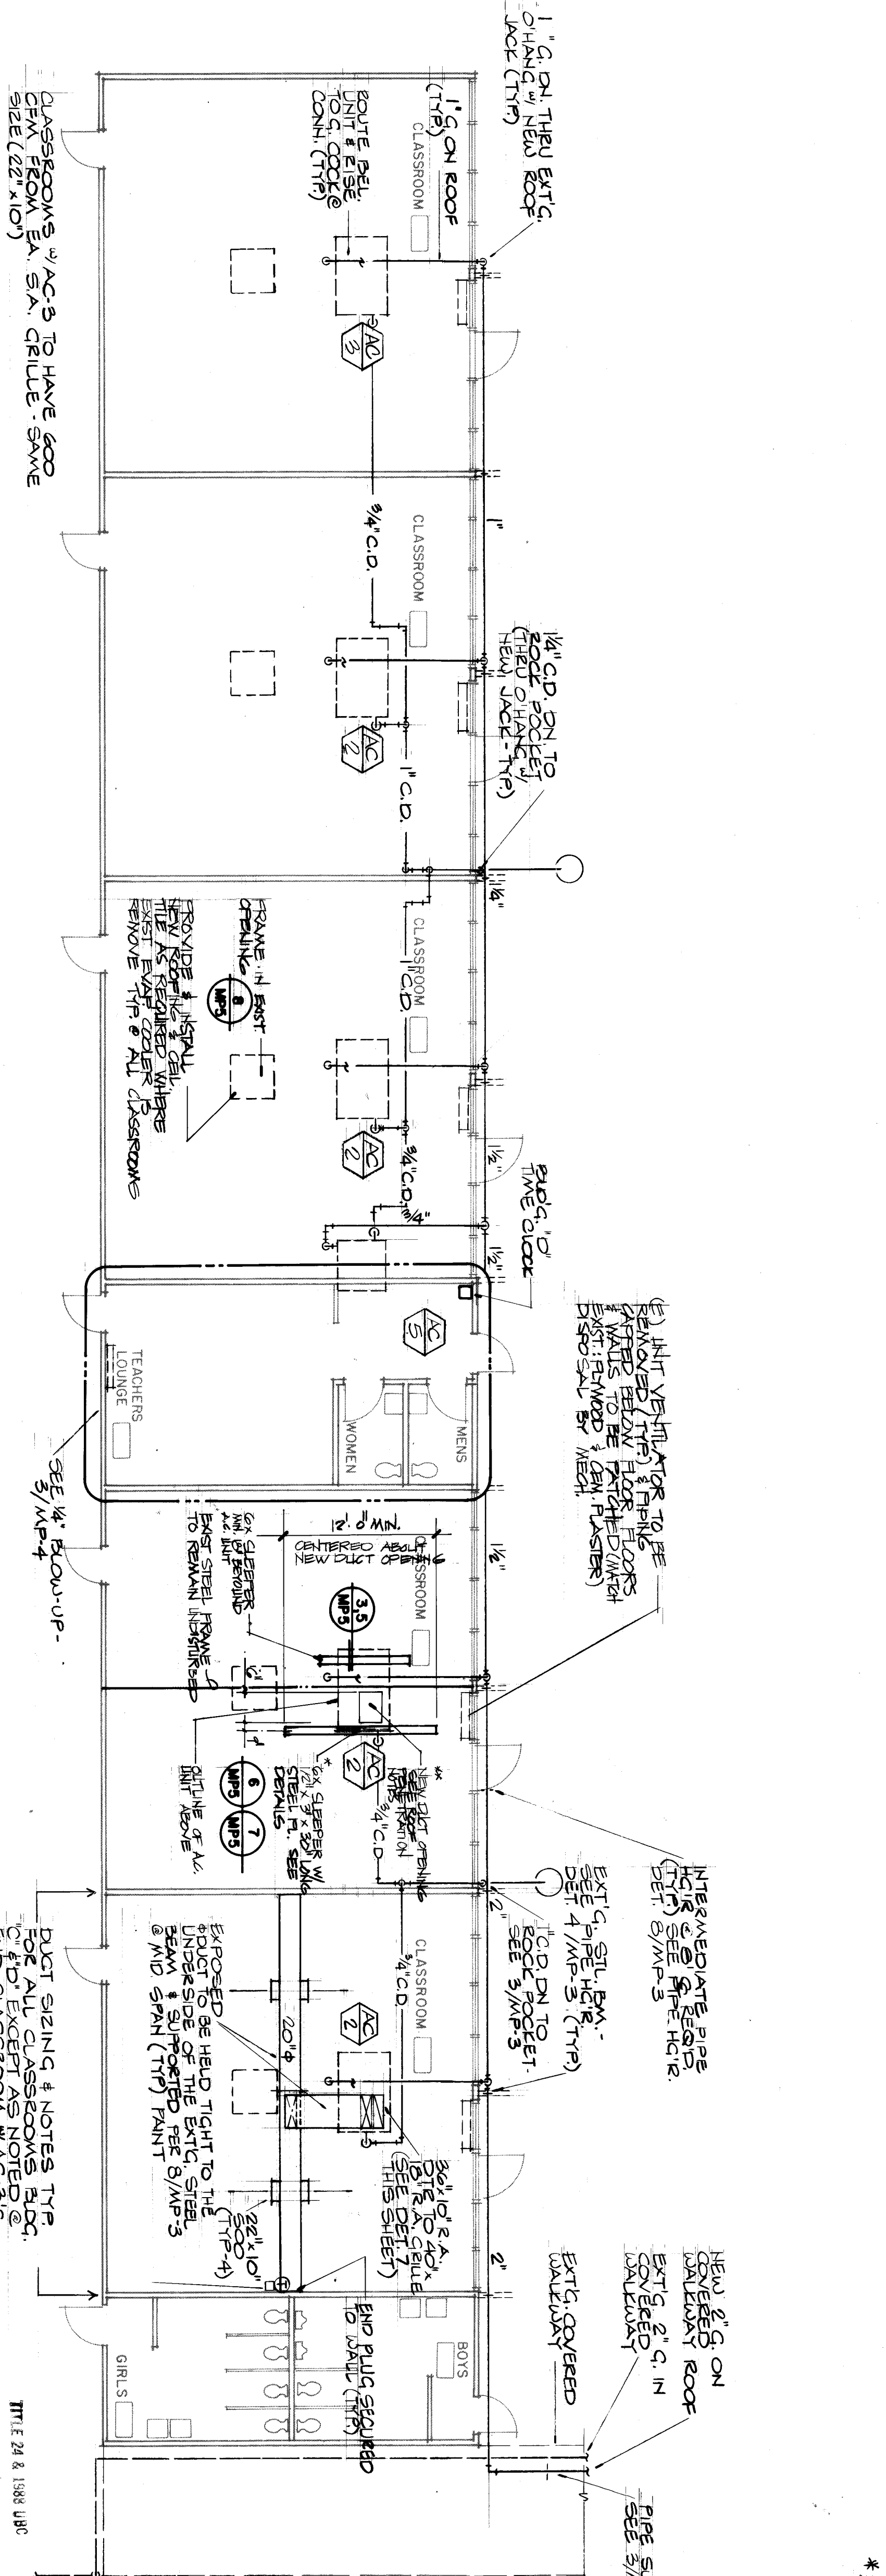


BUILDING D
1/8" = 1'-0"

NOTE 1:
* METAL STEEL TRIM & SHEETS
FRONT TO DITCH NEW DUCT OPENING (SEE DETAIL 8/MP3)
* NEW ROOF OPENING: 24" x 48" (MIN. DETAILS)
* ALL EXPOSED SURFACES SHALL BE PAINTED
* PAINTED TRIM (2 GATS)
* ALL EXPOSED WIRE MOLD SHALL BE PAINTED

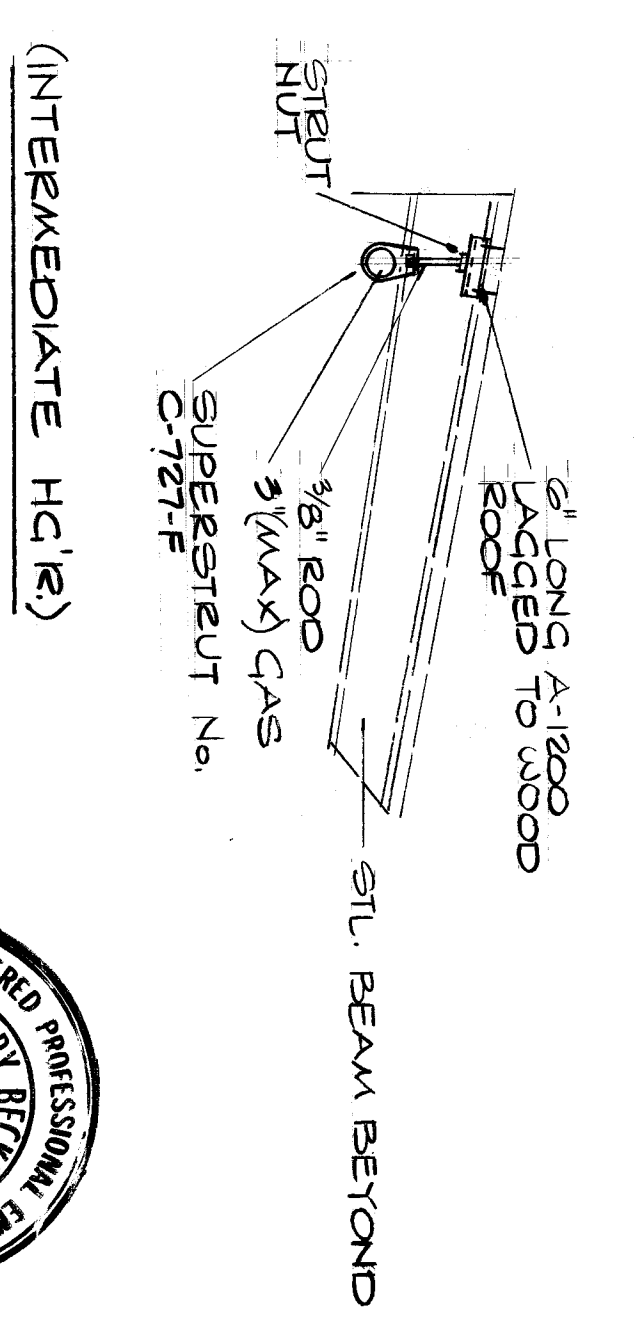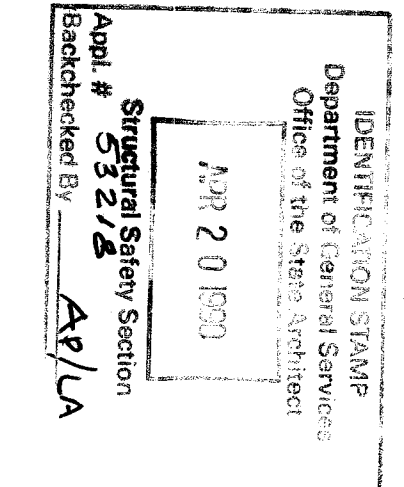

PIPE HANGER DET
NTS

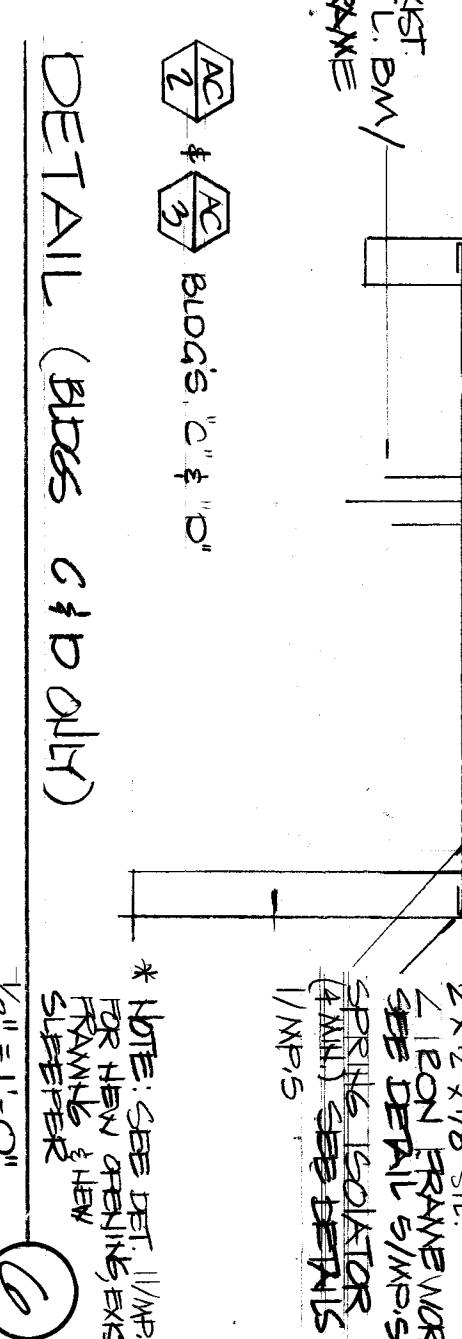

DETAIL (BLOCK 2 x 4)
1/2" = 1'-0"

FLOOR PLAN

1/8"

CONTRACTOR TO VERIFY ALL CONDITIONS AND DIMENSIONS AT THE SITE AND AS SHOWN ON THE DRAWINGS. REPORT ANY DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH ANY WORK.