

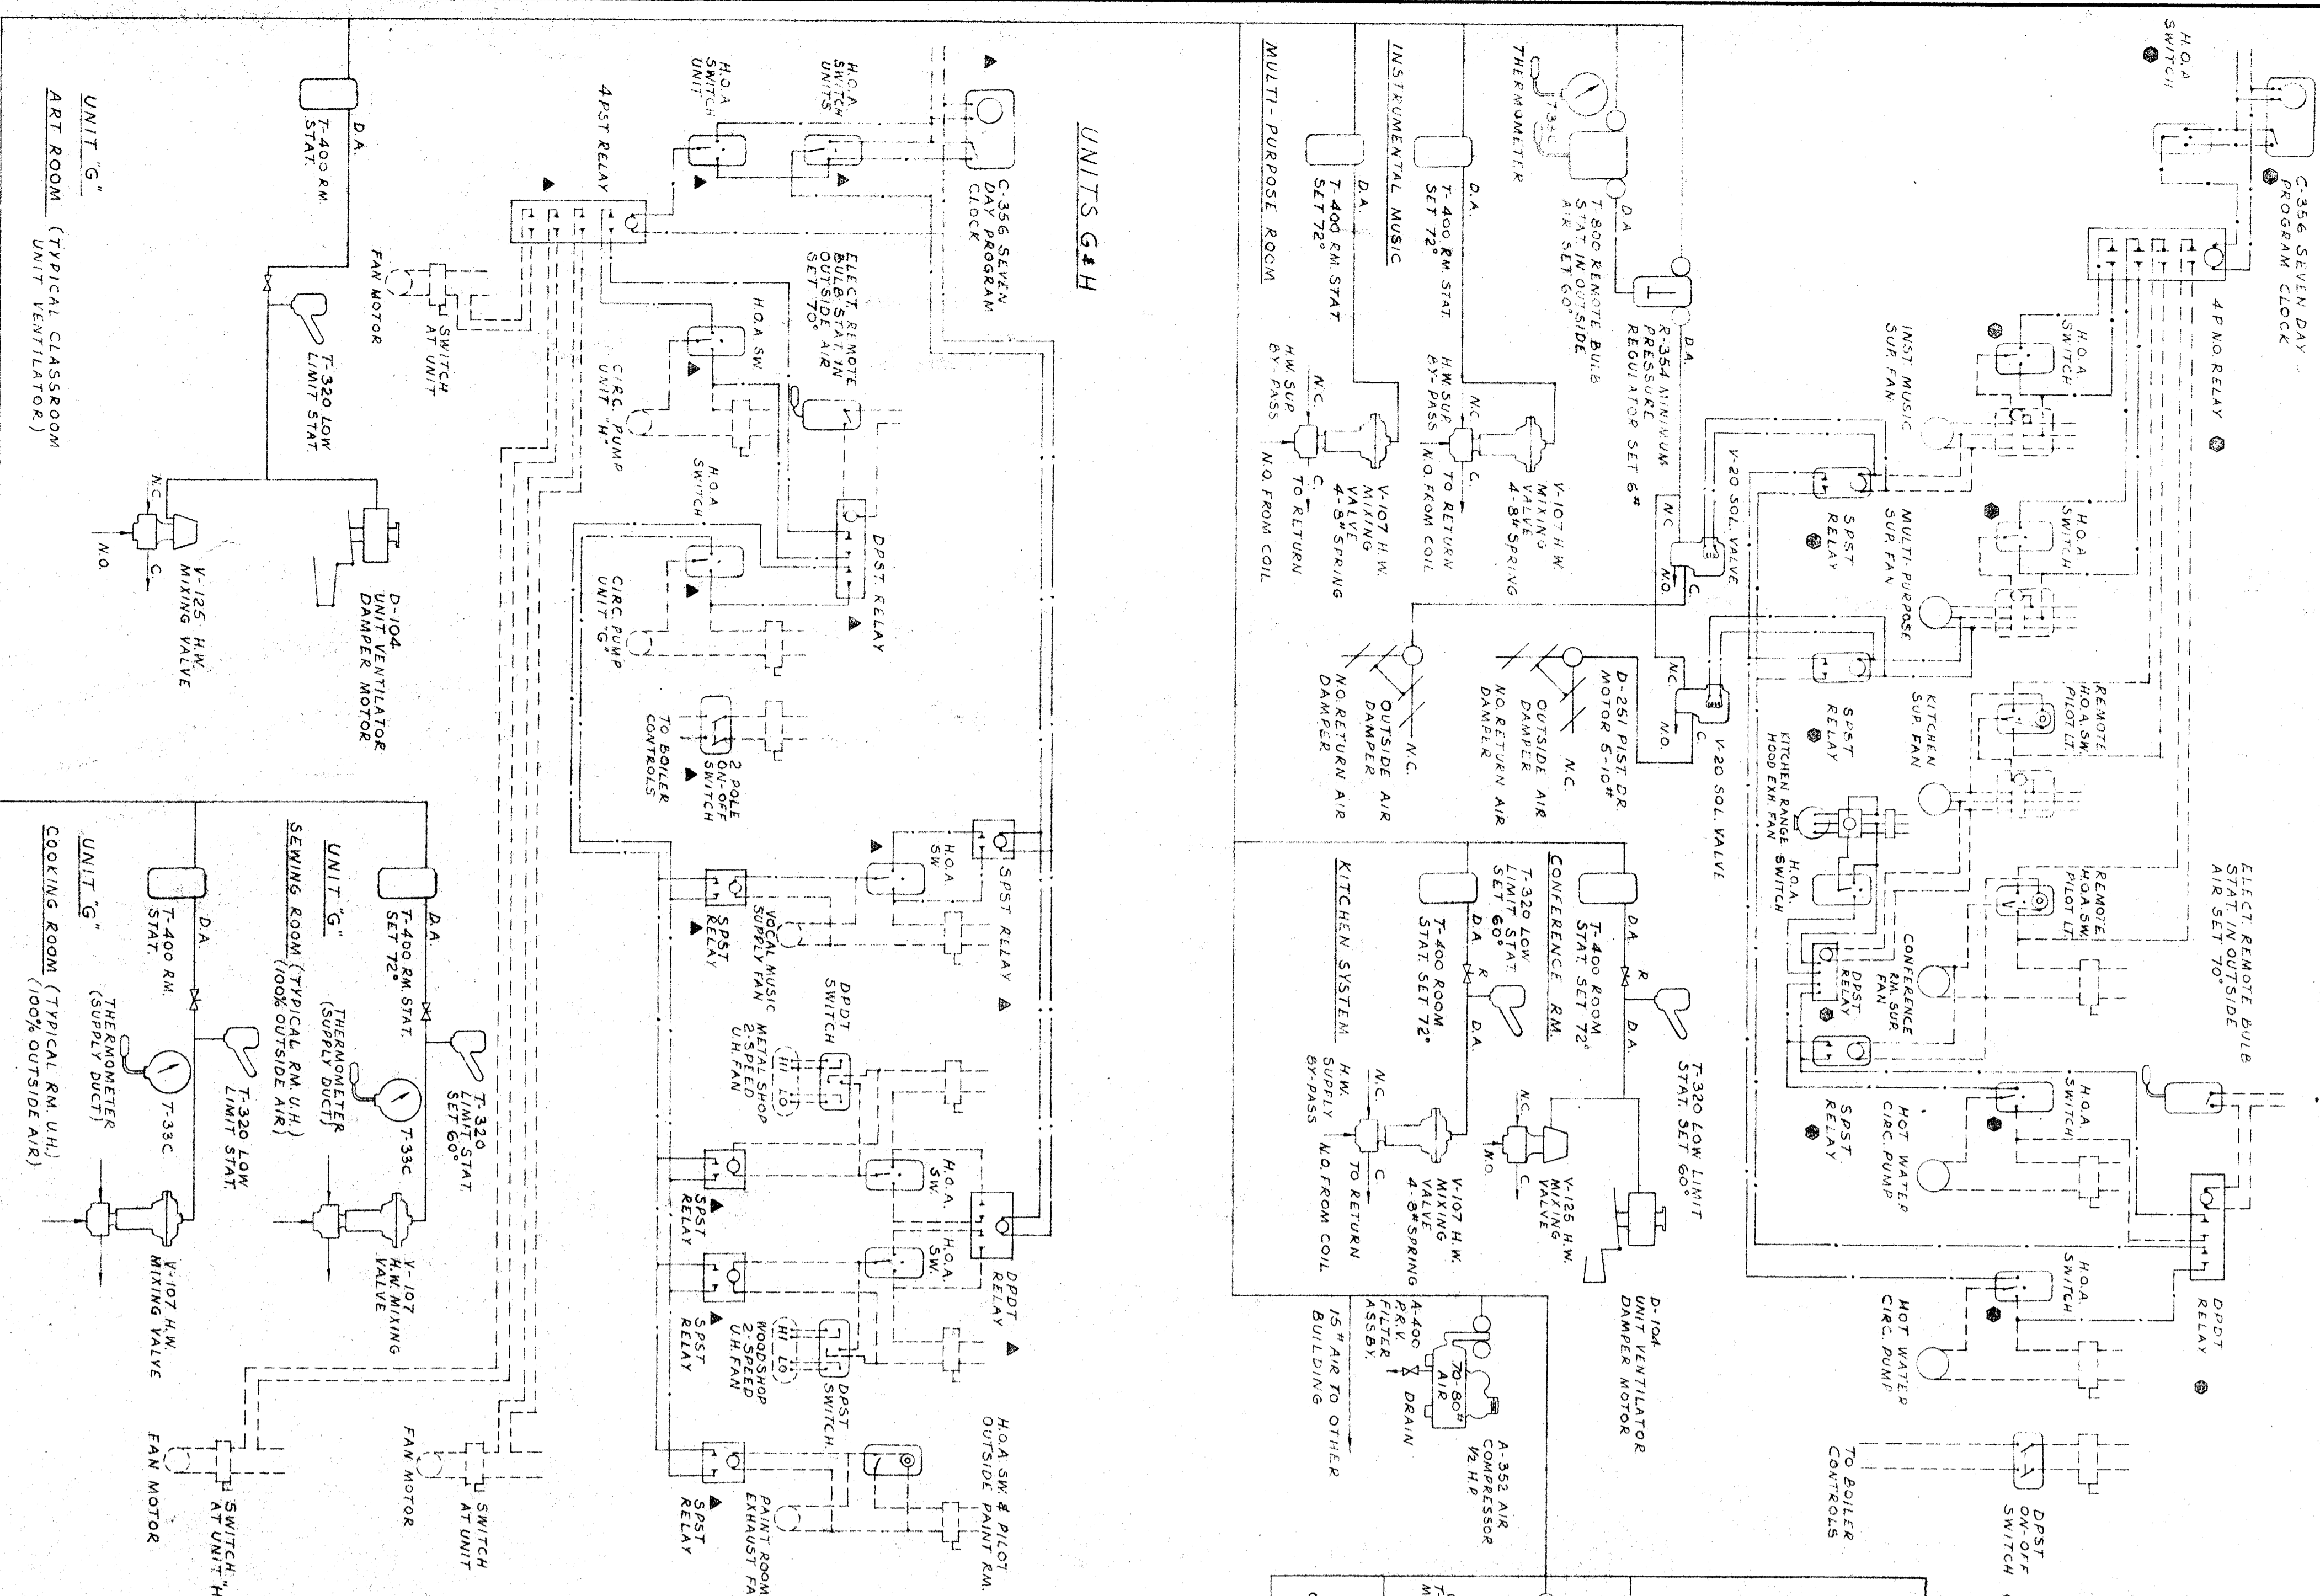


MULTI-PURPOSE BLDG UNIT F.

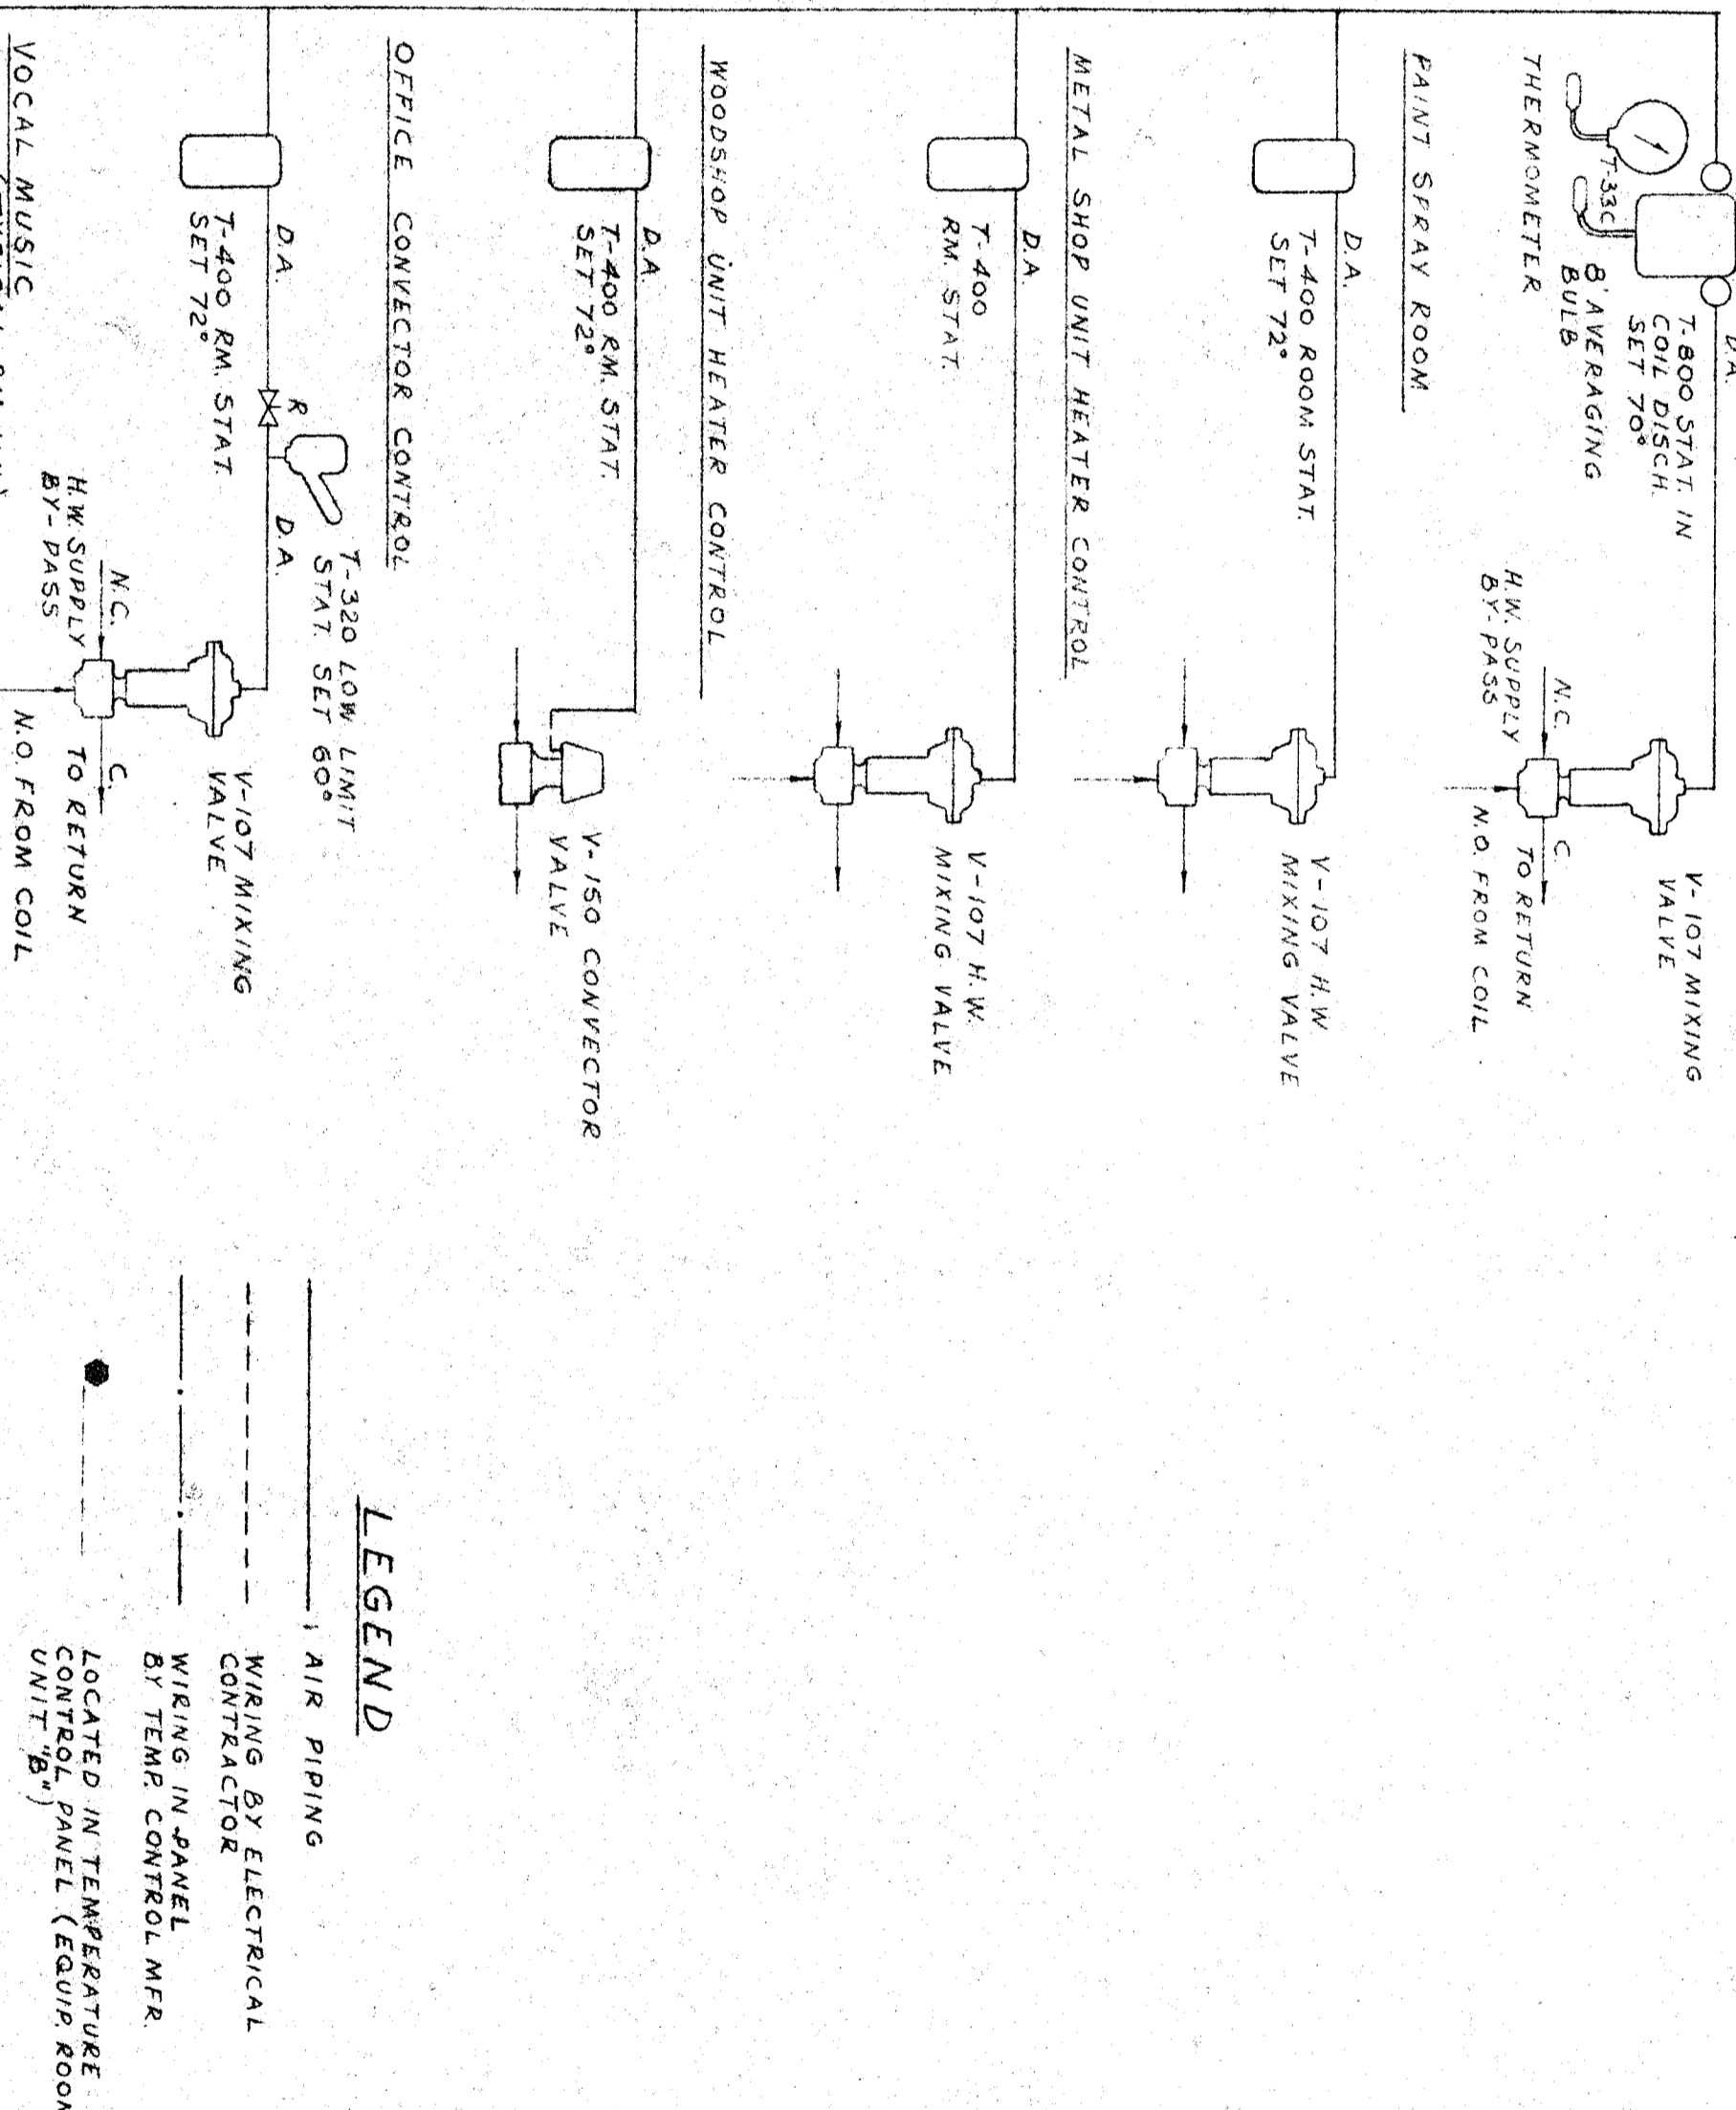

TYPICAL CLASSROOM BUILDING UNITS B, C, D & E.

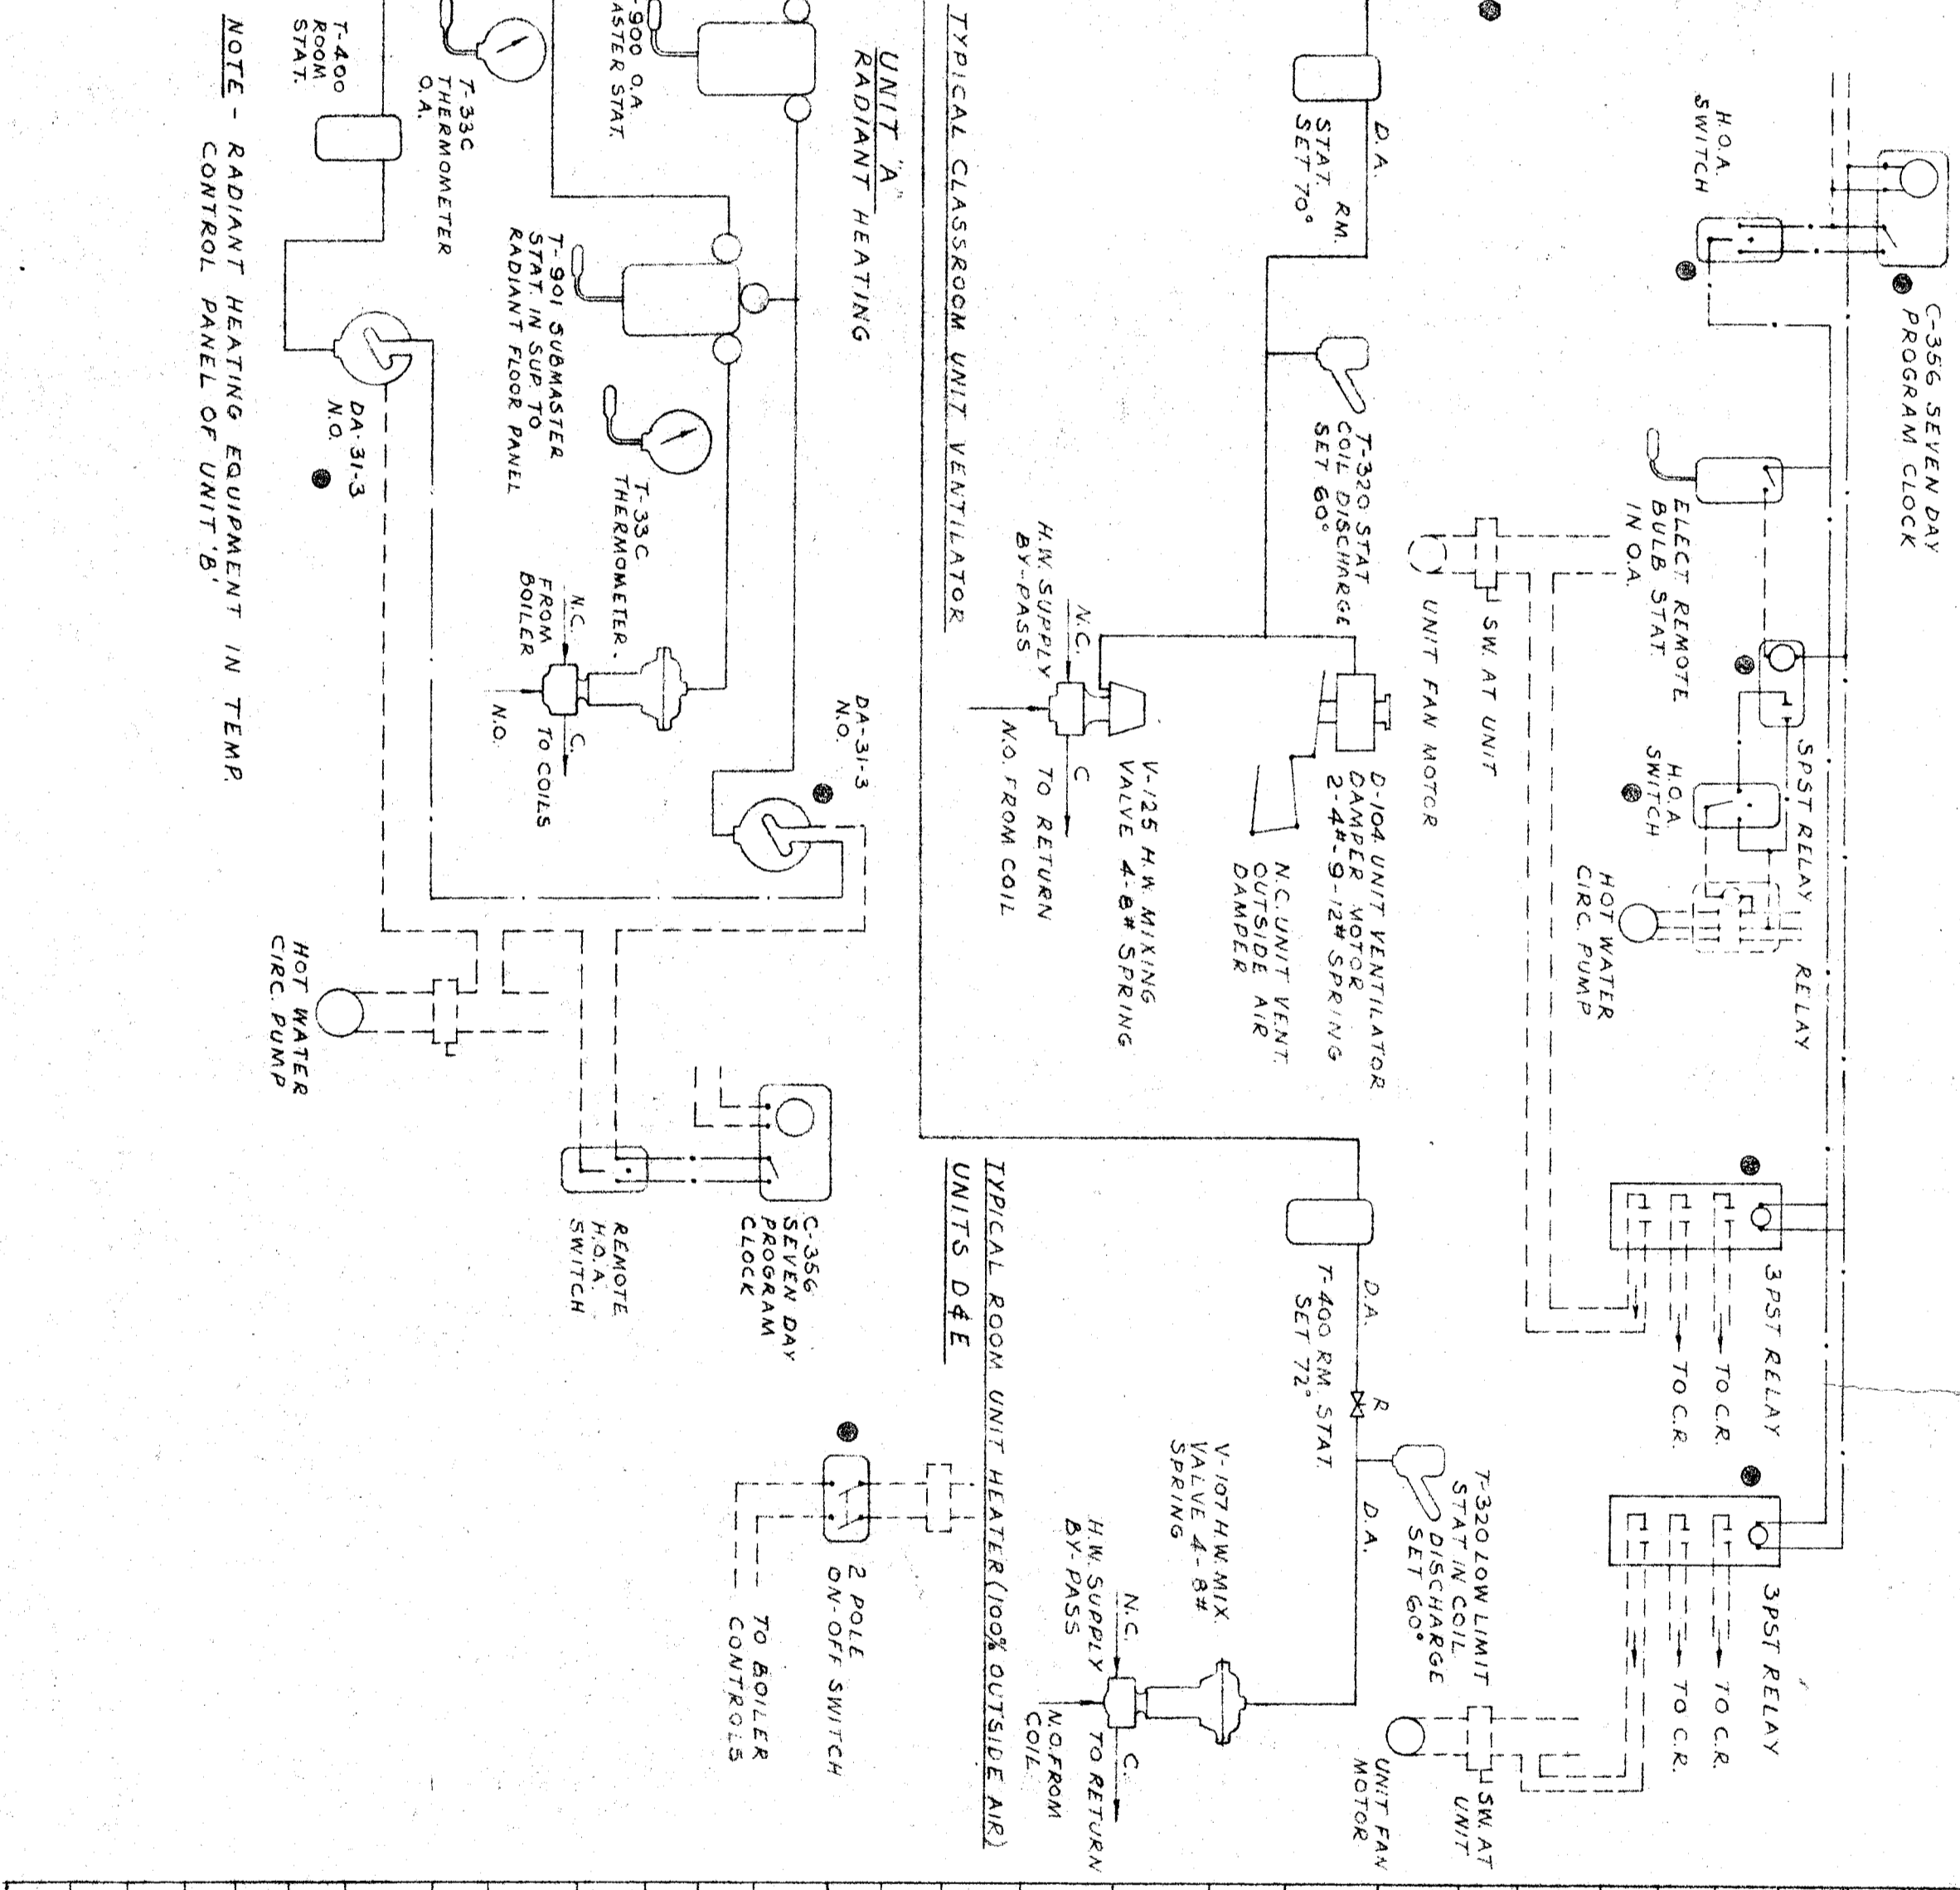

TEMPERATURE CONTROL SYSTEM

NOTE: JOHNSON SERVICE NUMBERS FOR REFERENCE ONLY

LEGEND

- AIR PIPING
- WIRING BY ELECTRICAL CONTRACTOR
- WIRING IN PANEL
- BY TERM. CONTROL MFR.
- LOCATED IN TEMPERATURE CONTROL PANEL (EQUIP ROOM UNIT B)
- LOCATED IN TEMPERATURE CONTROL PANEL (EQUIP ROOM UNIT F)
- LOCATED IN TEMPERATURE CONTROL PANEL OF TYPICAL CLASSROOM BUILDING UNITS B, C, D & E

EQUIPMENT SCHEDULE

| EQUIP NO | QUANTITY | NAME | LOCATION | H.P. | PHASE | DESIGN |
|----------|----------|--------------------------|--|------|-------|---------------------------------|
| 1 | 1 | RANGE EXHAUST FAN | KITCHEN UNIT F | 3/4 | 1 | 120 DIRECT |
| 2 | 1 | DISH WASHING EXHAUST FAN | KITCHEN UNIT F | 1/2 | 1 | 120 DIRECT |
| 3 | 1 | VERTICAL UNIT | KITCHEN UNIT F | 1/4 | 3 | 208 V-BLTD SETTLER COOLER MOTOR |
| 4 | 1 | VERTICAL UNIT | KITCHEN UNIT F | 1/4 | 3 | 208 V-BLTD SETTLER COOLER MOTOR |
| 5 | 3 | HORIZONTAL UNIT | KITCHEN UNIT F | 1/2 | 3 | 208 V-BLTD SETTLER COOLER MOTOR |
| 6 | 1 | HORIZONTAL UNIT | KITCHEN UNIT F | 1/2 | 1 | 208 V-BLTD SETTLER COOLER MOTOR |
| 7 | 4 | BOILER | MULTI-PURPOSE UNIT F | 3 | 3 | 208 V-BLTD SETTLER COOLER MOTOR |
| 8 | 1 | EXHAUST FAN | UNIT G | 1/2 | 1 | 120 DIRECT |
| 9 | 2 | UNIT HEATER | WOODSHOP UNIT G | 125 | 1 | 120 DIRECT |
| 10 | 19 | CLASSROOM UNIT | UNIT B (18) UNIT C (1) UNIT D (1) UNIT E (1) UNIT F (1) UNIT G (1) | 125 | 1 | 120 DIRECT |
| 11 | 4 | CLASSROOM UNIT | UNIT B (1) UNIT C (1) UNIT D (1) UNIT E (1) | 125 | 1 | 120 DIRECT |
| 12 | 1 | EXHAUST FAN | ROOM SPRAY UNIT G | 1/2 | 1 | 120 DIRECT |
| 13 | 1 | HEATING COIL | ROOM SPRAY UNIT G | 1/2 | 1 | 120 DIRECT |
| 14 | 1 | EXHAUST FAN | WOODSHOP UNIT G | 1/2 | 1 | 120 DIRECT |
| 15 | 1 | EXHAUST FAN | WOODSHOP UNIT G | 1/2 | 1 | 120 DIRECT |
| 16 | 1 | HORIZONTAL UNIT | COOKING UNIT H | 1 | 3 | 208 V-BLTD SETTLER COOLER MOTOR |
| 17 | 1 | UNIT VENTILATOR | UNIT H | 1/2 | 1 | 120 V-BLTD SETTLER COOLER MOTOR |
| 18 | 2 | BOILER | UNIT E (1) UNIT F (1) | 125 | 1 | 120 DIRECT |
| 19 | 1 | CLASSROOM UNIT | CONFERENCE UNIT F | 1/2 | 1 | 120 DIRECT |
| 20 | 1 | CIRCULATOR | UNIT H | 1/2 | 1 | 120 DIRECT |
| 21 | 7 | CIRCULATOR | UNIT B (1) UNIT C (1) UNIT D (1) UNIT E (1) UNIT F (1) UNIT G (1) | 1/2 | 1 | 120 DIRECT |
| 22 | 1 | CIRCULATOR | UNIT H | 1/2 | 1 | 120 DIRECT |
| 23 | 1 | PUMP | UNIT H | 1/2 | 1 | 120 DIRECT |
| 24 | 1 | REFRIG. COMPRESSOR | UNIT F | 1/2 | 1 | 120 DIRECT |
| 25 | 1 | EVAPORATOR | UNIT F | 1/2 | 1 | 120 DIRECT |
| 26 | 7 | CONNECTOR | UNIT G | 1/2 | 1 | 120 DIRECT |

NOTE: 24" X 12" DOOR LOWER ARCHITECTURAL DENOTES BOTTOM & TOP & BOTTOM LOUVERS

CHECK AND VERIFY ALL DIMENSIONS AND CONDITIONS AT JOB SITE BEFORE PROCEEDING WITH THE WORK. REPORT ANY DISCREPANCIES TO THE ARCHITECT.

DRAWN BY: *[Signature]* DATE: 5/5/54
 CHECKED BY: *[Signature]* DATE: 5/5/54
 APPROVED BY: *[Signature]* DATE: 5/5/54
 OFFICE OF SUPERINTENDENT OF SCHOOLS, DEPARTMENT OF PUBLIC WORKS, DIVISION OF ARCHITECTURE
 BAKERSFIELD CITY SCHOOLS, 1600 "K" STREET, BAKERSFIELD, CALIFORNIA
 WASHINGTON JR. HIGH SCHOOL, DISTRICT BAKERSFIELD, CALIFORNIA
 SHEET NO. H-7