



ELECTRICAL NOTES (THIS SHEET ONLY)

- 1 REMOVE AND REPLACE EXISTING BUS ASSEMBLY AND CIRCUIT BREAKERS WITH NEW PER PANEL REPLACEMENT SCHEDULE ON SHEET N17.
- 2 REMOVE EXISTING FLUSH MOUNTED 1-BAY FIXTURES. RE-USE EXISTING NEW UNMOUNTED LIGHTING CIRCUIT FOR NEW LIGHT FIXTURES. PULL OUT ANY TIE WIRE.
- 3 REMOVE EXISTING FIXTURE. REPLACE WITH NEW TYPE "D". EXISTING FIXTURE TO REMAIN. CLEAN AND REPAIR.
- 4 MOTION SENSOR SWITCHBACK UNIT IN ACCESSIBLE ATTIC SPACE. CONNECT TO ONE EXISTING 150V UNMOUNTED LIGHTING DETAIL #1411. REFER TO MOTION SENSOR WIRING DIAGRAM, DETAIL #1411.
- 5 MOTION SENSOR AT CEILING TO CONTROL LIGHT FIXTURES. NEW LIGHTING CONTROL AND OUTPUT MODULES, TWO OF EACH, ONE PAIR FOR "A" SWITCHED FIXTURES AND ONE PAIR FOR "C" DIMMED. MOUNT ATTACHED MODULES ON WALLS 6" BELOW CEILING TO TOP OF CONTROL MODULE. EXPOSED CONDUIT SHALL BE PERMITTED FROM MODULES TO ATTIC. GASKET AROUND MODULES TO PREVENT AIR INTRUSION. REFER TO NEW LIGHTING WIRING DIAGRAM, DETAIL #1411.
- 6 DISCONNECT EXISTING EMERGENCY COOLER OR ROOF BEING REMOVED. REMOVE AND RECONNECT ANY FEED-THRU CIRCUITS. PULL OUT ANY TIE WIRE. CAP OFF EXISTING CONDUIT. RE-CONNECT EXISTING CONDUIT FOR NEW LIGHTING RECEPTACLES AND UNIT VENTILATION.
- 7 DISCONNECT EXISTING FLOOR MOUNTED RECEPTACLES. REMOVE EXISTING FLOOR MOUNTED RECEPTACLES AND FEED-THRU CIRCUITS. PULL OUT ANY TIE WIRE.
- 8 PROVIDE EXTENSION ADAPTER AT EXISTING DUPLEX RECEPTACLE COMPATIBLE WITH SURFACE RECEPTACLE. RELOCATE EXISTING DUPLEX RECEPTACLE TO ADAPTER AND RECONNECT. PAINT TO MATCH ADJACENT SURFACE OR AS DIRECTED BY ARCHITECT.
- 9 REMOVE EXISTING SURFACE RECEPTACLE. PROVIDE SURFACE RECEPTACLE COMPATIBLE RECEPTACLE BOX FOR NEW DUPLEX RECEPTACLE.
- 10 REMOVE EXISTING SWITCHES AND REPLACE WITH THREE NEW TOGGLE SWITCHES AND ONE NEW KEY SWITCH. REPLACE EXISTING SURFACE RECEPTACLE WITH NEW TYPE "D" RECEPTACLE. PULL OUT TIE WIRE.
- 11 DISCONNECT EXISTING EMERGENCY COOLER OR ROOF BEING REMOVED. REMOVE AND RECONNECT ANY FEED-THRU CIRCUITS. PULL OUT ANY TIE WIRE. CAP OFF EXISTING CONDUIT. RE-CONNECT EXISTING CONDUIT FOR NEW LIGHTING RECEPTACLES AND UNIT VENTILATION.
- 12 DISCONNECT EXISTING FLOOR MOUNTED RECEPTACLES. REMOVE EXISTING FLOOR MOUNTED RECEPTACLES AND FEED-THRU CIRCUITS. PULL OUT ANY TIE WIRE.
- 13 PROVIDE EXTENSION ADAPTER AT EXISTING DUPLEX RECEPTACLE COMPATIBLE WITH SURFACE RECEPTACLE. RELOCATE EXISTING DUPLEX RECEPTACLE TO ADAPTER AND RECONNECT. PAINT TO MATCH ADJACENT SURFACE OR AS DIRECTED BY ARCHITECT.
- 14 REMOVE EXISTING SURFACE RECEPTACLE. PROVIDE SURFACE RECEPTACLE COMPATIBLE RECEPTACLE BOX FOR NEW DUPLEX RECEPTACLE.
- 15 RUN SURFACE RECEPTACLE WIREBOND 1/2" OR EQUAL UP EXISTING ATTIC SPACE. CONTRACTOR SHALL VERIFY EXACT LOCATION AT LOCATION AT SITE. (ABANDONED COOLER CIRCUIT).
- 16 REMOVE EXISTING FIRE ALARM HOSTER, RECTIFIER AND TROUBLE INDICATOR AND REPLACE WITH NEW FIRE ALARM MASTER PANEL. PROVIDE NEW CONDUIT AND WIRE AS REQUIRED TO RECONNECT EXISTING AND/OR NEW FIRE ALARM INITIATING CIRCUITS AND CONSULTING CONSOLE.
- 17 REMOVE EXISTING FIRE ALARM PULL STATION. PULL OUT TIE WIRE AND BLANK OFF BOX.
- 18 REPLACE EXISTING KEY SWITCH WITH NEW KEY SWITCH.

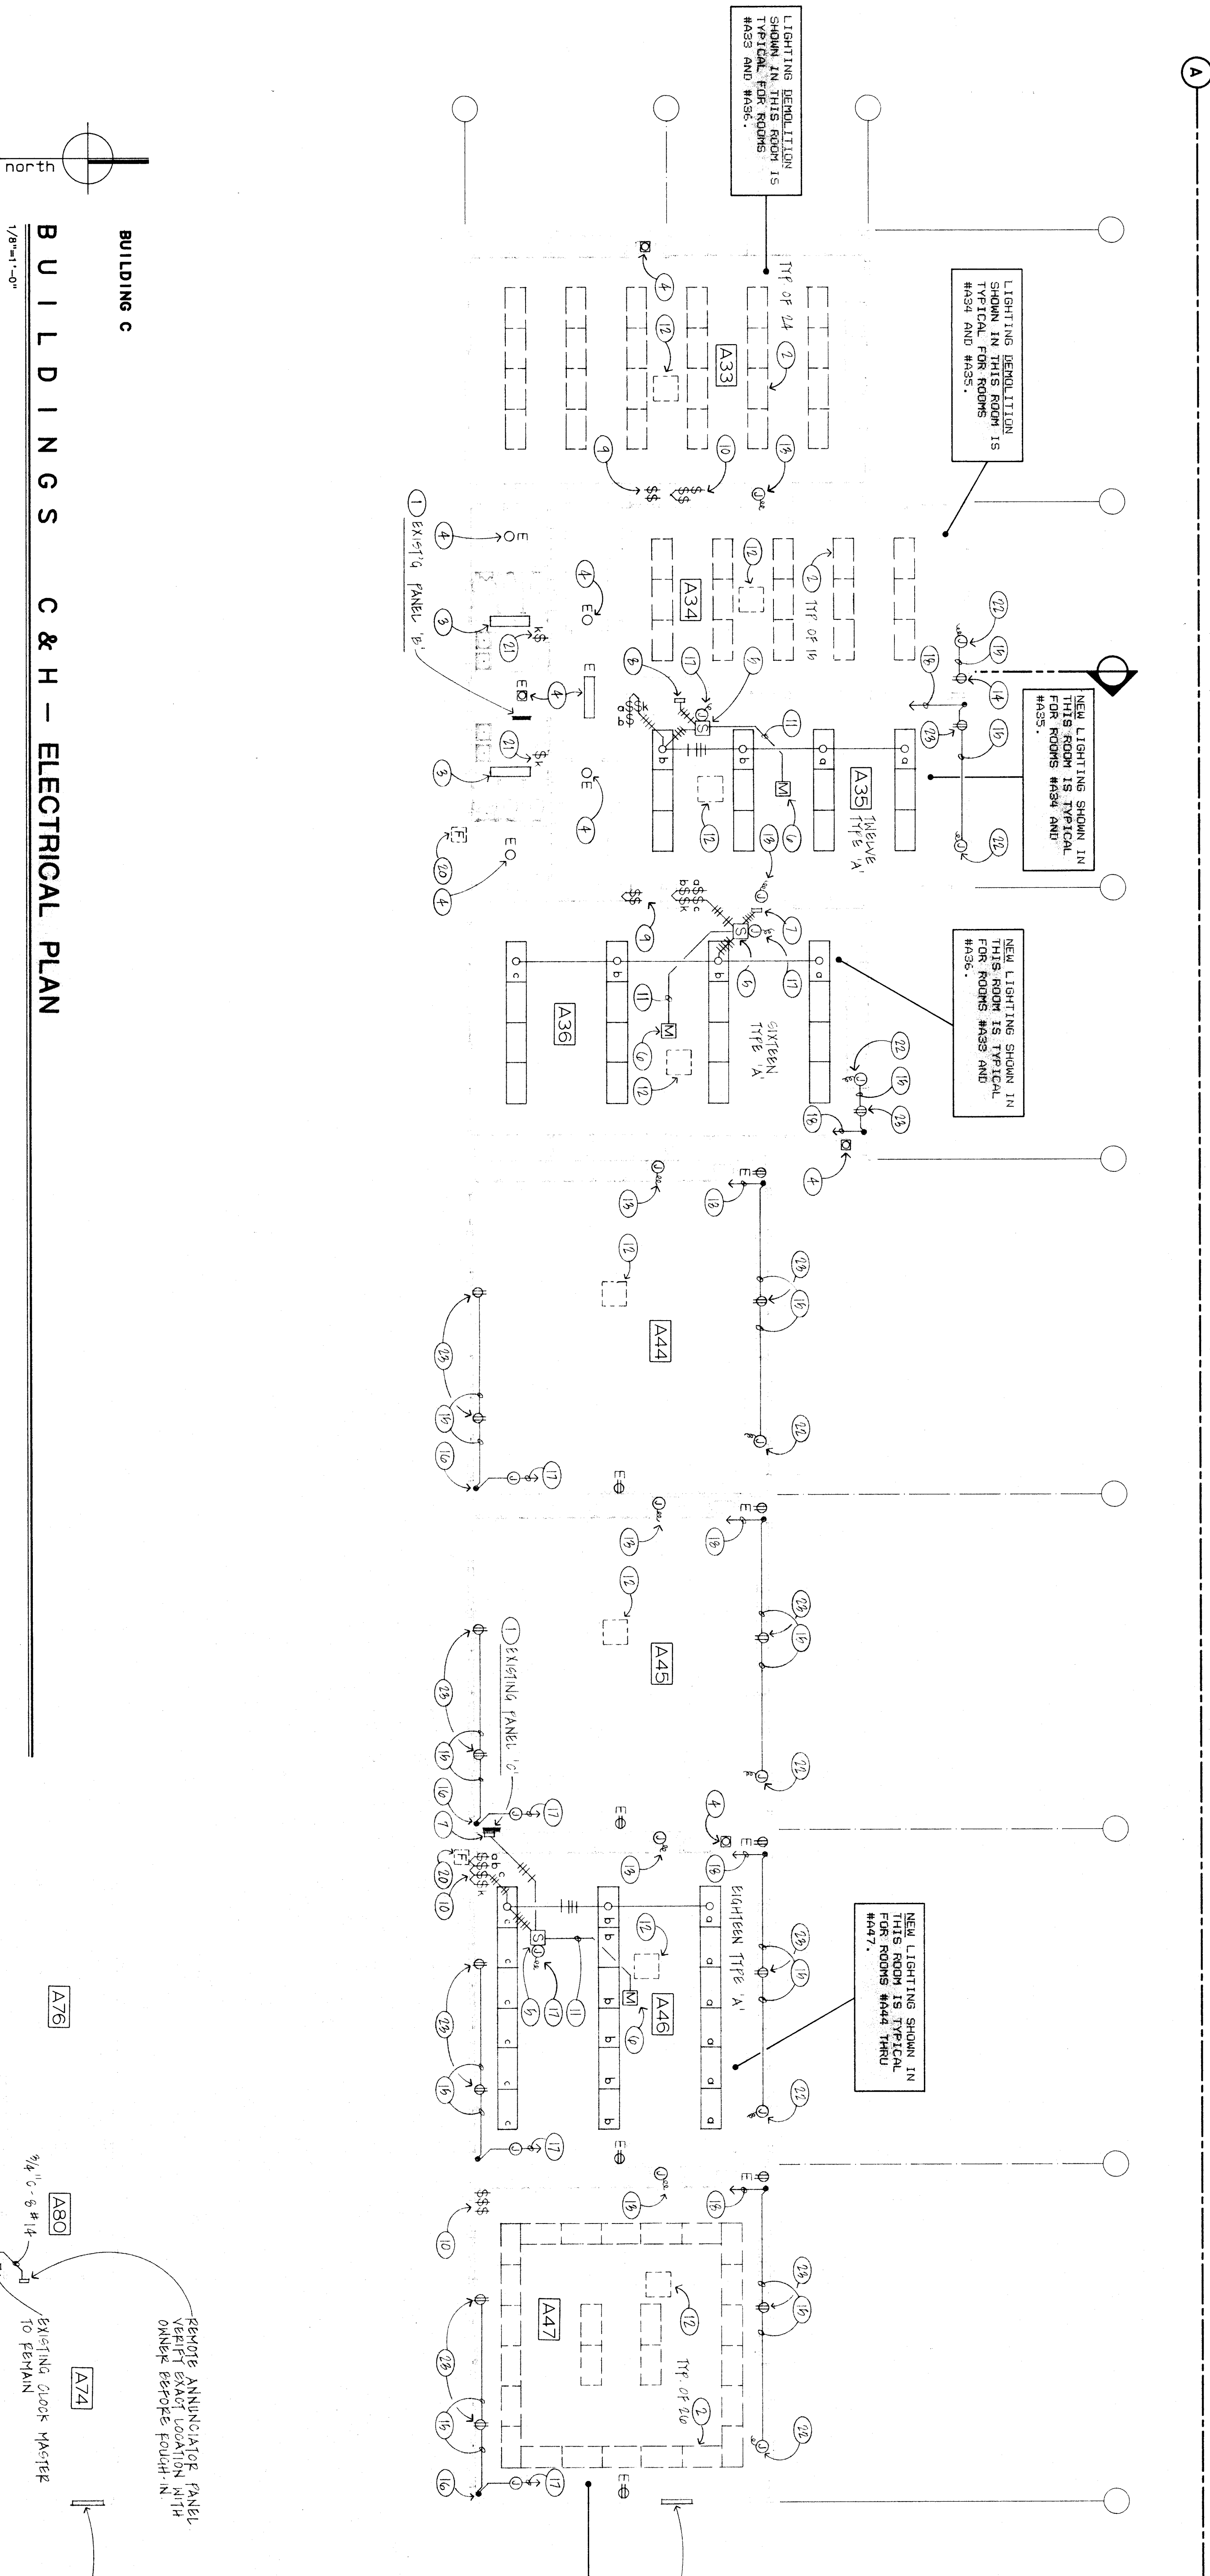

REFER TO METAL HAZARD FOR ADDITIONAL WORK IN BUILDINGS C & H CONTRACT WITH THE BAKERSFIELD CITY SCHOOL DISTRICT.

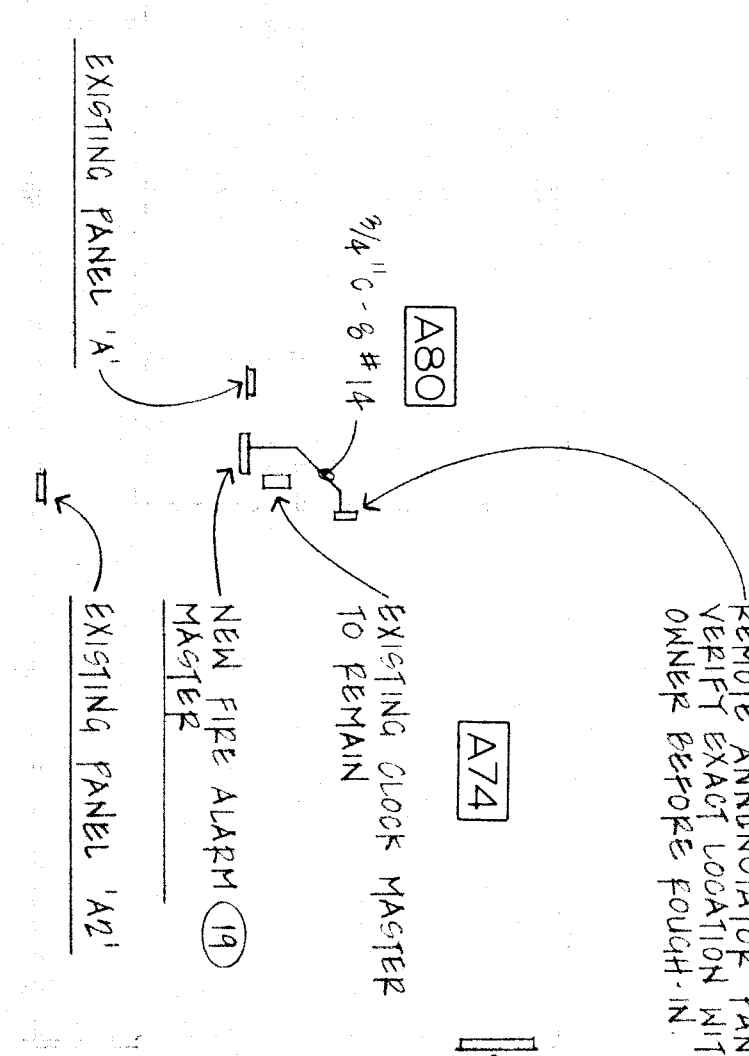

IDENTIFICATION STAMP Department of General Services Office of the State Architect State of California Stamp No. 7891 Date: 12/12/14	
DATE: 12/12/14 DRAWN BY: [Signature] CHECKED BY: [Signature]	DATE: DEC 7 1990 DRAWN BY: [Signature]

DATE: 12/12/14 DRAWN BY: [Signature]	DATE: 12/12/14 DRAWN BY: [Signature]
---	---

DATE: 12/12/14 DRAWN BY: [Signature]	DATE: 12/12/14 DRAWN BY: [Signature]
---	---

**BAKERSFIELD CITY SCHOOL DISTRICT**  
**WAYSIDE ELEMENTARY SCHOOL MODERNIZATION**  
**BAKERSFIELD, CALIFORNIA**

Sheet No: **BUILDINGS C & H**  
**ELECTRICAL PLAN**

WAYSIDE ELEMENTARY SCHOOL  
 BAKERSFIELD CITY SCHOOL DISTRICT  
 1800 MINS AVENUE

**KLASSEN CORPORATION**  
 Construction  
 2021 Westwind Drive  
 Bakersfield, CA 93301  
 (805) 827-0875