PLUMBING FIXTURE AND EQUIPMENT SCHEDULE (CONTINUED)						
		CONNECTION SIZES				
MARK	FIXTURE	S OR W	V.	C.W.	H.W.	DESCRIPTION
FD-1	FLOOR DRAIN	2"	1-1/2"	-	-	JAY R. SMITH #2005-B, W/5" SQUARE NICKEL BRONZE STRAINER. PROVIDE TRAP PRIMER CONNECTION WHEN APPLICABLE.
HB-1	HOSE BIBB	-	-	3/4"	-	WOODFORD #24P POLISHED CHROME WALL HOSE VALVE WITH LOCKSHIELD, VACUUM BREAKER, AND REMOVABLE TEE KEY.
HB-2	HOSE BIBB	-	-	3/4"	-	WOODFORD #24P ROUGH BRONZE WALL HOSE VALVE WITH LOCKSHIELD, VACUUM BREAKER, AND REMOVABLE TEE KEY.
FS-1	FLOOR SINK	-	-	-	-	JAY R. SMITH #3100-12C, 8-1/2" X 8-1/2" WITH FLASHING CLAMP AND WITH NICKEL BRONZE RIM AND HALF GRATE. SEE PLAN FOR SIZE. INSTALL FLUSH WITH FINISHED FLOOR. PROVIDE TRAP PRIMER CONNECTION WHEN APPLICABLE.
TP-1	TRAP PRIMER	-	-	1/2"	-	PRECISION PLUMBING PRODUCTS MODEL #P-1 VALVE WITH DISTRIBUTION UNITS AS REQUIRED FOR UP TO 4 DRAINS.
BP-1	BACKFLOW PREVENTER	-	-	3/4"	-	FEBCO #825Y-BV-AGD 3/4" REDUCED PRESSURE BACKFLOW PREVENTER ASSEMBLY WITH AIR GAP DRAIN PAN. PIPE A 1" DRAIN LINE FROM DRAIN PAN TO NEAREST RECEPTACLE.

NOTE !! INSULATE HOT WATER & DRAIN PIPES WHERE EXPOSED UNDER HANDICAP CLASSROOM SINKS (1/A7)

PLUMBING FIXTURE AND EQUIPMENT SCHEDULE						
		CONNECTION SIZES				
MARK	FIXTURE	S OR W	V.	C.W.	H.W.	DESCRIPTION
WC-1	WATER CLOSET	4"	2"	1/2"	-	AMERICAN STANDARD ELONGATED "WATER-SAVER CADET" #2812.053 WITH OLSONITE #95CC/SS OPEN FRONT SEAT.
WC-2	WATER CLOSET	4"	2"	1"	-	AMERICAN STANDARD ELONGATED "TRIBOR" #2342.012 WITH SLOAN "ROYAL" #110-3 FLUSH VALVE AND OLSONITE #L-210CC/SS, 2" HIGH LIFT SEAT. ORIENTATE FLUSH VALVE HANDLE TOWARDS WIDE SIDE OF STALL.
WCS-1	WATER CLOSET SEAT	-	-	-	-	OLSONITE #95CC/SS OPEN FRONT SEAT.
WCS-2	WATER CLOSET SETA	-	-	-	-	OLSONITE L-210CC/SS 2" HIGH LIFT SEAT.
FV-1	FLUSH VALVE ASSEMBLY	-	-	1"	-	SLOAN "ROYAL" #110-3 FLUSH VALVE.
U-1	URINAL	2"	1-1/2"	1"	-	AMERICAN STANDARD "ALLBROOK" #6540.017 WITH SLOAN "ROYAL" #180 FLUSH VALVE, AND JAY R. SMITH #644-Z SUPPORT CARRIER.
L-1	LAVATORY	2"	1-1/2	1/2"	1/2"	AMERICAN STANDARD "NEW LUCERNE" #0355.012, 20" X 18" WITH #2411.015 GRID DRAIN, #2000.100 SINGLE LEVER FAUCET, AND JAY R. SMITH #700-Z SUPPORT CARRIER.
LT-1	LAVATORY TRIM	2"	1-1/2"	1/2"	-	CHICAGO #335-E12-VPC "TIP-TAP" SLOW-CLOSING FAUCET INDEXED "C" AND JAY R. SMITH #700-Z SUPPORT CARRIER. ADJUST FAUCET TO STAY OPEN FOR 10 SECONDS.
S-1	CLASSROOM SINK	2"	1-1/2"	1/2"	-	WESTERN #1725-SS, 17" X 25 STAINLESS STEEL WITH CHICAGO #350-VPC PANTRY FAUCET INDEXED "C" AT LEFT REAR, CHICAGO #748-335-VPC DRINKING BUBBLER AT RIGHT FRONT, AND SINK STRAINER. 36" MAX. TO CTR. OF BUBBLER
DF-1	DRINKING FOUNTAIN	2"	1-1/2"	1/2"	-	WESTERN #12-AWC WALL-MOUNT FOR WHEELCHAIR ACCESS WITH THREE VANDAL PROOF BUBBLERS AND PUSH BUTTON VALVES, AND JAY R. SMITH #824-Z SUPPORT CARRIER.

(CONTINUED)

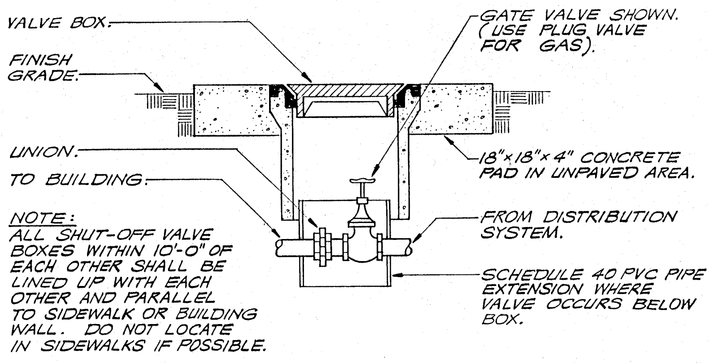

SHUT-OFF VALVE IN BOX DETAIL — C / P-2

SCALE: NONE

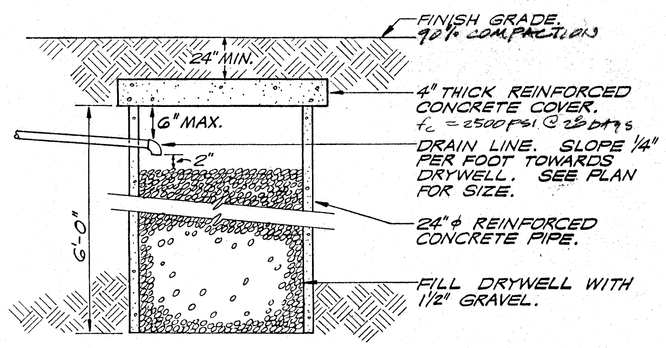

DRYWELL DETAIL — A / P-2

SCALE: NONE

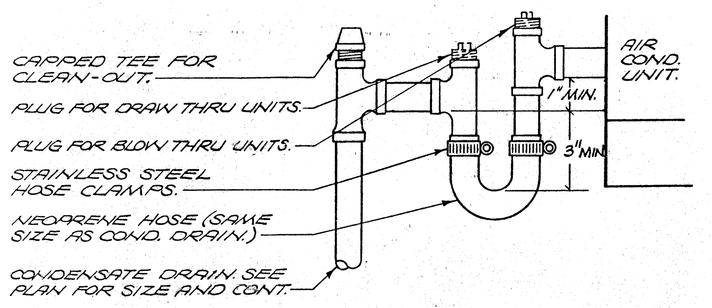

CONDENSATE DRAIN CONNECTION — D / P-2

SCALE: NONE

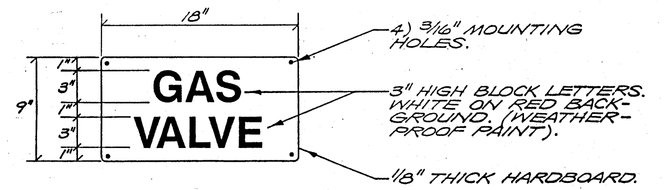

NOTE:
SIGN TO BE CONSPICUOUSLY LOCATED ABOVE BUILDING GAS SHUT-OFF VALVE AS INDICATED ON FLOOR PLAN.

GAS VALVE SIGN DETAIL — B / P-2

SCALE: NONE

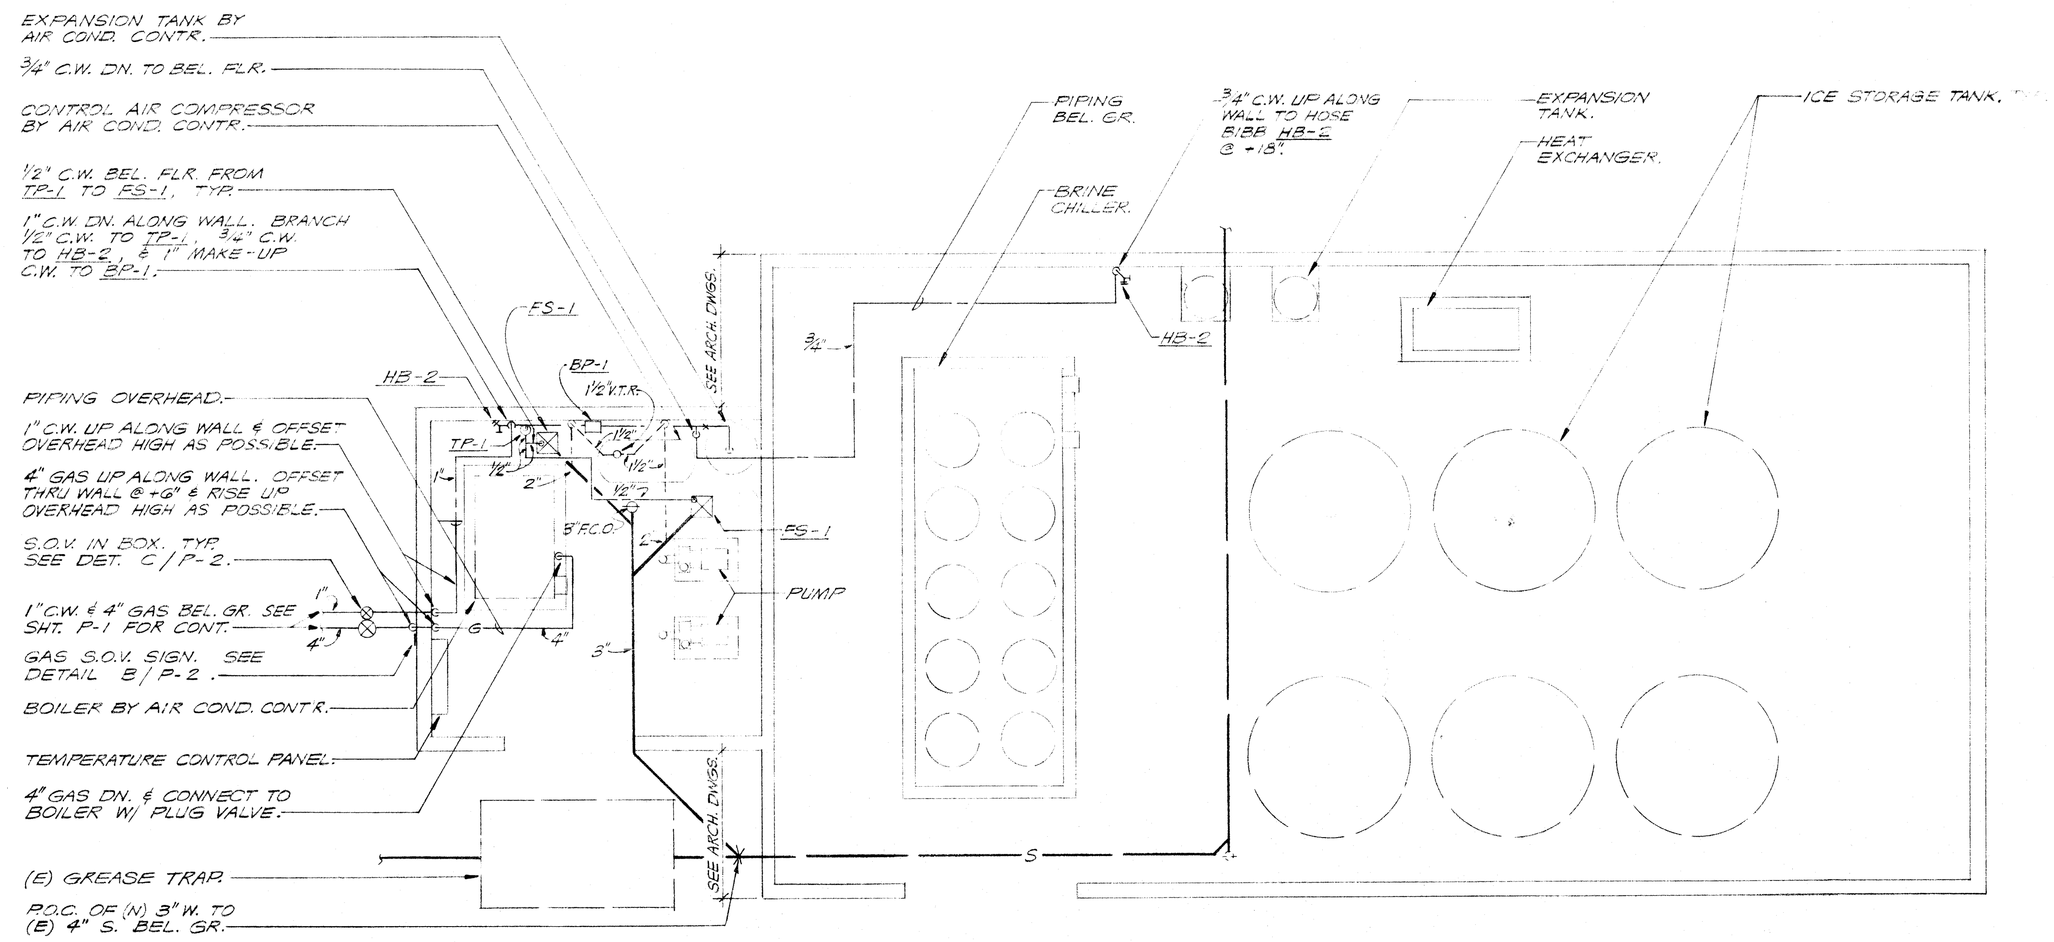

BOILER ROOM / CHILLER & ICE STORAGE YARD PLUMBING PLAN

SCALE: 1/4"=1'-0"

north

KLASSEN CORPORATION
Architecture
Planning
Construction
2021 Westwind Drive
Bakersfield, CA 93301
(805) 327-0875

C.S.B.E. C-10,401

The above drawings and specifications and ideas, designs and arrangements represented thereby are and shall remain the property of the architect and no part thereof shall be copied, disclosed to others or used in connection with any work or project other than the specific project for which they have been prepared and developed without the written consent of the architect. Visual contact with these drawings or specifications shall constitute conclusive evidence of acceptance of these restrictions.
Written dimensions on these drawings shall have precedence over scaled dimension. contractors shall verify and be responsible for all dimensions and conditions on the job and this office must be notified of any variations from the dimensions and conditions shown by these drawings. Shop details must be submitted to this office for approval before proceeding with fabrication.

BAKERSFIELD CITY SCHOOL DISTRICT
WAYSIDE ELEMENTARY SCHOOL MODERNIZATION
BAKERSFIELD, CALIFORNIA

WAYSIDE ELEMENTARY SCHOOL
BAKERSFIELD CITY SCHOOL DISTRICT
1000 MING AVENUE

Sheet title: BOILER ROOM / CHILLER & ICE STORAGE YARD PLUMBING PLAN

Lawrence • Nye • Becker Associates
CONSULTING MECHANICAL ENGINEERS, INCORPORATED
1500 W. Shaw Avenue, Suite 28 Fresno, CA 93711
(209) 226-0101 FAX-209-224-0227
M.O 11064

Date:	Issued for:
12/22/89	OLA/OSA APPROVAL
10/31/90	O.S.A. BACKCHECK

Date:	Revisions:

Drawn by: M.T.
Checked by: G. NYE
Job no: 1702
Sheet: P-2
Sheet of:
Date:
OLA APPLICATION NO 77-00012

TITLE 24 & 1988 UBC

STATE OF CALIFORNIA
Structural Safety Section
A 5349
JCH/LA

5548 NOV 27 '90

DEC 7 1990
STATE FIRE MARSHALL
SOUTHERN REGION