

PANEL SCHEDULE L-1

DESCRIPTION	LOAD	RK	RK	LOAD	DESCRIPTION
RECEPTS	1800	20	1	60	HMC UNIT
RECEPTS	1800	20	2	60	HMC UNIT
RECEPTS	1800	20	3	60	HMC UNIT
RECEPTS	1800	20	4	60	HMC UNIT
RECEPTS	1800	20	5	60	HMC UNIT
RECEPTS	1800	20	6	60	HMC UNIT
RECEPTS	1800	20	7	60	HMC UNIT
RECEPTS	1800	20	8	60	HMC UNIT
RECEPTS	1800	20	9	60	HMC UNIT
RECEPTS	1800	20	10	60	HMC UNIT
RECEPTS	1800	20	11	60	HMC UNIT
RECEPTS	1800	20	12	60	HMC UNIT
RECEPTS	1800	20	13	60	HMC UNIT
RECEPTS	1800	20	14	60	HMC UNIT
RECEPTS	1800	20	15	60	HMC UNIT
RECEPTS	1800	20	16	60	HMC UNIT
RECEPTS	1800	20	17	60	HMC UNIT
RECEPTS	1800	20	18	60	HMC UNIT
RECEPTS	1800	20	19	60	HMC UNIT
RECEPTS	1800	20	20	60	HMC UNIT
RECEPTS	1800	20	21	60	HMC UNIT
RECEPTS	1800	20	22	60	HMC UNIT
RECEPTS	1800	20	23	60	HMC UNIT
RECEPTS	1800	20	24	60	HMC UNIT

120V/240V
5 WIRE
NEUTRAL










* CREDIT PREAKER TO BE IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS

5460 10960

FLUSH
SURFACE

LIGHTING FIXTURE SCHEDULE

TYPE	MANUFACTURER	LAMP'S	NOM. VA.	MOUNTING	REMARKS
A	21-41 RECESSED FLUORESCENT RECESSED RECESSED	4-40W	180 VA	RECESSED	1-81 LAMPS OPTIONAL
B	RECESSED FLUORESCENT RECESSED	1-18.5 7 WATT	97 VA	RECESSED	WALL - SURFACE MOUNTED 1-81 LAMPS OPTIONAL

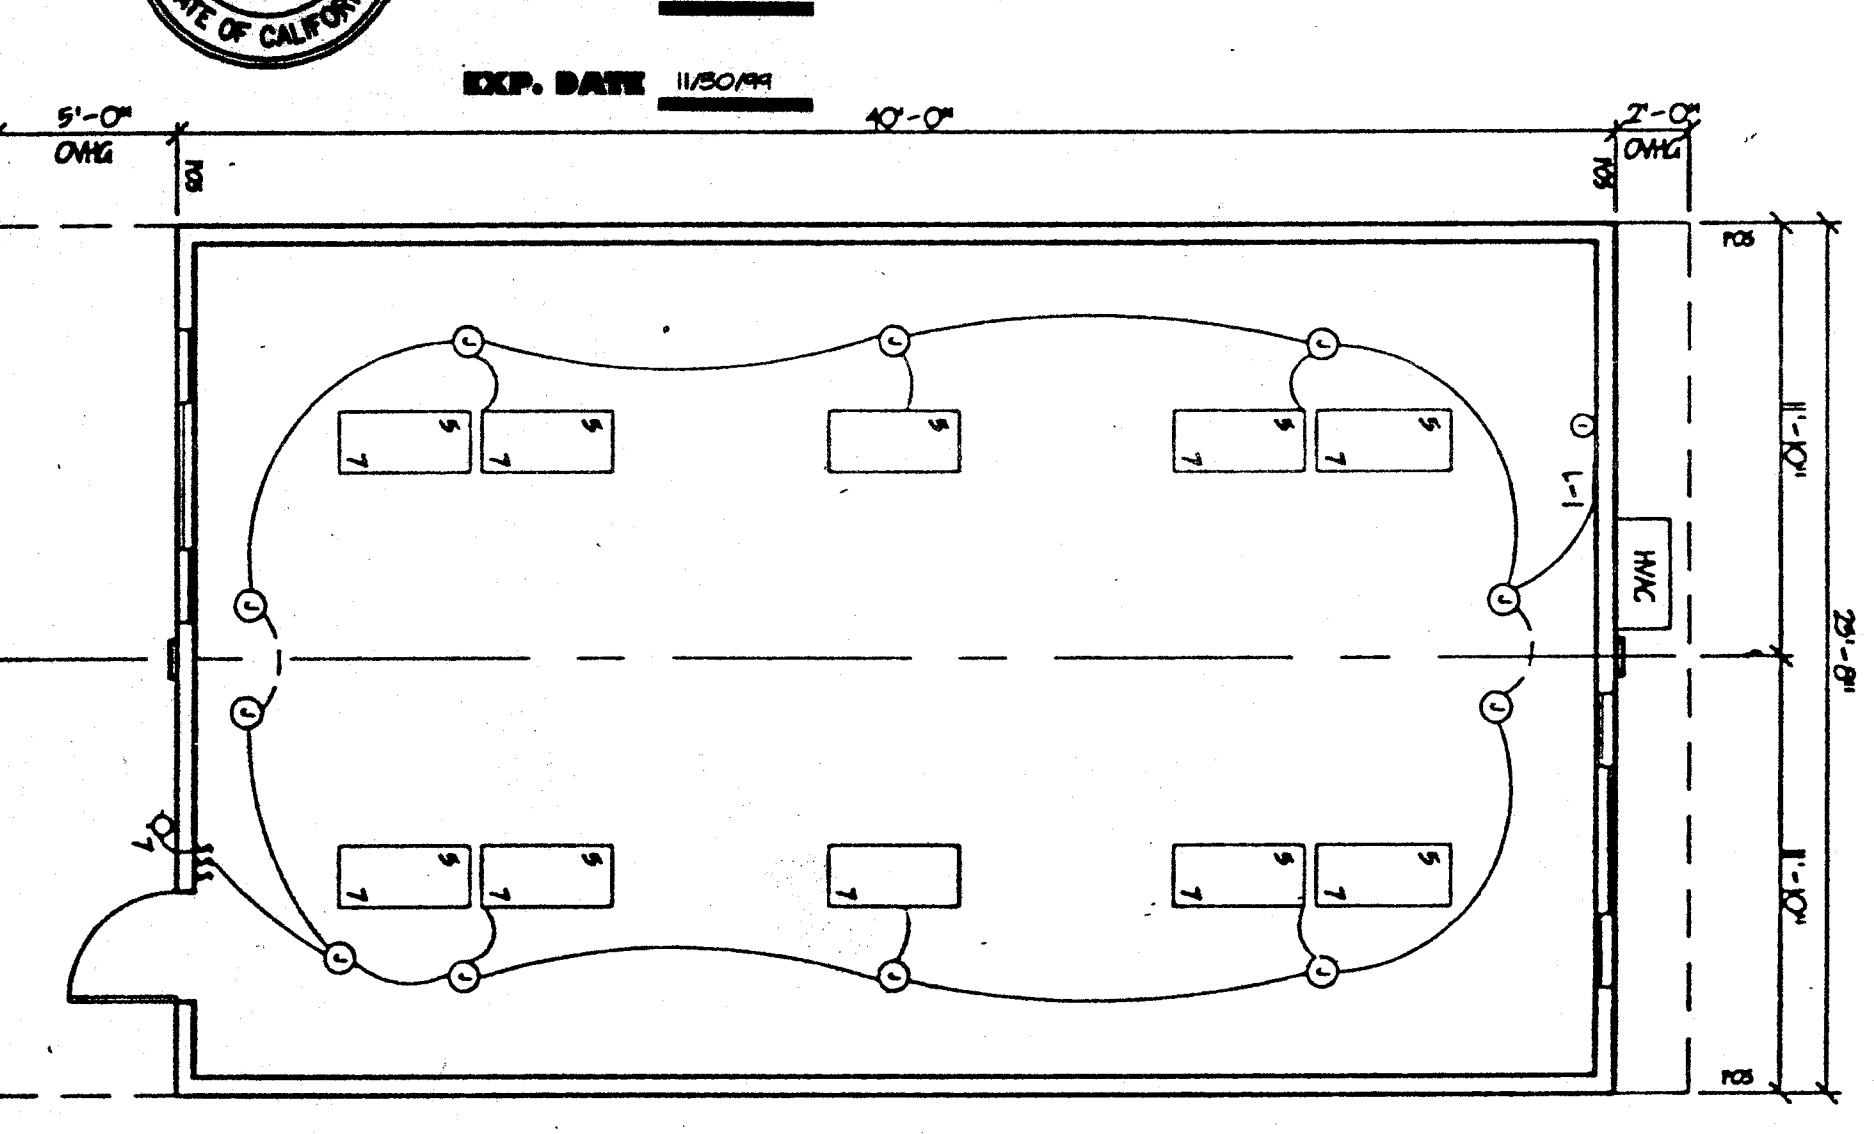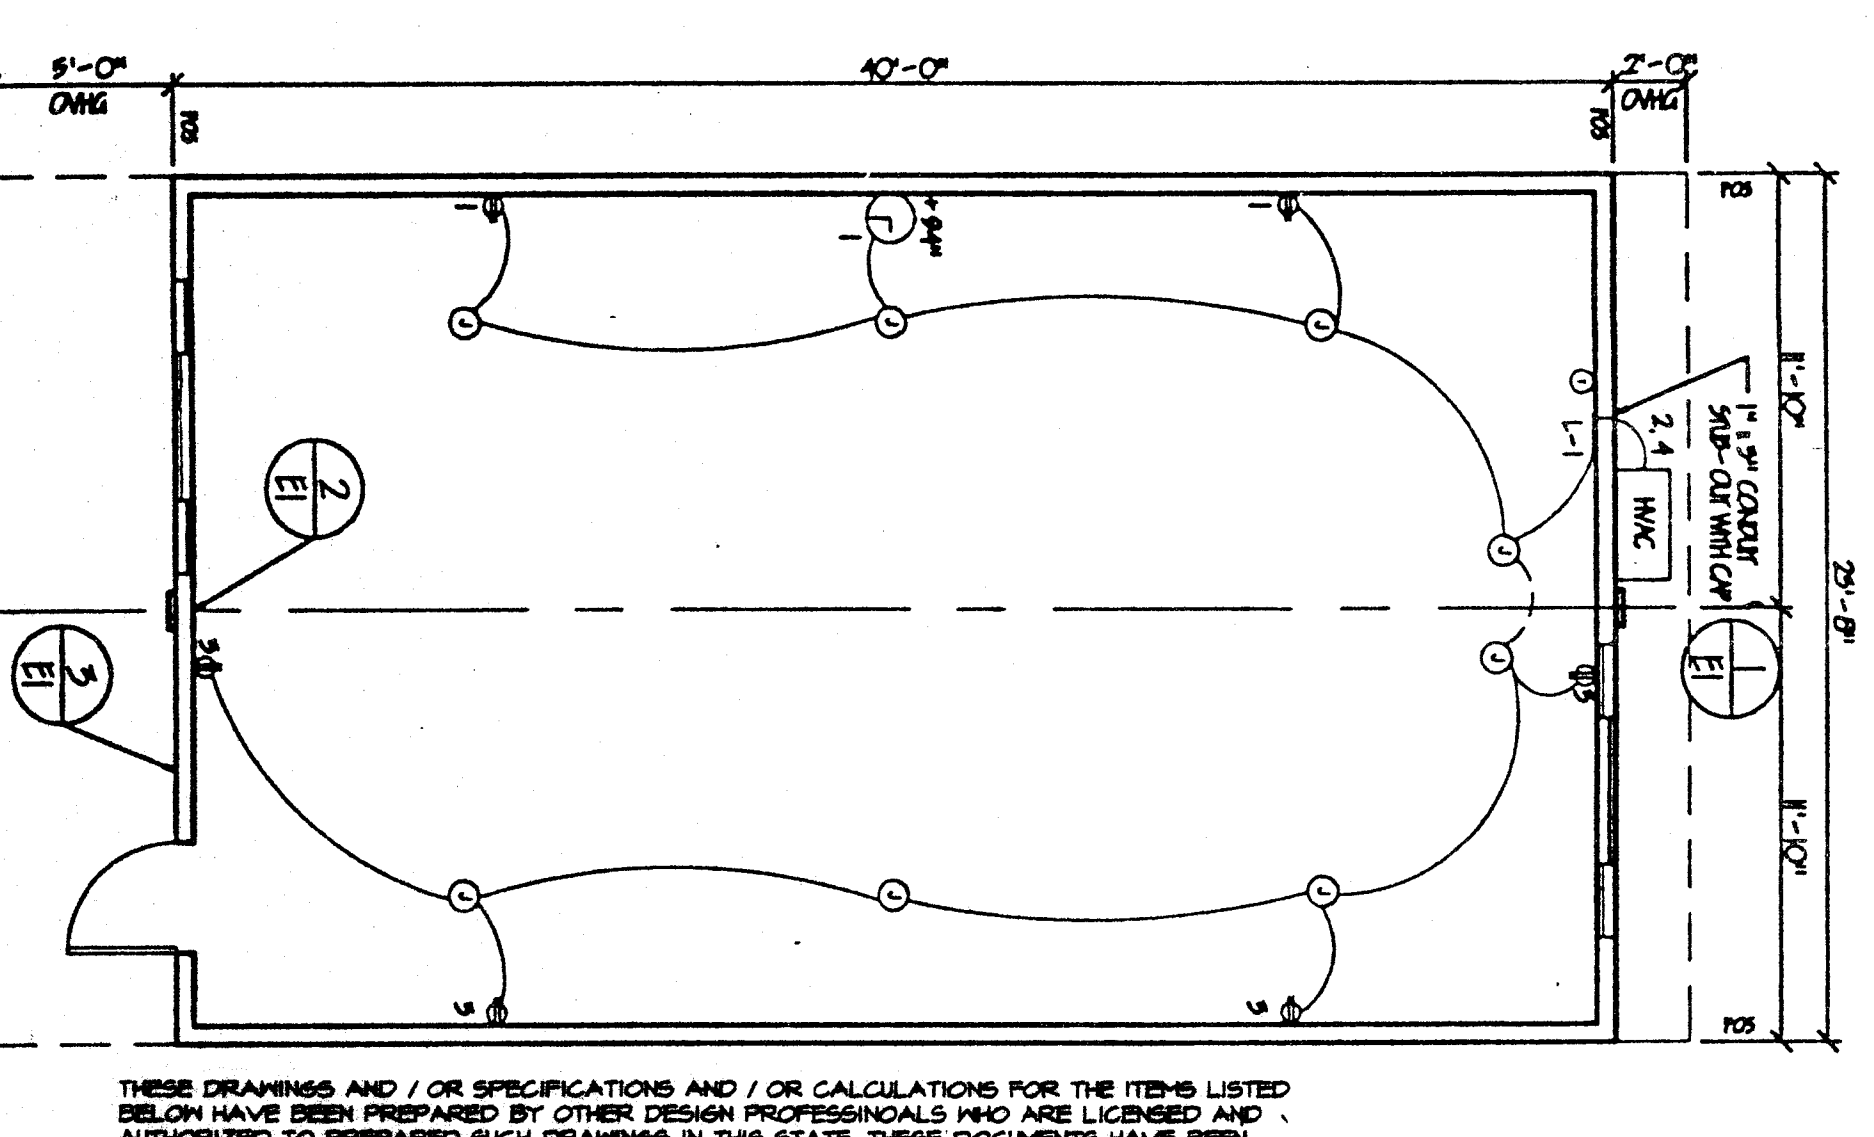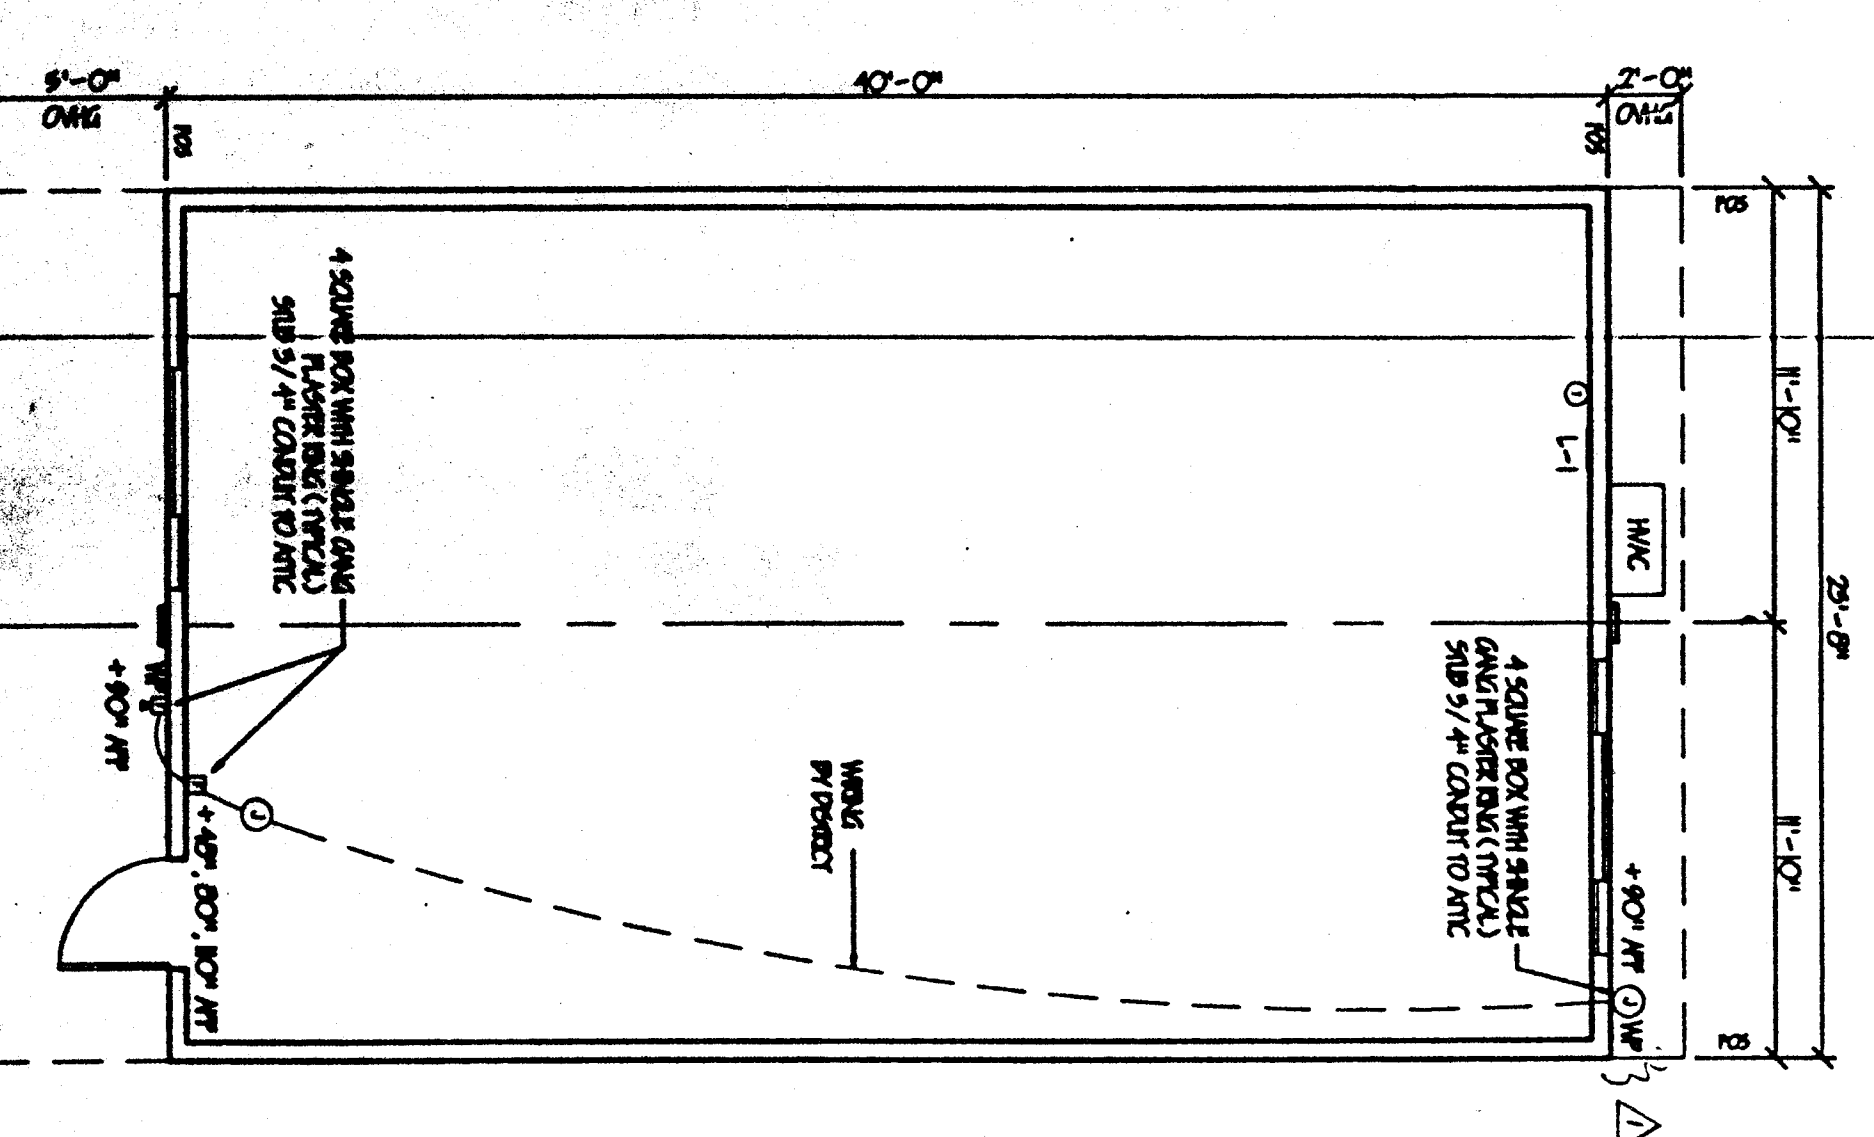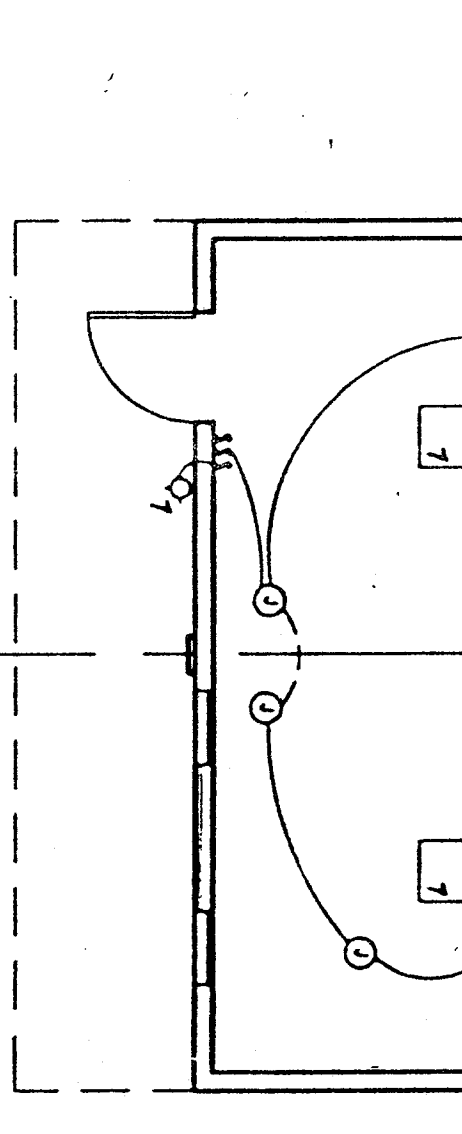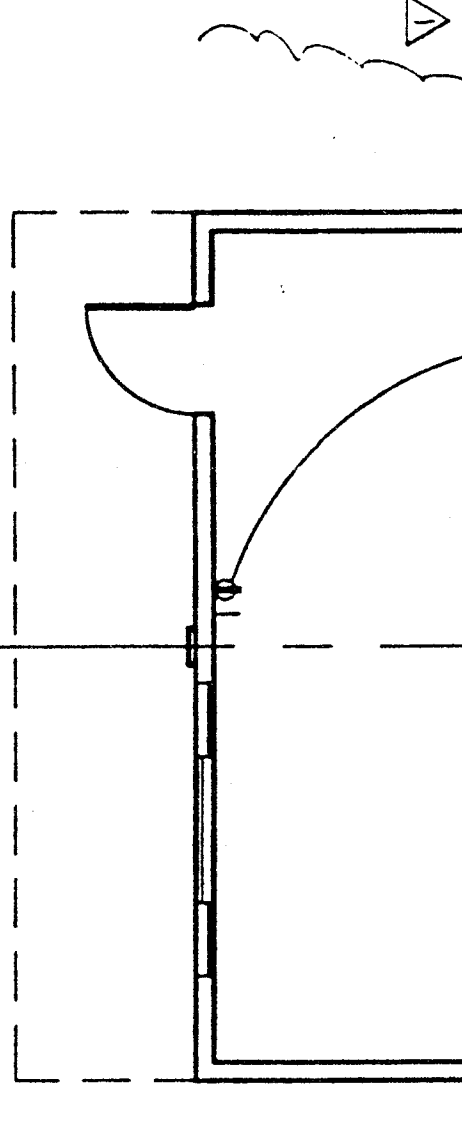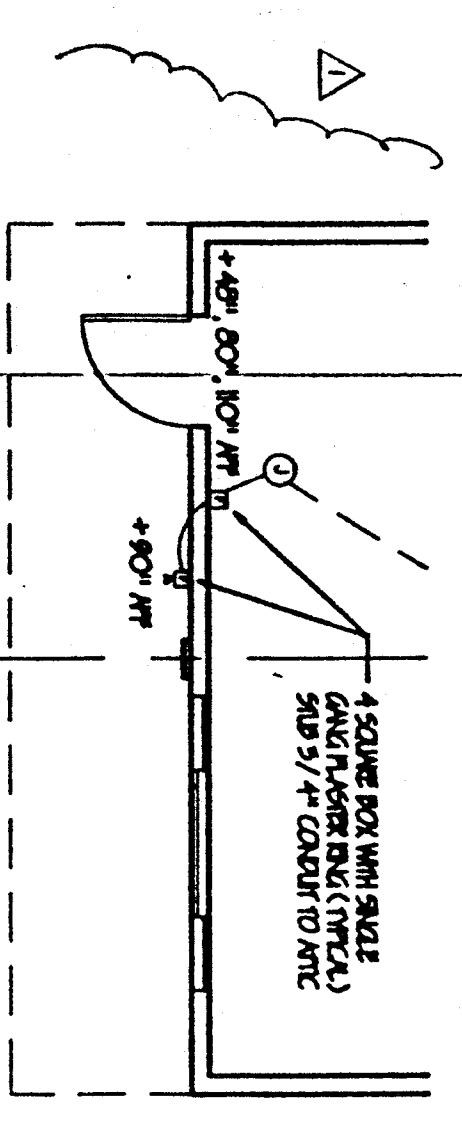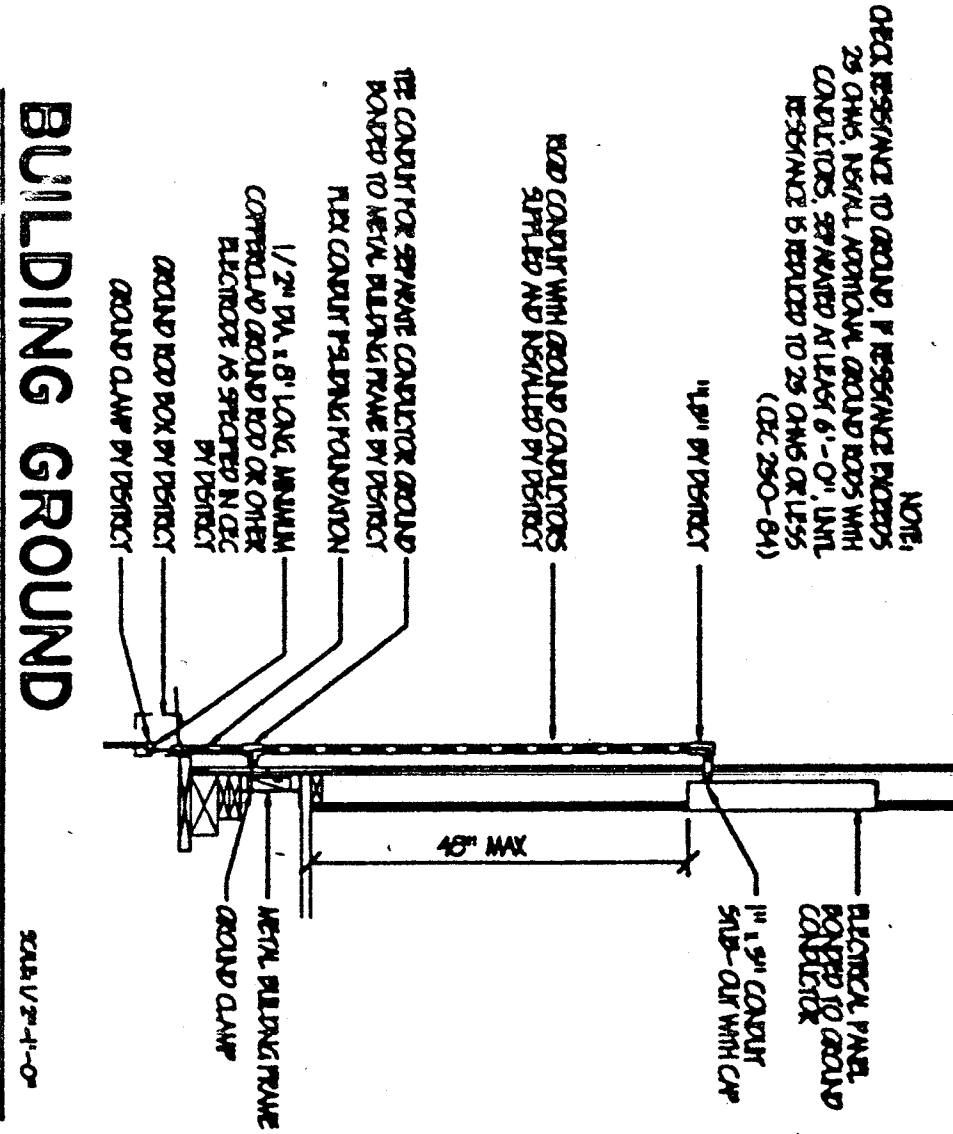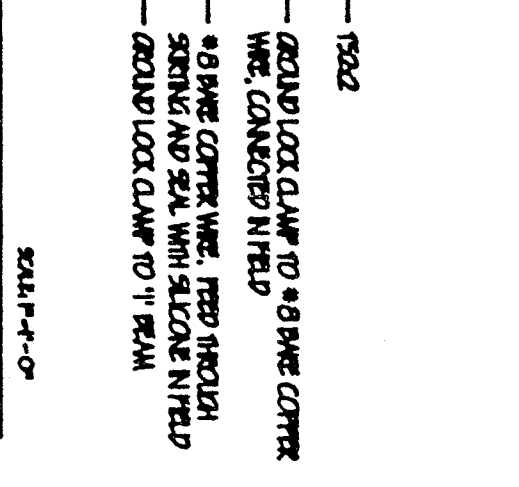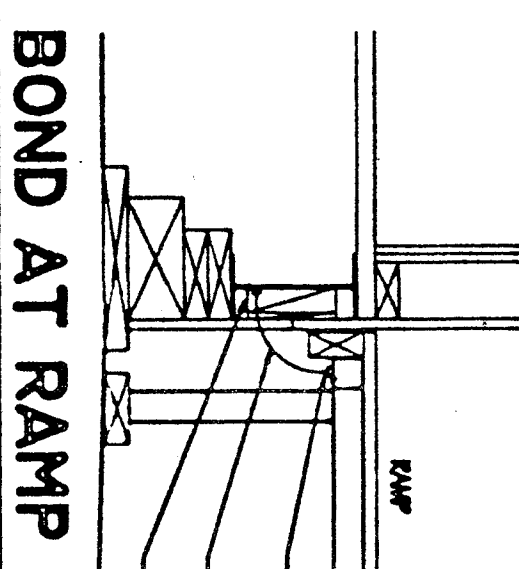

ELECTRICAL NOTES

1. ALL ELECTRICAL WORK SHALL BE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE (NEC) AND ALL LOCAL ORDINANCES THEREUNDER.

2. ALL ELECTRICAL WORK SHALL BE PERFORMED BY A LICENSED ELECTRICIAN OR UNDER HIS CLOSE PERSONAL SUPERVISION.

3. ALL ELECTRICAL WORK SHALL BE SUBJECT TO INSPECTION AND APPROVAL BY THE LOCAL ELECTRICAL INSPECTOR.

4. ALL ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.

5. ALL ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH THE PROJECT SPECIFICATIONS.

6. ALL ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE (NEC) AND ALL LOCAL ORDINANCES THEREUNDER.

7. ALL ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH THE PROJECT SPECIFICATIONS.

8. ALL ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE (NEC) AND ALL LOCAL ORDINANCES THEREUNDER.

9. ALL ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH THE PROJECT SPECIFICATIONS.

10. ALL ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE (NEC) AND ALL LOCAL ORDINANCES THEREUNDER.

GENERAL NOTES

1. ALL ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE (NEC) AND ALL LOCAL ORDINANCES THEREUNDER.

2. ALL ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH THE PROJECT SPECIFICATIONS.

3. ALL ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE (NEC) AND ALL LOCAL ORDINANCES THEREUNDER.

4. ALL ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH THE PROJECT SPECIFICATIONS.

5. ALL ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE (NEC) AND ALL LOCAL ORDINANCES THEREUNDER.

6. ALL ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH THE PROJECT SPECIFICATIONS.

7. ALL ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE (NEC) AND ALL LOCAL ORDINANCES THEREUNDER.

8. ALL ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH THE PROJECT SPECIFICATIONS.

9. ALL ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE (NEC) AND ALL LOCAL ORDINANCES THEREUNDER.

10. ALL ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH THE PROJECT SPECIFICATIONS.

LEGEND

1. 4 SQUARE FOOT SIGNAL PANEL

2. 4 SQUARE FOOT POWER PANEL

3. 4 SQUARE FOOT LIGHTING PANEL

4. 4 SQUARE FOOT SIGNAL PANEL

5. 4 SQUARE FOOT POWER PANEL

6. 4 SQUARE FOOT LIGHTING PANEL

7. 4 SQUARE FOOT SIGNAL PANEL

8. 4 SQUARE FOOT POWER PANEL

9. 4 SQUARE FOOT LIGHTING PANEL

10. 4 SQUARE FOOT SIGNAL PANEL

11. 4 SQUARE FOOT POWER PANEL

12. 4 SQUARE FOOT LIGHTING PANEL

13. 4 SQUARE FOOT SIGNAL PANEL

14. 4 SQUARE FOOT POWER PANEL

15. 4 SQUARE FOOT LIGHTING PANEL

16. 4 SQUARE FOOT SIGNAL PANEL

17. 4 SQUARE FOOT POWER PANEL

18. 4 SQUARE FOOT LIGHTING PANEL

19. 4 SQUARE FOOT SIGNAL PANEL

20. 4 SQUARE FOOT POWER PANEL

21. 4 SQUARE FOOT LIGHTING PANEL

22. 4 SQUARE FOOT SIGNAL PANEL

23. 4 SQUARE FOOT POWER PANEL

24. 4 SQUARE FOOT LIGHTING PANEL

APPROVALS

DATE: 10/28/97

APPROVED: [Signature]

PROJECT: 24x40 RELOCATABLE BUILDING

SCALE: 1/8" = 1'-0"

DATE: 10/28/97

APPROVED: [Signature]

PROJECT: 24x40 RELOCATABLE BUILDING

SCALE: 1/8" = 1'-0"

NORMAN A. GEIGER
AIA, CSI, CDT, ICB
P.O. BOX 41054
Sacramento, CA 95841
(916) 382-2465 FAX
(916) 382-2468 PHONE

ARCHITECTURAL SERVICES

PACESETTER INDUSTRIES, INC.
P.O. BOX 1131, MODESTO, CA 95353 (209) 521-1600

24x40 RELOCATABLE BUILDING

PC 330

DATE: 10/28/97

APPROVED: [Signature]

PROJECT: 24x40 RELOCATABLE BUILDING

SCALE: 1/8" = 1'-0"

DATE: 10/28/97

APPROVED: [Signature]

PROJECT: 24x40 RELOCATABLE BUILDING

SCALE: 1/8" = 1'-0"