


WINDOW SCHEDULE									
WINDOW NO.	QTY	TYPE	WIDTH	HEIGHT	FUNCTION	FRAME MATERIAL	GLASS MATERIAL	WALL THICKNESS	NOTES
A	1	5'-0"	4'-0"	XOX	ANOD	DP			
B	2	4'-0"	4'-0"	XO	ANOD	DP			


WINDOW FINISH

ANOD: CLEAR ANODIZED ALUMINUM FRAME DP: 3/16" MINIMUM DUAL PANE TEMPERED GLASS OF SOLAR
 BRONZ: BRONZE ANODIZED ALUMINUM FRAME GRAY - 5/16" ENERGY SHIELD WITH A LIGHT TRANSMISSION
 PAINT: PAINTED FRAME FACTOR OF 40%, ALL OPERABLE GLASS SHALL HAVE
 WP: 18GA WELDED FRAME SURFACES.
 FRW: FIRE RATED WINDOW
 FRAME: MIN 0.049" THICK WELDED FRAME
 FRG: FIRE RATED GLAZING: 1/4" WIRED GLASS. LABELED TO MEET THE REQUIREMENTS FOR A 34 HOUR FIRE WINDOW ASSEMBLY PER CBC SECTION 715.4

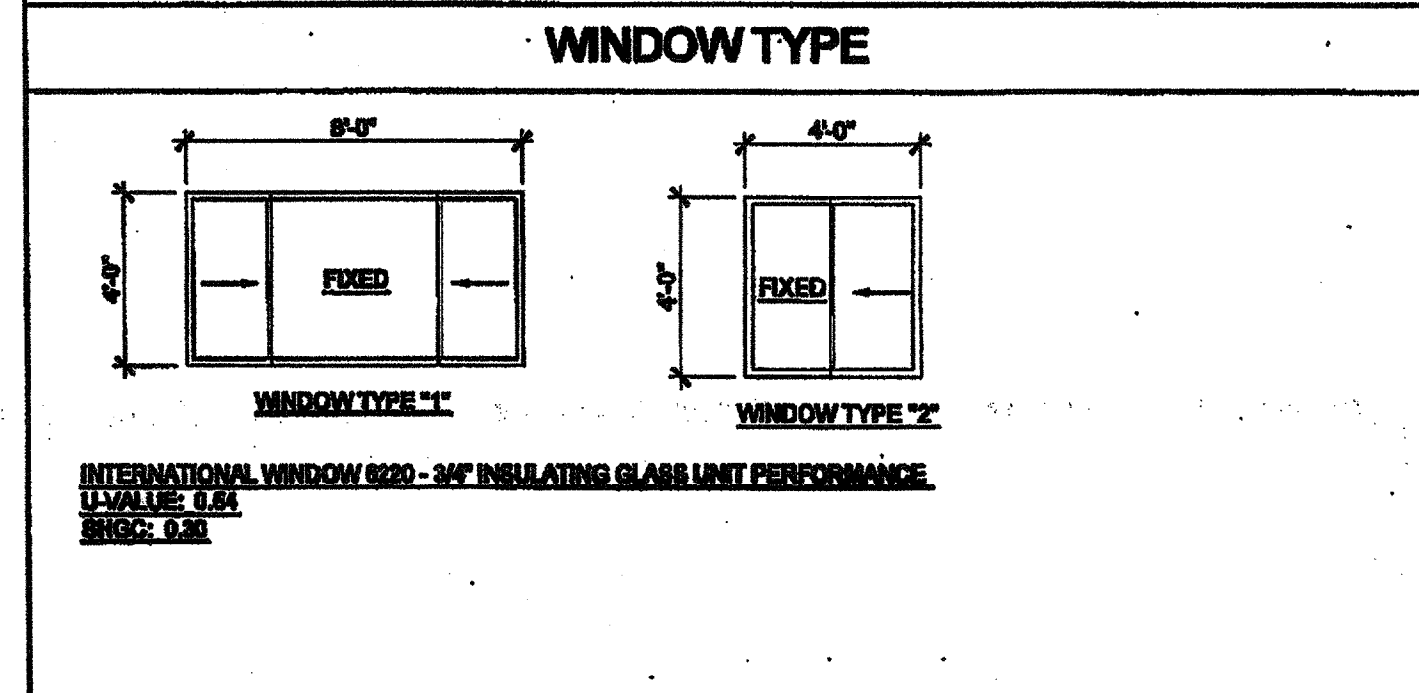

DOOR SCHEDULE									
DOOR NO.	WIDTH	HEIGHT	DOOR TYPE	DOOR QTY	DOOR MATFIN	FRAME MATFIN	HARDWARE SET	WALL THICKNESS	NOTES
1	3'-0"	7'-0"	A	1	HM	HD	HW-1	5 1/4"	2x6 WALL
2	3'-0"	7'-0"	A1	1	HM	HD	HW-2	5 1/4"	2x6 WALL
3	3'-0"	7'-0"	A	1	HM	HD	HW-3	5 1/4"	
4	3'-0"	7'-0"	B	1	HM	HD	HW-4	4 1/2"	NO CLOSER REQ.
5	3'-0"	7'-0"	B	1	HM	HD	HW-5	4 1/2"	
6	3'-0"	7'-0"	C	1	HM	HD	HW-6	4 1/2"	

DOOR MATERIAL AND FINISH ABBREVIATIONS			
HM:	18GA HOLLOW METAL	HD:	KNOCK DOWN FRAME
WP:	18GA WELDED FRAME	SCL:	SOLID CORE WOOD LEGACY
AL:	ALUMINUM	HC:	HOLLOW CORE WOOD
SST:	STAINLESS STEEL	PT:	PAINTED

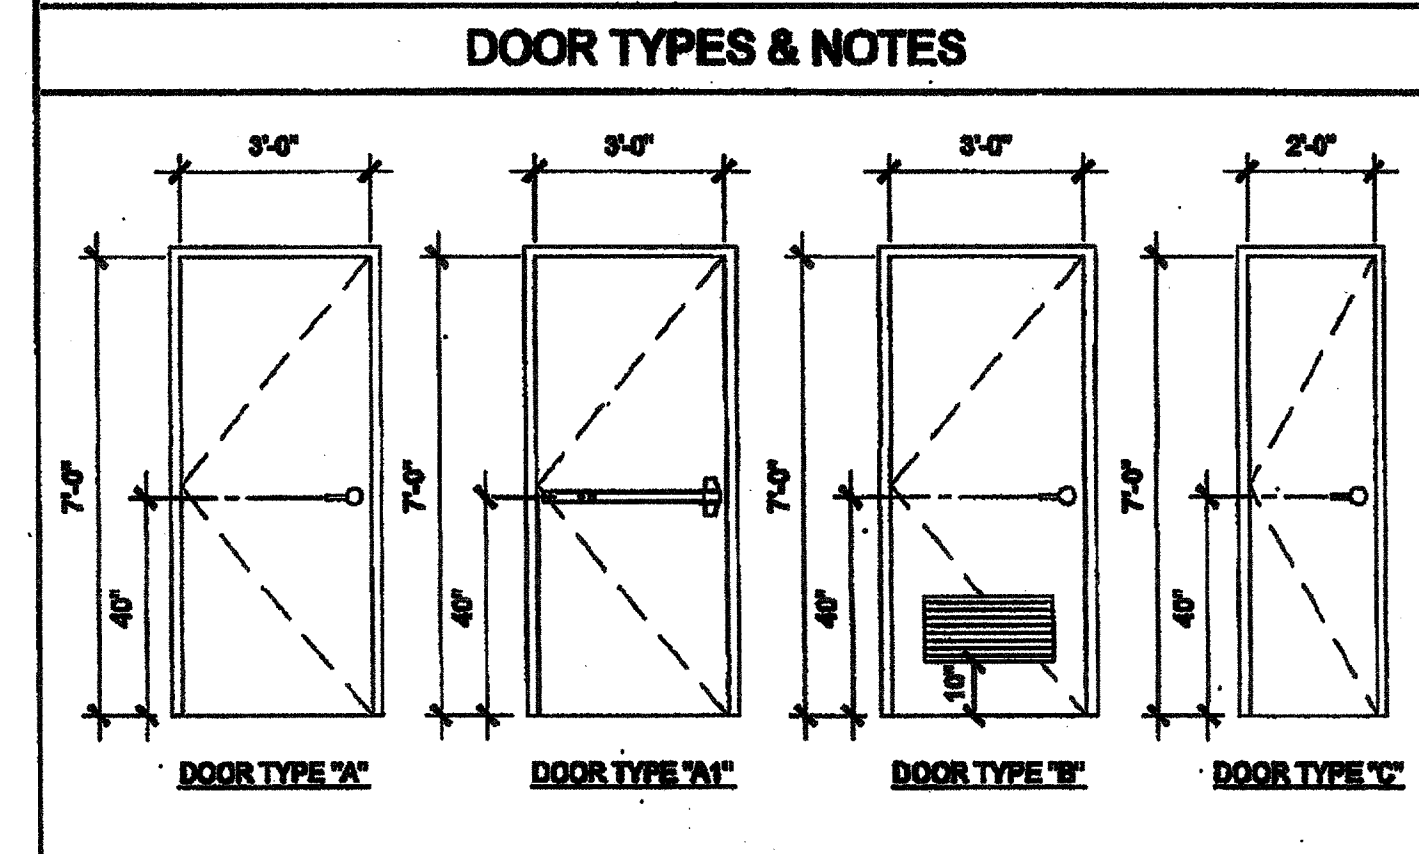

- DOOR HANDLE FOR LOCKSETS AND PANIC HARDWARE TO BE CENTERED AT 48" AFF. HARDWARE TO BE OPENED FROM THE INSIDE WITHOUT ANY SPECIAL KNOWLEDGE OR EFFORT. LEVERS TO RETURN TO WITHIN 1/2" OF DOOR.
- ALL DOORS SHALL BE 1 3/4" THICK U.N.O.
- CLOSER SHALL BE SET FOR MAXIMUM OPENING PRESSURE OF 8 LBS AT EXTERIOR AND INTERIOR DOORS.
- PANIC HARDWARE IS REQUIRED TO BE INSTALLED WHEN THE CONFIGURATION OF ANY ROOM PROVIDES AN OCCUPANT LOAD OF 50 OR GREATER. CBC 1008.1.10
- ALL HARDWARE SHALL COMPLY WITH SILVER CREEK'S SPECIFICATIONS ON THIS SHEET AND CBC SECTIONS 1128B.2 AND 1008
- DOOR CLOSER SHALL BE ADJUSTED TO GO THAT FROM AN OPEN POSITION OF 70°, THE DOOR WILL TAKE AT LEAST 3 SECONDS TO MOVE TO A POINT 3" FROM THE LATCH, MEASURED TO THE LANDING SIDE OF THE DOOR 1193 B.2.6.1
- PANIC AND FIRE EXIT HARDWARE. WHERE PANIC AND FIRE EXIT HARDWARE IS INSTALLED, IT SHALL COMPLY WITH THE FOLLOWING:
 - THE ACTUATING PORTION OF THE RELEASING DEVICE SHALL EXTEND AT LEAST ONE-HALF OF THE DOOR LEAF WIDTH.
 - THE MAXIMUM UNLATCHING FORCE SHALL NOT EXCEED 8 LBS PER 1178.5.4
 - APPROVED BY AUTHORITY IN JURISDICTION, PANIC HARDWARE SHALL COMPLY WITH CBC SECTION 1008.1.10
- THE FIRE PROTECTION FOR EXTERIOR WALL IS DETERMINED BASED UPON THE FIRE SEPARATION DISTANCE IN WHICH THE WALL IS LOCATED. SEE CBC TABLE 706.5 OR TABLE 602

FINISH SCHEDULE									
ROOM NAME	FLOORING	WALL FINISH	CEILING	NOTES					
	FLOOR	FRONT	LEFT	REAR	RIGHT	CEILING	CEILING HT		
CLASSROOM	4'-0" 4'-0"	TACK	TACK	TACK	TACK	OP	8'-0"		
TOILET	4'-0" 4'-0"	FRP	FRP	FRP	FRP	GBP	8'-0"		
BOYS	4'-0" 4'-0"	FRP	FRP	FRP	FRP	GBP	8'-0"		
GIRLS	4'-0" 4'-0"	FRP	FRP	FRP	FRP	GBP	8'-0"		
PLUMBING CHASE									

FLOOR, WALL, CEILING MATERIALS

FLOORING
 CARP: CARPET PER STATE OF CALIFORNIA SPECIFICATIONS COMPLYING WITH GROUP 1; TYPE "A" OR TYPE "B"; CLASS 2; DENSITY 400; DIRECT GLUE DOWN
 SV: SHEET VINYL FLOORING
 VCT: VINYL COMPOSITION TILE

BASE
 4" TS: 4" TOP SET BASE
 6" TS: 6" TOP SET BASE
 SC: 3" SELF-DRAVE BASE

WALLS
 TACK: 1/2" VINYL TACKBOARD CLASS 1 OVER 1/2" GYPSUM BOARD BACKING
 FRP: 1/2" FIBER REINFORCED PANEL OVER 1/2" WATER RESISTANT GYPSUM BOARD
 GYP: 1/2" GYPSUM BOARD; TAPE; TEXTURE; PAINTED FINISH
 PLY: 1/2" PLYWOOD FINISH
 NP: NO FINISH

CEILING
 OP: ACoustICAL LAY IN GRID CEILING PANELS (SEE SPECIFICATION NOTES ON REFLECTED CEILING PLAN)
 HC: 5/8" GYPSUM BOARD; TAPE; TEXTURE; PAINTED FINISH (HARD LID CEILING)
 GBP: 1/2" GYPSUM BOARD VISIBLE PANELS (PAINTED)

- FINISH NOTES**
- ALL FINISHES SHALL COMPLY WITH CBC, CFC AND TITLE 19 CCR.
 - PREPARATION FOR SUB-FLOOR TO ACCEPT FINISH FLOORING IS BY FLOORING CONTRACTOR. PLYWOOD SUB-FLOOR IS 2.4.1 PLYWOOD. OUTER PLYWOOD IS PLUGGED AND TOUGH BANDED. ANY DEFORMITIES DUE TO STANDARD CONSTRUCTION PRACTICES SHALL BE FILLED AND BANDED BY FLOORING CONTRACTOR. THE JOINT AT THE MOULINE SHALL NOT BE LARGER THAN 1/8" AND SHALL BE FILLED AND BANDED BY FLOORING CONTRACTOR.
 - RESILIENT FLOORING DEMONSTRATING A COEFFICIENT OF FRICTION OF AT LEAST 0.8 PER ASTM D2047, WILL BE ACCEPTED AS MEETING THE INTENT OF SLIP RESISTANCE.
 - CARPET SHALL HAVE A LEVEL LOOP, TEXTURED LOOP, LEVEL CUT, OR LEVEL CUT / UNICUT PILE TEXTURE AND MAXIMUM PILE HEIGHT OF 1/2" PER CBC SECTION 1128B.3. CARPET EDGED SHALL COMPLY WITH CBC SECTION 1128B.2.

DOOR HARDWARE			
CLASSROOM - EXTERIOR DOOR HW-1			
LOCKSET	SCHLAGE NIO50RHO288 (cylindrical)	Finish 28D	or equal
BUTTS	HAGER 89181 4 1/2" x 4 1/2" NRP	Finish 28D	or equal
CLOSER	FALCON 689	Finish 689	or equal
WEATHER STRIP	HAGER 8918AV 3894	Finish Alum	or equal
THRESHOLD	HAGER 4138A 38	Finish Alum	or equal
DOOR BOTTOM	HAGER 788AV 38H	Finish Alum	or equal
DOOR W/ PANIC HARDWARE - EXTERIOR DOOR HW-2			
EXIT DEVICE	YALE 7000 SERIES	Finish Alum	or equal
BUTTS	HAGER 89181 4 1/2" x 4 1/2" NRP	Finish 28D	or equal
CLOSER	FALCON 689	Finish 689	or equal
WEATHER STRIP	HAGER 8918AV 3894	Finish Alum	or equal
THRESHOLD	HAGER 4138A 38	Finish Alum	or equal
DOOR BOTTOM	HAGER 788AV 38H	Finish Alum	or equal
STAFF RESTROOM / SINGLE OCCUPANCY - INTERIOR DOOR HW-3			
LOCKSET	SCHLAGE NIO50RHO288 (cylindrical)	Finish 28D	or equal
BUTTS	HAGER 1279 4 1/2" x 4 1/2"	Finish 28D	or equal
BOYS & GIRLS RESTROOM - EXTERIOR DOOR HW-4			
LOCKSET	SCHLAGE NIO50RHO288 (cylindrical)	Finish 28D	or equal
BUTTS	HAGER 89181 4 1/2" x 4 1/2" NRP	Finish 28D	or equal
CLOSER	FALCON 689	Finish 689	or equal
WEATHER STRIP	HAGER 8918AV 3894	Finish Alum	or equal
THRESHOLD	HAGER 4138A 38	Finish Alum	or equal
DOOR BOTTOM	HAGER 788AV 38H	Finish Alum	or equal
LOUVER	ALUMINO 34 x 12	Finish Bronze	or equal
STAFF RESTROOM - EXTERIOR DOOR HW-5			
LOCKSET	SCHLAGE NIO50RHO288 (cylindrical)	Finish 28D	or equal
BUTTS	HAGER 89181 4 1/2" x 4 1/2" NRP	Finish 28D	or equal
WEATHER STRIP	HAGER 8918AV 3894	Finish Alum	or equal
THRESHOLD	HAGER 4138A 38	Finish Alum	or equal
DOOR BOTTOM	HAGER 788AV 38H	Finish Alum	or equal
LOUVER	ALUMINO 34 x 12	Finish Alum	or equal
PLUMBING CHASE DOOR - INTERIOR DOOR HW-6			
LOCKSET	SCHLAGE NIO50RHO288 (cylindrical)	Finish 28D	or equal
BUTTS	HAGER 89181 4 1/2" x 4 1/2" NRP	Finish 28D	or equal

INSULATION SPECIFICATIONS

MOISTURE PROTECTION INSULATION:
 DESCRIPTION OF WORK: THE FURISHING AND INSTALLING OF ALL INSULATION FOR ALL CEILING, FLOOR AREAS, AND EXTERIOR WALLS. (CLASS 1 + 0-00 FLAME SPREAD) GIBBS DEVELOPMENT DENSITY LESS THAN 400.
 MATERIAL: INSULATING MATERIAL FOR WALLS, CEILING, AND FLOORING SHALL BE FIBERGLASS BATT (UNFACED) AND SHALL COMPLY WITH CBC 718.2-718.3. INSULATION SHALL BE AS MANUFACTURED BY OWENS-CORNING FIBERGLASS CORPORATION, JOHNS-MANVILLE, CERTANTIER, OR EQUAL.

INSULATION VALUES
 SEE SHEETS A-0.2, A-0.7, A-0.8 FOR REQUIRED INSULATION VALUES PER CLIMATE ZONE

EXTERIOR WALL INSULATION (MIN.)
 R-15 (2x4)
 R-19 (2x6)
 R-30 (2x8)

INTERIOR WALL INSULATION (MIN.)
 R-15

FLOOR INSULATION (MIN.)
 NONE
 R-15
 R-19

ROOF INSULATION (MIN.)
 R-19
 R-30
 R-30
 R-19 BETWEEN JOISTS AND R-19 BELOW JOISTS

THESE DRAWINGS AND ALL MATERIAL CONTAINED HEREIN ARE THE PROPERTY OF SILVERCREEK INDUSTRIES, INC. (SCI INC) AND SHALL NOT BE REPRODUCED, COPIED OR OTHERWISE DISSEMINATED IN WHOLE OR IN PART TO ASSIST IN THE MAKING OF OR FOR THE PURPOSE OF FURNISHING ANY INFORMATION FOR THE MAKING OF DRAWINGS, PRINTS, APPARATUS OR PARTS THEREOF WITHOUT THE FULL KNOWLEDGE AND WRITTEN CONSENT OF SCI INC. ALL PATENTABLE MATERIAL CONTAINED HEREIN AND ORIGINATING WITH SCI INC SHALL BE THE PROPERTY OF SCI INC.

SILVER CREEK INDUSTRIES, INC.
 "BUILDING FOR THE NEXT GENERATION"
 195 EAST MORGAN FERRIS, CALIFORNIA 92571
 PHONE: 951-949-3368 FAX: 951-949-2211

PROJECT NAME:
CLASS LEASING CLASSROOM BLDG'S

SHEET TITLE:
SCHEDULES

STAVARES
 ARCHITECT
 12222011

ARCHITECT'S STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 No. 0-2891
 FEB 19 2015
 12222011

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 04 11 2015
 DATE FEB 26 2015

PROJECT SPECIFIC STATE AGENCY APPROVAL
 IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 04 11 2015
 DATE APR 04 2015

ORIGINAL FC STATE AGENCY APPROVAL
 IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 OFFICE OF REGULATION SERVICES
 PC 04-112072
 DATE DEC 8 2015

REVISIONS

SILVER CREEK INDUSTRIES
 24' x 49' FC

PROJECT NO:
 DRAWN BY:
 SCALE: AS NOTED
 DATE: 12-23-11
 P.C. SHEET NUMBER
A-0.2

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP03 11 6973
 AC / FLS / SSS
 DATE APR 19 2016

STR 126