

CBC 1998

PC

D.S.A. IDENTIFICATION STAMP DIV. OF THE STATE ARCHITECT OFFICE OF REGULATION SERVICES 04-101055

D.S.A. PORTION 1 IDENTIFICATION STAMP PROJECT TITLE: STATE ARCHITECT NO. 005678

STRUCT. ENGINEER ARCHITECT


CHANGE ORDER

CHECKED BY


JURORA MODULAR INDUSTRIES

19031 Vermont Ave., Norwalk, Ct. 06854 Tel: (959) 782-1918 Fax: (959) 782-0283

AIR CONDITIONING PLAN VIEW SHEET 6-22-08

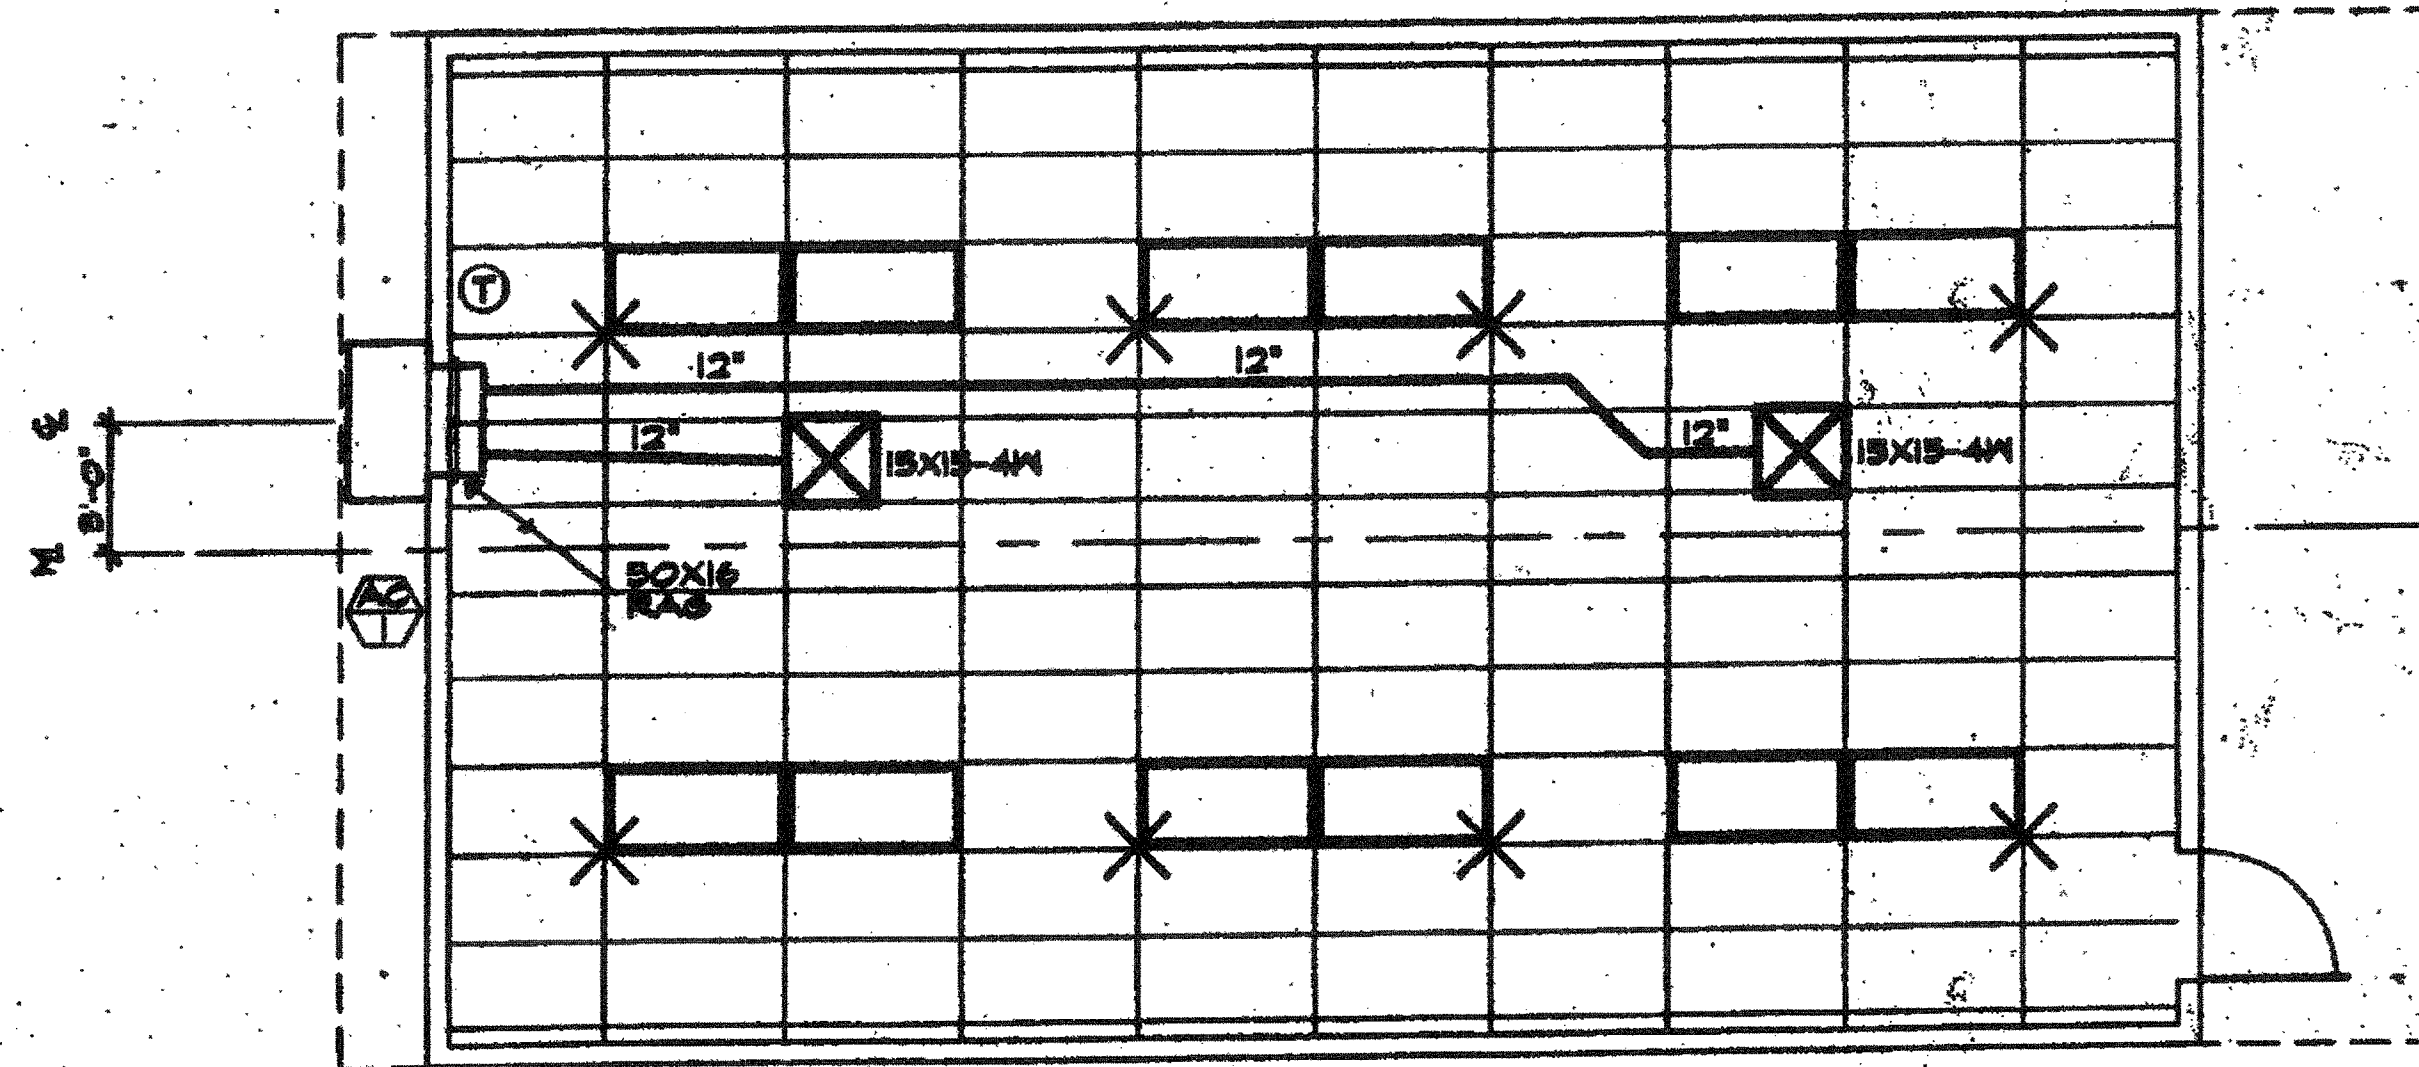

AIR CONDITIONING PLAN VIEW 24'X40' BUILDING SCALE 1/4"=1'-0"

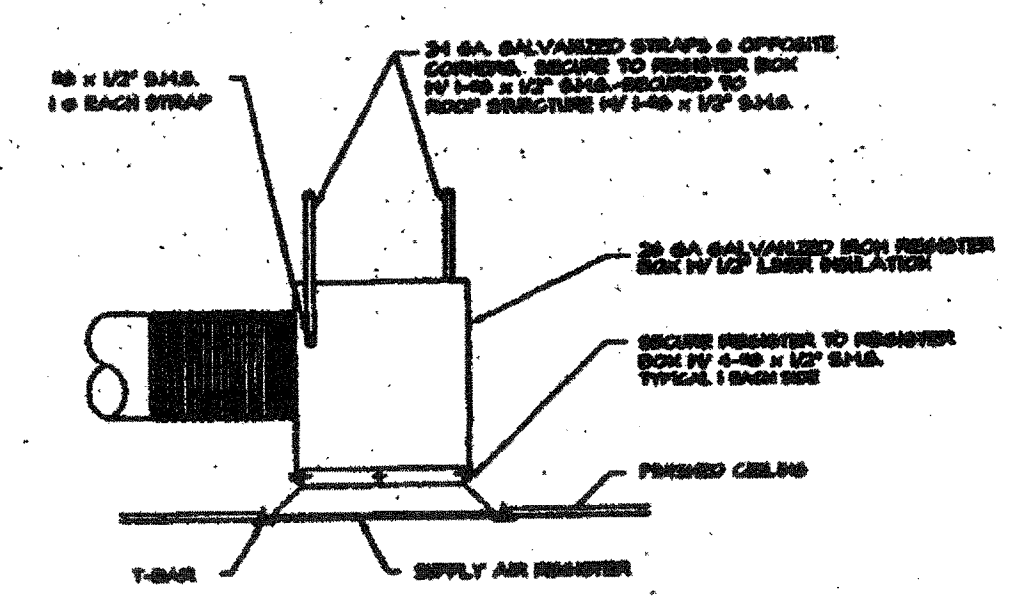

REGISTER BOX DETAIL N.T.S.

EQUIPMENT & MATERIAL SCHEDULE

- MARVAIR MODEL# AYP42HPA08NS WALL MOUNTED HEAT PUMP. 42500 BTUH COOLING, SEER = 10.20 42500 BTUH HEATING, HSPF = 6.40 1400 CFM NOMINAL @ 45°F, WT = 545 LBS. 208/230-1PH-60CY, MAXIMUM P.L.A. = 49.55 AMPS. W/FACORY MOTORIZED DAMPER
 - SUPPLY AIR PLENUM: GALV. IRON SHEETS W/ 1/2" LINER INSULATION
 - INTERIOR DUCTWORK: FLEX DUCT CLASS 1 UL-181
 - REGISTER BOXES: GALV. IRON SHEETS W/ 1/2" LINER INSULATION
 - SUPPLY AIR REGISTERS: KRUESSER '204-P28' SERIES
 - RETURN AIR GRILLES: METALAIRE 'R4' SERIES
 - THERMOSTAT: WHITE RODGERS '1P42 (6 +48" A.P.P.)
- ATTACH ALL SUPPLY AND RETURN AIR REGISTERS TO REGISTER BOXES WITH 4-80x1/2" S.M.S. - ATTACH REGISTER BOX TO ROOF STRUCTURE WITH 2-1 1/2" GALV. STRAPS AT OPPOSITE CORNERS

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITECT APP03 116978 AGC FLS MISS REC Date MAY 03 2016