

THESE DRAWINGS AND ALL MATERIAL CONTAINED HEREIN ARE THE PROPERTY OF SILVERCREEK INDUSTRIES, INC. (SCI) AND SHALL NOT BE REPRODUCED, COPIED OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY AND SHALL NOT BE USED IN WHOLE OR IN PART TO ASSIST IN THE MAKING OF OR FOR THE PURPOSE OF FURNISHING ANY INFORMATION FOR THE MAKING OF DRAWINGS, PRINTS, APPARATUS OR PARTS THEREOF WITHOUT THE FULL KNOWLEDGE AND WRITTEN CONSENT OF SCI. ALL PATENTABLE MATERIAL CONTAINED HEREIN AND ORIGINATING WITH SCI SHALL BE THE PROPERTY OF SCI.

SILVERCREEK INDUSTRIES, INC.



195 EAST MORGAN AVENUE, CALIFORNIA 92571
PHONE: 951-948-8999 FAX: 951-948-3211



PROJECT NAME:
CLASS LEASING CLASSROOM BLDG'S

SHEET TITLE:
ROOF FRAMING DETAILS TRUSS


TRUSS MARK	QTY	Yr
A TOP CHORD	4" x 3" x 1/4" (LLV)	1 1/4
B BOTTOM CHORD	4" x 3" x 1/4" (LLV)	1 1/4
C END DIAGONALS @ EACH END	2" x 2" x 1/4"	2/16
D TYPICAL DIAGONALS	1 1/2" x 1 1/2" x 3/16"	2/16
E END VERTICAL @ EACH END	1 1/2" x 1 1/2" x 3/16"	2/16
F TYPICAL VERTICALS	1 1/2" x 1 1/2" x 3/16"	2/16

STAVAREZ ARCHITECTS INC. 12/22/2011


REVISED FEB 26 2015

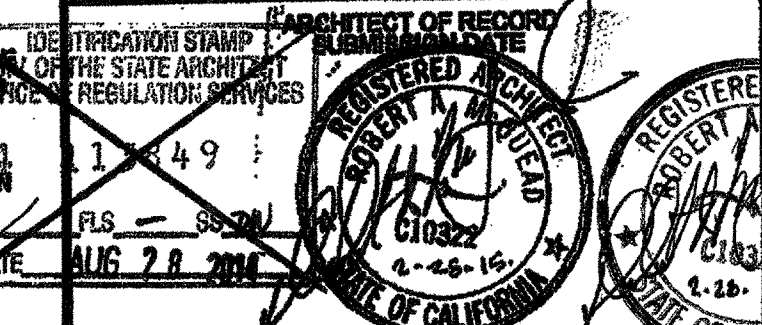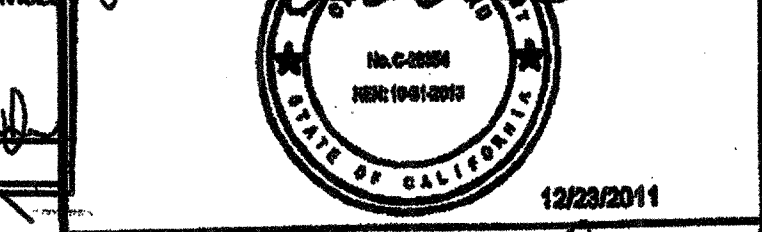

PROJECT SPECIFIC STATE AGENCY APPROVAL

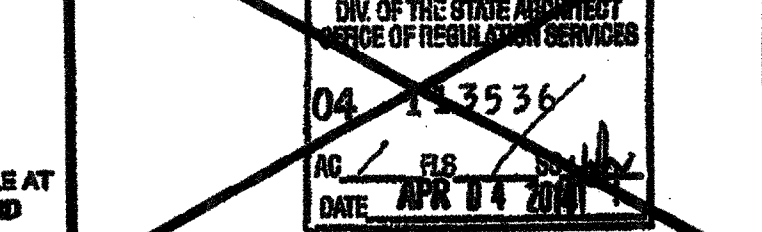

ORIGINAL PC STATE AGENCY APPROVAL

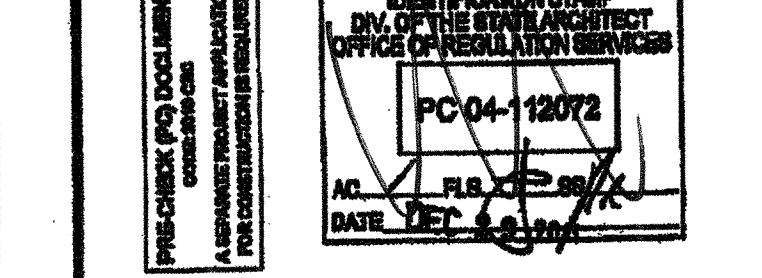


REVISIONS

SILVERCREEK INDUSTRIES
24" x 40" PC


PROJECT NO:
DRAWN BY:
SCALE: AS NOTED

DATE: 12-22-11
P.C. SHEET NUMBER


S-2.90 STKP 140

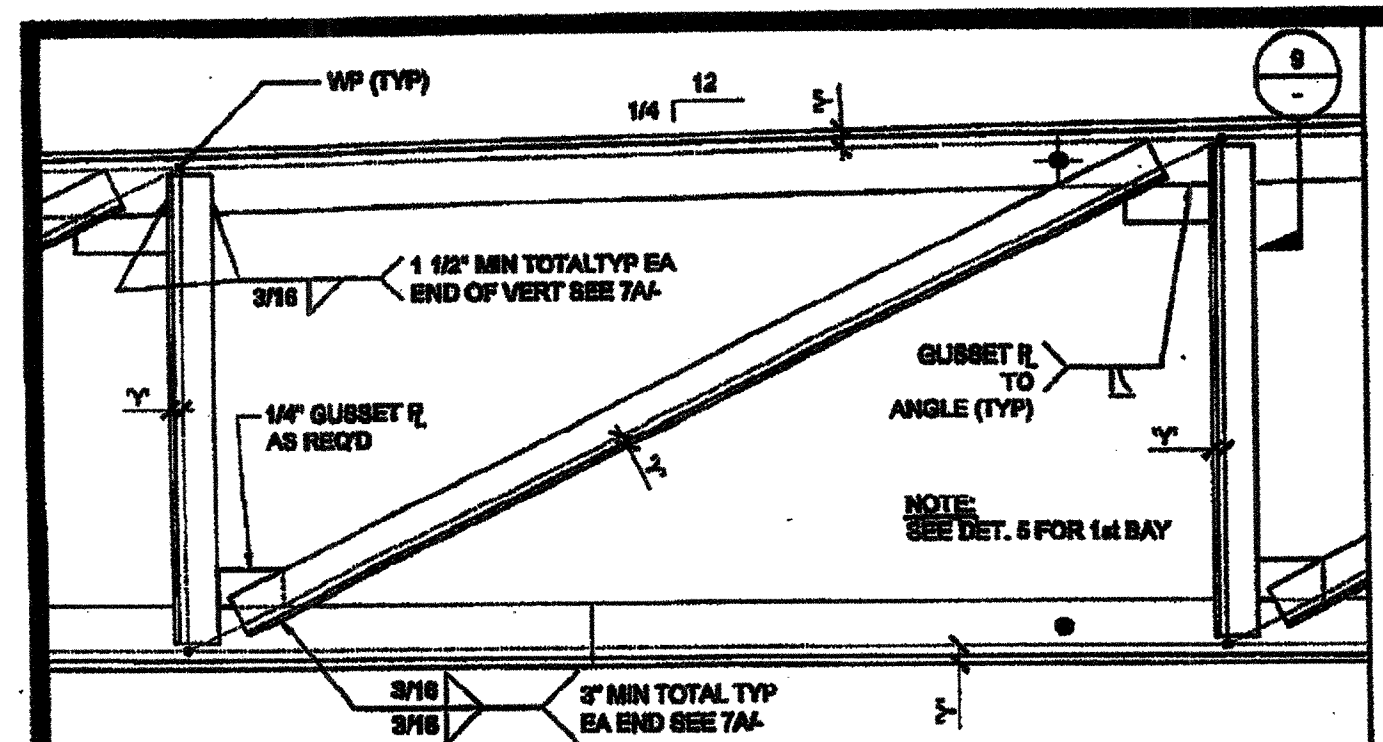


TYP. VERTICAL & DIAGONAL (U.N.O.) SCALE: 1 1/2" = 1'-0" 6

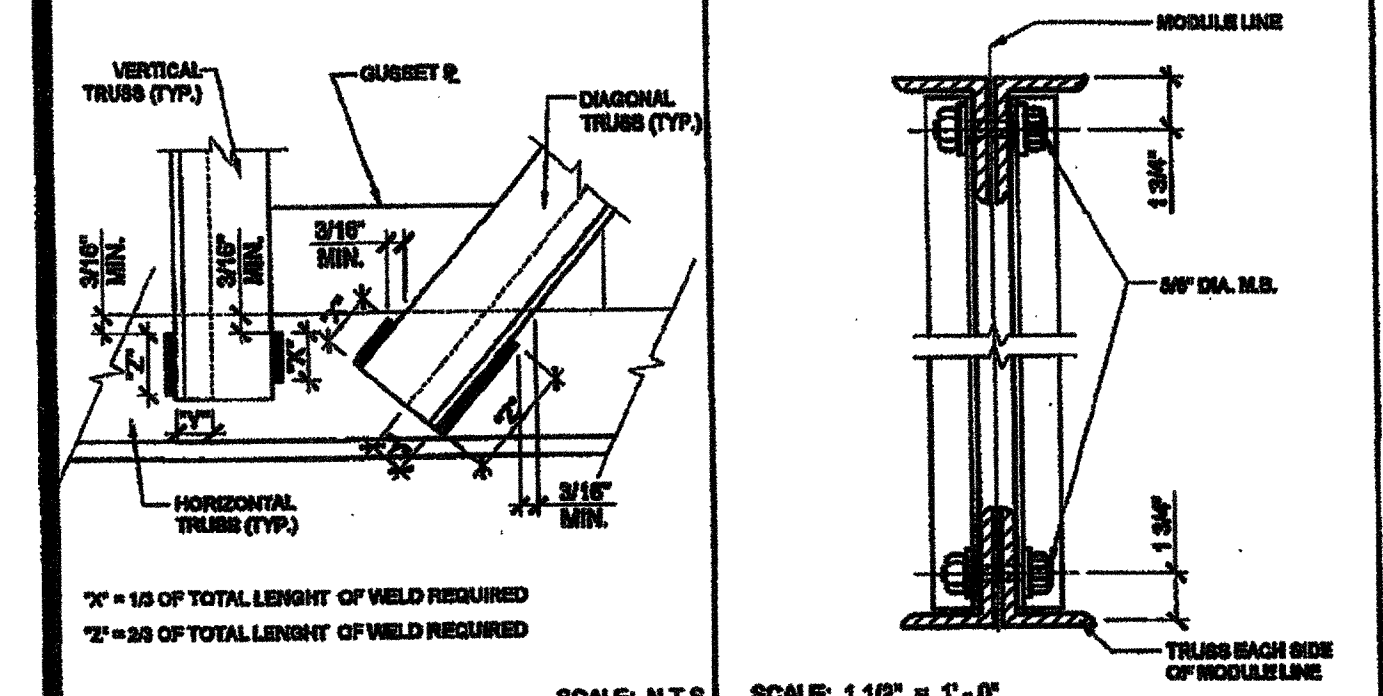


FILLET WELD TERMINATION 7A CONNECTION @ MODULE LINE SCALE: 1 1/2" = 1'-0" 7

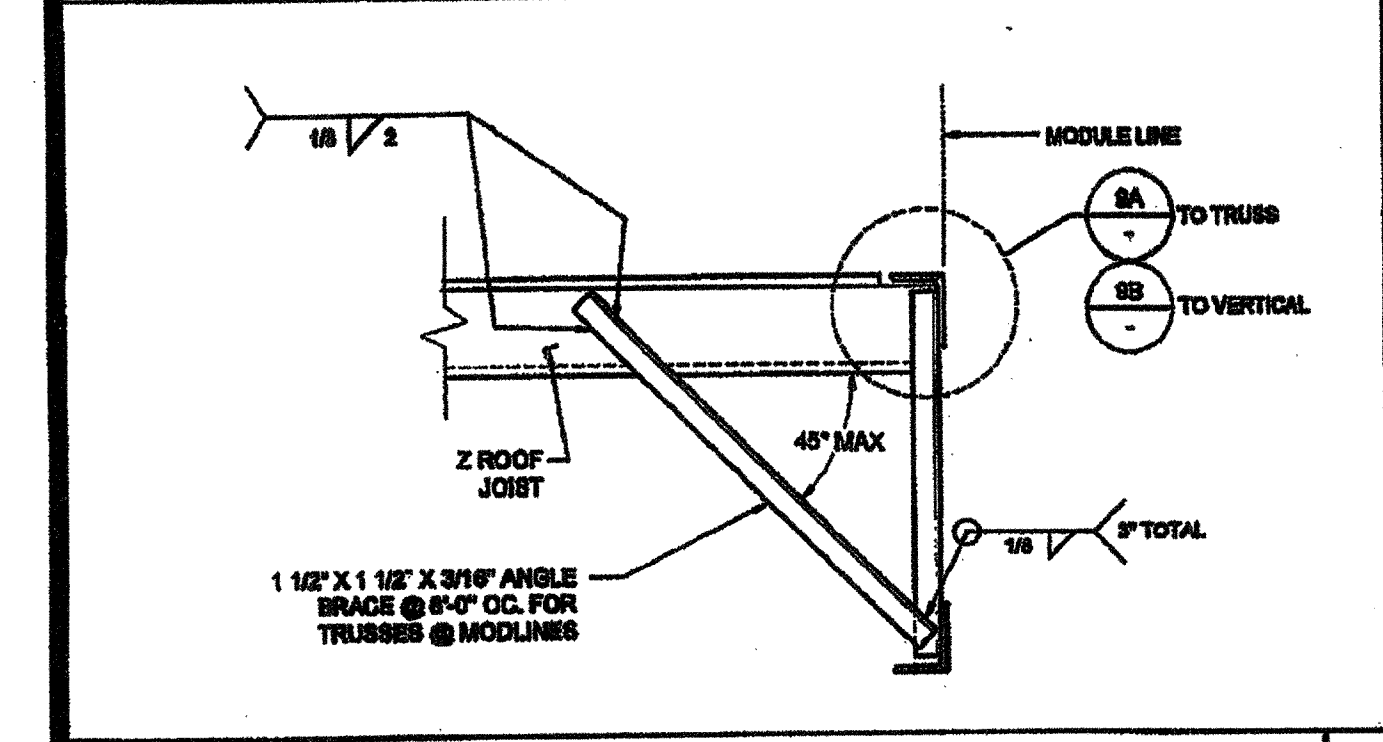


BRACE @ TRUSS & MATING LINE SCALE: 1 1/2" = 1'-0" 8

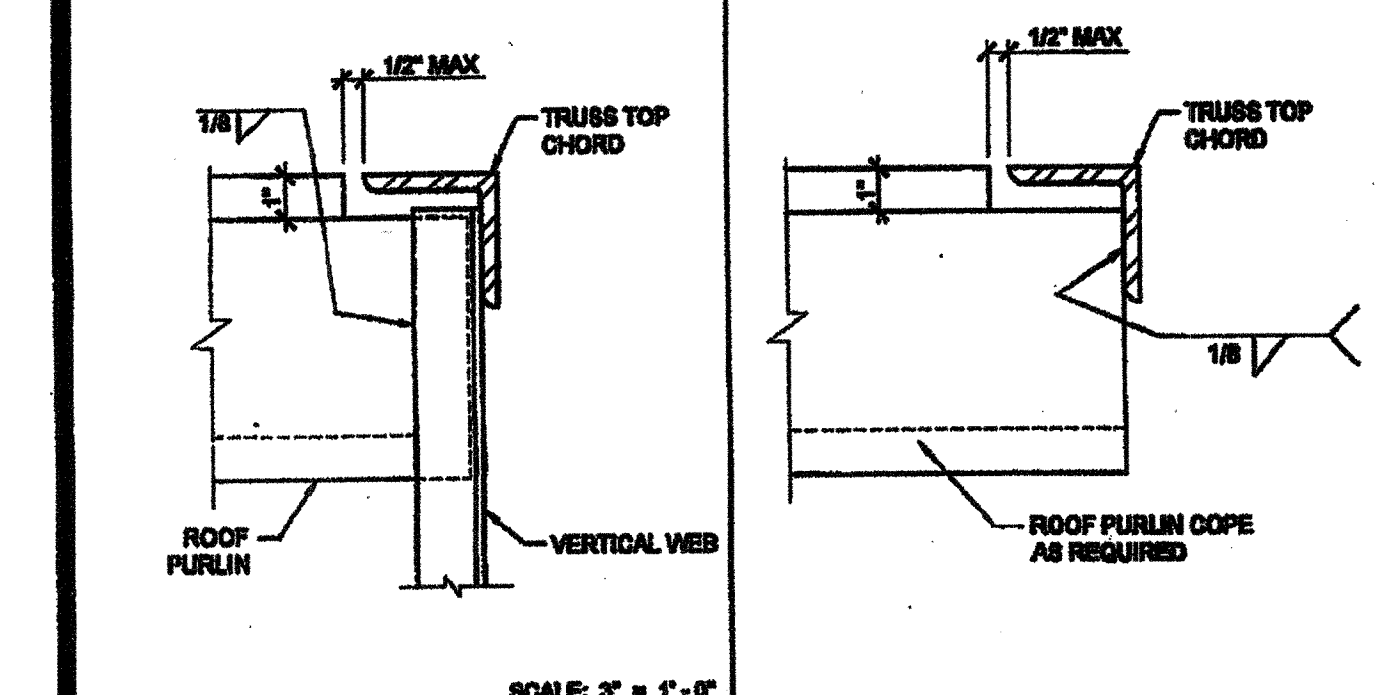

PURLIN TO VERT. ANGLE CONN. 9B PURLIN TO TRUSS CONN. SCALE: 3/4" = 1'-0" 9A

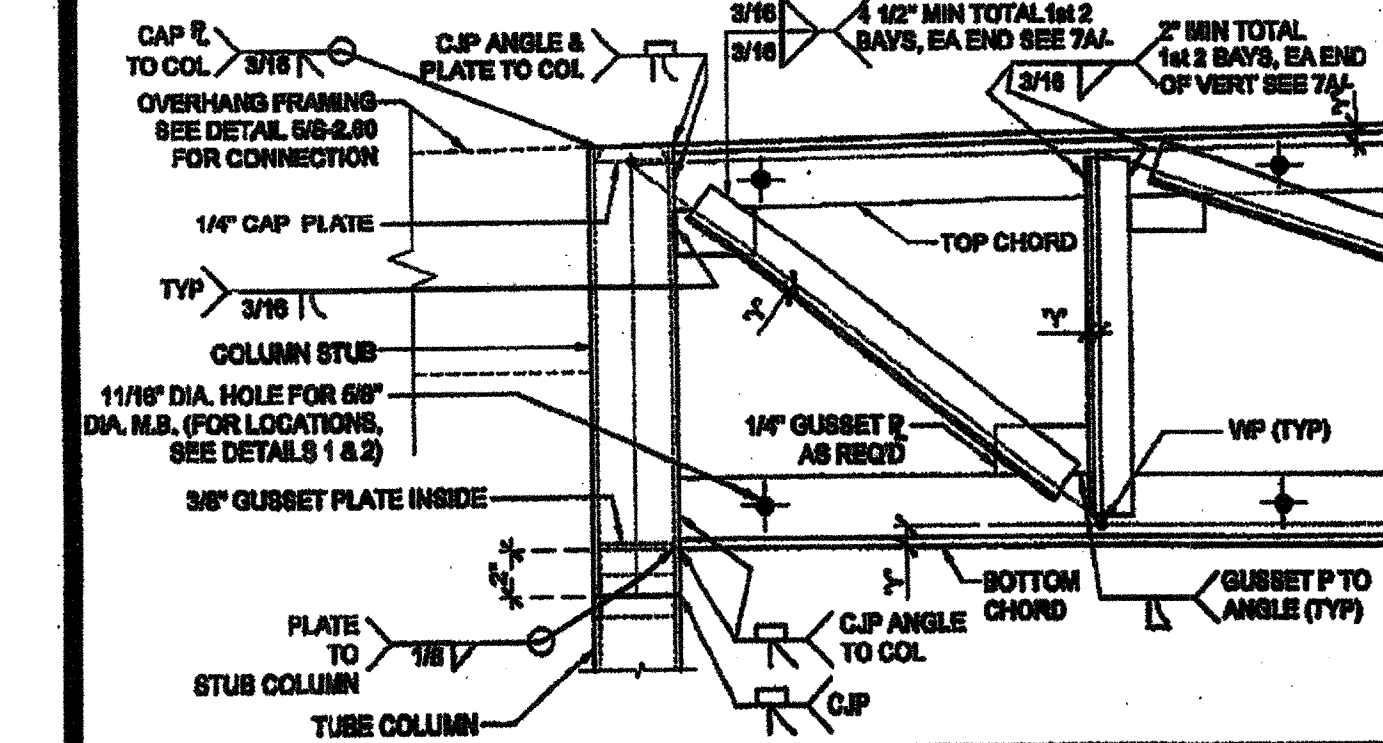


TRUSS TO COLUMN / OH FRAME CONN. SCALE: 1 1/2" = 1'-0" 10

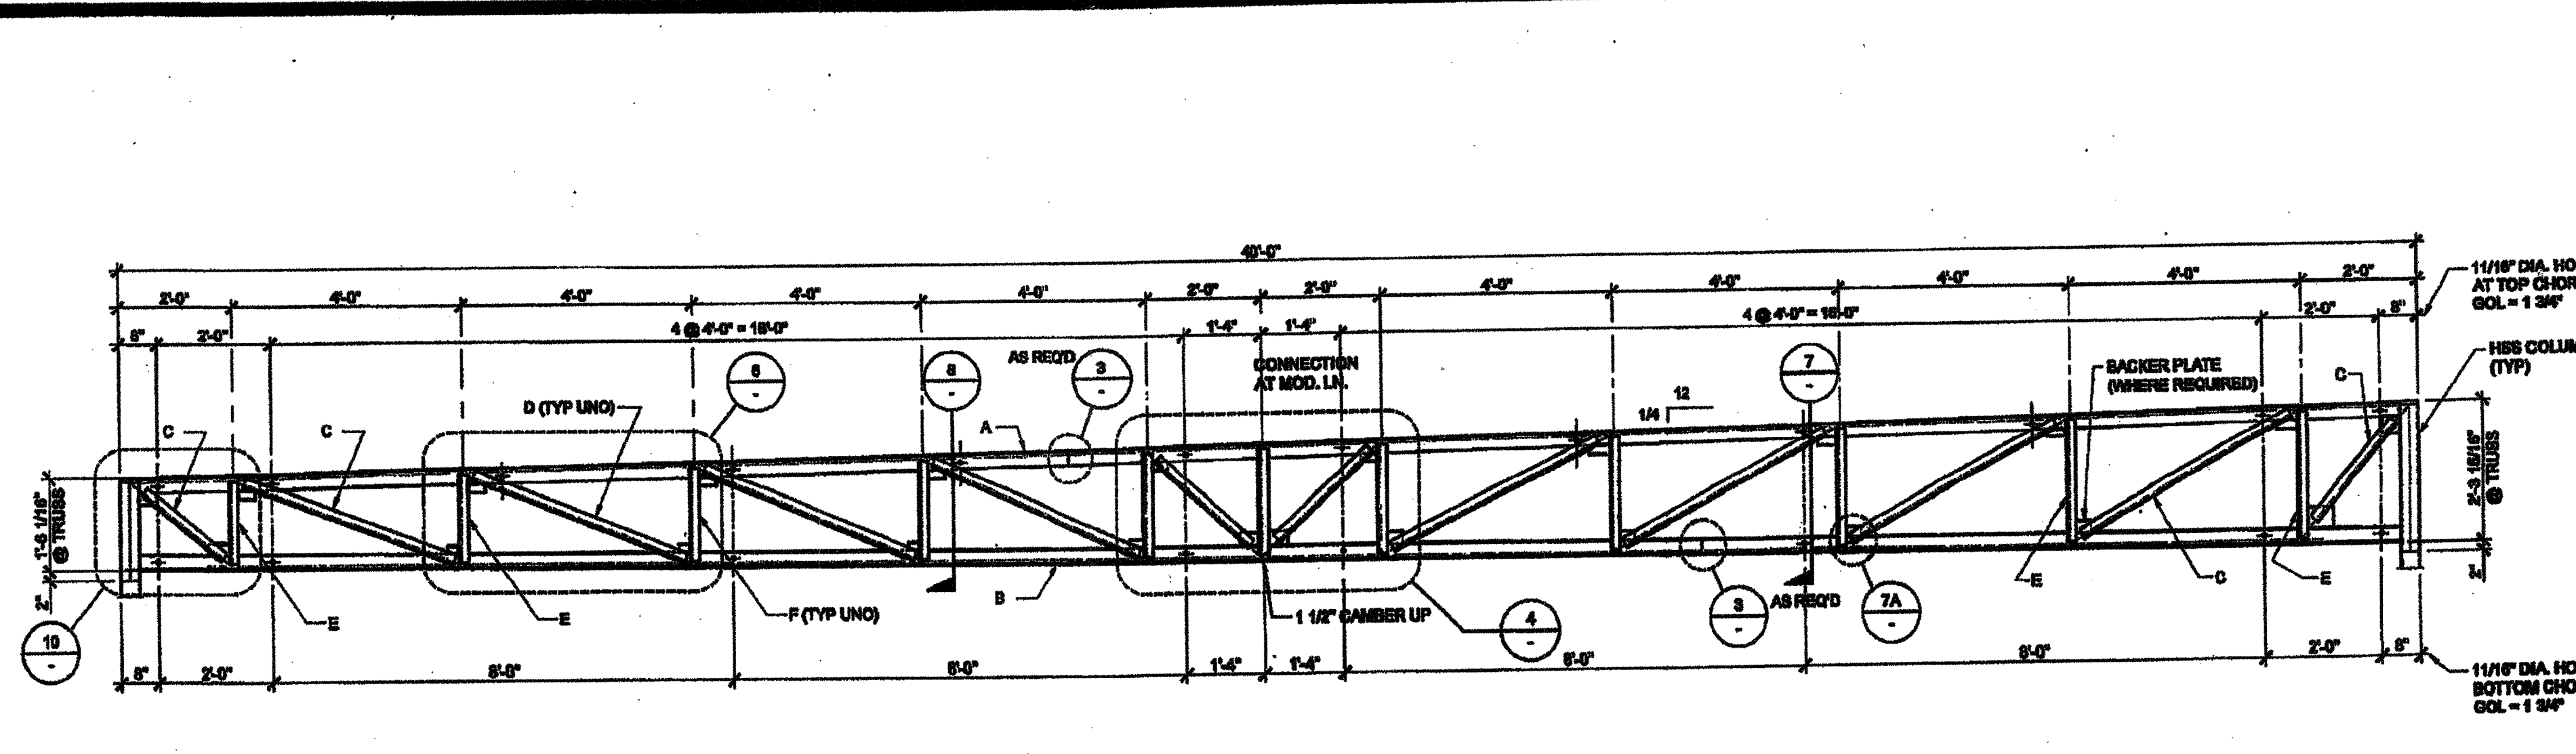

MONO SLOPE TRUSS SCALE: 1/2" = 1'-0" 1

NOTES:
1. ALL STEEL GRADES TO BE A-36 WITH 58 K.S.I. MIN. YIELD
2. REQUIRED ELECTRODES FOR ALL WELDS TO BE E-70
3. VOLTAGE & AMPERAGE SHALL BE PER ELECTRODE MANUFACTURER'S SPECIFICATIONS
4. BOLTS AND NUTS GRADES TO BE A307


IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
04 114277
AC [Signature]
DATE APR 23 2015

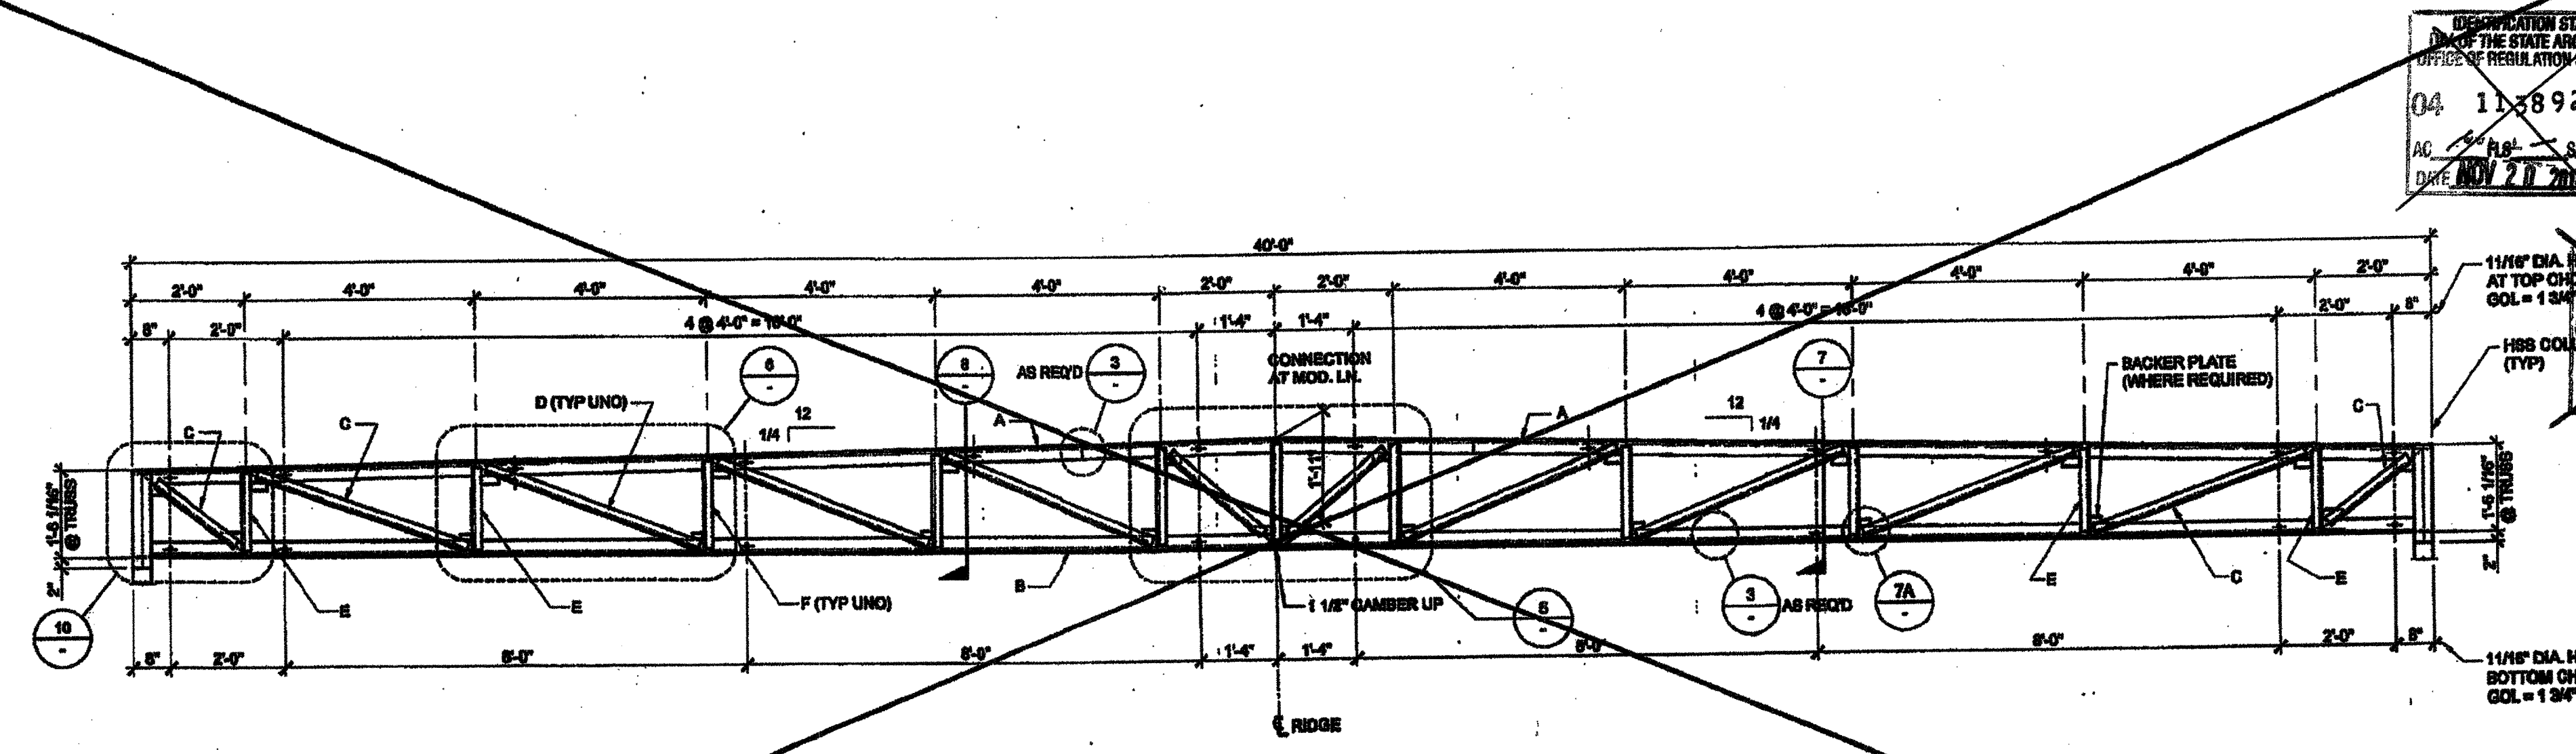


DUAL SLOPE TRUSS SCALE: 1/2" = 1'-0" 2

NOTES:
1. ALL STEEL GRADES TO BE A-36 WITH 58 K.S.I. MIN. YIELD
2. REQUIRED ELECTRODES FOR ALL WELDS TO BE E-70
3. VOLTAGE & AMPERAGE SHALL BE PER ELECTRODE MANUFACTURER'S SPECIFICATIONS
4. BOLTS AND NUTS GRADES TO BE A307


IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
04 113536
AC [Signature]
DATE APR 04 2015

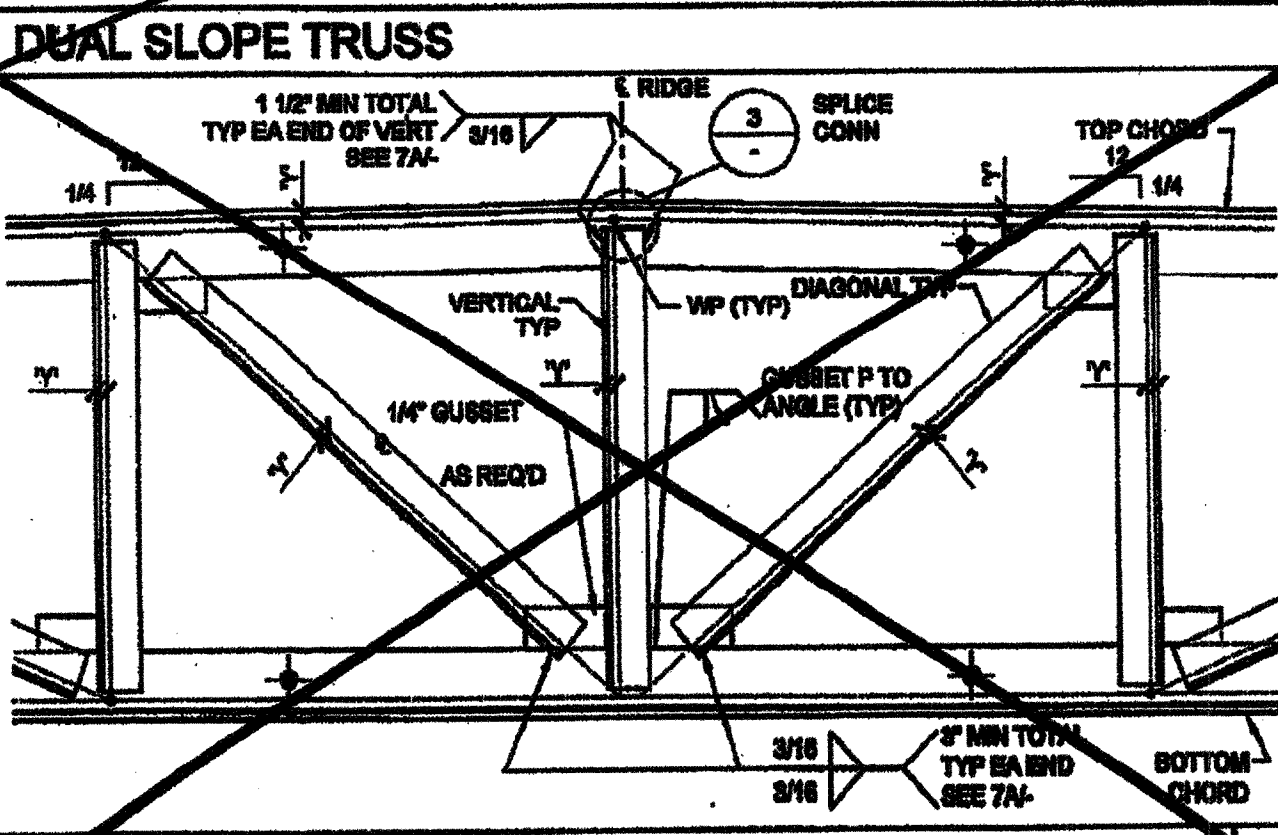

VERT. & DIAG. AT MID-POINT SCALE: 1 1/2" = 1'-0" 5

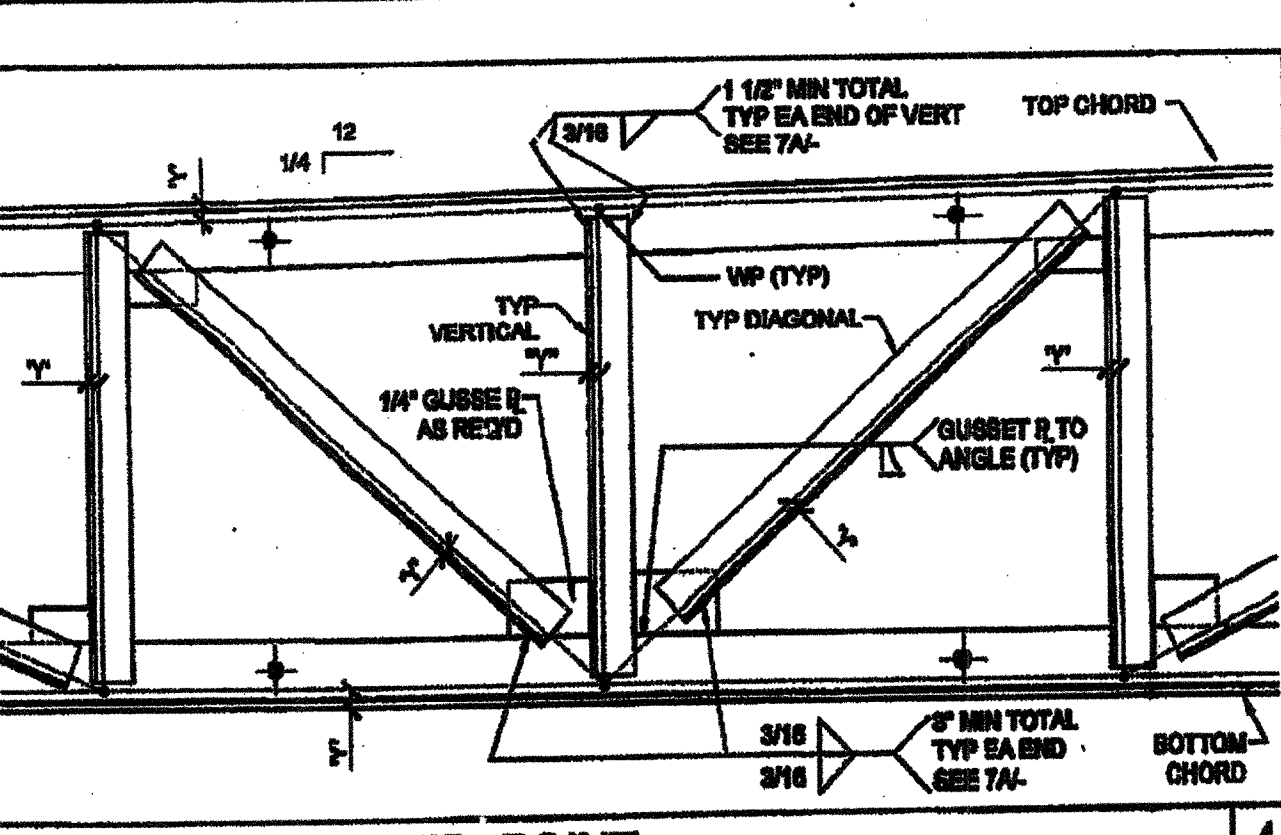

VERT. & DIAG. AT MID-POINT SCALE: 1 1/2" = 1'-0" 4

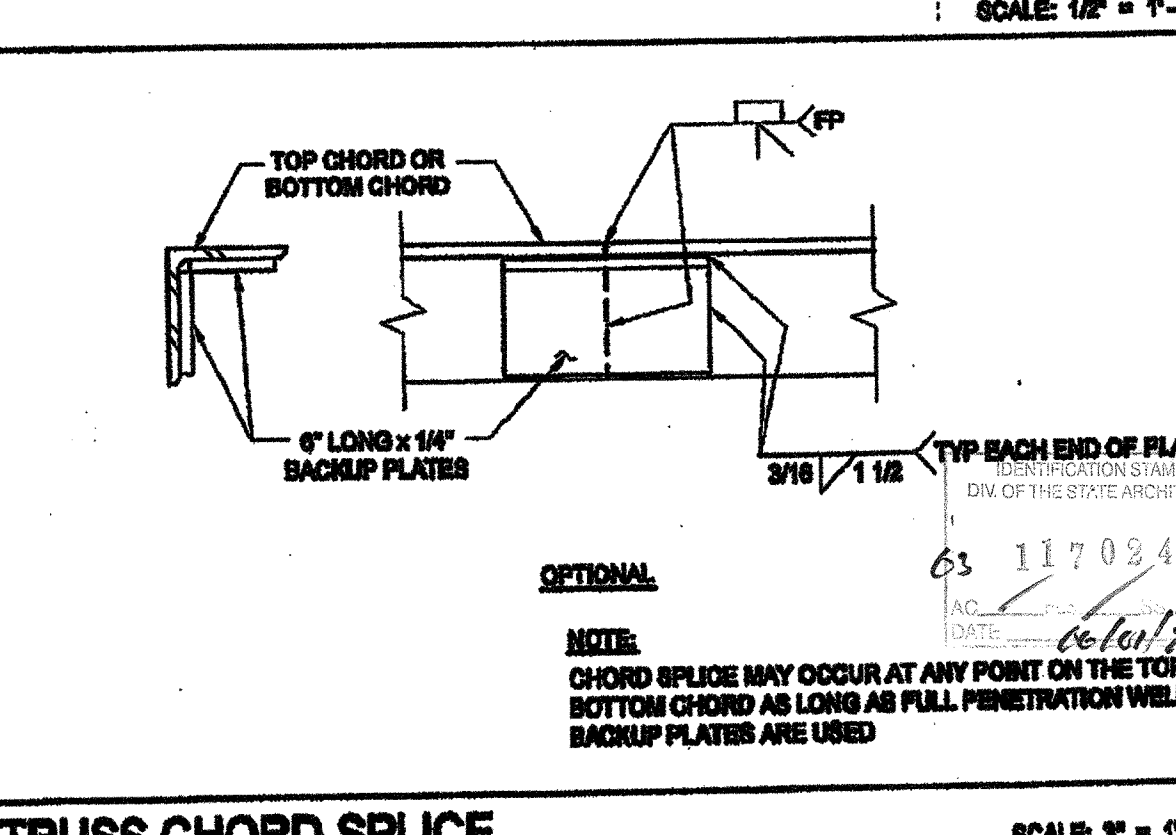

TRUSS CHORD SPLICE SCALE: 3/4" = 1'-0" 3