


WINDOW SCHEDULE

WINDOW NO.	QTY	TYPE	WIDTH	HEIGHT	FUNCTION	FRAME MATERIAL	GLASS MATERIAL	WALL THICKNESS	NOTES
A	1	3'-0"	4'-0"	XOX	ANOD	DP			
B	2	4'-0"	4'-0"	XO	ANOD	DP			

WINDOW FINISH

ANOD: CLEAR ANODIZED ALUMINUM FRAME
 BRONZ: BRONZE ANODIZED ALUMINUM FRAME
 PAINT: PAINTED FRAME
 WF: WELD WELDED FRAME
 FRG: FIRE RATED WINDOW FRAME: MIN 0.04" THICK WELDED FRAME
 FRG: FIRE RATED GLAZING: 1/2" WIRED GLASS, LABELED TO MEET THE REQUIREMENTS FOR A 3/4 HOUR FIRE WINDOW ASSEMBLY PER CBC SECTION TABLE 716.5

WINDOW TYPE

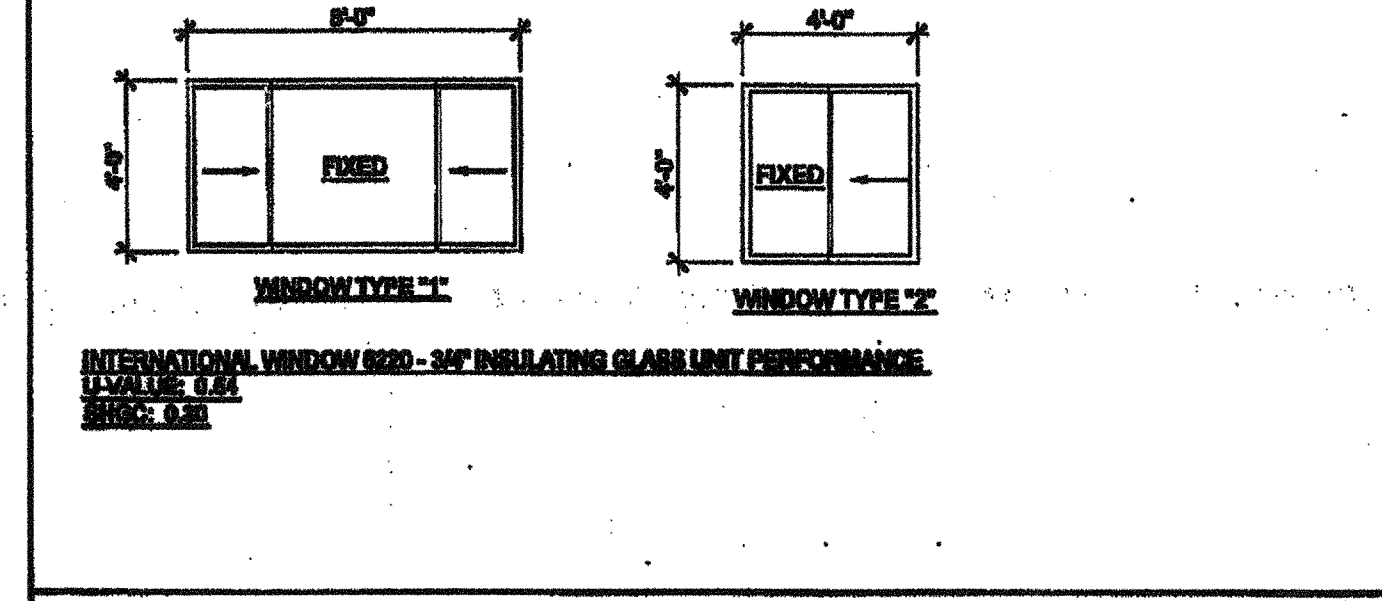


DOOR SCHEDULE

DOOR NO.	WIDTH	HEIGHT	DOOR TYPE	QTY	DOOR MAT/FIN	FRAME MAT/FIN	HARDWARE SET	WALL THICKNESS	NOTES
1	3'-0"	7'-0"	A	1	HM	HD	HW-1	5 1/2"	2x6 WALL
2	3'-0"	7'-0"	A1	1	HM	HD	HW-2	5 1/2"	2x6 WALL
3	3'-0"	7'-0"	A	1	HM	HD	HW-3	5 1/2"	
4	3'-0"	7'-0"	B	1	HM	HD	HW-4	5 1/2"	
5	3'-0"	7'-0"	B	1	HM	HD	HW-5	5 1/2"	NO CLOSER REQUIRED
6	3'-0"	7'-0"	C	1	HM	HD	HW-6	5 1/2"	

DOOR MATERIAL AND FINISH ABBREVIATIONS

HM: 18GA HOLLOW METAL
 WF: 18GA WELDED FRAME
 AL: ALUMINUM
 SST: STAINLESS STEEL
 HD: WIND DOWN FRAME
 SOL: SOLID CORE WOOD LEGACY
 HW: HOLLOW CORE WOOD
 PT: PAINTED

DOOR TYPES & NOTES

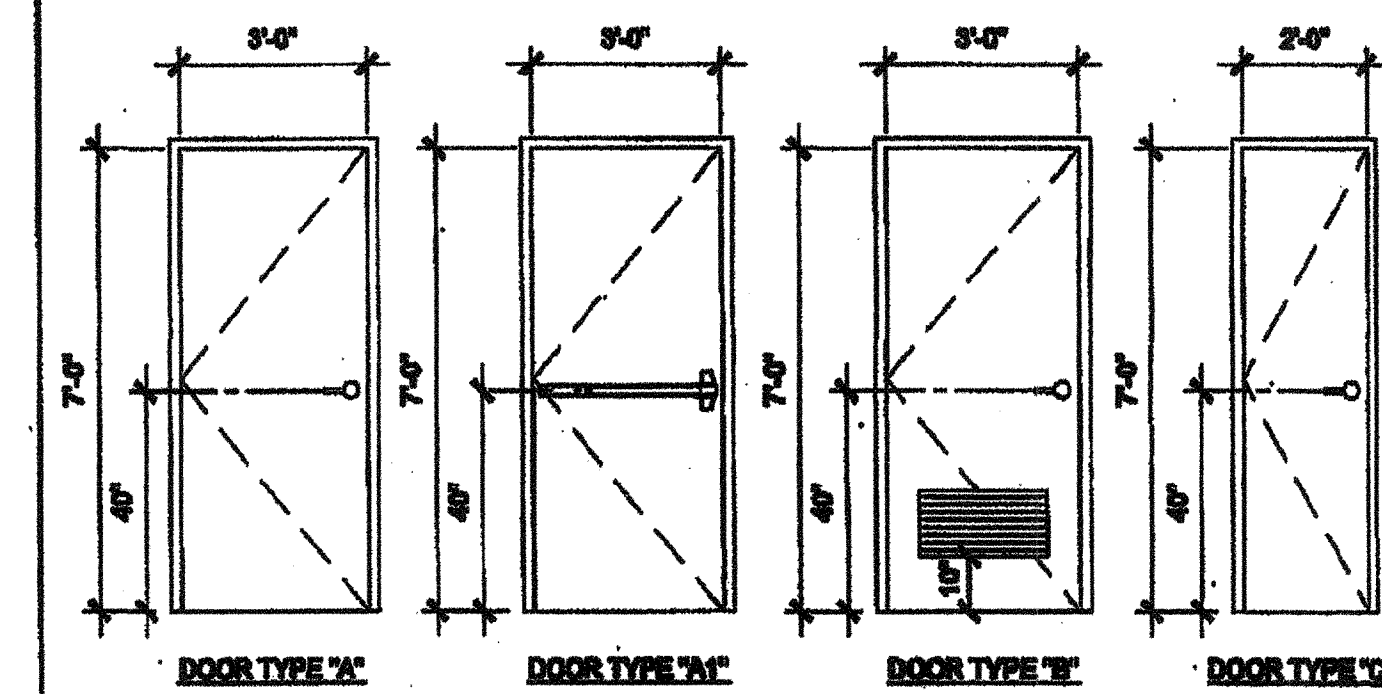

- DOOR HANDLE FOR LOCKSETS AND PANIC HARDWARE TO BE CENTERED AT 40" AFF. HARDWARE TO BE OPENED FROM THE INSIDE WITHOUT THE USE OF A KEY OR SPECIAL KNOWLEDGE OR EFFORT. LEVERS TO RETURN TO WITHIN 1/2" OF DOOR.
- ALL DOORS SHALL BE 1 3/4" THICK U.N.O.
- CLOSER SHALL BE SET FOR MAXIMUM OPENING PRESSURE OF 5 LBS AT EXTERIOR AND INTERIOR DOORS.
- PANIC HARDWARE IS REQUIRED TO BE INSTALLED WHEN THE CONFIGURATION OF ANY ROOM PROVIDES AN OCCUPANT LOAD OF 50 OR GREATER. CBC 1008.1.10
- ALL HARDWARE SHALL COMPLY WITH SILVER CREEK'S SPEC'S ON THIS SHEET AND CBC SECTIONS 11B-205.5, 11B-404.1 AND 1008.
- DOOR CLOSER SHALL BE ADJUSTED TO SO THAT FROM AN OPEN POSITION OF 70°, THE DOOR WILL TAKE AT LEAST 3 SECONDS TO MOVE TO A POINT 3" FROM THE LATCH, MEASURED TO THE LANDING SIDE OF THE DOOR.
- PANIC AND FIRE EXIT HARDWARE WHERE THIS TYPE HARDWARE IS INSTALLED, IT SHALL COMPLY WITH THE FOLLOWING - THE ACTUATING PORTION OF THE RELEASING DEVICE SHALL EXTEND AT LEAST ONE-HALF OF THE DOOR LEAF WIDTH - THE MAXIMUM UNLATCHING FORCE SHALL NOT EXCEED 50 LBS PER THE 2013 CBC APPROVED BY AUTHORITY W/ JURISDICTION, PANIC HARDWARE SHALL COMPLY WITH CBC SECTION 1008.1.10
- THE FIRE PROTECTION FOR EXTERIOR WALL IS DETERMINED BASED UPON THE FIRE SEPARATION DISTANCE IN WHICH THE WALL IS LOCATED. SEE CBC TABLE 705.8 OR TABLE 602

FINISH SCHEDULE

ROOM NAME	FLOORING		WALL FINISH				CEILING		NOTES
	FLOOR	BASE	FRONT	LEFT	REAR	RIGHT	CEILING	CEILING HT	
CLASSROOM	GRP	GRP	TACK	TACK	TACK	TACK	OP	8'-0"	
CLASSROOM	GRP	GRP	TACK	TACK	TACK	TACK	OP	8'-0"	
CLASSROOM	GRP	GRP	TACK	TACK	TACK	TACK	OP	8'-0"	
CLASSROOM	GRP	GRP	TACK	TACK	TACK	TACK	OP	8'-0"	
CLASSROOM	GRP	GRP	TACK	TACK	TACK	TACK	OP	8'-0"	
CLASSROOM	GRP	GRP	TACK	TACK	TACK	TACK	OP	8'-0"	
CLASSROOM	GRP	GRP	TACK	TACK	TACK	TACK	OP	8'-0"	
CLASSROOM	GRP	GRP	TACK	TACK	TACK	TACK	OP	8'-0"	
CLASSROOM	GRP	GRP	TACK	TACK	TACK	TACK	OP	8'-0"	
PLUMBING CHASE									

FLOOR, WALL, CEILING MATERIALS

FLOORING
 GRP: CARPET PER STATE OF CALIFORNIA SPECIFICATIONS COMPLYING WITH GROUP 1; TYPE "W" OR TYPE "B"; CLASS 2; DENSITY 400; DIRECT GLUE DOWN
 SV: SHEET VINYL FLOORING
 VOT: VINYL COMPOSITION TILE
BASE
 4" TS: 4" TOP SET BASE
 6" TS: 6" TOP SET BASE
 SC: 3" SELF-DOME BASE
WALLS
 TACK: 1/2" VINYL TACKBOARD CLASS 1 OVER 1/2" GYPSUM BOARD BACKING
 FRP: 1/2" FIBER REINFORCED PANEL OVER 1/2" WATER RESISTANT GYPSUM BOARD
 GYP: 1/2" GYPSUM BOARD; TAPE; TEXTURE: PAINTED FINISH
 PLY: 1/2" PLYWOOD FINISH
 NP: NO FINISH
CEILING
 OP: ACoustICAL LAY IN GRID CEILING PANELS (SEE SPECIFICATION NOTES ON REFLECTED CEILING PLAN)
 HC: 5/8" GYPSUM BOARD; TAPE; TEXTURE: PAINTED FINISH (HARD LID CEILING)
 GBP: 1/2" GYPSUM BOARD VISIBLE PANELS (PAINTED)

FINISH NOTES

- ALL FINISHES SHALL COMPLY WITH CBC, CFC AND TITLE 19 OCR.
- PREPARATION FOR SUB-FLOOR TO ACCEPT FINISH FLOORING IS BY FLOORING CONTRACTOR. PLYWOOD SUB-FLOOR IS 2x1 PLYWOOD. OUTER PLYWOOD IS PLUGGED AND TOUCH SANDED. ANY DEFORMITIES DUE TO STANDARD CONSTRUCTION PRACTICES SHALL BE FILLED AND SANDED BY FLOORING CONTRACTOR. THE JOINT AT THE MOULINE SHALL NOT BE LARGER THAN 1/8" AND SHALL BE FILLED AND SANDED BY FLOORING CONTRACTOR.
- RESILIENT FLOORING DEMONSTRATING A COEFFICIENT OF FRICTION OF AT LEAST 0.6 PER ASTM D2047, WILL BE ACCEPTED AS MEETING THE INTENT OF SLIP RESISTANCE.
- CARPET SHALL HAVE A LEVEL LOOP, TEXTURED LOOP, LEVEL OUT, OR LEVEL OUT / UNLATCH FILE TEXTURE AND MAXIMUM FILE HEIGHT OF 1/2" PER CBC SECTION 11B26.3. CARPET EDGED SHALL COMPLY WITH CBC SECTION 11B26.2

DOOR HARDWARE

CLASSROOM -	EXTERIOR DOOR HW-1
LOCKSET: SCHLAGE NORTON/POH2000 (cylindrical)	Finish 200 or equal
BUTTS: HAGER BB1191 4 1/2" x 4 1/2" NRP	Finish 200 or equal
CLOSER: FALCON 889	Finish 000 or equal
WEATHER STRIP: HAGER 8918AV 2004	Finish Alum or equal
THRESHOLD: HAGER 4188A 26	Finish Alum or equal
DOOR BOTTOM: HAGER 788AV 36N	Finish Alum or equal
DOOR W/ PANIC HARDWARE -	EXTERIOR DOOR HW-2
EXIT DEVICE: VON DUFRIN 99LZ-PA	Finish Alum or equal
BUTTS: HAGER BB1191 4 1/2" x 4 1/2" NRP	Finish 200 or equal
CLOSER: FALCON 889	Finish 000 or equal
WEATHER STRIP: HAGER 8918AV 2004	Finish Alum or equal
THRESHOLD: HAGER 4188A 26	Finish Alum or equal
DOOR BOTTOM: HAGER 788AV 36N	Finish Alum or equal
STAFF RESTROOM / SINGLE OCCUPANCY -	INTERIOR DOOR HW-3
LOCKSET: SCHLAGE NORTON/POH2000 (cylindrical)	Finish 200 or equal
BUTTS: HAGER BB1191 4 1/2" x 4 1/2" NRP	Finish 200 or equal
BOYS & GIRLS RESTROOM -	EXTERIOR DOOR HW-4
LOCKSET: SCHLAGE NORTON/POH2000 (cylindrical)	Finish 200 or equal
BUTTS: HAGER BB1191 4 1/2" x 4 1/2" NRP	Finish 200 or equal
CLOSER: FALCON 889	Finish 000 or equal
WEATHER STRIP: HAGER 8918AV 2004	Finish Alum or equal
THRESHOLD: HAGER 4188A 26	Finish Alum or equal
DOOR BOTTOM: HAGER 788AV 36N	Finish Alum or equal
LOUVER: HAGER 26 x 12	Finish Bronze or equal
STAFF RESTROOM -	EXTERIOR DOOR HW-5
LOCKSET: SCHLAGE NORTON/POH2000 (cylindrical)	Finish 200 or equal
BUTTS: HAGER BB1191 4 1/2" x 4 1/2" NRP	Finish 200 or equal
WEATHER STRIP: HAGER 8918AV 2004	Finish Alum or equal
THRESHOLD: HAGER 4188A 26	Finish Alum or equal
DOOR BOTTOM: HAGER 788AV 36N	Finish Alum or equal
LOUVER: HAGER 26 x 12	Finish Bronze or equal
PLUMBING CHASE DOOR -	INTERIOR DOOR HW-6
LOCKSET: SCHLAGE NORTON/POH2000 (cylindrical)	Finish 200 or equal
BUTTS: HAGER BB1191 4 1/2" x 4 1/2" NRP	Finish 200 or equal

INSULATION SPECIFICATIONS

MOISTURE PROTECTION INSULATION:
 DESCRIPTION OF WORK: THE FURNISHING AND INSTALLING OF ALL INSULATION FOR ALL CEILING, FLOOR AREAS, AND EXTERIOR WALLS. (CLASS 1 - 0-05 FLAME SPREAD) (SMOKE DEVELOPMENT DENSITY LESS THAN 45).
 MATERIAL: INSULATING MATERIAL FOR WALLS, CEILING, AND FLOORS SHALL BE FIBERGLASS BATT (UNFACED) AND SHALL COMPLY WITH CBC 718.2-718.3. INSULATION SHALL BE AS MANUFACTURED BY OWENS-CORNING FIBERGLASS CORPORATION, JOHNS-MANVILLE, CERTANTIER, OR EQUAL.

INSULATION VALUES:
 SEE SHEETS A-0.1, A-0.7, A-0.8 FOR REQUIRED INSULATION VALUES PER CLIMATE ZONE

EXTERIOR WALL INSULATION (MIN):
 R-13 (2x4)
 R-19 (2x6)
 R-20 (2x8)

INTERIOR WALL INSULATION (MIN):
 R-13

FLOOR INSULATION (MIN):
 NONE
 R-13
 R-19








ROOF INSULATION (MIN):
 R-19
 R-30
 R-35
 R-48 BETWEEN JOISTS AND R-10 BELOW JOISTS

THESE DRAWINGS AND ALL MATERIAL CONTAINED HEREIN ARE THE PROPERTY OF SILVERCREEK INDUSTRIES, INC. (SCI INC) AND SHALL NOT BE REPRODUCED, COPIED OR OTHERWISE SHIPPED OF WHOLELY OR IN PART TO ASSIST IN THE MAKING OF OR FOR THE PURPOSE OF FURNISHING ANY INFORMATION FOR THE MAKING OF DRAWINGS, PRINTS, APPENDICES OR PARTS THEREOF WITHOUT THE FULL KNOWLEDGE AND WRITTEN CONSENT OF SCI INC. ALL PATENTABLE MATERIAL CONTAINED HEREIN AND CONTINUING WITH SCI INC SHALL BE THE PROPERTY OF SCI INC.



PROJECT NAME:
CLASS LEASING CLASSROOM BLDG'S

SHEET TITLE:
SCHEDULES

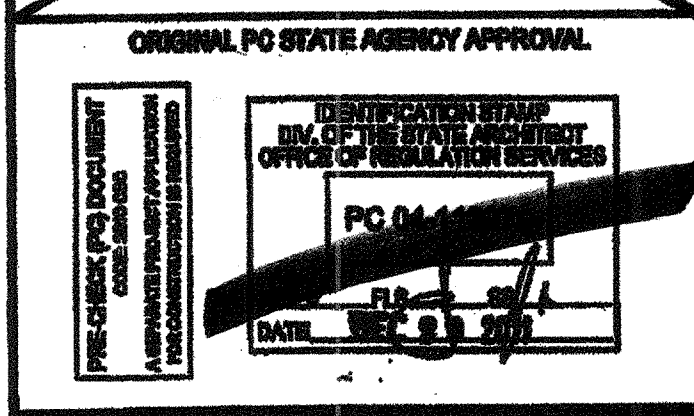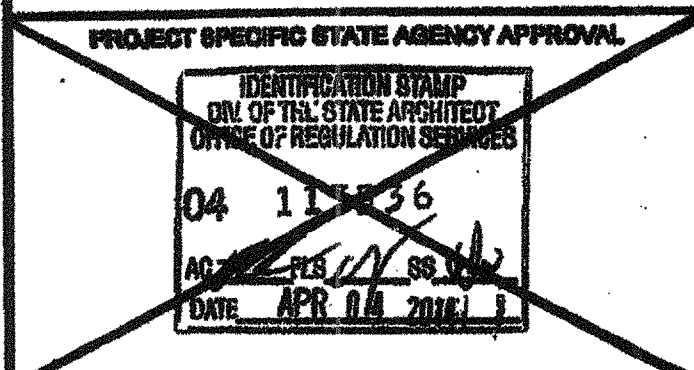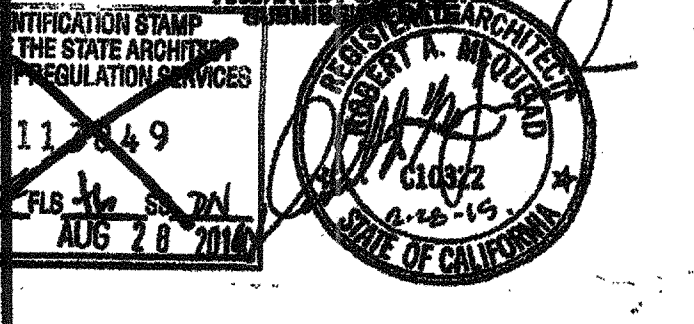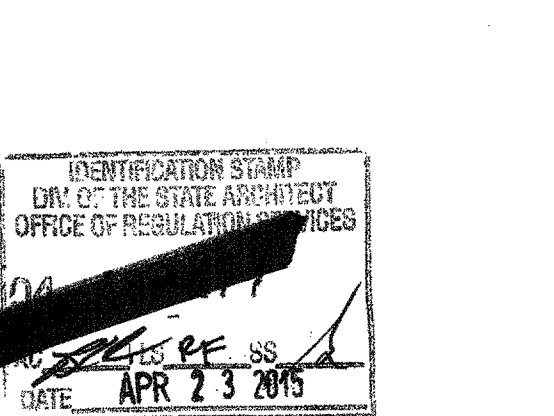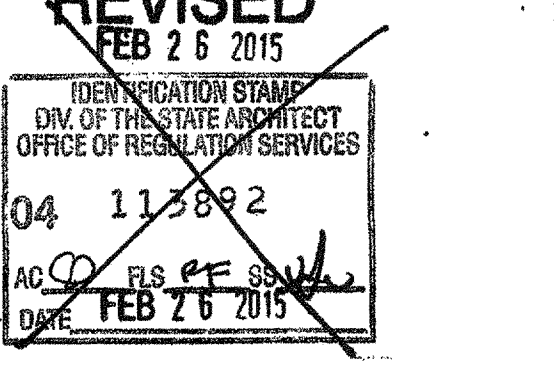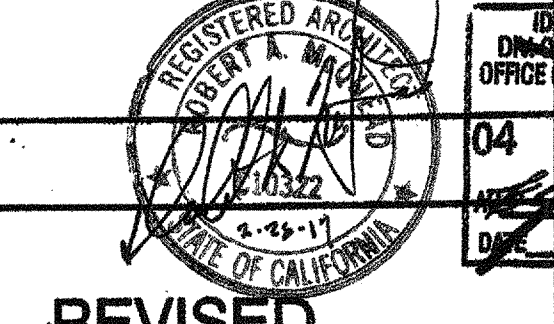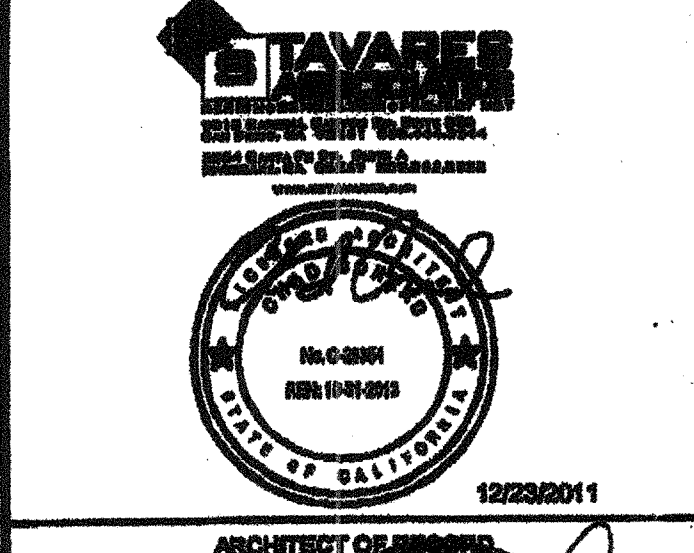

PROJECT NO:
 DRAWN BY:
 SCALE: AS NOTED
 DATE: 02-23-11

P.C. SHEET NUMBER
A-0.2
 STR#140

