


WINDOW SCHEDULE									
WINDOW NO.	QTY	TYPE	WIDTH	HEIGHT	FUNCTION	FRAME MATERIAL	GLASS MATERIAL	WALL THICKNESS	NOTES
A	1	8'-0"	4'-0"	XOX	ANOD	DP			
B	2	8'-0"	4'-0"	FIXED	FRW	FRG		45 MINUTE ASSEMBLY	

**WINDOW FINISH**

ANOD: CLEAR ANODIZED ALUMINUM FRAME  
 BRONZ: BRONZE ANODIZED ALUMINUM FRAME  
 PAINT: PAINTED FRAME  
 WF: 16GA WELDED FRAME  
 FRW: FIRE RATED WINDOW FRAME: MIN 0.06" THICK WELDED FRAME  
 FRG: FIRE RATED GLAZING: 1/4" WIRED GLASS. LABELED TO MEET THE REQUIREMENTS FOR A 3-HOUR FIRE WINDOW ASSEMBLY PER CBC SECTION 715.5

DP: 3/16" MINIMUM DUAL PANE TEMPERED GLASS OF SOLAR GRAY - 3/16" ENERGYSHIELD WITH A LIGHT TRANSMISSION FACTOR OF 40%. ALL OPERABLE SASH SHALL HAVE SCREENS.

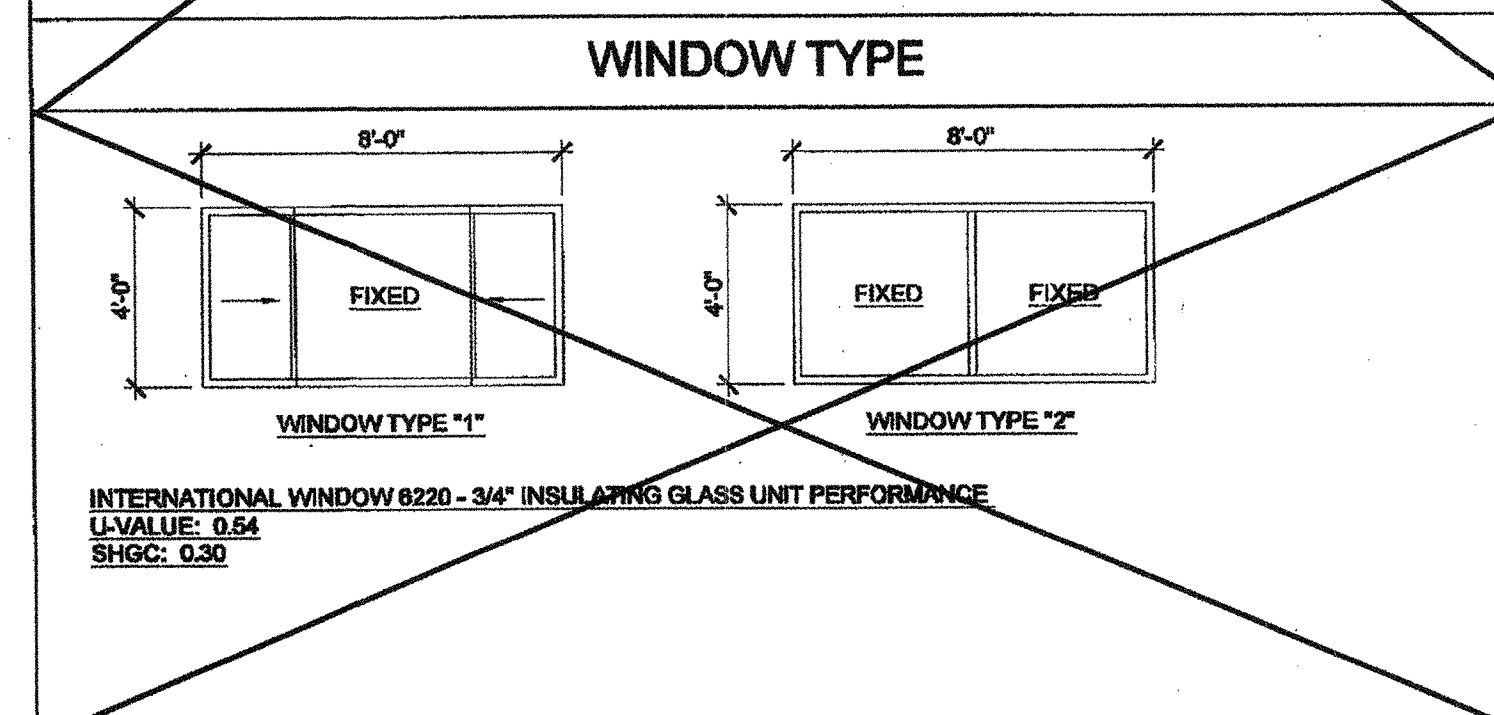


DOOR SCHEDULE									
DOOR NO.	WIDTH	HEIGHT	DOOR TYPE	QTY	DOOR MAT/FIN	FRAME MAT/FIN	HARDWARE SET	WALL THICKNESS	NOTES
1	3'-0"	7'-0"	A	2	HM	KD	HW-1	4 7/8"	
2	3'-0"	7'-0"	A	2	HM	KD	HW-2	4 7/8"	NO CLOSER REQUIRED
3	2'-0"	7'-0"	B		HM	KD	HW-3	4 1/8"	
4	3'-0"	7'-0"	C		HM	KD	HW-4	5 1/4"	

**DOOR MATERIAL AND FINISH ABBREVIATIONS**

HM: 16GA HOLLOW METAL  
 WF: 16GA WELDED FRAME  
 AL: ALUMINUM  
 SST: STAINLESS STEEL

KD: KNOCK DOWN FRAME  
 SCL: SOLID CORE WOOD LEGACY  
 HC: HOLLOW CORE WOOD  
 PT: PAINTED

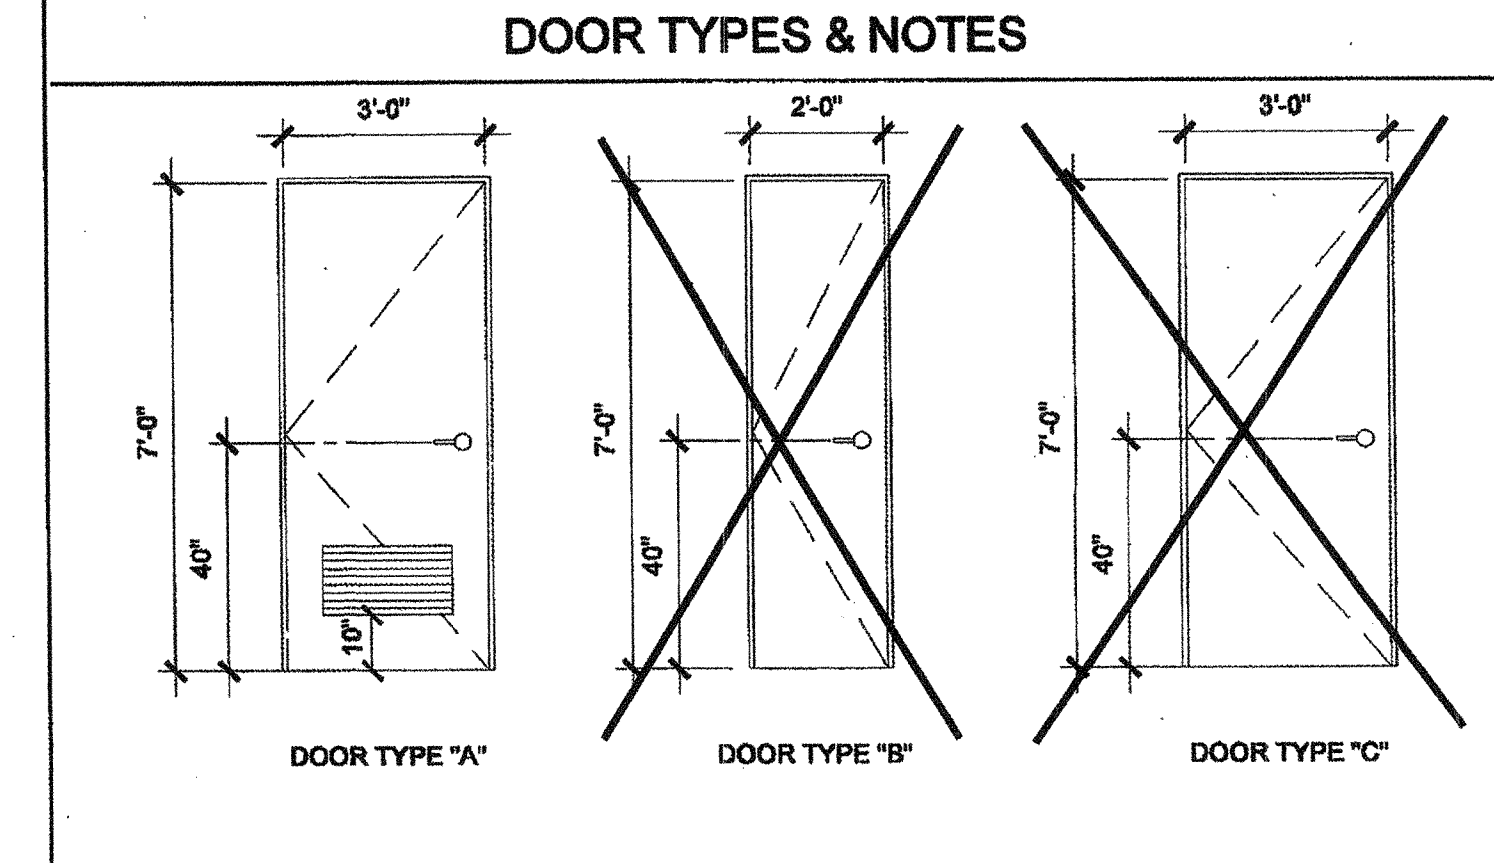

- DOOR HANDLE FOR LOCKSETS AND PANIC HARDWARE TO BE CENTERED AT 40" AFF. HARDWARE TO BE OPENED FROM THE INSIDE WITHOUT ANY SPECIAL KNOWLEDGE OR EFFORT. LEVERS TO RETURN TO WITHIN 1/2" OF DOOR.
- ALL DOORS SHALL BE 1 3/4" THICK U.L.O.
- CLOSER SHALL BE SET FOR MAXIMUM OPENING PRESSURE OF 5 LBS AT EXTERIOR AND INTERIOR DOORS.
- PANIC HARDWARE IS REQUIRED TO BE INSTALLED WHEN THE CONFIGURATION OF ANY ROOM PROVIDES AN OCCUPANT LOAD OF 50 OR GREATER. CBC 1008.1.10
- ALL HARDWARE SHALL COMPLY WITH SILVER CREEK'S SPECIFICATIONS ON THIS SHEET AND CBC SECTIONS 11338.2 AND 1008
- DOOR CLOSER SHALL BE ADJUSTED TO SO THAT FROM AN OPEN POSITION OF 70°, THE DOOR WILL TAKE AT LEAST 3 SECONDS TO MOVE TO A POINT 3" FROM THE LATCH, MEASURED TO THE LANDING SIDE OF THE DOOR 1133 B.2.5.1
- PANIC AND FIRE EXIT HARDWARE. WHERE PANIC AND FIRE EXIT HARDWARE IS INSTALLED, IT SHALL COMPLY WITH THE FOLLOWING:
  - THE ACTUATING PORTION OF THE RELEASING DEVICE SHALL EXTEND AT LEAST ONE-HALF OF THE DOOR LEAF WIDTH.
  - THE MAXIMUM UNLATCHING FORCE SHALL NOT EXCEED 8 LBS PER 1117B.6.4
  - APPROVED BY AUTHORITY W/ JURISDICTION, PANIC HARDWARE SHALL COMPLY WITH CBC SECTION 1008.1.10
- THE FIRE PROTECTION FOR EXTERIOR WALL IS DETERMINED BASED UPON THE FIRE SEPARATION DISTANCE IN WHICH THE WALL IS LOCATED. SEE CBC TABLE 705.6 OR TABLE 602

FINISH SCHEDULE									
ROOM NAME	FLOORING	WALL FINISH			CEILING		NOTES		
	FLOOR/ BASE	FRONT	LEFT	REAR	RIGHT	CEILING	CEILING HT		
GIRLS [101]	SV	SC	FRP	FRP	FRP	GBP	8'-0"		
BOYS [102]	SV	SC	FRP	FRP	FRP	GBP	8'-0"		
STAFF [103]	SV	SC	FRP	FRP	FRP	GBP	8'-0"		
STAFF [104]	SV	SC	FRP	FRP	FRP	GBP	8'-0"		
WORK ROOM [105]	CARP	4" TS	TACK	TACK	TACK	CP	8'-0"		
PLUMBING CHASE									

**FLOOR, WALL, CEILING MATERIALS**

**FLOORING**  
 CARP: CARPET PER STATE OF CALIFORNIA SPECIFICATIONS COMPLYING WITH GROUP 1; TYPE "A" OR TYPE "B"; CLASS 2; DENSITY 4800; DIRECT GLUE DOWN  
 SV: SHEET VINYL FLOORING  
 VCT: VINYL COMPOSITION TILE

**BASE**  
 4" TS: 4" TOP SET BASE  
 6" TS: 6" TOP SET BASE  
 SC: 6" SELF-COVE BASE

**WALLS**  
 TACK: 1/2" VINYL TACKBOARD CLASS 1 OVER 1/2" GYPSUM BOARD BACKING  
 FRP: 1/8" FIBER REINFORCED PANEL OVER 1/2" WATER RESISTANT GYPSUM BOARD  
 GYP: 1/2" GYPSUM BOARD; TAPE; TEXTURE; PAINTED FINISH  
 PLY: 1/2" PLYWOOD FINISH  
 NF: NO FINISH

**CEILING**  
 CP: ACOUSTICAL LAY IN GRID CEILING PANELS (SEE SPECIFICATION NOTES ON REFLECTED CEILING PLAN)  
 HC: 5/8" GYPSUM BOARD; TAPE; TEXTURE; PAINTED FINISH (HARD LID CEILING)  
 GBBP: 1/2" GYPSUM BOARD WASHABLE PANELS (PAINTED)

- FINISH NOTES**
- ALL FINISHES SHALL COMPLY WITH CBC, CFC AND TITLE 19 CCR.
  - PREPARATION FOR SUB-FLOOR TO ACCEPT FINISH FLOORING IS BY FLOORING CONTRACTOR. PLYWOOD SUB-FLOOR IS 24.1. PLYWOOD. OUTER PLYWOOD IS PLUGGED AND TOUCH SANDED. ANY DEFORMITIES DUE TO STANDARD CONSTRUCTION PRACTICES SHALL BE FILLED AND SANDED BY FLOORING CONTRACTOR. THE JOINT AT THE MOULINE SHALL NOT BE LARGER THAN 1/8" AND SHALL BE FILLED AND SANDED BY FLOORING CONTRACTOR.
  - RESILIENT FLOORING DEMONSTRATING A COEFFICIENT OF FRICTION OF AT LEAST 0.6 PER ASTM D2047, WILL BE ACCEPTED AS MEETING THE INTENT OF SLIP RESISTANCE.
  - CARPET SHALL HAVE A LEVEL LOOP, TEXTURED LOOP, LEVEL CUT, OR LEVEL CUT / UNCUT PILE TEXTURE AND MAXIMUM PILE HEIGHT OF 1/2" PER CBC SECTION 1124B.3. CARPET EDGED SHALL COMPLY WITH CBC SECTION 1124B.2.

BOYS & GIRLS RESTROOM - EXTERIOR DOOR HW-1			
LOCKSET	SCHLAGE ND70PDRHO626 (cylindrical)	Finish 26D	or equal
BUTTS	HAGER BB1191 4 1/2" x 4 1/2" NRP	Finish 26D	or equal
CLOSER	FALCON DEL 689	Finish 689	or equal
WEATHER STRIP	HAGER 801SAV 3684	Finish Alum	or equal
THRESHOLD	HAGER 413SA 38	Finish Alum	or equal
DOOR BOTTOM	HAGER 783SAV 35N	Finish Alum	or equal
LOUVER	ANEMO 24 x 12	Finish Bronze	or equal

STAFF RESTROOM - EXTERIOR DOOR HW-2			
LOCKSET	SCHLAGE ND85PDRHO626 (cylindrical)	Finish 26D	or equal
BUTTS	HAGER BB1191 4 1/2" x 4 1/2" NRP	Finish 26D	or equal
WEATHER STRIP	HAGER 801SAV 3684	Finish Alum	or equal
THRESHOLD	HAGER 413SA 38	Finish Alum	or equal
DOOR BOTTOM	HAGER 783SAV 35N	Finish Alum	or equal
LOUVER	ANEMO 24 x 12	Finish Bronze	or equal

CHASE EXTERIOR DOOR - EXTERIOR DOOR HW-3			
LOCKSET	SCHLAGE ND70PDRHO626 (cylindrical)	Finish 26D	or equal
BUTTS	HAGER BB1191 4 1/2" x 4 1/2" NRP	Finish 26D	or equal
THRESHOLD	HAGER 413SA 38	Finish Alum	or equal
DOOR BOTTOM	HAGER 783SAV 35N	Finish Alum	or equal

WORKROOM - EXTERIOR DOOR HW-4			
LOCKSET	SCHLAGE ND70PDRHO626 (cylindrical)	Finish 26D	or equal
BUTTS	HAGER BB1191 4 1/2" x 4 1/2" NRP	Finish 26D	or equal
CLOSER	NORTON 850T BPSA	Finish 689	or equal
WEATHER STRIP	HAGER 801SAV 3684	Finish Alum	or equal
THRESHOLD	HAGER 413SA 38	Finish Alum	or equal
DOOR BOTTOM	HAGER 783SAV 35N	Finish Alum	or equal

**INSULATION SPECIFICATIONS**

**MOISTURE PROTECTION INSULATION:**

DESCRIPTION OF WORK: THE FURNISHING AND INSTALLING OF ALL INSULATION FOR ALL CEILING, FLOOR AREAS, AND EXTERIOR WALLS. (CLASS 1 = 0.25 FLAME SPREAD; SMOKE DEVELOPMENT DENSITY LESS THAN 450.)

MATERIAL: INSULATING MATERIAL FOR WALLS, CEILINGS, AND FLOORS SHALL BE FIBERGLASS BATT'S (UNFACED) AND SHALL COMPLY WITH CBC 718.2-718.3. INSULATION SHALL BE AS MANUFACTURED BY OWENS-CORNING FIBERGLASS CORPORATION, JOHNS-MANVILLE, CERTAINTECS, OR EQUAL.

R-30 ROOF  
 R-13 FLOOR  
 R-13 SIDE WALL

THESE DRAWINGS AND ALL MATERIAL CONTAINED HEREIN ARE THE PROPERTY OF SILVERCREEK INDUSTRIES, INC (SCI Inc) AND SHALL NOT BE REPRODUCED, COPIED OR OTHERWISE USED IN WHOLE OR IN PART TO ASSIST IN THE MAKING OF OR FOR THE PURPOSE OF FURNISHING ANY INFORMATION FOR THE MAKING OF DRAWINGS, PRINTS, APPARATUS OR PARTS THEREOF WITHOUT THE FULL KNOWLEDGE AND WRITTEN CONSENT OF SCI Inc. ALL PATENTABLE MATERIAL CONTAINED HEREIN AND ORIGINATING WITH SCI Inc SHALL BE THE PROPERTY OF SCI Inc

**SILVER CREEK INDUSTRIES, INC.**

"BUILDING FOR THE NEXT GENERATION"

195 EAST MORGAN PERRIS, CALIFORNIA 92571  
 PHONE: 951-943-5393 FAX: 951-943-2211

PROJECT NAME:

# CLASS LEASING

SHEET TITLE:

## SCHEDULES

**STAVARES ASSOCIATES**

REGISTERED ARCHITECT

No. 02354  
 Exp. 10-31-2013

12/23/2011

ARCHITECT OF RECORD SUBMISSION DATE

REGISTERED ARCHITECT

NOV 20 2011

PROJECT SPECIFIC STATE AGENCY APPROVAL

IDENTIFICATION STAMP  
 DIV. OF THE STATE ARCHITECT  
 OFFICE OF REGULATION SERVICES

04 1 2011  
 DATE AUG 27 2011

ORIGINAL PC STATE AGENCY APPROVAL

IDENTIFICATION STAMP  
 DIV. OF THE STATE ARCHITECT  
 OFFICE OF REGULATION SERVICES

04-112137  
 DATE DEC 2 2011

REVISIONS


SILVER CREEK INDUSTRIES  
 12' x 40' PC

PROJECT NO:

DRAWN BY:

SCALE: AS NOTED

DATE: 8-17-11

P.C. SHEET NUMBER

A-0.2

STKP 125

IDENTIFICATION STAMP  
 DIV. OF THE STATE ARCHITECT

117337  
 DATE 6 29 11