

600.98' N89°19'17"E

CHARGER STREET


ELECTRICAL SYSTEM HAS BEEN INVESTIGATED AND HAS CAPACITY FOR THE ADDITIONAL LOAD

BLDG. 501 (LIBRARY)
DSA A#30609 (1970)
V-N
E-1

BLDG. 100 (ADMINISTRATION)
DSA #30609 (1970), #03-106755
V-N
B

ELECTRICAL PARTIAL SITE PLAN NOTES

1 CONTRACTOR SHALL PROVIDE NEW 200/3 BREAKER IN EXISTING DP-1

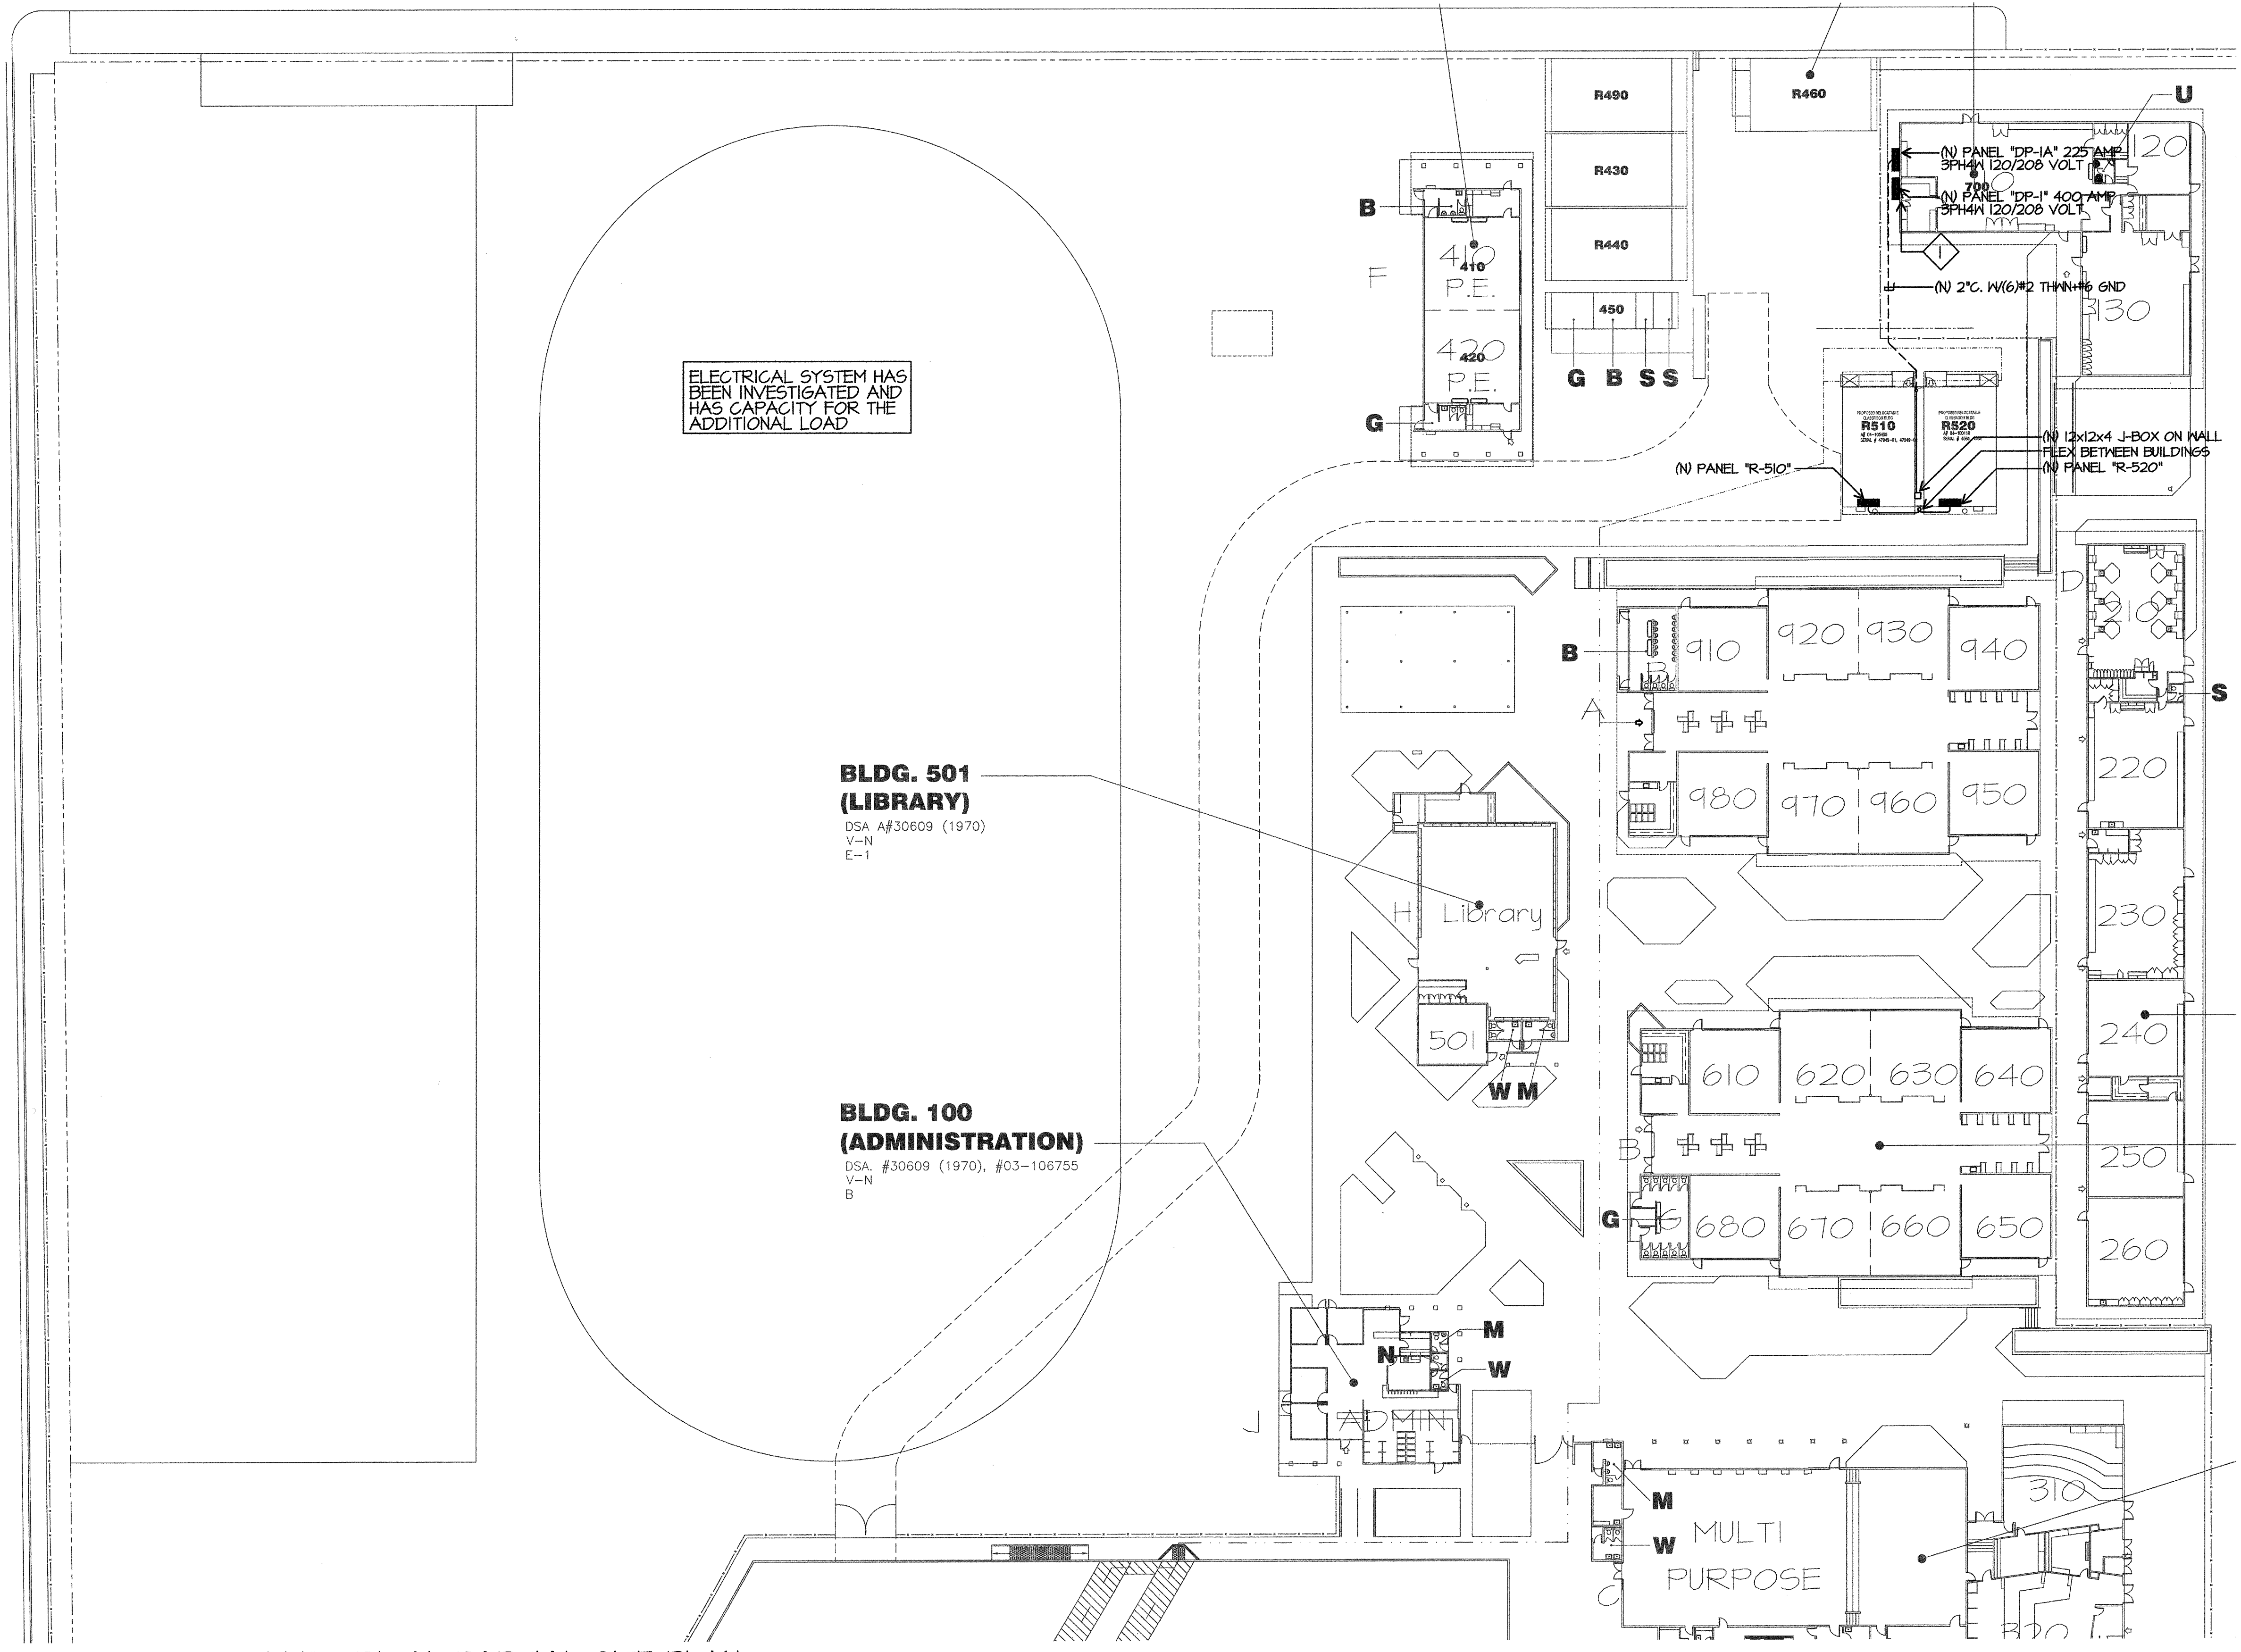

ELECTRICAL PARTIAL SITE PLAN

SCALE: 1"=30'-0"

PRIME CONSULTANT

IBI ARCHITECTURE PLANNING
San Luis Obispo
4119 Broad Street, Suite 210
San Luis Obispo, CA 93401
805.546.0433 fax:805.546.0504

SEAL



COPYRIGHT: Any reproduction or distribution for any purpose other than authorized by IBI Group is forbidden.

COPYRIGHT 2014 IBI GROUP


REVISIONS			
NO.	DATE	APPRD.	DESCRIPTION

CONSULTANT




AGENCY INFORMATION:

AGENCY TRACKING NO. 63321-154
FILE NO. 15-6

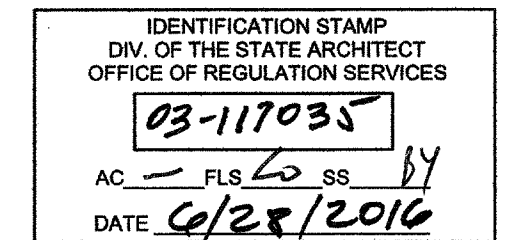

BAKERSFIELD CITY SCHOOL DISTRICT

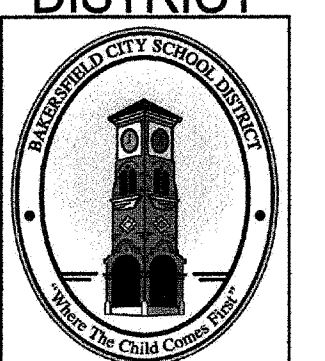

CHIPMAN JR. HIGH SCHOOL (2) RELOCATABLES
2905 ESSLER STREET
BAKERSFIELD, CA 93306

OPSC or OSHPD PROJ. NO:

PROJECT NO: 14146.000

DRAWN BY: AC

CHKD BY: KT

ISSUE DATE: 04/27/2016

SHEET TITLE

ELECTRICAL PARTIAL SITE PLAN

SHEET NUMBER

E-1