

GENERAL NOTES AND SPECIFICATIONS

SECTION 1A GENERAL REQUIREMENTS

1. GENERAL
A. THE REQUIREMENTS OF THE GENERAL CONDITIONS OF THE AGREEMENT AND THIS GENERAL REQUIREMENT APPLY TO THE SEVERAL TRADE SECTIONS WITH THE SAME FORCE AS THOUGH FULLY REPEATED IN EACH TRADE SECTION.
B. NAME BRANDS ARE INDICATED TO ESTABLISH A STANDARD OF QUALITY. ITEMS OF EQUAL OR BETTER QUALITY MAY BE SUBSTITUTED FOR THE LISTED BRAND NAMED PRODUCTS WITH THE WRITTEN APPROVAL OF D.S.A. AND THE ARCHITECT.
C. ALL WORK SHALL COMPLY WITH THE REQUIREMENTS OF TITLES 19 AND 24 CALIFORNIA CODE OF REGULATIONS. NO CHANGES SHALL BE MADE FROM D.S.A. APPROVED DRAWINGS OR SPECIFICATIONS WITHOUT PRIOR WRITTEN APPROVAL OF D.S.A. AND THE ARCHITECT.
2. SCOPE OF WORK
A. THE WORK CONSISTS OF MANUFACTURING OFF-SITE IN A PLANT AND INSTALLING ON-SITE MODULAR RELOCATABLE BUILDINGS AS DEFINED HEREIN AND SHOWN AND DETAILED ON DRAWINGS.
B. ALL REQUIREMENTS OF TITLES 24 OF THE STATE OF CALIFORNIA CODE OF REGULATIONS RELATING TO INSPECTIONS AND VERIFIED REPORTS SHALL BE COMPLIED WITH AND SHALL INCLUDE:
1. GENERAL RESPONSIBLE CHARGE OF FIELD ADMINISTRATION BY THE ARCHITECT OF RECORD.
2. INSPECTION IN-PLANT DURING THE COURSE OF CONSTRUCTION BY AN INSPECTOR APPROVED BY THE DIVISION OF THE STATE ARCHITECT AND THE DISTRICT ARCHITECT. THE INSPECTOR SHALL BE RESPONSIBLE FOR AND APPROVED TO INSPECT THE GENERAL CONSTRUCTION WELDING, MECHANICAL, AND ELECTRICAL WORK. COST OF THESE INSPECTIONS SHALL BE BORNE BY THE SCHOOL DISTRICTS.
3. ON-SITE INSPECTION OF THE BUILDING INSTALLATION, ELECTRICAL AND UTILITY INSTALLATION OR CONNECTIONS BY AN INSPECTOR APPROVED BY THE DIVISION OF THE STATE ARCHITECT AND THE DISTRICT ARCHITECT AND RETAINED BY THE SCHOOL DISTRICT.
4. OTHER SPECIAL TESTS OR INSPECTIONS AS MAY BE REQUIRED BY THE DIVISION OF THE STATE ARCHITECT.
5. ADDENDUMS SHALL BE SIGNED BY THE ARCHITECT & APPROVED BY D.S.A.
6. CHANGE ORDERS SHALL BE SIGNED BY THE OWNER & ARCHITECT & APPROVED BY D.S.A.
7. THE TESTING LAB SHALL BE IN THE EMPLOY OF THE OWNER.
8. ALL CONTRACTORS SHALL VERIFY ALL WORK CONDITIONS, DIMENSIONS AND DETAILS AND REPORT ANY OR ALL OMISSIONS AND DISCREPANCIES TO THE DESIGNER/OWNER IMMEDIATELY BEFORE COMMENCING WORK.
9. EACH CONTRACTOR TO BE RESPONSIBLE TO SEE THAT THEIR WORK CONFORMS TO ALL GOVERNMENTAL CODES WHETHER OR NOT SO STATED ON THE DRAWINGS.
10. ALL MATERIALS AND WORKMANSHIP TO CONFORM TO THE LATEST REQUIREMENTS OF THE GOVERNING BUILDING CODES IN EFFECT AT TIME OF DSA APPLICATION.
11. ALL MANUFACTURED ARTICLES, MATERIALS AND EQUIPMENT SHALL BE APPLIED, INSTALLED, CONNECTED AND ERECTED PER MANUFACTURER'S DIRECTIONS AND INSTRUCTIONS.
12. SHOP DRAWINGS MAY BE REQUIRED. IF SO, THEY WILL BE ACCURATELY DRAWN TO A LARGE ENOUGH SCALE TO SHOW ALL PERTINENT FEATURES OF THE ITEM AND ITS CONNECTION TO RELATED WORK.
13. THE MANUFACTURER OF BUILDING IS TO PLACE TWO PERMANENT METAL IDENTIFICATION LABEL ON EACH MODULE, MECHANICALLY FASTENED TO THE FRAME SEE "GENERAL DESIGN REQUIREMENTS", THIS PAGE.
FOR PROJECTS MANUFACTURED OFF-SITE, THE PLANT INSPECTOR IS TO INDICATE THE MANUFACTURER'S NAME AND SERIAL NUMBER OF EACH MODULE ON THE VERIFIED REPORT AND D.S.A. APP. NUMBER.
14. ALL TESTS AND INSPECTIONS REQUIRED BY DSA SHALL BE COMPLIED WITH. ALL TESTS REQ. BY FIRE AND LIFE SAFETY REGULATIONS SHALL BE BY A NATIONAL, RECOGNIZED TESTING LABORATORY.
FOUNDATION
1. ASSUMED ALLOWABLE SOIL BEARING - 1000 PSF
2. FOOTINGS SHALL BE LOCATED ON UNDISTURBED FIRM NATURAL SOIL. APPROVED COMPACT FILL OR ON AN APPROVED PAVED SURFACE.
NOTE: THE FOUNDATION SYSTEM PRESENTED HEREIN COMPLIES WITH INTERPRETATION OF REGULATIONS, IR-16-1, ISSUED BY DIVISION OF THE STATE ARCHITECT FOR TEMPORARY BUILDINGS. THIS FOUNDATION SYSTEM IS NON-CONVENTIONAL AND THE STRUCTURAL ENGINEER TAKES NO RESPONSIBILITY FOR ITS CONSTRUCTION OR LONGEVITY.
3. WORK NOT INCLUDED
A. ALL ON-SITE OR OFF-SITE UTILITIES AND THE CONNECTION OF THEM TO THE BUILDING UNLESS INDICATED ON THE DRAWINGS.
B. ALL LEVELING, GRADING OR OTHER SITE PREPARATION EXCEPT CONCRETE OR WOOD LEVELING STRIPS WHERE REQUIRED, UNLESS OTHERWISE INDICATED ON THE DRAWINGS.
C. FIRE ALARM SYSTEM, PROGRAM BELL, PUBLIC ADDRESS SYSTEM, INTERCOM SYSTEM, TELEPHONE SYSTEM UNLESS OTHERWISE INDICATED ON THE DRAWINGS, OR MODIFIED BY CHANGE ORDER.
D. WHEELS AND HITCH
E. SHALL REMAIN THE PROPERTY OF THE CONTRACTOR.
5. ACCESSIBILITY OF SITE
THE SCHOOL DISTRICT SHALL PROVIDE ACCESS TO THE SITE FOR THE INSTALLATION OF BUILDINGS. REMOVAL OF TREES SHRUBS, FENCING, SPRINKLERS ETC. NECESSARY FOR THE MOVE-IN OF BUILDINGS SHALL BE THE RESPONSIBILITY OF THE SCHOOL DISTRICT.

SECTION 5 STEEL

GENERAL - ALL WORK SHALL CONFORM TO THE REQUIREMENTS OF AISC STANDARD SPECIFICATIONS, TITLE 24 OF CALIFORNIA CODE OF REGULATIONS AND THE AMERICAN IRON AND STEEL INSTITUTE SPECIFICATIONS FOR DESIGN OF STEEL STRUCTURAL MEMBERS.
A. WELDING - ALL WELDING DONE BY SHIELDED ELECTRIC-ARC OR FLUX CORED-ARC PROCESS COMPLYING WITH REQUIREMENTS OF THE "STRUCTURAL WELDING CODE" OF THE AMERICAN WELDING SOCIETY. WELDING DONE BY OPERATORS QUALIFIED BY TESTS ACCEPTABLE TO THE DIVISION OF THE STATE ARCHITECT. WELDING INSPECTION PER TITLE 24 PART 2.CCR. SECTION 2231.A.5 WELDING ELECTRODE SHALL BE E70XX.
1. STRUCTURAL STEEL SHALL CONFORM TO A.S.T.M. A-36 & A-570 OR 36 UNLESS OTHERWISE NOTED.
2. PIPE COLUMNS SHALL CONFORM TO A.S.T.M. A-53 WITH SULFUR CONTENT NOT EXCEEDING 0.05%.
3. STEEL TUBING SHALL CONFORM TO A.S.T.M. A-500 GRADE B OR A.S.T.M. A579 GRADE 50 FOR GAUGE TUBING-TYP. U.N.C.
4. STRUCTURAL WELDS ARE DESIGN FOR FULL ALLOWABLE STRESS UNLESS OTHERWISE NOTED.
C. ERECTION - STRUCTURAL STEEL ERECTED TRUE, STRAIGHT, PLUMB AND TO ITS DESIGNATED LOCATIONS. FIELD CONNECTIONS BOLTED OR WELDED AS INDICATED ON THE DRAWINGS.
D. NUTS, BOLTS, SCREWS AND NUTS ETC. - FOR EXTERIOR WORK SHALL BE CADMIUM PLATED OR GALVANIZED.
1. BOLTS FOR STRUCTURAL STEEL JOINTS SHALL CONFORM TO A.S.T.M. A-307 UNLESS OTHERWISE NOTED. ALL HOLES FOR MACHINE AND CARRIAGE BOLTS THROUGH STEEL TO BE DRILLED, OR TORCH PILOT HOLE AND REAM MIN. 1/16" TO CORRECT SIZE. NELSON STUDS (WELDED TO STEEL) MAY BE SUBSTITUTED FOR BOLTS SAME LENGTH AND DIAMETER.
E. HANDRAILS - FABRICATED, AS DETAILED, WELDS GROUND SMOOTH.
F. SHOP PAINT
1. EXPOSED STEEL COATED WITH ONE SHOP COAT OF RED OXIDE PRIMER.
2. NON-EXPOSED STEEL COATED WITH ONE SHOP COAT OF RED OXIDE PRIMER.
3. ALL SURFACES THOROUGHLY CLEANED BY EFFECTIVE MEANS PRIOR TO APPLICATION OF SHOP COATS. PRIME ALL EXPOSED STEEL SURFACES AFTER FIELD WELDING.
G. TESTS
1. PROVIDE MILL CERTIFICATES OR TEST ALL STEEL MEMBERS PER T-24 PART 2.CCR SECTION 2231.A.1.

SECTION 6A CARPENTRY

1. SCOPE OF WORK
CONTRACTOR SHALL PROVIDE ALL LABOR, MATERIALS AND SERVICES TO INSTALL CARPENTRY.
2. MATERIALS
LUMBER GRADE MARKED IN ACCORDANCE WITH "STANDARD GRADING AND DRESSING RULE NO. 17 OF WEST COAST LUMBER INSPECTION BUREAU, OR "GRADING RULES FOR LUMBER" 5TH EDITION OF WESTERN WOOD PRODUCTS ASSOCIATION OR W.C.L.B. PLYWOOD GRADE MARKED IN ACCORDANCE WITH PRODUCT STANDARD PS 1-95 FOR SOFTWOOD PLYWOOD, OF AMERICAN PLYWOOD ASSOCIATION, COMPLYING WITH CBC EACH SHEET SHALL BEAR THE STAMP OF
A. APA, PITTSBURGH TESTING, OR TECO.
JOISTS, PLATES, STUDS-DOUGLAS FIR OR HEM FIR #4S #2 U.N.O. UNLESS OTHERWISE INDICATED.
B. HEADERS, POSTS AND TIMBERS-DOUGLAS FIR #4S #1
C. BLOCKING - DOUG FIR #3.0R HEM FIR #3.0R STD. & BET.
D. SILLS AND LUMBER & SHIM PLATES IN CONTACT WITH CONCRETE, MASONRY OR EARTH, DOUG FIR #2 PRESSURE TREATED IN ACCORDANCE WITH CBC 1917.1. EACH PIECE SHALL BEAR AMPB STAMP, LP-22, GROUND CONTACT, D.#2 ABOVE GROUND.
E. PLYWOOD ROOF DECKING - SEE S3
F. PLYWOOD FLOOR DECKING - APA STUD-1-FLOOR 2-4-1 OR UNI-FLOOR BY PITTSBURGH TESTING LAB, 1-1/8" NOM. TONGUE AND GROOVE FLOOR SHEATHING, WITH EXTERIOR GLUE.
G. EXTERIOR SIDING/SHEATHING - APA TYPE 303, EXTERIOR, OR HARD/PANEL FIBER CEMENT SIDING AS MFG. BY JAMES HARDIE BUILDING PRODUCTS NER-405 REPORT
H. MOISTURE BARRIER - KRAFT WATERPROOF BUILDING PAPER, OR 15 LB. FELT, UBC STANDARD 14-1 FOR KRAFT, 15-1 FOR FELT.
J. STUDS - DOUG FIR #2 OR HEM FIR #2 MOISTURE CONTENT NOT OVER 19%. FASTENERS - ALL NAILS SHALL BE CORROSION RESISTANT PER C.B.C. 2318A.3.4 COMMON NAILS-FOR EXT. SIDING & FNDN. ONLY.
K. L. LINING TRIM - 2X RESEAU SELECTED CEDAR, OR CEDAR DOOR/WINDOW TRIM - 1X4 RESEAU D.W.F., H.F., OR CEDAR.
M. FRAMING CONNECTORS SHALL BE FROM SIMPSON CATALOG LATEST ED. FIRE BLOCKS SHALL CONFORM TO CBC SECTION 708.
N. ALL NAILS SHALL BE COMMON NAILS UNLESS OTHERWISE NOTED.
O. FOUNDATION LUMBER: ALL CUT ENDS AND HOLES IN PRESSURE TREATED LUMBER SHALL BE TREATED WITH "CUPRINOL".
P. WORKMANSHIP
A. FRAMING - SECURELY NAIL BRIDGED AND BLOCKED TO FORM RIGID STRUCTURE. WORK CUT, FITTED AND ASSEMBLED LEVEL PLUMB AND TRUE TO LINE. TRIM IN AS LONG LENGTHS AS POSSIBLE WITH ALL STANDING TRIM IN ONE PIECE. TRIM SEALED AT ALL EDGES.
B. NAILING - IN ACCORDANCE WITH TITLE 24, PART 2, CALIFORNIA BUILDING CODE, TABLE 23A-1.1-2-1.
C. EXTERIOR WALLS - FACTORY FABRICATED, CAULKING PROVIDED BETWEEN PERIMETER OF WALL AND STRUCTURAL MEMBERS PROVIDING WEATHER-PROOF AND WATER-TIGHT SEAL. NECESSARY CLOSERS, SEALS, AND FLASHINGS PLACED AT TOP AND BASE SUPPORT OF PANELS AND AROUND OPENINGS.
D. MACHINE APPLIED NAILING:
USE OF MACHINE NAILING IS SUBJECT TO A SATISFACTORY JOBSITE DEMONSTRATION FOR EACH PROJECT AND THE APPROVAL BY THE PROJECT ARCHITECT OR STRUCTURAL ENGINEER AND THE DIVISION OF THE STATE ARCHITECT. THE APPROVAL IS SUBJECT TO CONTINUED SATISFACTORY PERFORMANCE.
MACHINE NAILING WILL NOT BE APPROVED IN 5/16" PLYWOOD. IF NAILHEADS PENETRATE THE OUTER PLY MORE THAN WOULD BE NORMAL FOR A HAND HAMMER OR IF MINIMUM ALLOWABLE EDGE DISTANCES ARE NOT MAINTAINED THE PERFORMANCE WILL BE DEEMED UNSATISFACTORY.
E. MOISTURE BARRIER - APPLIED TO STUDS WEATHER-BOARD FASHION, HORIZONTAL.
JOINTS LAPPED MIN 6" INCLUDING BUILDING CORNERS. SHEATHING APPLIED OVER MOISTURE BARRIER.
F. TRIM SEALED AT ALL EDGES. SEALANT APPLIED TO MATCH TRIM OR SIDING UNLESS TRANSPARENT TYPE.

SECTION 7B SHEET METAL

1. SCOPE OF WORK
CONTRACTOR SHALL PROVIDE ALL LABOR, MATERIALS AND SERVICES TO INSTALL INDICATED SHEET METAL.
2. MATERIALS
A. SHEET METAL - STEEL SHEETS HOT DIP GALVANIZED WITH 1.25 OZ. PER SQUARE FOOT ZINC COATING CONFORMING TO ASTM A653 - MINIMUM 26 GA. UNLESS OTHERWISE NOTED ON THE DRAWINGS.
B. SOLDER - OF STAND. GRADE "A" OF EQUAL PARTS RAD BRAND LEAD AND TIN ASTM B32.
C. FLUX - ZINC SATURATED MURIATIC ACID.
D. GUTTERS: 26 GA. G-90 GALV. STEEL. DOWNSPOUTS: 2"x3" CONVOLUTED 30 GA. G-90 GALV. STEEL. GUTTER ENDCAPS: 26 GA. G-90 GALV. STEEL. GUTTER CLIPS: 18 GA. G-90 GALV. STEEL.
3. WORKMANSHIP
SHEET METAL ACCURATELY FORMED TO DIMENSIONS AND SHAPES DETAILED WITH TRUE STRAIGHT LINES, CORNERS AND ANGLES. FLASHING INSTALLED IN LONGEST LENGTHS POSSIBLE. EXTERIOR WORK FORMED, FABRICATED AND INSTALLED SO THAT IT ADEQUATELY PROVIDES FOR EXPANSION AND CONTRACTION IN THE COMPLETED WORK AND FINISHES WATER AND WEATHER TIGHT. ALUMINUM SHALL BE SEPARATED FROM FERROUS METAL BY POLYETHYLENE TAPE OR FLOOD COAT OF ASPHALTIC PAINT.

SECTION 7C METAL ROOFING

1. SCOPE OF WORK
CONTRACTOR SHALL PROVIDE ALL LABOR, MATERIALS AND SERVICES TO INSTALL METAL ROOFING. TEST RESULTS SHOWING THE ROOFING SYSTEM WILL WITHSTAND THE UPLIFT OF A 80 MPH WIND SHALL BE SUBMITTED WITH THE PLANS AND SPECIFICATIONS.
2. MATERIALS
A. ROOFING - 3" INCH STANDING SEAM 22-GAUGE G-90 GALV. INTERLOCKING STEEL STL. PANELS (090).
B. ROOFING: CLASS B FIRE RATING
3. WORKMANSHIP
SEALANT APPLIED TO DRY CLEAN SURFACES, WHEREVER INDICATED ON DETAILS AND AS NEEDED TO MAKE BUILDING WEATHER TIGHT IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.

SECTION 7J SEALANT

1. SCOPE OF WORK
CONTRACTOR SHALL PROVIDE ALL LABOR, MATERIALS AND SERVICES TO SEAL BUILDINGS.
2. MATERIALS
POLYURETHANE, MANUFACTURED BY MAMECO INTERNATIONAL FOR ROOFS, "GEOLCEL" SILICONIZED CAULK, GE, DUPONT, EAGLESEAL OR DAP FOR ALL OTHER APPLICATIONS, OR EQUAL.
3. WORKMANSHIP
SEALANT APPLIED TO DRY CLEAN SURFACES, WHEREVER INDICATED ON DETAILS AND AS NEEDED TO MAKE BUILDING WEATHER TIGHT IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.

SECTION CONCRETE CONCRETE (IF USED)

1. CONCRETE MORTAR AND RELATED MATERIALS TO CONFORM TO APPLICABLE PROVISIONS OF TITLE 24 EXCEPT AS MODIFIED HEREIN.
2. REINFORCING BARS-ASTM A615 OR ASTM A706 DEFORMED GRADE 40 BILLET STEEL.
3. EXPANSION JOINT FILLER: ASTM D994
4. FORM MATERIALS: SIDE FORMS DOUGLAS FIR, CONSTRUCTION GRADE OR BETTER; OR METAL FORMS.
5. PLACING REINFORCEMENT, PLACING CONCRETE SURFACE FINISHES, CURING AND REMOVAL OF FORMS SHALL BE IN ACCORDANCE WITH APPLICABLE PROVISIONS OF TITLE 24, PART 2.

ACCESSIBILITY STANDARDS

CALIFORNIA BUILDING CODE (PART 2, TITLE 24, CCR)
SEC. 11039.1 BUILDING ACCESSIBILITY, GENERAL
THE 2001 CBC REQUIRES THAT BUILDINGS EXCEEDING 10,000 SQUARE FEET ON ANY FLOOR MUST HAVE AN ACCESSIBLE MEANS OF VERTICAL ACCESS VIA RAMP, ELEVATOR, OR LIFT WITHIN 200 FEET OF TRAVEL OF EACH STAIR AND EACH STAIR AND EACH ESCALATOR.
TABLE 115B-1 SUGGESTED DIMENSIONS FOR CHILDREN'S USE
THE 2001 CBC REQUIRES A 27" MINIMUM DIMENSION FOR LAVATORY/SINK KNEE CLEARANCE, WHICH IS THE DISTANCE FROM THE FINISH FLOOR TO THE UNDERSIDE OF THE LAVATORY/SINK. THE 1998 CBC INCORRECTLY SPECIFIED A 29" MAXIMUM DIMENSION FOR LAVATORY/SINK KNEE CLEARANCE.
SECTION 115B.7.1 (3) ACCESSIBLE WATER CLOSET COMPARTMENT
THE 2001 CBC REQUIRES AN ACCESSIBLE TOILET SHALL TO HAVE A MINIMUM WIDTH OF 60" UNLESS SPECIFICALLY CALLED FOR IN THE CONTRACT. STEPS, RAMPS, OR HANDRAILS SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.
SECTION 115B.6.2.4.1 WATER CONTROLS
Each lavatory/shower shall not exceed 5lbs maximum force (pull). The 1998 CBC DID NOT ADDRESS THIS ISSUE.
Section 11178.5 Signs and Identification (also refer to Sections 1003.2.8.1, 1003.2.8.2, 1003.2.8.4, 1003.2.8.5, 1003.2.8.6, 1003.2.8.7, 1003.3.3.13.1, 1003.3.1.10)
The 2001 CBC makes several general design changes and clarifications to signage from the 1998 CBCS provisions:
All ground floor exit door shall have tactile exit signage.
*All stairs, each floor shall receive tactile "stair level" signage in addition to special tactile at the exit deck door level.
*Each exit door that leads to a grade level exit by means of a stairway shall have tactile exit signage.
*Each exit access door to a corridor or hallway that is required to have a visual exit sign shall be identified by tactile exit signage.
Section 1129B.4 (1), (2), (3) Accessible Parking Required.
The 2001 CBC requires the words "NO PARKING" in 12" height white letters to be painted on the pavement within all parking space access areas. Non parking access signs shall be placed on the passenger side of the vehicle. Ramps may not encroach into any required access aisle. Parking space access aisles shall not exceed 25 feet in any direction.
*Elevating Sites:
All elevating sites, any ramp which exceeds a 2 access aisles for accessible parking spaces per CBCS Section 1129B, may require removal and redesign per the path of travel (POT) provisions of CBCS Section 1134B, in order to approve the building placement.
Section 1133B.2.5 Closer Effort to Operate Doors.
The 2001 CBC requires that the effort to open an exterior door shall not exceed 5 pounds (pull). The 1998 CBC allowed a maximum pull effort of 8.5 pounds.
Section 1133B.2.5 Door Closer.
The 2001 CBC requires that the sweep period of accessible doors shall be 3 seconds maximum, based on an open door position of 70 degrees (from closed), to a door position of 37 from the latch.
Sections 1133B.2.4.5 & 1133B.2.5.3 Recessed Doors.
The 2001 CBC requires that doors recessed 6" or more shall have strike edge clearances in accordance with Figure 11B-33 (c).
Section 1133B.4.2.6 Handrail Orientation.
The 2001 CBC specifies that at least one handrail shall be parallel to the direction of the stair run, and perpendicular to the edge of the stair nosing.
Section 1133B.2.4.5 Ramp Width.
The 2001 CBC requires that sign edges less than 80" above the finished floor must contain rounded or eased radius of 0.125" minimum.
California Building Standards Administrative Code (Part 1, Title 24, CCR) Chapter 5, Articles 2, 3, & 4; California Building Code (Part 2, Title 24, CCR) Sections 1102A.3-C, 117A.4.7, 1102B, 1127B.6, 1117B.4, 1133B.8.1, 1133B.8.4, 1133B.8.5.
The 2001 CBC requires that detectable warnings shall be evaluated and approved by DSA, and that only DSA-approved products shall be installed. Refer to the attached DSA Bulletin, Independent Entity Evaluation and Approval of Detectable Warnings and Directional Signatures dated October 31, 2002.
The project plans or specifications shall indicate the requirement that the manufacturer shall provide a written five-year product warranty, in accordance with the Bulletin.

SECTION 8B HOLLOW METAL DOORS AND FRAMES

1. SCOPE OF WORK
CONTRACTOR SHALL PROVIDE ALL LABOR, MATERIALS AND SERVICES TO INSTALL HOLLOW METAL DOORS AND FRAMES.
2. MATERIALS
A. DOORS - INSULATED TYPE L FULL FLUSH, MANUFACTURED BY AMWELD MANUFACTURING COMPANY, 18 GA. 1 3/4" THICK PER CS242 MIN. REINFORCE FOR HARDWARE-BOTH FACES FOR CLOSER. SOUND DEADEN INTERIOR.
B. FRAMES - 16 GA. COLD ROLLED, 2" FACES, CS242 MIN. 3 ANCHORS PER JAMB & ADJUSTABLE FLOOR ANCHOR EACH JAMB REINFORCE FOR HARDWARE. PROVIDE STRIKE BOX, PROVIDE SOUND DEADENING; 1/8" UNDERCUTTING OR INSULATING FILL.
3. WORKMANSHIP
ALL WORK FABRICATED IN SHOP TO REQUIRED PROFILES BY FORMING AND WELDING, WITH ARISES AND EDGES STRAIGHT, SHARP FIT FABRICATED ACCURATELY WITH SQUARE CORNERS, HAIRLINE JOINTS AND SURFACES FREE FROM WARP, WAVE, BUCKLE OR OTHER DEFECTS AFTER FABRICATION. DOORS AND FRAMES CLEANED THOROUGHLY, ALL WELDS GROUND SMOOTH AND GIVEN PRIME COAT.
FINISH HARDWARE
SEE SHEET 1

SECTION 9E PAINTING

1. SCOPE OF WORK
CONTRACTOR SHALL PROVIDE ALL LABOR, MATERIALS AND SERVICES TO PAINT BUILDING. ALL EXPOSED SURFACES OF BUILDING AND RAMPS SHALL BE PAINTED EXCEPT ALUMINUM WINDOW FRAMES, THRESHOLDS, AND ROOFING.
2. MATERIALS
A. FOR EXTERIOR WOOD:
REF. BRAND DUNN KELLY SHERWIN SINCLAIR EDWARDS MOORE WILLIAMS 1240 124K20 289-N FINISH QD-60-XX 1240-XXX B54WZ102 GE2-NXX
B. FOR INTERIOR TRIM:
REF. BRAND DUNN KELLY SHERWIN SINCLAIR EDWARDS MOORE WILLIAMS W450-XX 1650-XXX A26W11 40XX
C. FINISH METAL:
REF. BRAND DUNN KELLY SHERWIN SINCLAIR EDWARDS MOORE WILLIAMS 43-4 1710 B50N26 15N FINISH 10-XX 1700-XXX B54WZ102 GE2-NXX
3. WORKMANSHIP
ALL EXPOSED SURFACES SHALL BE PAINTED EXCEPT ALUMINUM WINDOW FRAMES AND THRESHOLDS. MATERIAL SHALL BE OF THE GRADE SPECIFIED OR EQUAL.
A. EXTERIOR - WOOD SIDING, TRIM AND SKIRTING FLAT OR SEMI-GLOSS LATEX - APPLY ONE COAT OF PRIME AND AT LEAST ONE FINISH COAT. PRIME COAT SHALL BE BRUSHED ON OR SPRAYED AND BACK BRUSHED INTO ALL GROOVES IN THE SIDING. IF NECESSARY, IN THE OPINION OF THE INSPECTOR, AN EXTRA COAT SHALL BE APPLIED TO ALL GROOVES SO THAT THE FINISH COAT WILL HAVE A UNIFORM APPEARANCE. ALLOW PRIME COAT TO DRY ACCORDING TO MANUFACTURER'S RECOMMENDATION. PRIME AND FINISH COATS SHALL BE COMPATIBLE AND MANUFACTURED BY THE SAME COMPANY.
B. INTERIOR TRIM - TRIM NOT PRECOATED SHALL BE PAINTED WITH TWO COATS OF SEMI-GLOSS LATEX OVER PRIMER.
C. INTERIOR HARDWOOD CABINETS - TWO COATS LOW LUSTER POLYURETHANE FINISH. APPLY FIRST COAT THINNED WITH ONE QUART MINERAL SPIRITS PER GALLON. APPLY SECOND COAT AS RECOMMENDED BY MANUFACTURER.
D. METAL - ALL METAL SURFACES SHALL BE PAINTED WITH TWO COATS OF ALKYL FINISH COAT OVER ZINC CHROMATE OR EQUAL RUST INHIBITING PRIMER.
E. RAMP - ONE COAT OF FERROX NON-SLIP SURFACING AS MANUFACTURED BY AMERICAN ABRASIVE METALS OR COMPARABLE (0.7 MIN. CO.F.) ALL PARTS OF THE TYPE INDICATED SHALL BE LISTED ON THE STATE OF CALIFORNIA QUALIFIED PRODUCTS LIST FOR MAINTENANCE PAINTS 8010-910-98A DATED JULY 1989. OR EQUAL.
F. SUBMIT ONE SET COLOR SAMPLES TO ARCHITECT FOR EACH PRODUCT TO ASSIST IN SELECTION.

SECTION 13F SITE ASSEMBLY

1. SCOPE OF WORK
CONTRACTOR SHALL PROVIDE ALL LABOR MATERIALS AND SERVICES TO PREPARE THE BUILDING ELEMENTS, TRANSPORT THEM FROM THE PLANT TO THE SITE AND TO COMPLETE THE ASSEMBLY AT THE SITE. THE CONDITION OF THE SITE, SUCH AS DRAINAGE AND SOIL BEARING CAPACITY, SHALL BE THE RESPONSIBILITY OF THE SCHOOL DISTRICT UNLESS SPECIFICALLY CALLED FOR IN THE CONTRACT. STEPS, RAMPS, OR HANDRAILS SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.
2. ASSEMBLY OF ELEMENTS
IN A LOCATION ON THE SITE AS DETERMINED BY THE SCHOOL DISTRICT (APPROVED BY DSA) THE CONTRACTOR SHALL PLACE WOOD LEVELING STRIPS OR OTHER SUITABLE SUPPORTS AS DETAILED ON THE DRAWINGS.
THE ELEMENTS SHALL BE BROUGHT TO THE SITE ON WHEEL ASSEMBLY AND TRANSFERRED TO THE PREPARED SITE. GREAT CARE SHALL BE TAKEN TO AVOID DAMAGE TO THE ELEMENTS BY RACKING OR BUMPING EACH OTHER.
CONNECTION OF THE ELEMENTS TOGETHER SHALL BE DONE ACCORDING TO INSTRUCTION ON THE DRAWINGS. FLASHINGS, TRIM AND OTHER LOOSE ITEMS SHALL BE INSTALLED PER DETAILS ON THE DRAWINGS.
NOTE:
WALL FINISH MATERIAL
FLAME SPREAD MAX = 200
SMOKE DENSITY MAX = 450
BUILDING INSULATION
FLAME SPREAD MAX = 25
SMOKE DENSITY MAX = 450
PIPE INSULATION
FLAME SPREAD MAX = 25
SMOKE DENSITY MAX = 450
DUCT INSULATION
FLAME SPREAD MAX = 25
SMOKE DENSITY MAX = 50

SECTION 15A AIR CONDITIONING

1. SCOPE OF WORK (SEE SHEET M-1 FOR HVAC SPEC. AND NOTES)
CONTRACTOR SHALL PROVIDE ALL LABOR, MATERIALS AND SERVICES TO INSTALL THE AIR CONDITIONING SYSTEM AS SHOWN ON THE DRAWINGS AND SPECIFICATIONS, INCLUDING A/C UNITS AND ACCESSORIES, REMOTE THERMOSTAT, GRILLS AND POWER WIRING COMPLETE TO LOAD CENTER. CONTRACTOR SHALL INSTRUCT OWNER'S OPERATORS ON OPERATION AND MAINTENANCE OF A/C SYSTEM.
2. EQUIPMENT
SEE NOTE ON FLOOR PLAN FOR SIZE AND TYPE.
3. WORKMANSHIP
UNITS SHALL BE INSTALLED COMPLETE AND OPERATING WITH ALL ACCESSORIES IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.

SECTION 16A ELECTRICAL

1. SCOPE OF WORK
CONTRACTOR SHALL PROVIDE ALL LABOR, MATERIALS AND SERVICES FOR ELECTRICAL INSTALLATION COMPLETE WITH ASSOCIATED EQUIPMENT AND FIXTURES, IN OPERATING CONDITION READY FOR USE. THE WORK INCLUDES: LIGHT AND POWER SYSTEMS, LIGHTING FIXTURES COMPLETE WITH LAMPS, CONNECTIONS AND DISCONNECTS TO A/C EQUIPMENT.
2. MATERIALS
ALL NEW COMPLYING WITH REQUIREMENTS OF CALIFORNIA ELECTRICAL CODE AND NATIONAL FIRE PROTECTION ASSOCIATION.
A. ELECTRICAL TUBING - COPOLYMER AND FLEX CONDUIT GALVANIZED OR SHERARIZED, EXTERIOR FLEX - GALV. STEEL W/ FACTORY APPLIED P.V.C. JACKET.
B. PANELBOARDS - FLUSH MOUNTED.
C. CONDUCTORS - COPPER INSULATED FOR 600 VOLTS, TYPE THHN FOR SIZES #12 TO #6, TYPE THW FOR LARGER SIZES, MINIMUM SIZE - #14.
D. RECEPTACLES - AS NOTED, +18" A.F.F. MIN.
E. CLOCK RECEPTACLE - AS NOTED.
F. SWITCHES - AS NOTED, +48" A.F.F. MAX.
G. LIGHTING FIXTURES - AS NOTED ON THE DRAWINGS.
3. WORKMANSHIP
MATERIALS AND EQUIPMENT INSTALLED IN A SECURE, NEAT WORKMANLIKE MANNER IN ACCORDANCE WITH CODE REQUIREMENTS. PANELBOARD CARDS FILLED OUT. CONDUIT AND CABLE INSTALLED IN WALL AND CEILING SPACES. WORK PIERCING WATERPROOFED AREAS FLASHED AND SEALED TO A WATER TIGHT CONDITION. BUILDING CONDUIT/WIRING FROM FACE OF BLDG TO SITE TERMINATION BY SITE CONTRACTOR (N.I.C.), (FLEXIBLE CONDUIT S-BEND SEALITE)

INSPECTION

INSPECTION OF PREFABRICATED BUILDINGS IS DIVIDED INTO TWO SEPARATE FUNCTIONS.
1. IN-PLANT INSPECTION.
2. ON-SITE INSPECTION.
THE CONTRACTOR SHALL ALLOW UP TO SEVEN (7) DAYS FROM THE DATE OF PLAN APPROVAL TO OBTAIN AN IN-PLANT INSPECTOR APPROVED BY D.S.A.
IN-PLANT INSPECTION AND MATERIAL TESTING SHALL BE ACCOMPLISHED UNDER THE SUPERVISION OF THE DISTRICT ARCHITECT. THE CONTRACTOR SHALL NOTIFY THE DISTRICT ARCHITECT, DSA, AND THE DESIGNATED INSPECTOR/INSPECTION AGENCY AT LEAST 48 HOURS PRIOR TO COMMENCING WORK. THE MANUFACTURER SHALL PROVIDE THE INSPECTOR WITH FULL ACCESS TO ALL PLANT OPERATIONS INVOLVING WORK UNDER THIS CONTRACT AND SHALL ADVISE THE INSPECTOR IN ADVANCE OF THE TIME AND PLACE WHEN OPERATIONS THAT THE INSPECTOR WANTS TO OBSERVE TAKE PLACE. BEFORE THE BUILDINGS ARE REMOVED FROM THE PLANT FOR DELIVERY TO THE STORAGE FACILITY OR FROM THE STORAGE FACILITY TO THE SITE THE INSPECTOR SHALL DETERMINE THAT THEY ARE ACCEPTABLE AND ISSUE A WRITTEN RELEASE WHICH SHALL BE IN THE FORM OF A VERIFIED REPORT (FORM SSS-6). A COPY OF THE INSPECTOR'S VERIFIED REPORT SHALL ACCOMPANY EACH BUILDING TO STORAGE OR TO THE SITE. THE INSPECTOR SHALL PUT ONE COPY IN EACH BUILDING.
COORDINATION OF WORK
IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO MAKE ALL NECESSARY ARRANGEMENTS WITH THE SCHOOL DISTRICT AUTHORIZED REPRESENTATIVE FOR ACCESS TO GROUNDS AND REMOVAL OF EQUIPMENT, IF NECESSARY. THIS CONTACT SHALL BE MADE AT LEAST 48 HOURS PRIOR TO DELIVERY OF ANY MODULE. ON-SITE INSPECTION SHALL BE DONE BY THE SITE INSPECTOR. ALL WORK WHICH THE MANUFACTURER OR HIS SUBCONTRACTORS PERFORM AT THE SITE SHALL BE SUBJECT TO THE INSPECTION OF THE SITE INSPECTOR. THE MANUFACTURER WILL FURNISH THE SITE INSPECTOR WITH SUCH INFORMATION AS MAY BE NECESSARY TO KEEP HIM FULLY INFORMED AS TO PROGRESS OF WORK AND DATES WHEN SITE WORK WILL OCCUR. THE CONTRACTOR SHALL NOTIFY THE INSPECTION AGENCY AT LEAST 48 HOURS PRIOR TO COMMENCING WORK.
THE CONTRACTOR SHALL VERIFY THAT THE DISTRICT'S SITE IS READY TO RECEIVE THE CLASSROOM(S) PRIOR TO THE DELIVERY OF ANY CLASSROOM(S) BY VISITING EACH SITE (THIS MAY BE DONE BY THE INSPECTOR).


MATERIALS AND WORKMANSHIP

ALL CONTRACTORS SHALL CERTIFY THAT NO ASBESTOS-CONTAINING BUILDING MATERIALS WHICH EXCEED STATE AND FEDERAL MANDATED SAFE ASBESTOS LEVELS HAVE BEEN USED IN THE CONSTRUCTION OF RELOCATABLE FACILITIES.
ALL WORKMEN SHALL BE SKILLED AND QUALIFIED FOR THE WORK WHICH THEY PERFORM. ALL MATERIALS USED, UNLESS OTHERWISE SPECIFIED, SHALL BE NEW AND OF THE TYPES AND GRADES SPECIFIED. THE CONTRACTOR SHALL, IF REQUESTED, FURNISH EVIDENCE SATISFACTORY TO THE ARCHITECT THAT SUCH IS THE CASE.
CONTRACTOR'S CREWS ASSIGNED TO ANY WORK PERFORMED UNDER THIS CONTRACT SHALL INCLUDE ONE COMPETENT AND FULLY EXPERIENCED PERSON DESIGNATED AS THE RESPONSIBLE PERSON IN CHARGE. SUCH PERSON MUST BE IDENTIFIED BY NAME TO THE DISTRICT IN ADVANCE OF ANY WORK. UPON REQUEST, THE CONTRACTOR SHALL PROMPTLY FURNISH TO THE DISTRICT INFORMATION RELATING TO THIS EMPLOYEE'S EXPERIENCE.
WORKMANSHIP SHALL BE EQUAL OR BETTER IN QUALITY TO THAT REQUIRED BY THE CONSTRUCTION TRADES FOR A FINISHED PRODUCT. A QUALITY CONTROL SUPERVISOR, DESIGNATED BY THE MANUFACTURER, SHALL REVIEW ALL WORK IN PROGRESS AND SHALL REVIEW THE FINISHED BUILDING PRIOR TO FINAL INSPECTION TO ASSURE IT IS COMPLETE AND CORRECT. THE QUALITY CONTROL SUPERVISOR SHALL HAVE THE AUTHORITY TO HAVE MATERIALS REPLACED AND WORK REDONE IN ORDER TO CORRECT FAULTY MATERIALS OR WORKMANSHIP.
GENERAL DESIGN REQUIREMENTS:
TWO (2) APPROXIMATELY 12' X 40' MODULES DESIGNED SO THAT TWO MODULES MAY BE JOINED TOGETHER TO FORM A COMPLETE STRUCTURE TO MAINTAIN A POSITIVE ALIGNMENT OF FLOORS, WALLS, AND ROOF AND TO PERMIT SIMPLE NON-DESTRUCTIVE DETACHMENT FOR FUTURE RELOCATION.
EACH MODULE SHALL BE PERMANENTLY IDENTIFIED WITH AN IMPRINTED (STAMPED NOT ENGRAVED) METAL IDENTIFICATION TAG 3"x1"-1/2" MINIMUM SIZE WITH THE FOLLOWING INFORMATION:
1. MANUFACTURER'S BUILDING NUMBER.
2. DESIGN WIND LOAD / EXPOSURE
3. DESIGN ROOF LIVE LOAD
4. DESIGN FLOOR LIVE LOAD
5. D.S.A. APPLICATION NUMBER.
2-TAGS PER MODULE ONE ON EXTERIOR AND ONE ON MODULE BEAM AT FRONT OF BUILDING ABOVE CEILING.
EACH MODULE SHALL BE CAPABLE OF RESISTING ALL VERTICAL AND LATERAL LOADS DURING TRANSPORTATION AND RELOCATION. (NORMAL INDUSTRY PRACTICE FOR BRACING MODULES DURING TRANSPORTATION AND RELOCATIONS IS ACCEPTABLE.) WHEN MODULES ARE ASSEMBLED JOINTS SHALL BE SEALED WITH REMOVABLE CLOSING STRIPS OR OTHER METHOD TO PRESENT A FINISHED APPEARANCE AND BE PERMANENTLY WATERPROOF.

EACH 12' X 40' MODULE SHALL BE SUFFICIENTLY RIGID TO BE JACKED UP AT THE FRONT AND BACK CORNERS FOR RELOCATION WITHOUT DAMAGE OR THE MODULE SHALL HAVE LIFT LUGS AT FRONT AND BACK LOCATED AS REQUIRED SO THAT THE MODULE MAY BE JACKED UP FOR RELOCATION IN ONE PIECE WITHOUT ADDITIONAL SUPPORTS OF ANY TYPE. EVIDENCE OF EXCESSIVE BOWING DURING THE INSTALLATION OF THE MODULES WHICH, IN THE OPINION OF THE AGENCY ARCHITECT OR STRUCTURAL ENGINEER, CAUSES EXCESSIVE WORKING AT ANY JOINT OR COMPROMISES THE STRUCTURAL INTEGRITY OF THE MODULE SHALL BE SUFFICIENT REASON FOR REJECTION OF THE MODULE.
FINISH AND BASE MATERIALS AT EACH MODULE SHALL TERMINATE AT INTERIOR MODULE JOINTS IN A MANNER TO JOIN FLUSH AND TIGHT WITH SAME MATERIAL IN ADJACENT MODULE SO THE MODULE MAY BE RELOCATED WITH MINIMUM CUTTING AND PATCHING.
DIMENSIONS
THE BUILDINGS SHALL OCCUPY AN AREA OF 960 SQUARE FEET WITH A TOLERANCE OF MINUS 5 SQUARE FEET. THE BUILDINGS SHALL BE 24' X 40'. ALL BUILDINGS SHALL MEET THE SQUARE FOOTAGE REQUIREMENT. LINEAR DIMENSIONS SHALL BE VERTICAL TRIM FINISH LINE TO VERTICAL TRIM FINISH LINE.
FASCIA AND REQUIRED OVERHANGS ARE NOT INCLUDED IN THE CALCULATION OF THE SQUARE FOOTAGE THE BUILDING OCCUPIES. THE ENTRANCE WALL SHALL HAVE A 5' MINIMUM ROOF OVERHANG. THE REAR WALL SHALL HAVE A MINIMUM 2' OVERHANG, FULL LENGTH GUTTERS AND DOWNSPOUTS SHALL BE FURNISHED ON THE SIDES OF EACH OVERHANG AND EACH ROOF EDGE WHERE DRAINAGE OCCURS. THE INTERIOR HEIGHT/FLOOR TO CEILING SHALL BE 8'-8" U.O.N. THE MODULE SHALL BE CLEAR SPAN TYPE EXCEPT AS PROVIDED FOR IN THE BID SPECIFICATIONS NOTING TYPE PROTRUDE MORE THAN 1" BELOW THE CEILING LEVEL.
ITEMS NOTED AS N.I.C. (NOT IN CONTACT) OR "BY OTHERS" IS THE RESPONSIBILITY OF THE SCHOOL DISTRICT DEPENDING ON THE AGREEMENT WITH DISTRICT.
IN THE EVENT OF CONFLICT BETWEEN THESE SPECIFICATIONS AND THE DISTRICT BID SPECIFICATIONS, THE DISTRICT SPECIFICATIONS SHALL PREVAIL.

Table with 4 columns: DESCRIPTION, SET, LENGTH, FINISH. Rows include SIDING, CASING SILL & INT. CORNER TRIM, 2X FASCIA, SOFFIT, 1X EXT. TRIM, WINDOWS, EXT., DOORS, EXT. TRIM.

24 X 40 RELOCATABLE CLASSROOMS

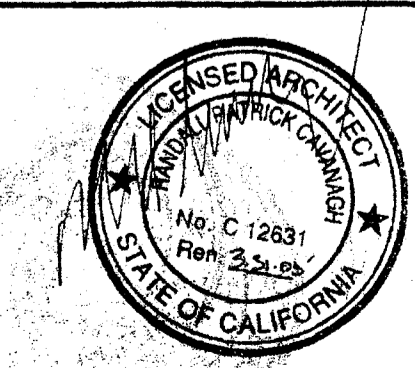

CUSTOMER: GENERAL NOTES AND SPECIFICATIONS

DATE: 04-28-08
SCALE: NONE
DRAWN BY: M.H.
CHECKED BY:
CHECKED BY:
SERIAL NO.

REVISIONS table with columns: NO, DATE, DESCRIPTION, NO, DATE, DESCRIPTION

PROJECT No. SHEET No. N-1

IDENTIFICATION STAMP: PC 02-104915, DATE: JUL 26 2005