

GENERAL NOTES

THE SEISMIC ANCHORAGE OF MECHANICAL EQUIPMENT SHALL CONFORM TO CCR TITLE 24. (SEE STRUCTURAL DRAWINGS)

ANCHORAGE DETAILS FOR ROOF/FLOOR MOUNTED EQUIPMENT LESS THAN 400 POUNDS AND HANGING EQUIPMENT LESS THAN 20 POUNDS MAY BE OBTAINED FROM THE DRAWINGS.

ALL MECHANICAL EQUIPMENT SHALL BE BRACED OR ANCHORED TO RESIST A HORIZONTAL FORCE ACTING IN ANY DIRECTION USING THE FOLLOWING TABLE. SIZE OF CONNECTION WEIGHT SHALL BE PROPORTIONATE. SIZE OF CONNECTION WEIGHT FOR FLEXIBLY MOUNTED EQUIPMENT USE 4 TIMES THE ABOVE VALUES. FOR SIMULTANEOUS VERTICAL FORCE USE 1/3 TIMES THE HORIZONTAL FORCE. THE ABOVE VALUES ARE FOR ALL IMPACTIVE FACTOR, I=1.0 AND SEISMIC ZONE, Z=4

WHERE ANCHORAGE DETAILS ARE NOT SHOWN, THE FIELD INSTALLATION SHALL BE SUBJECT TO THE APPROVAL OF THE ARCHITECT, AND THE FIELD ENGINEER OF PSA.

ALL FINISHES SHALL COMPLY WITH CRC CHAPTERS 5, 6, 7, 8, AND 10

FIELDWORK SHALL BE THOROUGHLY ATTACHED TO BUILDING AND SHALL NOT BE CLOSER THAN 6\"/>

ROOFERS SHALL BE POSITIVELY ATTACHED WITH 4-10GA SHEET METAL SCREWS OR AS NOTED.

CEILING PANELS 2\"/>

SEE SHEET A FOR GENERAL SPECIFICATIONS AND VARIOUS SPECIFICATIONS

SEE SHEET 501 FOR STRUCTURAL NOTES

SEE FOOTING 1/2 FOR STRUCTURAL DRAWING

FILE # 15-6

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES

03-118272

AC. FLS. SS. ca

DATE NOV - 8 - 2017

TRACKING #: 63321-292

APPENDICES

A. OR ALUM	ALUMINUM
NE	NOT NOTED
NO.	NUMBER
MIN.	MINIMUM
MAX.	MAXIMUM
ATT.	ABOVE FINISH FLOOR

LEGEND

MINIMUM	TYPE CEILING
CROSS NUMBER	INDICATED FREE SIDE
	INDICATED FREE SIDE
	SPRAY WIRE - 4 WY
	THERMOSTAT
	AT + 60\"/>
	AT + 40\"/>
	2\"/>
	SUPPLY AIR DIFFUSER
	(18\"/>

APPROVALS

MECHANICAL (HVAC) PLAN
HEAT/SUPPLY CROSS SECTION
GENERAL NOTES
CONTROL SCHEMATIC

DWG. DATE: APR 23, 1997

REV. # 2: JUNE 20, 1997

DRAWING SCALE: AS SHOWN

PROJECT NUMBER: 97-09

SHEET: M1

20 of 21

GENERAL NOTES

THE SEISMIC ANCHORAGE OF MECHANICAL EQUIPMENT SHALL CONFORM TO CCR TITLE 24. (SEE STRUCTURAL DRAWINGS)

ANCHORAGE DETAILS FOR ROOF/FLOOR MOUNTED EQUIPMENT LESS THAN 400 POUNDS AND HANGING EQUIPMENT LESS THAN 20 POUNDS MAY BE OBTAINED FROM THE DRAWINGS.

ALL MECHANICAL EQUIPMENT SHALL BE BRACED OR ANCHORED TO RESIST A HORIZONTAL FORCE ACTING IN ANY DIRECTION USING THE FOLLOWING TABLE. SIZE OF CONNECTION WEIGHT SHALL BE PROPORTIONATE. SIZE OF CONNECTION WEIGHT FOR FLEXIBLY MOUNTED EQUIPMENT USE 4 TIMES THE ABOVE VALUES. FOR SIMULTANEOUS VERTICAL FORCE USE 1/3 TIMES THE HORIZONTAL FORCE. THE ABOVE VALUES ARE FOR ALL IMPACTIVE FACTOR, I=1.0 AND SEISMIC ZONE, Z=4

WHERE ANCHORAGE DETAILS ARE NOT SHOWN, THE FIELD INSTALLATION SHALL BE SUBJECT TO THE APPROVAL OF THE ARCHITECT, AND THE FIELD ENGINEER OF PSA.

ALL FINISHES SHALL COMPLY WITH CRC CHAPTERS 5, 6, 7, 8, AND 10

FIELDWORK SHALL BE THOROUGHLY ATTACHED TO BUILDING AND SHALL NOT BE CLOSER THAN 6\"/>

ROOFERS SHALL BE POSITIVELY ATTACHED WITH 4-10GA SHEET METAL SCREWS OR AS NOTED.

CEILING PANELS 2\"/>


SEE SHEET A FOR GENERAL SPECIFICATIONS AND VARIOUS SPECIFICATIONS

SEE SHEET 501 FOR STRUCTURAL NOTES

SEE FOOTING 1/2 FOR STRUCTURAL DRAWING

NORMAN A. GEIGER
AIA, CSI, CDT, ICBO
P.O. BOX 41054
Sacramento, CA 95841
(916) 332-2453 FAX
(916) 332-2453 PHONE

GRAFICS ARCHITECTURAL SERVICES
GEIGER

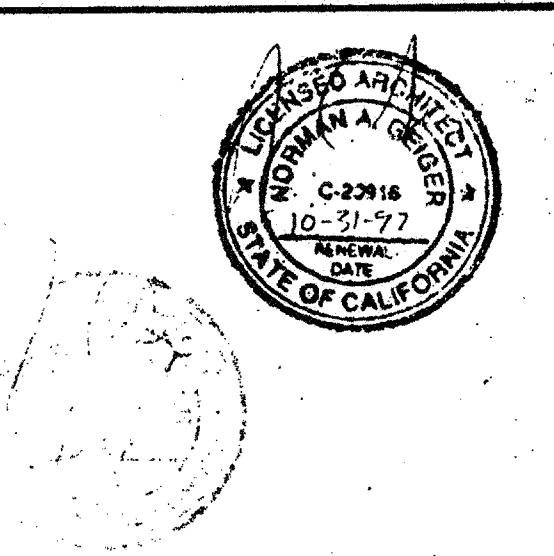

PACESSETTER INDUSTRIES, INC.
P.O. BOX 1151, MODESTO, CA 95355 (209) 521-1600

24x40 RELOCATABLE BUILDING

SHEET CONTENTS

MECHANICAL (HVAC) PLAN
HEAT/SUPPLY CROSS SECTION
GENERAL NOTES
CONTROL SCHEMATIC

DWG. DATE: APR 23, 1997

REV. # 2: JUNE 20, 1997

DRAWING SCALE: AS SHOWN

PROJECT NUMBER: 97-09

SHEET: M1

20 of 21

24'x40' MECHANICAL (HVAC) PLAN