

CLASS LEASING, LLC.

1221 Harley Knox Blvd. Perris, CA 92571-7408
(951) 943-1908 Fax (951) 943-5768

SPECIFICATIONS RELOCATABLE CLASSROOMS

- 3.01 CARPENTRY:**
1. **Scope of Work:** Contractor shall provide all labor, materials and services to install carpentry.
2. **Workmanship:**
a) **FRAMING:** securely nailed, bridged and blocked to form rigid structure. Work cut, fitted and assembled level, plumb and true to line. Trim in as long lengths as possible with all standing trim in one piece. Trim sealed at all edges.
b) **NAILING:** In accordance with the title 24 CCR-Table 2304.9.1. Nails shall be corrosion resistant box nails.
c) Machine applied nailing shall have prior demonstration and approval by DSA Field Inspector and the Architect. The approval is subject to continuous satisfactory performance. Plywood shall have a minimum thickness of 3/8". If nail heads penetrate the outer ply more than would be normal for a hand hammer or if minimum allowable edge distances are not maintained, the performance will be deemed unsatisfactory.
d) **TRIM:** sealed at all edges. Sealant painted to match trim or siding.

- 4.01 MATERIAL SPECIFICATIONS:**
- Structural framing shall be Hem Fir-Larch graded in accordance with the standard grading rules of the Western Wood Products Association or standard grading rules No. 16 of the West Coast Lumber Inspection Bureau, latest editions. Grades shall be as follows unless noted otherwise on the drawings. (Hem Fir South is not allowed.) Each piece shall be grade marked and no piece may fall below grade indicated. All framing except as noted Hem Fir No. 2
 - Plywood shall be as shown on these drawings with exterior glue in accordance with U.S. Product Standard PS 1-07. All panels shall be marked with an APA grade mark with an identification index as shown on drawings. Use 4"x8" panels minimum, except at boundaries and at framing changes where minimum panel dimension shall be 24" at roofs and floors and 12" at walls.
 - Bolts for timber connections shall conform to ANSI/AISI Standard B18.2.1-2012 & 2012 edition of NDS (The National Design Specification for Wood Construction by the National Forest Products Association). Bolts shall be installed in accordance with the requirements of 2012 NDS. Bolt holes shall be 1/32" to 1/16" inch larger than bolt diameter. Bolts shall be full body steel bolts with minimum yield strength of 45,000 PSI. Re-tighten bolts before closing of work.
 - Lag screws shall be steel and conform to ANSI/AISI Standard B18.2.1 and 2012 NDS. Holes for lag screw shanks shall be bored to the same depth and diameter as the shank. The remaining depth of penetration of the screw shall be bored to 70% of the shank diameter. One quarter inch (1/4") diameter lag screws need not have pre-drilled holes if it can be shown that wood members are not damaged during installation. Provide full diameter body lag screws with bending yield strengths per Table 11J in NDS
 - Provide malleable iron washers or equivalent cut plate washers (not less than a standard cut washer) under nuts and /or lag screw heads which bear on wood.
 - Wood screws shall conform to ANSI/AISI Standard B18.6.1 and the requirements of the 2012 NDS. Galvanized or other corrosion resistant coating where exposed to weather or used in foundations. Screws shall be steel with cut threads and bending yield strengths per Table 11L in NDS.
 - Wood members shall be cut or notched only as shown on structural drawings.
 - When required nailing tends to split wood members, nail holes shall be pre-bored to 3/4 of the nail diameter.
 - Structural nailing shall be with BOK NAILS per all requirements of 2012 NDS. Nailing not specifically indicated shall comply with CCR Title 24, Part 2, Table 2304.9.1. All nails shall be galvanized or other corrosion resistant coating where exposed to weather, in foundations and as noted on plans, per the requirements of CCR Title 24, Part 2, with minimum bending yields per table 11N in NDS. (See nail equivalence below.)
Nail equivalence:
(provide minimum nail lengths as required for specified penetration, TYPICAL: U.N.O.)
6d equals .113" DIA. - provide 1.30" minimum point penetration
8d equals .131" DIA. - provide "1.57" minimum point penetration
 - Pressure preservative treatment shall be per Section 2303.1.3, CCR Title 24, Part 2. Provide quality mark on all treated foundation members that comply with CCR 2303.1.3.1. All foundation members shall be marked as "For ground contact" or "For above ground use" as appropriate. Pressure treated material shall comply with ANPA Standard U1 as required by CCR 2303.1.3. Treat all cut ends of pressure treated members with an approved preservative. (Millard WB Copper Green 2% or an approved equivalent). Where noted, members below the sub floor that are not a part of the foundation shall be pressure treated.
 - Only material in contact with ground needs to be pressure treated, all other foundation lumber can be DF or HF#2 or equal.
 - If machine nailing is utilized for this project, contractor shall comply with all requirements of CCR Title 24, Part 2. Machine nailing is subject to approval by the Structural Engineer or Architect and the Division of the State Architect.
 - Fasteners for pressure-preservative treated and fire-retardant treated wood shall comply with Section 2304.9 of CBC.
 - Nails and spikes used in wet or exterior locations shall comply with Section 2304.9.1.1 of CBC.
 - Shim material shall be plywood CD EXP 1 or equal (not pressure treated).
 - Used lumber in good condition is acceptable for use in foundation system.
 - The plates shall conform to A-1011 Grade 33.

- 5.01 SITE INSTALLATION REQUIREMENTS FOR DSA CLASSROOM BUILDINGS:**
- In the case of equipment located in the State of California, the LESSEE (School District) is responsible for the site being cleared (free of grass, trees, shrubs, etc) and graded to within 4 1/2" of level grade for each building. If the site exceeds the 4 1/2" level grade requirement additional costs may be charged to lessee.
- Under no circumstances should the site be greater than 9" from level grade or have less than a 1000 PSF MINIMUM SOIL BEARING PRESSURE.
- Prior to delivery, the lessee shall mark the four corners of the building on the site, including door location. Should special handling be required to other place, install or relocate the classroom on the lessee's site due to site obstruction such as fencing, landscaping, other classrooms, etc., additional costs will be charge to the lessee.

- 6.01 TEST AND INSTALLATION:**
- Provide Electrical Grounding Test per DSA IR E-1.
 - Field Welding for welded tie plate option. (If used, requires Test and Inspection.)
The example form DSA 103's shown on this sheet are for illustration purposes only. A form DSA 103 is to be completed for each application that this PC is being incorporated into and all example form DSA-103's are to be processed out on this drawing.
 - No other tests and inspections are required.

- 1.01 GENERAL REQUIREMENTS:**
- The requirements of the general conditions of the agreement and these General Requirements apply to the several trade sections with the same force as though fully repeated in each section.
 - Name brands are indicated to establish a standard of quality. Items of equal or better quality may be substituted for the listed brand named products.
- 1.02 SCOPE OF WORK:**
- The work consists of installing on-site, modular Relocatable buildings as defined herein, shown and detailed on the drawings.
 - All requirements of CCR (California Code of Regulation) Title 19 and 24 relating to inspections and verified reports shall be complied with and shall include:
a) General responsible charge of Field Administration by the Architect of Record.
b) Inspection during the course of construction by an inspector approved by DSA (Division of the State Architect) and the District Architect. The inspector shall be responsible for and approved to inspect the general construction, welding, mechanical and electrical work. Cost of these inspections shall be borne by the School District.
c) On site inspection of the building installation, electrical and utility of the building installation or connection by an inspector approved by the DSA and retained by the School District.
d) Other special tests or inspections as may be required by DSA. Cost of these inspections/tests shall be borne by the School District.
- 1.03 WORK NOT INCLUDED:**
- All on-site or off-site utilities and the connection of them to the building unless indicated on the drawings.
 - All leveling, grading or other site preparation (except concrete or wood leveling strips, where Required) unless otherwise indicated on the drawings.
 - Fire alarm system, program bell, clock, public address system, intercom system, TV system, computer data or any other low voltage system, unless otherwise indicated on the drawings or the lease agreement.
- 1.04 ACCESSIBILITY OF SITE:**
The School District shall provide access to the site for the installation of the building. Removal of trees, shrubs, fencing, sprinklers, etc. necessary for move-in and removal of the buildings shall be the responsibility of the School District.
- 2.01 SITE ASSEMBLY:**
- Scope of Work:** Contractor shall provide all labor, materials and services to prepare the building elements, transport them from the plant to the site and to complete the assembly at the site.
The condition of the site, such as drainage and soil bearing capacity, shall be the responsibility of the School District and the District Architect.
a) In a location off the site as determined by the District Architect. The contractor shall place the foundation as detailed on the drawings.
b) The elements shall be brought to the site on wheel assembly and transferred to the prepared site. Great care shall be taken to avoid damage to the elements by racking or bumping.
c) Connection of the elements together shall be done according to instructions on the drawings. Flashing, trim and other loose items shall be installed per plans and details of the original building manufacturer's drawings.

DSA DIVISION OF STATE ARCHITECT
Statement of Structural Tests & Special Inspections - 2013 CBC

DATE: 01/28/2015
PROJECT: CLASS LEASING APPROVED STOCKPILE A NUMBERS FOR THIS FOUNDATION PC

TEST OR SPECIAL INSPECTION: SOILS, CONCRETE, MASONRY, STEEL

1. Verify that all materials are appropriately tested and that all test certificates include required procedures that comply with applicable codes, laws and codes with amendments.
2. Verify that all materials are tested in accordance with the applicable code, laws and codes with amendments.
3. Verify that all materials are tested in accordance with the applicable code, laws and codes with amendments.
4. Verify that all materials are tested in accordance with the applicable code, laws and codes with amendments.

1. Field Welding Inspection: Special Inspection Visual Report - Form DSA-202

KEY TO COULDS:


1. Inspects that a certificate special inspection is required	2. Performed by:
2. Inspects that a certificate special inspection is required	3. Inspects that the test or inspection is to be performed by a registered professional engineer or his or her designee.
3. Inspects that the test or inspection is to be performed by a testing laboratory approved by the DSA.	4. Inspects that the test or inspection is to be performed by a testing laboratory approved by the DSA.
4. Inspects that the test or inspection is to be performed by a testing laboratory approved by the DSA.	5. Inspects that the test or inspection is to be performed by a testing laboratory approved by the DSA.

APPLICABLE BUILDING CODES
ALL NEW WORK SHALL COMPLY AND CONFORM TO THE REQUIREMENTS OF THE 2013 CBC
2013 CALIFORNIA CODE OF REGULATIONS (CCR) As of January 01, 2014*
-2013 CALIFORNIA BUILDING STANDARDS ADMINISTRATIVE CODE PART 1, TITLE 2 (2012 INTERNATIONAL BUILDING CODE VOLUMES 1-2 WITH 2013 CALIFORNIA AMENDMENTS)
-2013 CALIFORNIA ELECTRICAL CODE (CEC) PART 3, TITLE 24, CCR (2011 NATIONAL ELECTRICAL CODE WITH 2013 CALIFORNIA AMENDMENTS)
-2013 CALIFORNIA MECHANICAL CODE (CMC) PART 4, TITLE 24, CCR (2012 UNIFORM MECHANICAL CODE WITH 2013 CALIFORNIA AMENDMENTS)
-2013 CALIFORNIA PLUMBING CODE (CPC) PART 5, TITLE 24, CCR (2012 UNIFORM PLUMBING CODE WITH 2013 CALIFORNIA AMENDMENTS)
-2013 CALIFORNIA ENERGY CODE (CEC) PART 6, TITLE 24, CCR*
-2013 CALIFORNIA FIRE CODE PART 9, TITLE 24, CCR (2012 INTERNATIONAL FIRE CODE WITH 2013 CALIFORNIA AMENDMENTS)
-2013 CALIFORNIA REFERENCED STANDARDS CODE PART 12, TITLE 24, CCR TITLE 19 CCR PUBLIC SAFETY, STATE FIRE MARSHALL REGULATIONS.

DESIGN DATA:
FLOOR LIVE LOAD = 50 PSF, 60 + 20 PSF PARTITIONS, 100 PSF
ROOF LIVE LOAD = 20 PSF REDUCIBLE FOR TRIBUTARY AREA
WIND SPEED = 120 MPH (V) (3 SECOND GUST), Kz = 1.0
SNOW LOAD: PROJECT IS NOT LOCATED IN A SNOW REGION.
BUILDING CODES = 2012 IBC AND CBC 2013

SEISMIC DESIGN DATA:
Basic Seismic-Force-Resisting System = STEEL MOMENT FRAME
ANALYSIS PROCEDURE USED = ANALYSIS PROCEDURE USED = E (per CBC Section 1613A.5.6)
Design Base Shear = 2400 BUILDING = 9400 # (Roof, Floor, Walls & Partitions)
2400 BUILDING = 14500 # (Roof, Floor, Walls & Partitions)
4500 BUILDING = 19200 # (Roof, Floor, Walls & Partitions)

LIMITATIONS FOUNDATION PC ONLY:
FOUNDATION ONLY PC IS DESIGNED TO SUPPORT THE SUPERSTRUCTURE FOR THE RELOCATABLE BUILDINGS AS LISTED ON THIS DRAWING.
THE DESIGN CALCULATIONS ARE BASED ON THE FOLLOWING:
1. DSA APPROVED STOCKPILE BUILDINGS
2. ROOF OVERHANGS OF 6'-0" MAXIMUM
3. SINGLE SLOPE OR DUAL SLOPE BUILDINGS:
WALL HEIGHT: 9'-0" MAXIMUM ON DUAL SLOPE BUILDING;
WALL HEIGHT: 10'-0" MAXIMUM ON SINGLE SLOPE BUILDING;
(HEIGHT DETERMINED FROM FINISH FLOOR IN BUILDING TO BOTTOM OF STEEL ROOF STRUCTURE: BEAMS OR ROOF HEADERS)
WALL HEIGHT: 9'-10" MAXIMUM ON SHEAR WALL-DUAL SLOPE BUILDING
4. WALL DEAD LOAD OF 10 PSF (NO STUCCO)
5. FLOOR DEAD LOAD OF 8 PSF

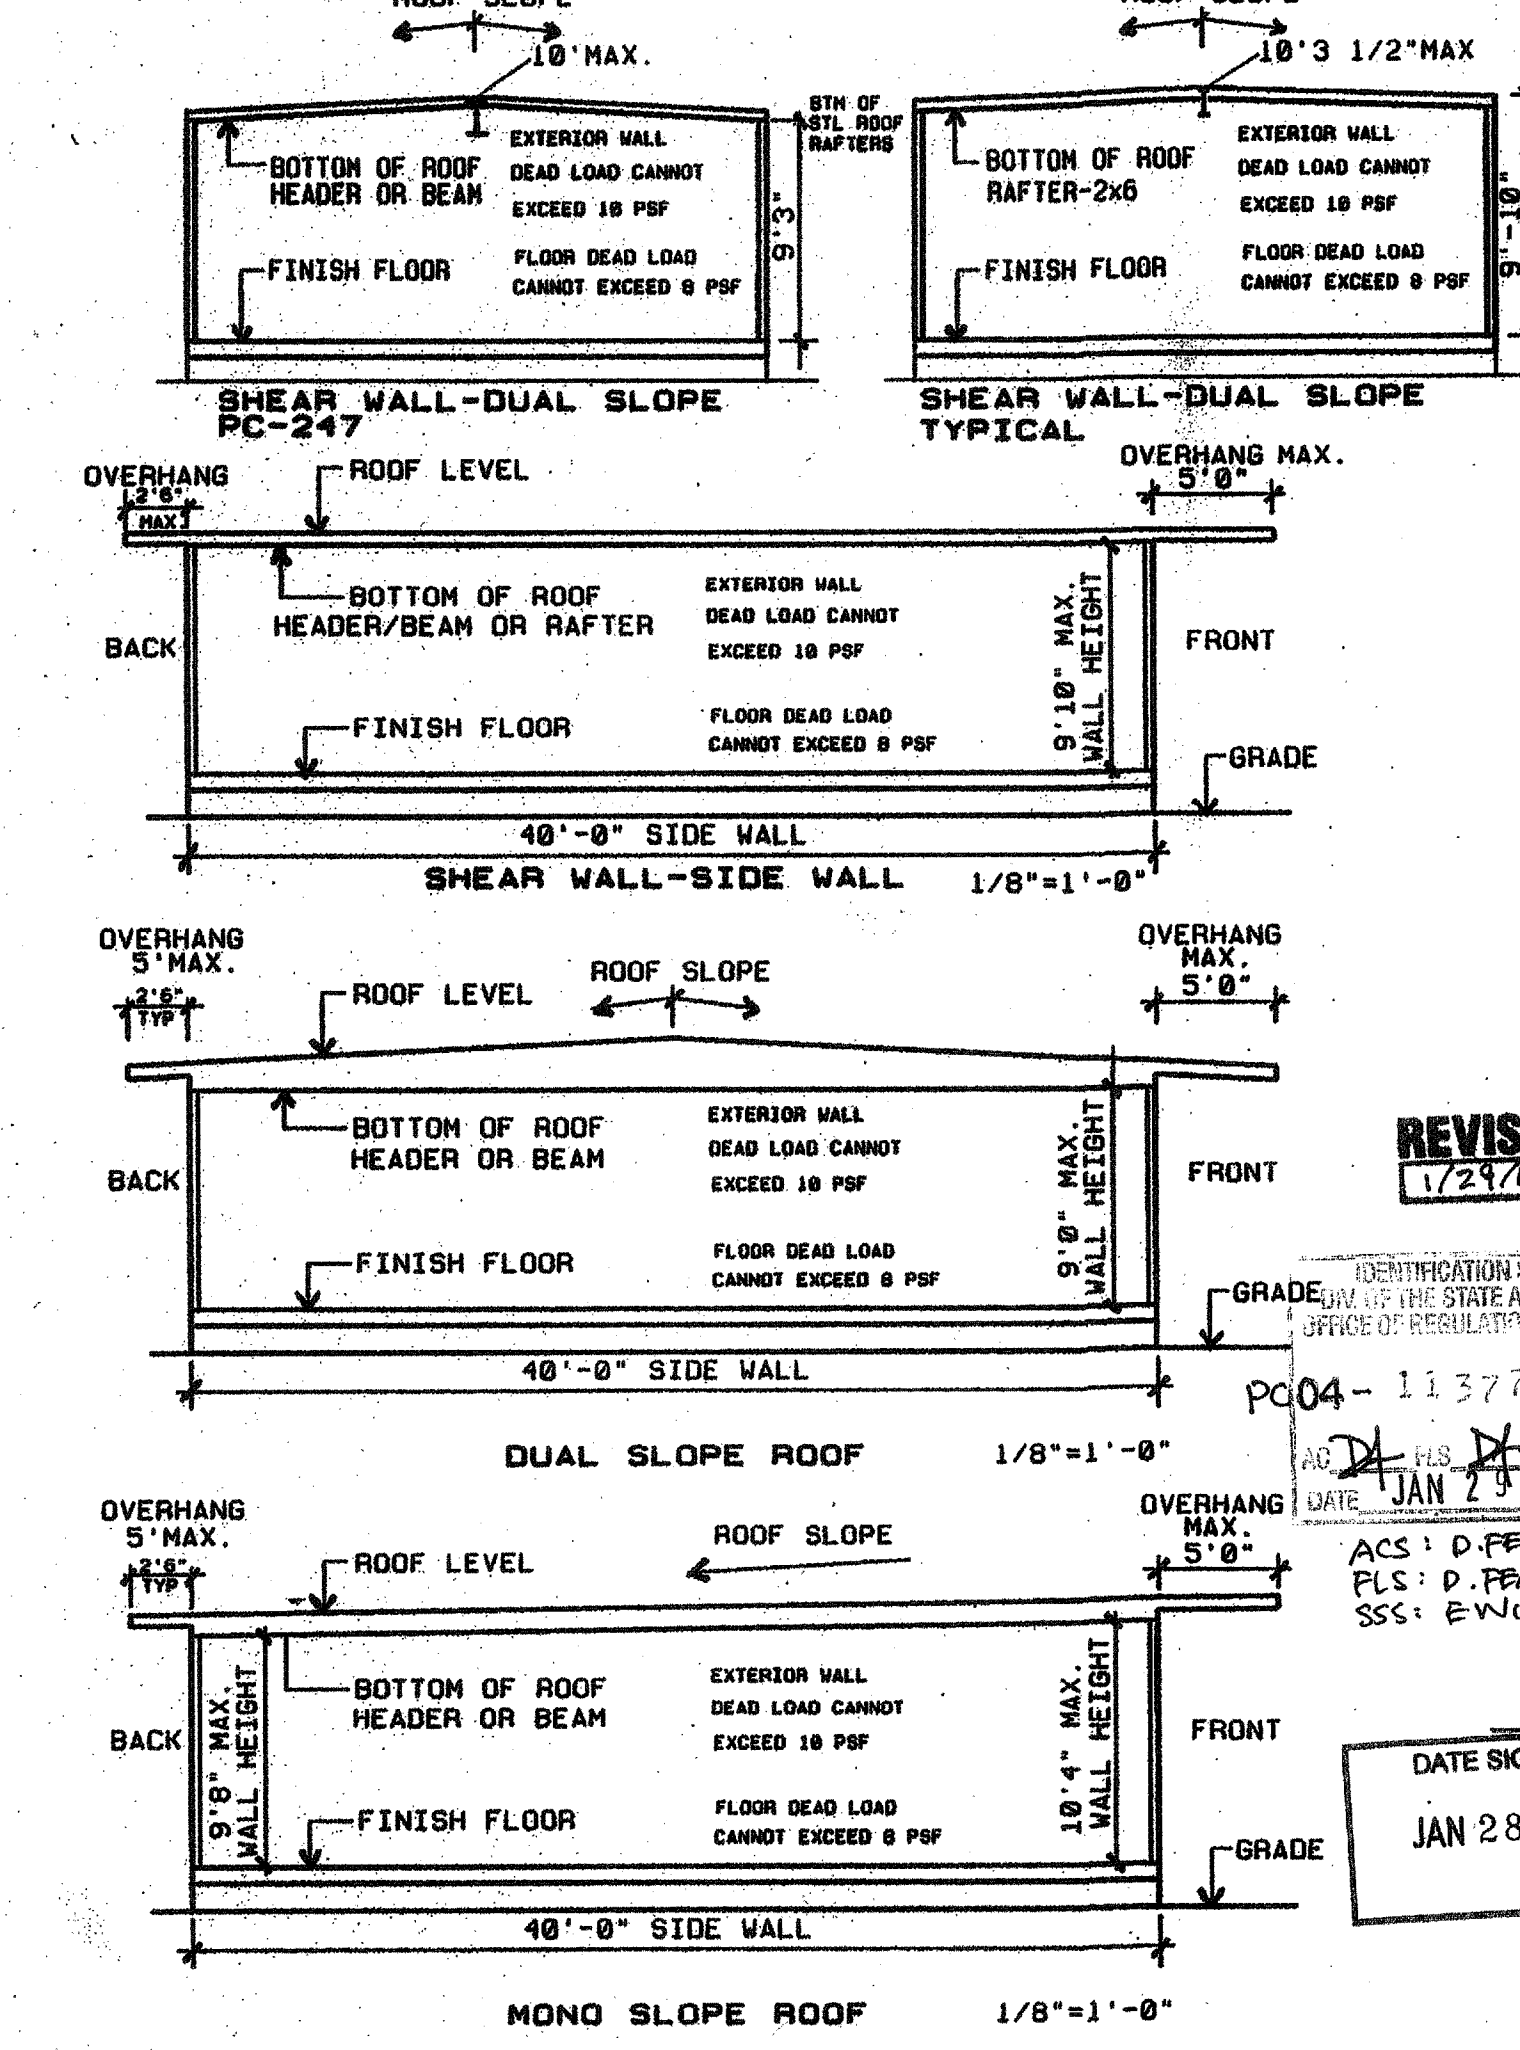

SCOPE OF WORK: DSA FOUNDATION PLANS FOR EXISTING STOCKPILE BUILDINGS FOR CLASS LEASING, LLC.

SHEET INDEX: STOCKPILE BUILDING FOUNDATION - 2013 CODE UPDATE

F1.0	COVER SHEET, BUILDING DATA, STOCKPILE APPROVAL INDEX
F2.0	24x40 50 PSF FOUNDATION PLAN AND DETAILS, ADJACENT BUILDING PAD
F2.1	24x40 50+20 PSF FOUNDATION PLAN AND DETAILS, ADJACENT BUILDING PAD
F2.2	30x40 50 PSF FOUNDATION PLAN AND DETAILS, ADJACENT BUILDING PAD
F2.3	30x40 50+20 PSF FOUNDATION PLAN AND DETAILS, ADJACENT BUILDING PAD
F2.4	30x40 100 PSF FOUNDATION PLAN AND DETAILS, ADJACENT BUILDING PAD
F2.5	30x40 50 PSF FOUNDATION PLAN AND DETAILS, ADJACENT BUILDING PAD
F2.6	30x40 50+20 PSF FOUNDATION PLAN AND DETAILS, ADJACENT BUILDING PAD
F2.7	48x40 50 PSF FOUNDATION PLAN AND DETAILS, ADJACENT BUILDING PAD
F2.8	48x40 50+20 PSF FOUNDATION PLAN AND DETAILS, ADJACENT BUILDING PAD
F2.9	48x40 100 PSF FOUNDATION PLAN AND DETAILS, ADJACENT BUILDING PAD

SHEET INDEX: BELOW GRADE CONCRETE FOUNDATION DESIGNED FOR MODTECH BUILDINGS ONLY

C1.0	COVER SHEET, BUILDING DATA, STOCKPILE APPROVAL INDEX
C2.0	24 x 40 - 50 PSF CONCRETE FOUNDATION PLAN & DETAILS, ADJACENT BUILDING PAD
C2.1	24 x 40 - 50+20 PSF CONCRETE FOUNDATION PLAN & DETAILS, ADJACENT BUILDING PAD
C3.0	36 x 40 - 50 PSF CONCRETE FOUNDATION PLAN & DETAILS, ADJACENT BUILDING PAD
C3.1	36 x 40 - 50+20 PSF CONCRETE FOUNDATION PLAN & DETAILS, ADJACENT BUILDING PAD
C3.2	36 x 40 - 100 PSF CONCRETE FOUNDATION PLAN & DETAILS, ADJACENT BUILDING PAD
C4.0	48 x 40 - 50 PSF CONCRETE FOUNDATION PLAN & DETAILS, ADJACENT BUILDING PAD
C4.1	48 x 40 - 50+20 PSF CONCRETE FOUNDATION PLAN & DETAILS, ADJACENT BUILDING PAD
C4.2	48 x 40 - 100 PSF CONCRETE FOUNDATION PLAN & DETAILS, ADJACENT BUILDING PAD

ADJACENT BUILDINGS: ONLY THOSE BUILDINGS MANUFACTURED BY THE SAME COMPANY MAY BE PLACED ADJACENT TO EACH OTHER

CLASS LEASING-APPROVED STOCKPILE A NUMBERS FOR THIS FOUNDATION PC

BUILDING DATA - 24 x 40 SHEAR WALL	DSA #	PC-BASE	DATE	SIZE	FLOOR LOAD	BLDG MFG
STKP 029	02972	SHR	11-06-1998	24 x 40	50#	MODTECH
STKP 02	02972	48130-SHR	11-06-1998	24 x 40	50#	MODTECH
STKP 01	02973	48700-SHR	11-06-1998	24 x 40	50#	MODTECH
STKP 03	02974	SHR	11-06-1998	24 x 40	50#	MODTECH
STKP 04	02975	48400-SHR	12-07-1999	24 x 40	50#	AURORA
STKP 05	02976	SHR	10-05-1990	24 x 40	50#	MODTECH
STKP 06	02976	SHR	10-05-1990	24 x 40	50#	MODTECH
STKP 22	05113	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 24	05113	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 13	01897	PC 247	06-28-1994	24 x 40	50#	MODTECH
STKP 17	01970	PC 247	11-10-1997	24 x 40	50#	MODTECH

BUILDING DATA - 24 x 40 RIGID FRAME

STKP #	DSA #	PC-BASE	DATE	SIZE	FLOOR LOAD	BLDG MFG
STKP 05	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 06	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 07	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 08	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 09	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 10	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 11	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 12	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 14	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 15	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 16	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 18	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 19	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 20	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 21	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 23	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 25	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 26	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 27	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 28	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 29	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 30	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 31	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 32	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 33	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 34	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 35	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 36	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 37	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 38	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 39	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 40	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 41	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 42	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 43	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 44	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 45	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 46	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 47	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 48	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 49	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 50	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 51	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 52	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 53	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 54	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 55	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 56	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 57	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 58	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 59	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 60	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 61	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 62	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 63	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 64	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 65	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 66	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 67	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 68	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 69	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 70	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 71	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 72	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 73	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 74	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 75	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 76	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 77	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 78	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 79	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 80	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 81	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 82	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 83	02972	PC 20	06-14-1994	24 x 40	50#	MODTECH
STKP 84						