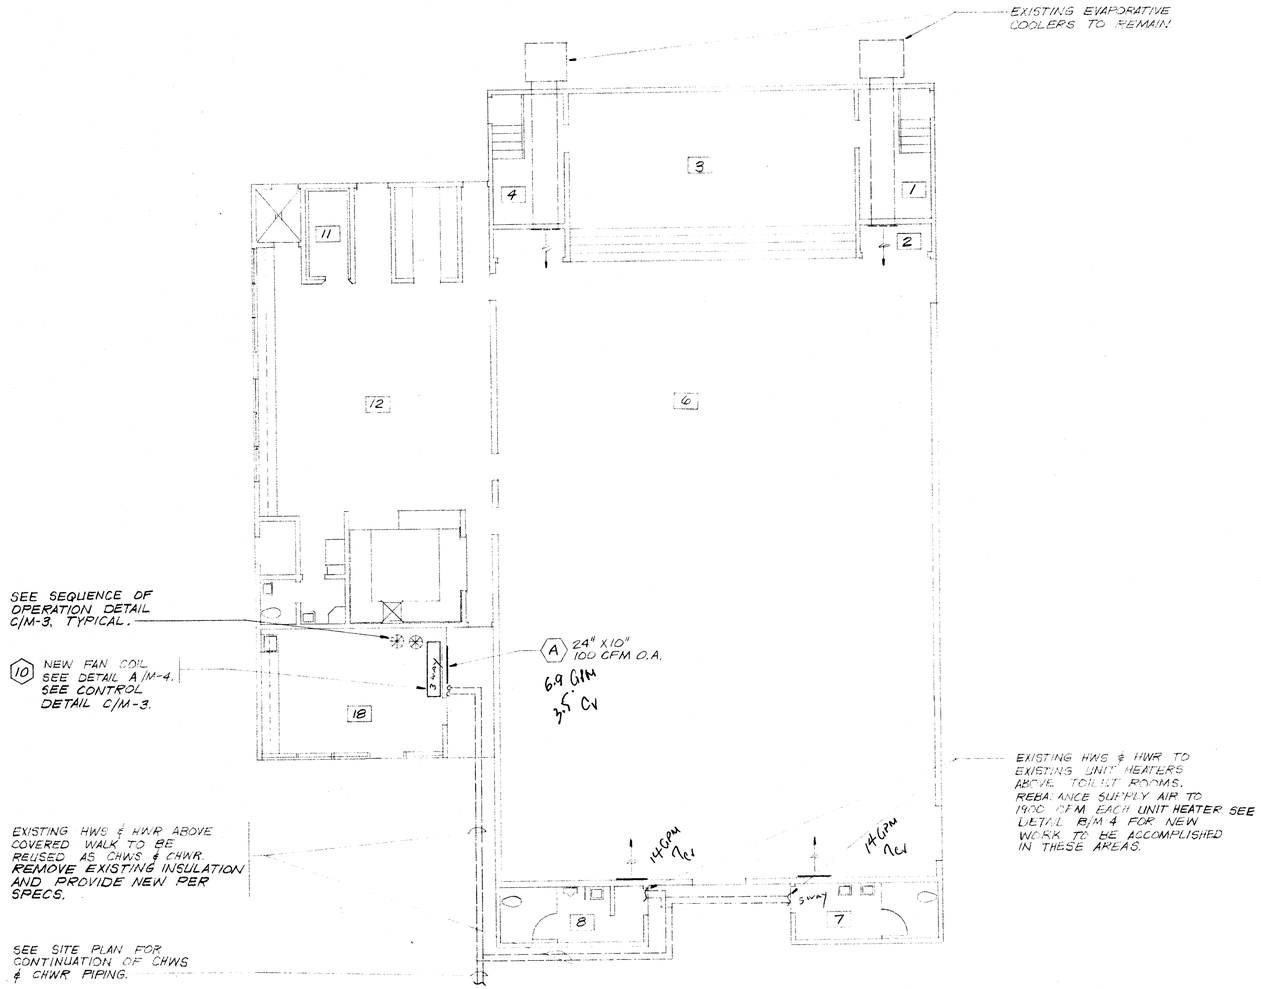

UNIT A
AIR CONDITIONING PLAN

SCALE: 1/8" = 1'-0"

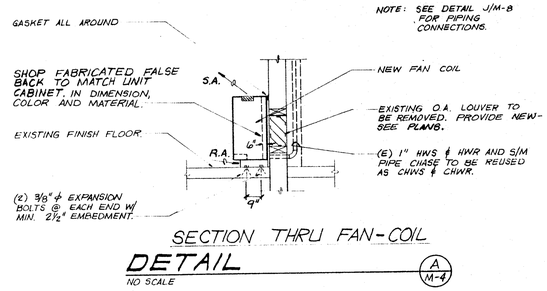

SECTION THRU FAN-COIL

DETAIL A/M-4

NO SCALE

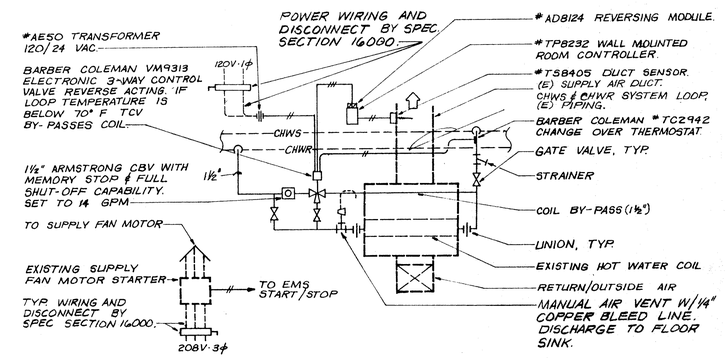

AIR HANDLER CONTROL DIAGRAM

DETAIL B/M-4

DIAGRAMMATIC

NOTES:

1. REMOVE EXISTING HWS & HWR PIPING AND MANIFOLDING. PROVIDE NEW AS INDICATED.
2. ALL MODEL NUMBERS SHOWN ABOVE ARE BARBER-COLEMAN.
3. START/STOP SHALL BE CAPABLE FROM NEW EMS.
4. PIPE SIZES AND GPM ARE FOR UNIT A AIR HANDLERS. UNIT B AIR HANDLER: USE 1¼" PIPE SIZE AND SET FLOW RATE TO 10 GPM.
5. REMOVE EXISTING INSULATION FROM CENTRAL SYSTEM PIPING. PROVIDE NEW INSULATION ON ALL PIPING, MANIFOLDING, AND VALVES. SEE SPECS.

TITLE 24 & 1978 UMC

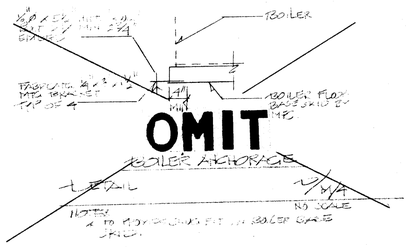

date
2·26·90
revisions

MUNSEY SCHOOL MODERNIZATION
BAKERSFIELD CITY SCHOOL DISTRICT
BAKERSFIELD, CALIFORNIA

APPROVED
Department of Public Works
Office of the State Architect

FEB 2

ONLY

JOHN FRANK MITCHELL M12910 Expires 9/1/90
CONSULTING MECHANICAL ENGINEERS
444 WEST BEMIS, SUITE 107
FRESNO, CALIFORNIA 93728
PHONE 275-3299
8737.2

Kentwood Design Group
Shuckhardt Lloyd A.I.A.
architects • planners
2115 19th street • bakersfield, ca 93301 • (805) 322-1863

job number
8712

sheet number
M-4
OF 9