


SITE FIRE ALARM PLAN NOTES

- 1 PULL NEW CABLES IN EXISTING CONDUIT. PULL PAST EXISTING CABLES.
- 2 SAWCUT AND REPAIR TO MATCH EXISTING. BORING IS AN ACCEPTABLE METHOD OF CONDUIT INSTALLATION. PROVIDE METHOD OF PROCEDURE FOR BORING TO ENGINEER FOR REVIEW AND APPROVAL. DETAIL BORING PROCEDURE. IDENTIFY TYPE OF CONDUIT TO BE USED IN BORE.

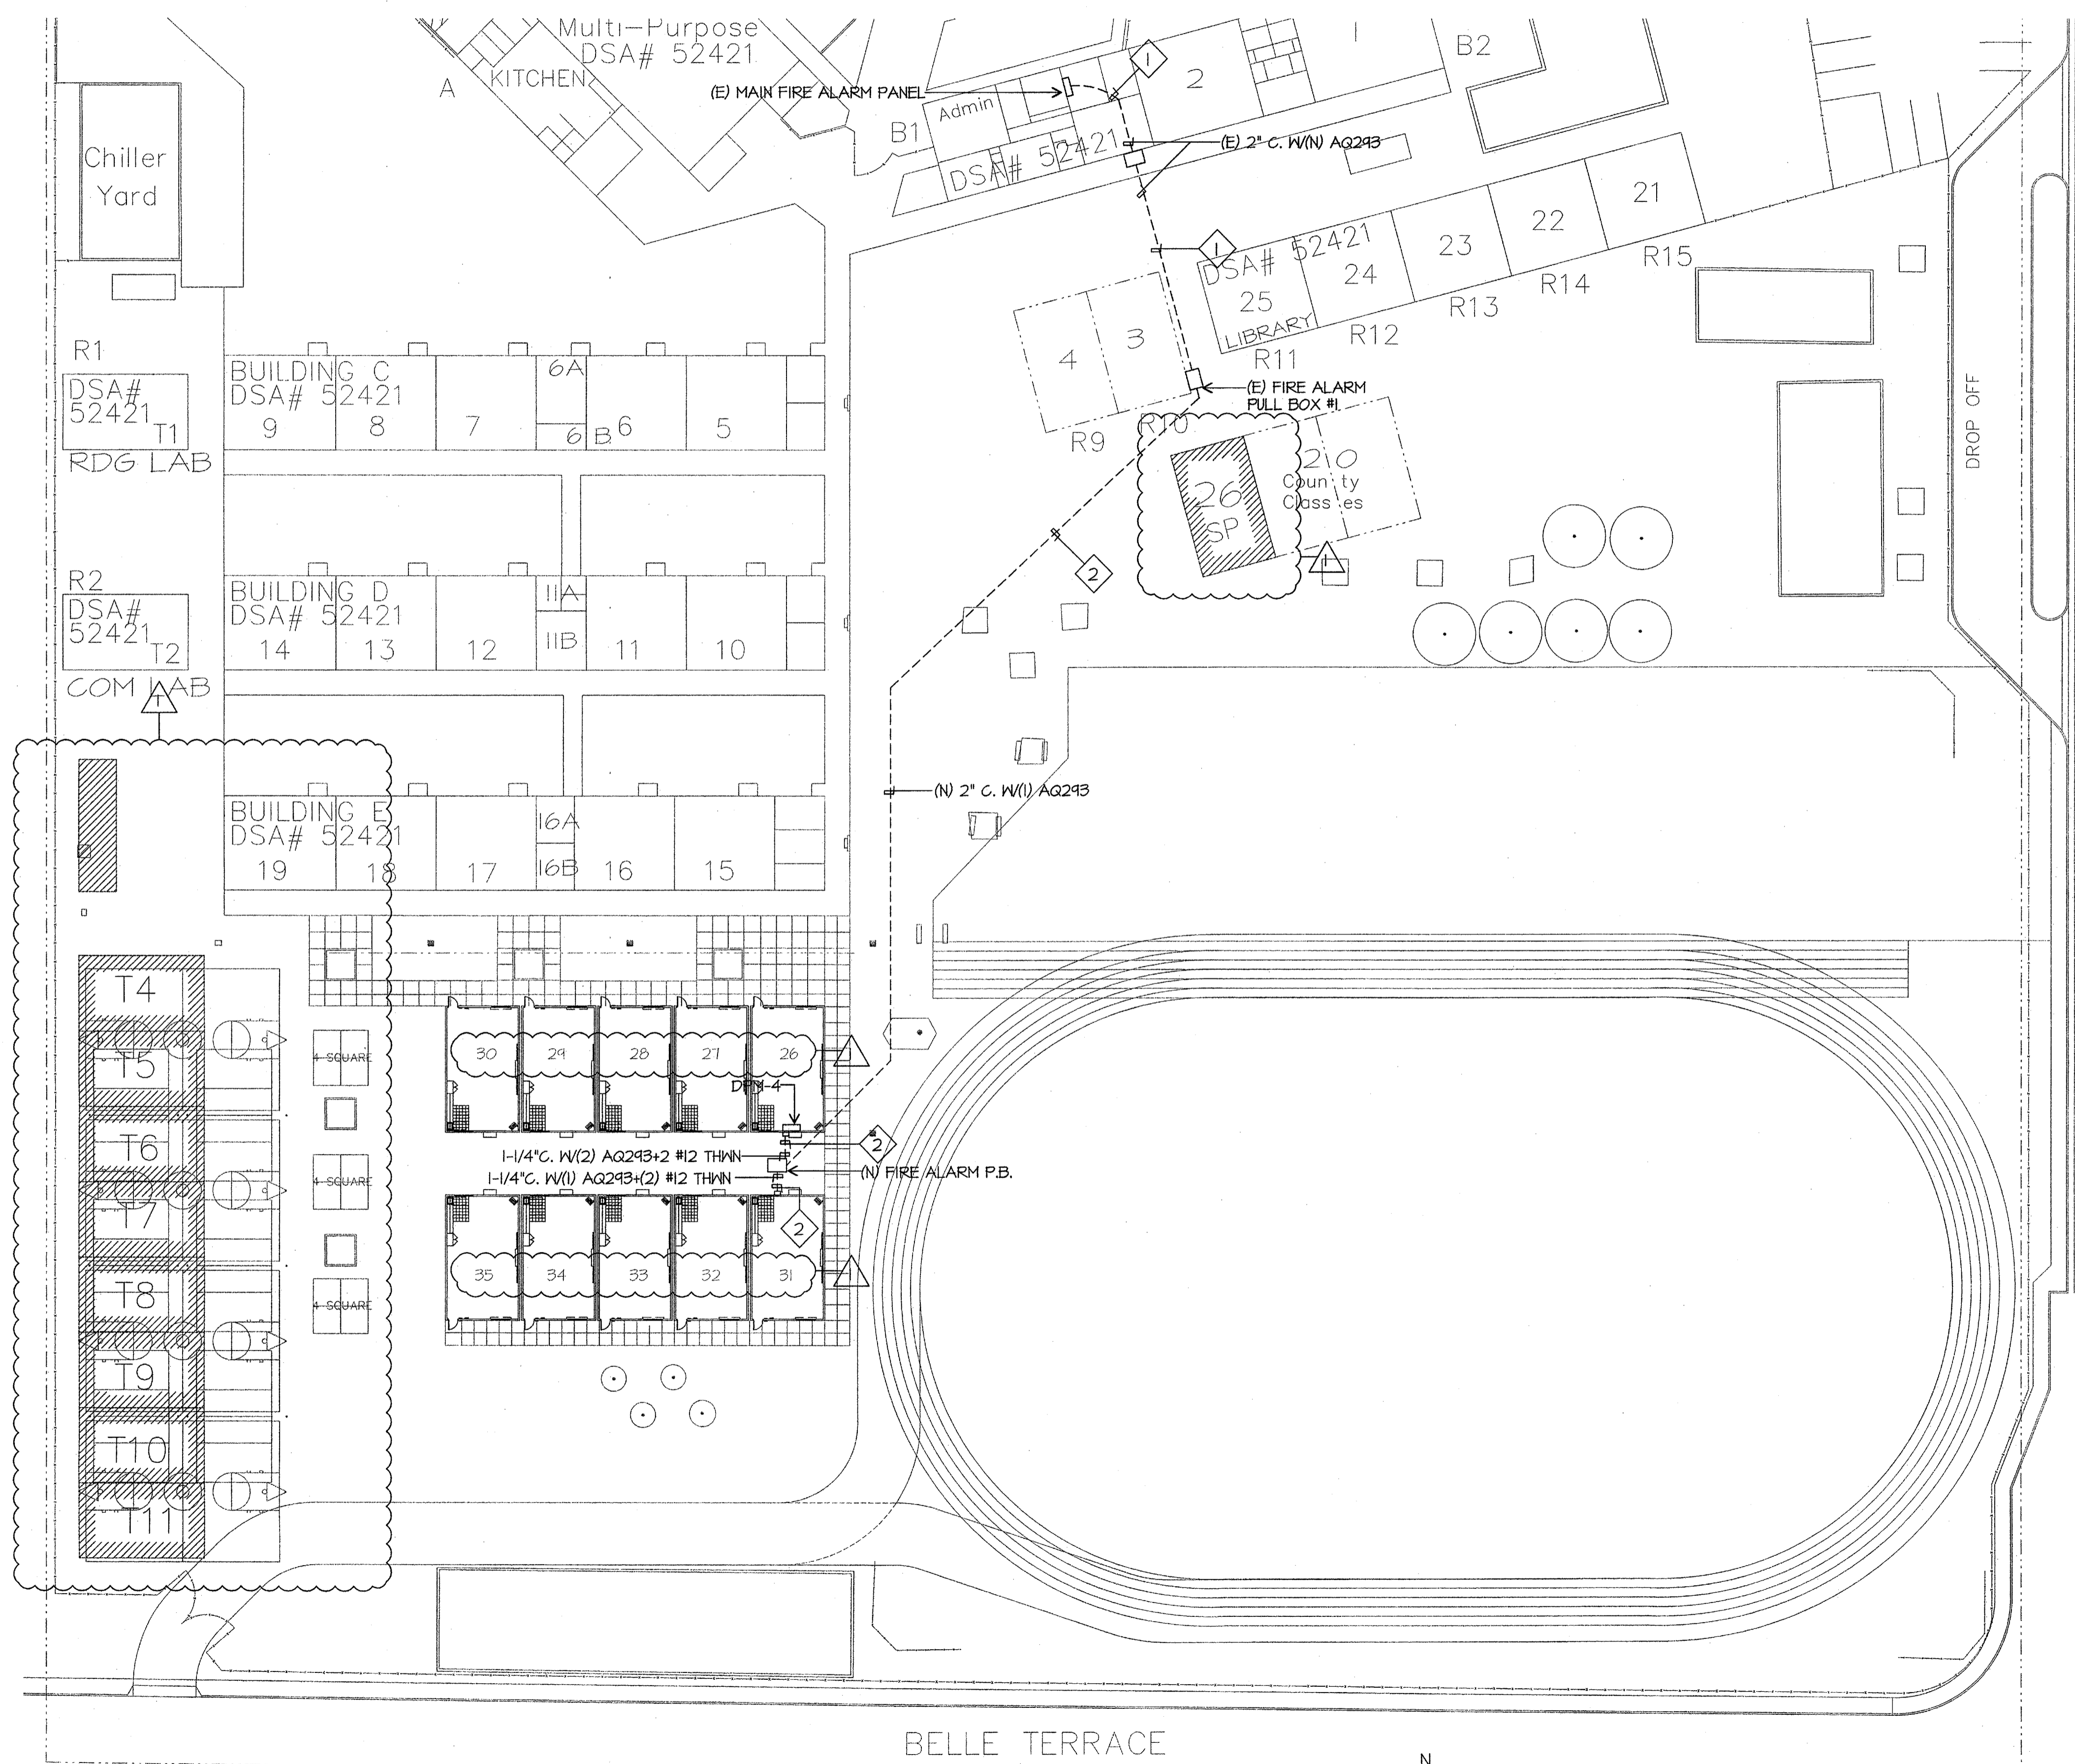

SITE FIRE ALARM PLAN

SCALE: 1"=30'-0"



integrated designs by SOMAM, Inc.

ARCHITECTURE • ENGINEERING • INTERIOR DESIGN • CONSTRUCTION MANAGEMENT

8011 N. Fresno, Suite 130 - Fresno, California 93710
 Phone (559) 336-0881 Fax (559) 336-0887 E-Mail: design@somam.com
 www.integrateddesigns.com

Ownership of Documents
 This document, the ideas and designs incorporated herein, as an instrument of Professional Service is the property of Integrated Designs by SOMAM Inc. and is not to be used, in whole or in part for any other project without written authorization.
 © COPYRIGHT 2009

Revision:	10/16/09	Revision Description:	ADDENDUM 1
Rev. Date:		Revision Description:	

Sheet Title:
SITE FIRE ALARM PLAN

Issue Date:
Date: 05/02/06
Designer: DESIGNER
DR: DRAFTER
PC: CJM

Project Name & Address:
**MUNSEY ELEMENTARY SCHOOL
10 NEW PORTABLE CLASSROOMS**
BAKERSFIELD CITY SCHOOL DISTRICT
3801 BRAVE AVE. BAKERSFIELD, CA 93309

DSA Identification Stamp:

Stamp(s):

Job No.: **3832**

Sheet No.: **E-3**

Release: **ADDENDUM 1**

J.M.P.E. ELECTRICAL ENGINEERING AND LIGHTING DESIGN
 6500 MIRO AVENUE, SUITE 201, BAKERSFIELD, CA 93309
 (805) 833-7844 FAX (805) 833-7843
 e-mail: mpe@jimpempe.com www.jimpempe.com

J.M.P.E. ELECTRICAL ENGINEERING AND LIGHTING DESIGN
 6500 MIRO AVENUE, SUITE 201, BAKERSFIELD, CA 93309
 (805) 833-7844 FAX (805) 833-7843
 e-mail: mpe@jimpempe.com www.jimpempe.com