




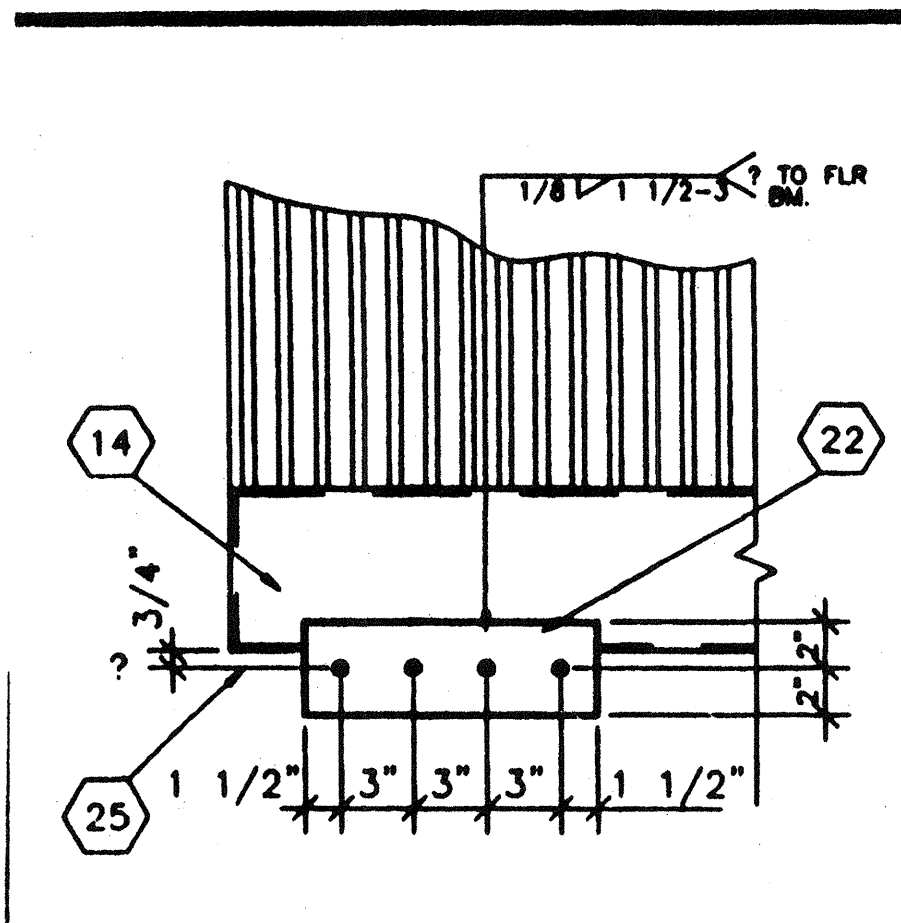

9 SCALE: 1 1/2"=1'-0"
ALTERNATE HOLD DOWN

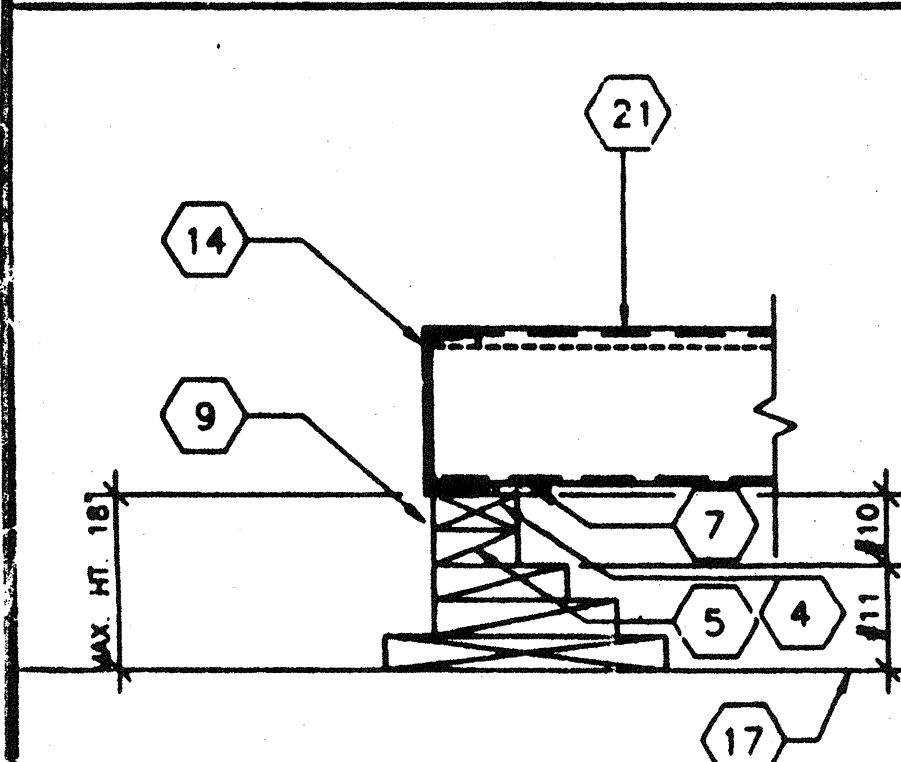


10 SCALE: 1 1/2"=1'-0"
ADD BLK'S/SHIMS TO LEVEL FOUND.

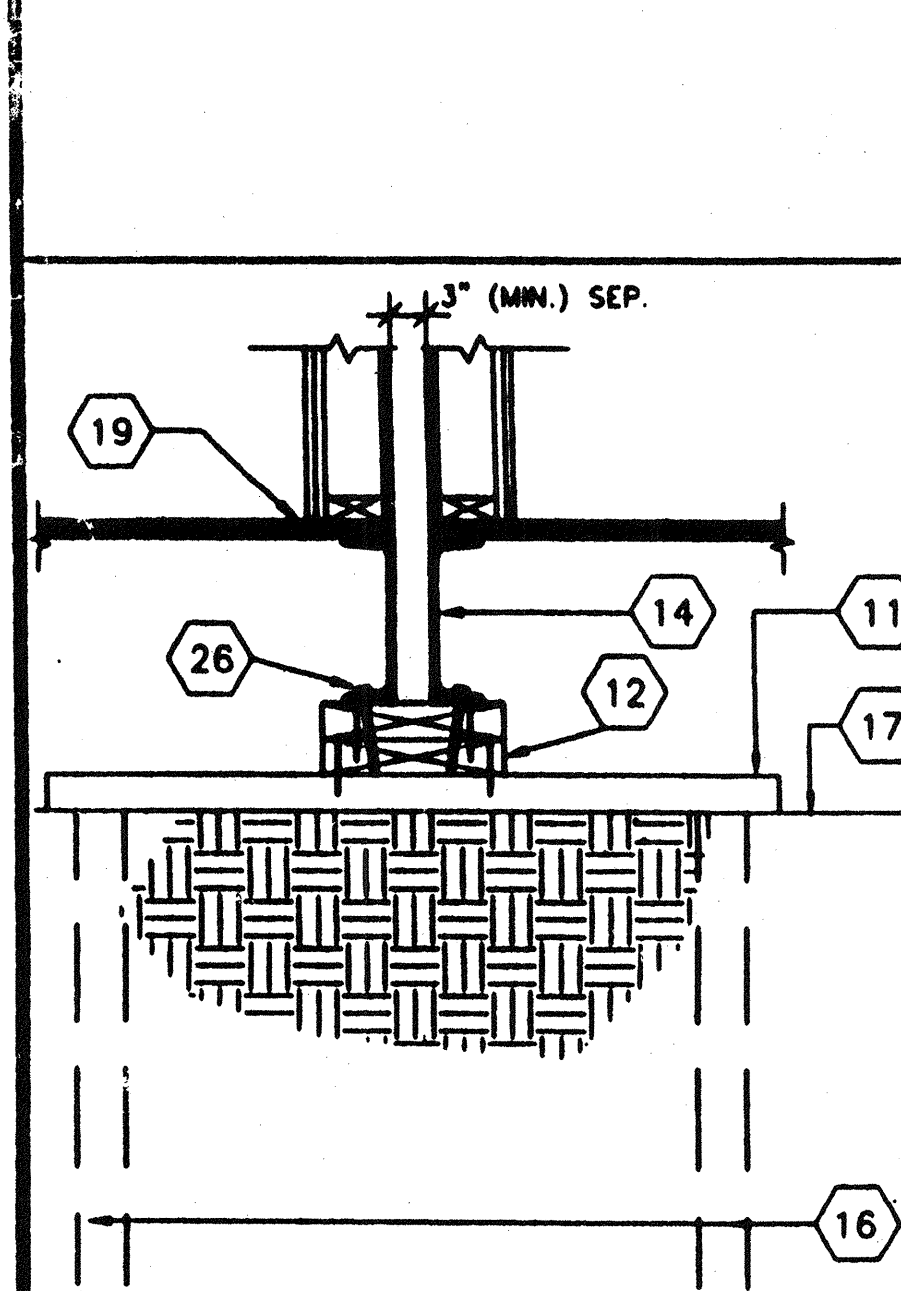


11 SCALE: 1 1/2"=1'-0"
FOUND. AT ADJ. BLDG


REVISIONS

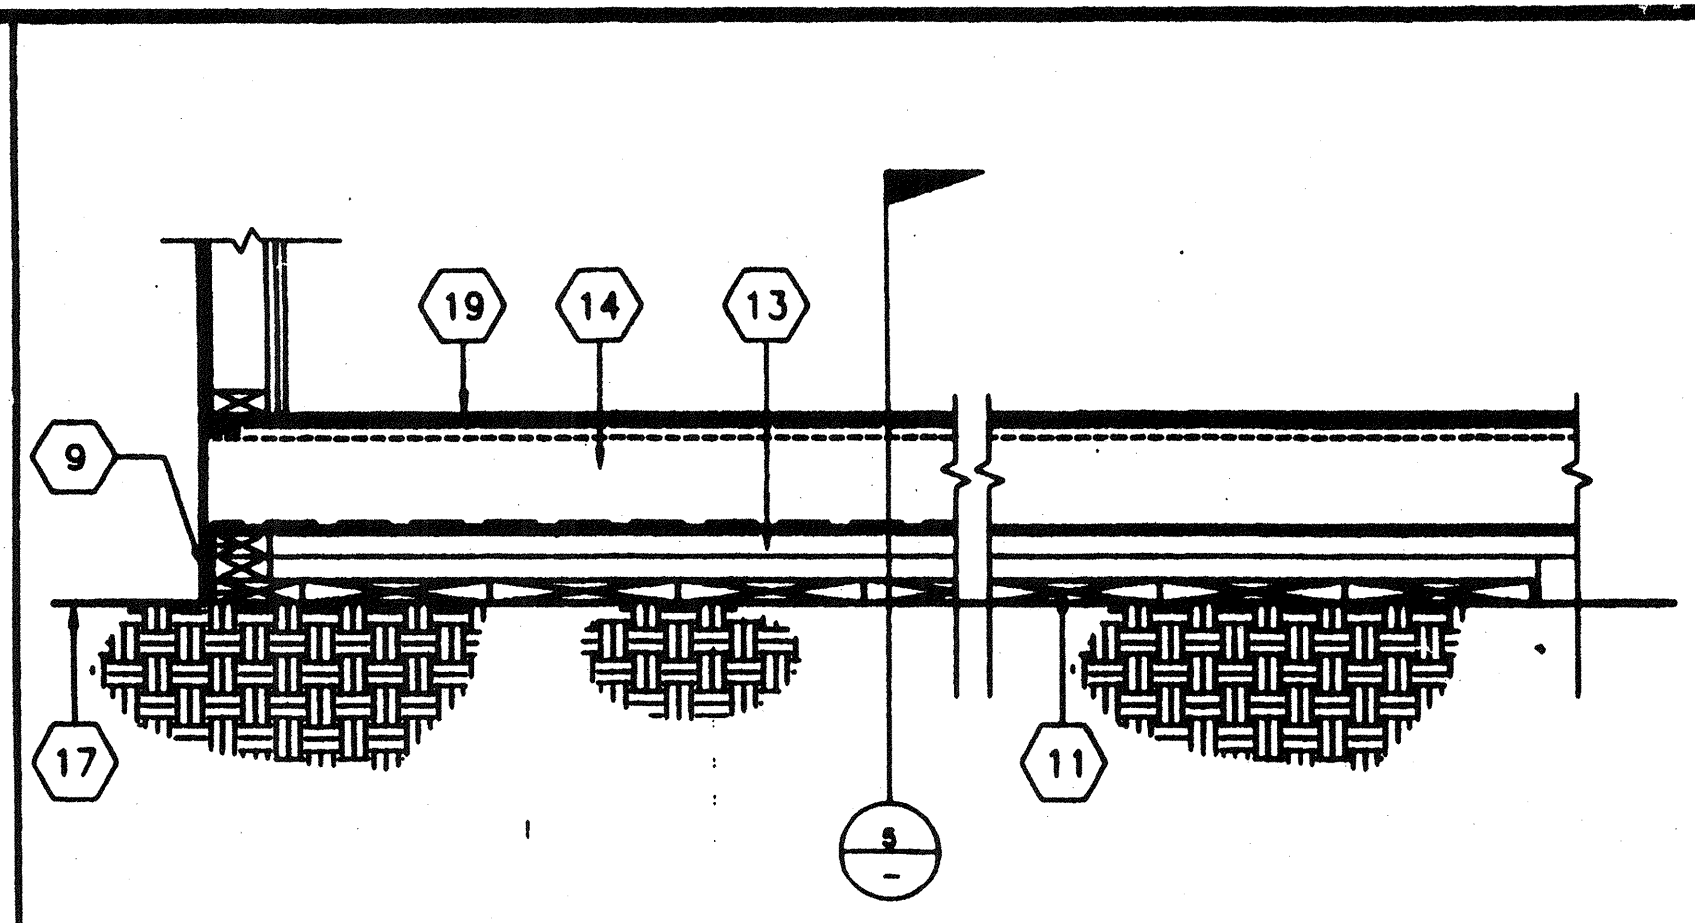

6 SCALE: 1 1/2"=1'-0"
MODLINE PAD @ END WALL

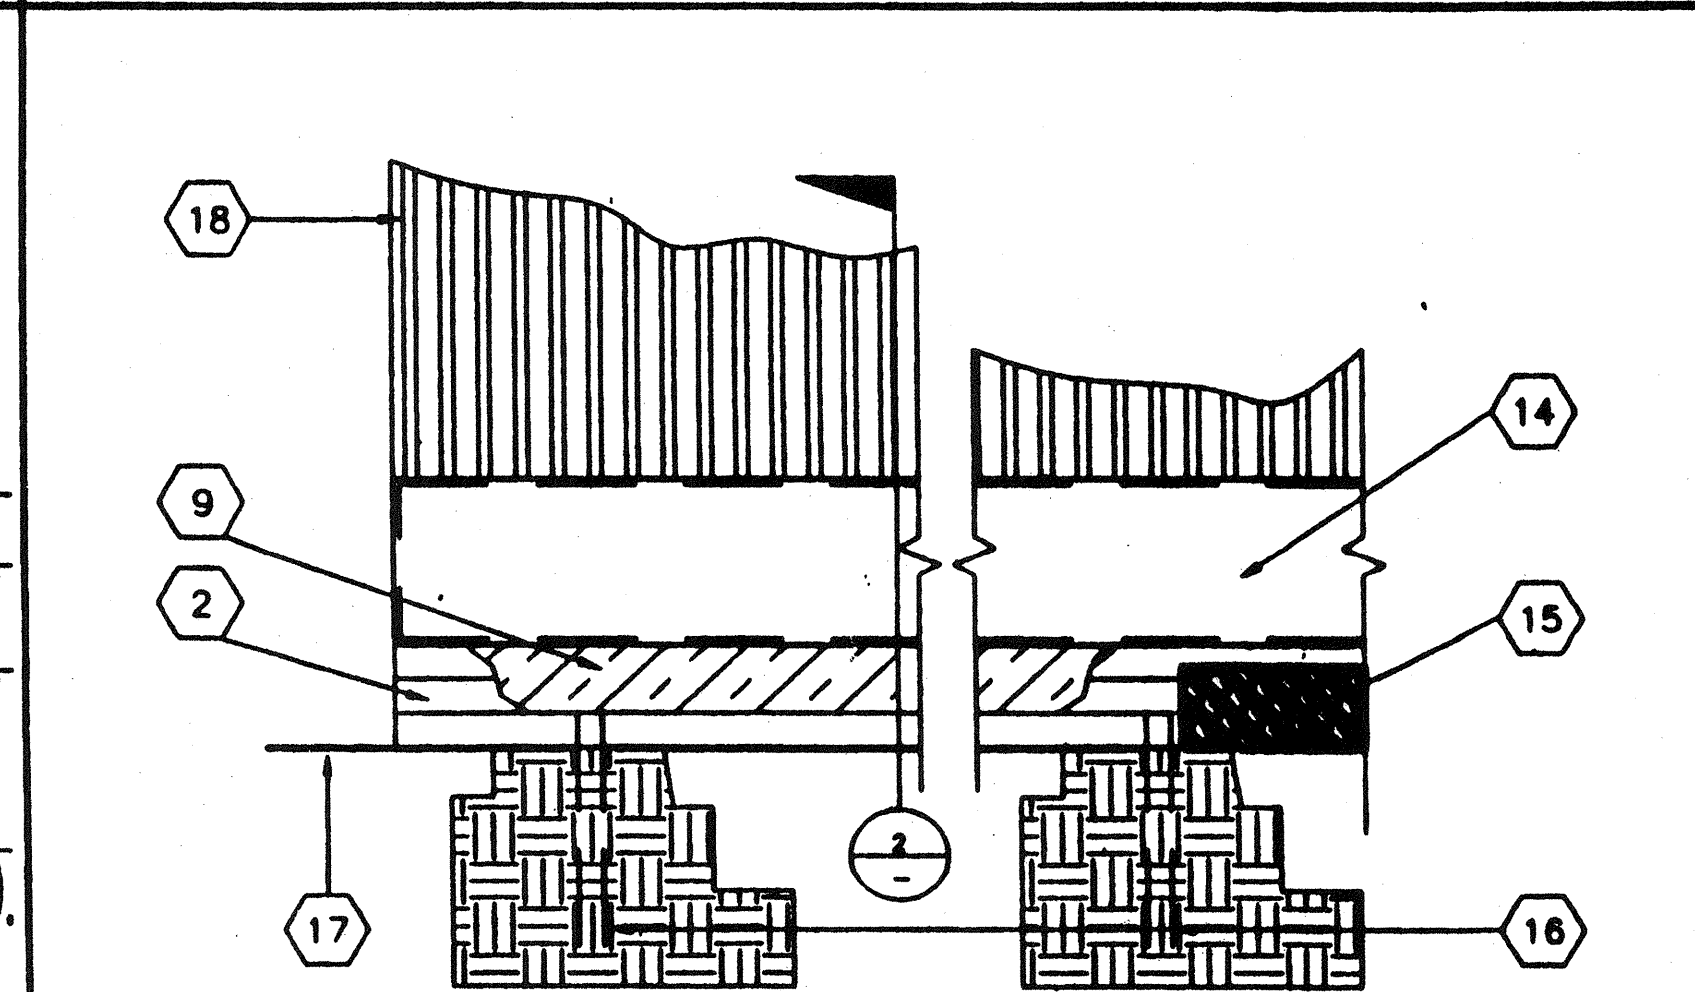


7 SCALE: 1 1/2"=1'-0"
FOUNDATION ELEVATION @ SIDE WALL

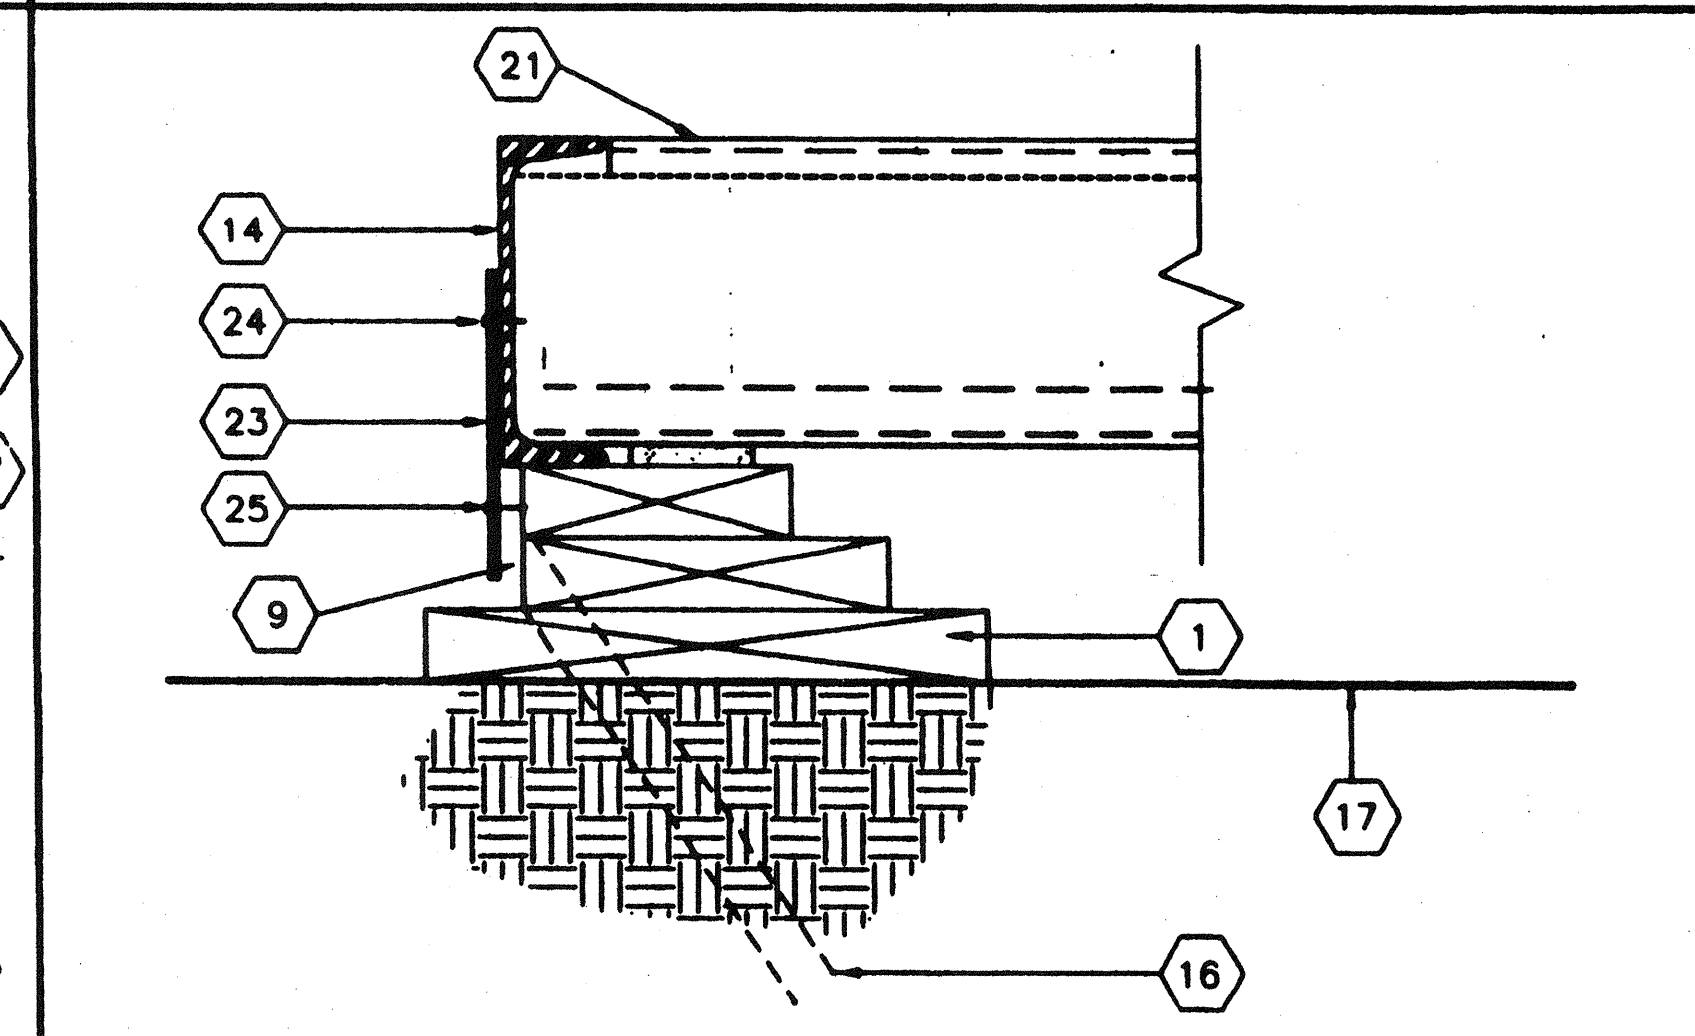


8 SCALE: 3"=1'-0"
TYPICAL TIE PLATE


ELECTRICAL	MECHANICAL	STRUCTURAL	ARCHITECT	DIVISION OF THE STATE ARCHITECT

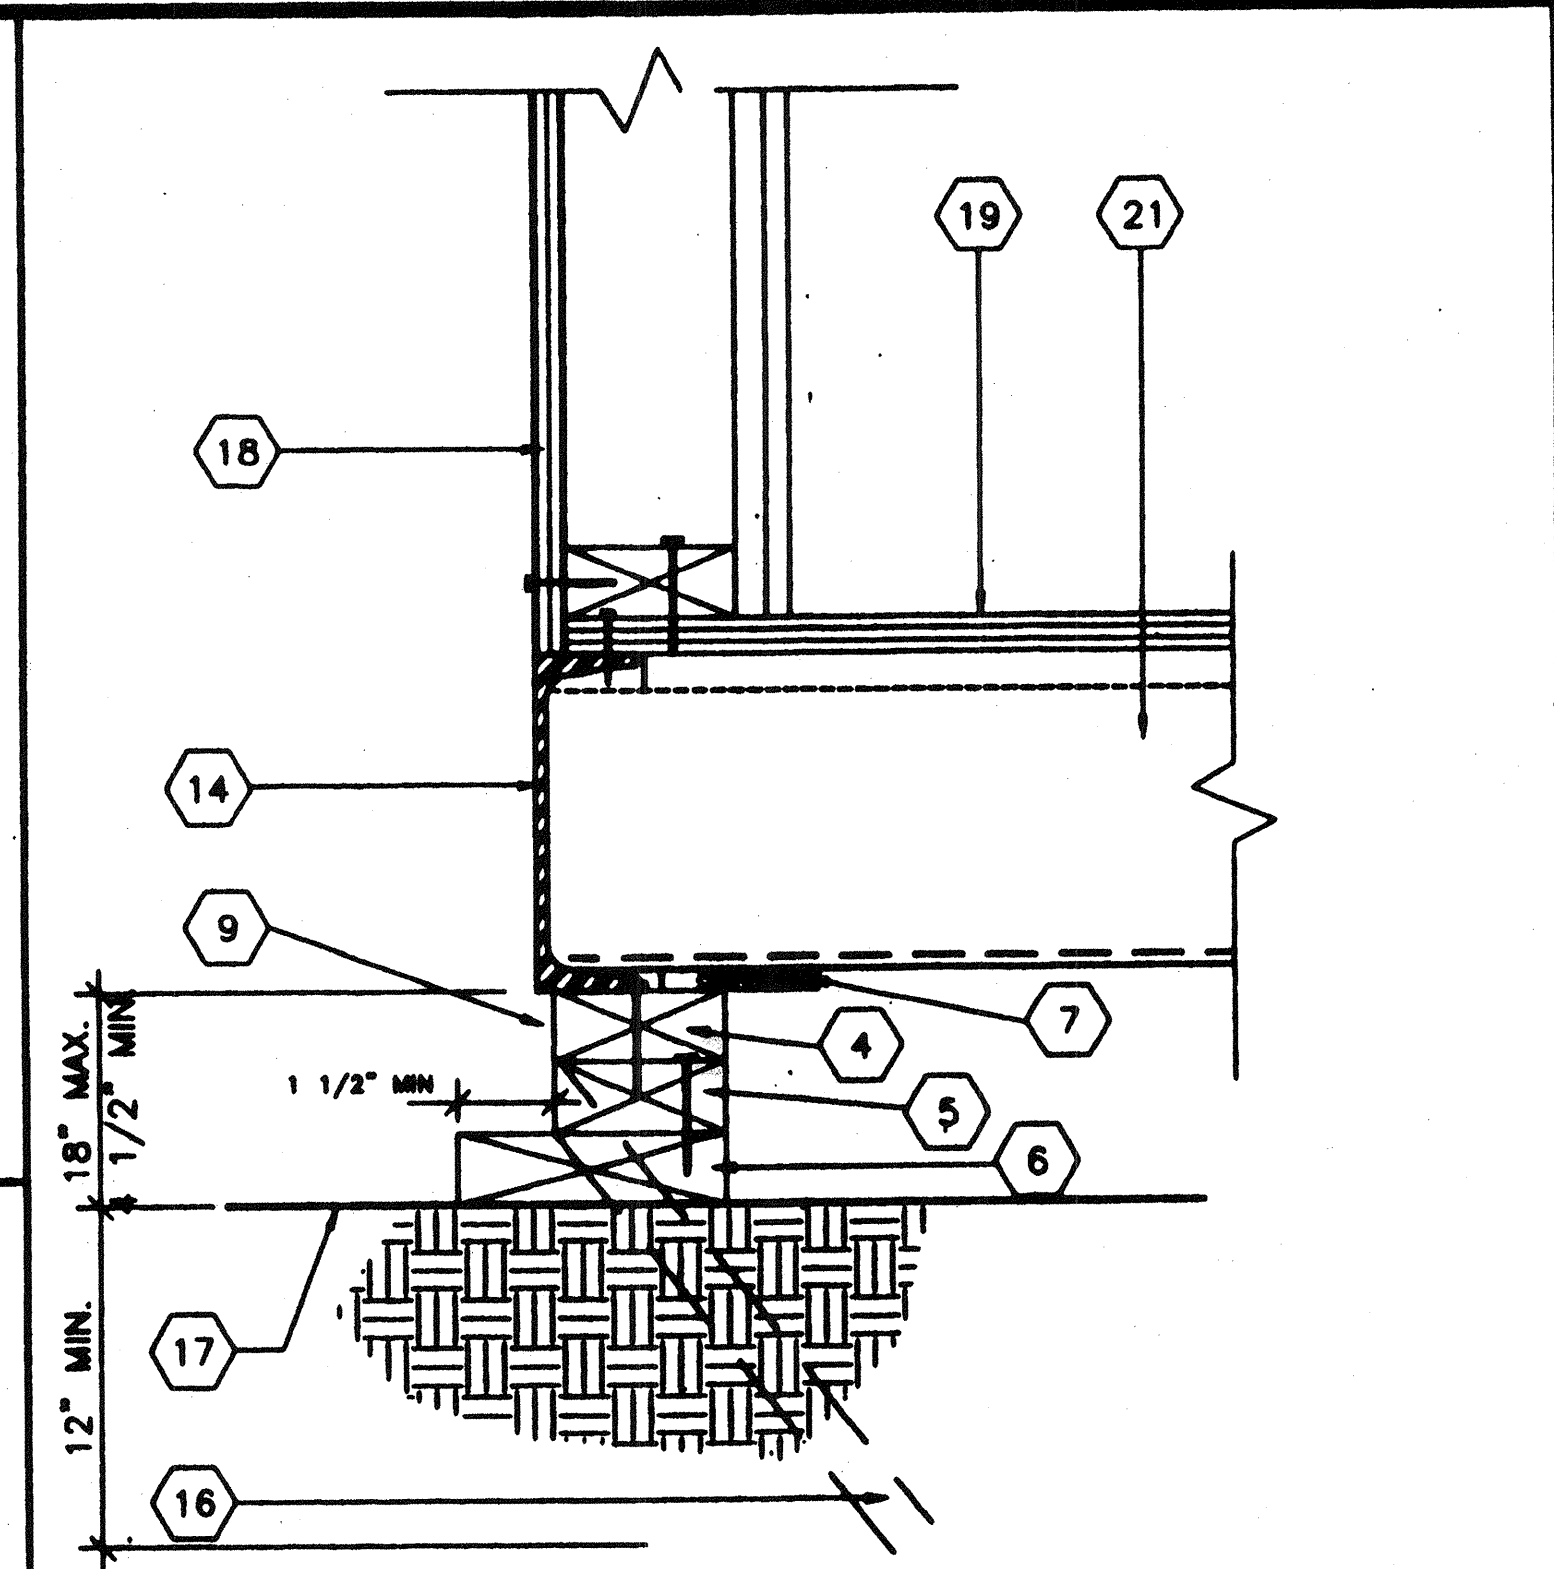

3 SCALE: 3"=1'-0"
FOUNDATION @ END WALL


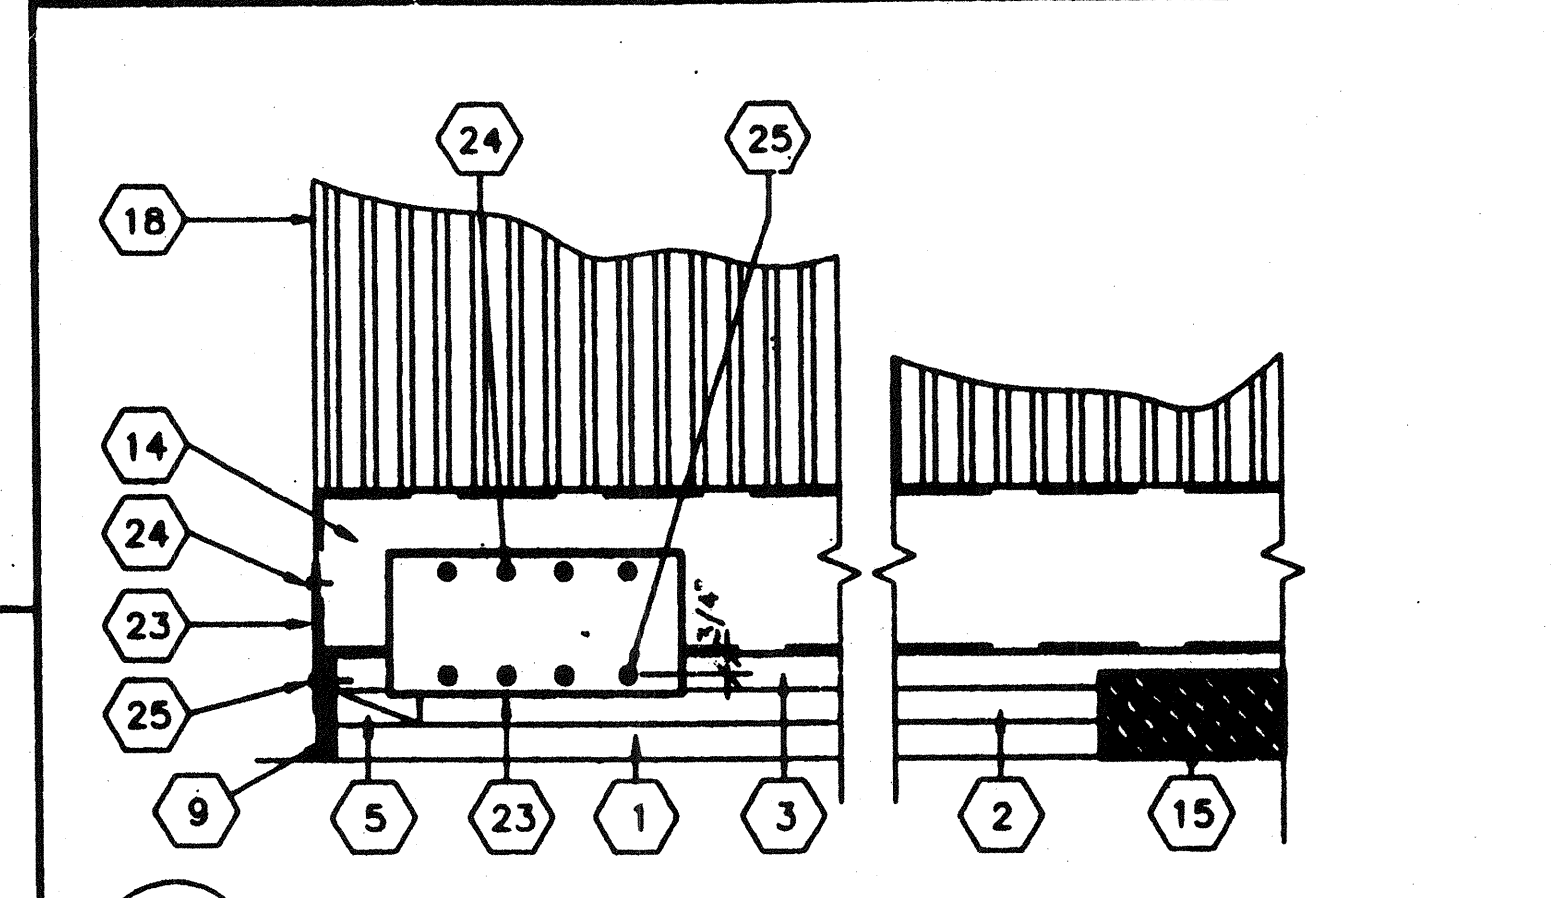


4 SCALE: 1 1/2"=1'-0"
DETAIL @ FOUNDATION CORNER

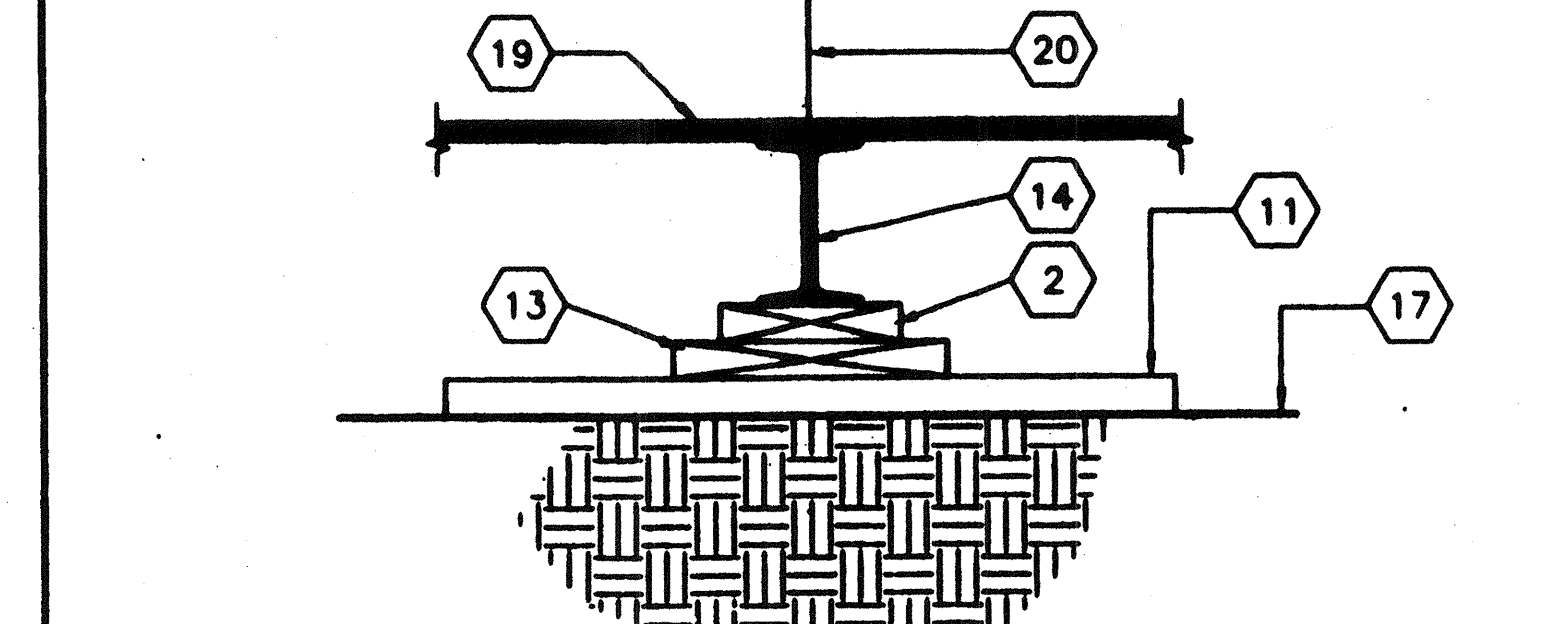


5 SCALE: 1 1/2"=1'-0"
FOUNDATION PAD @ MODLINE

REVISIONS

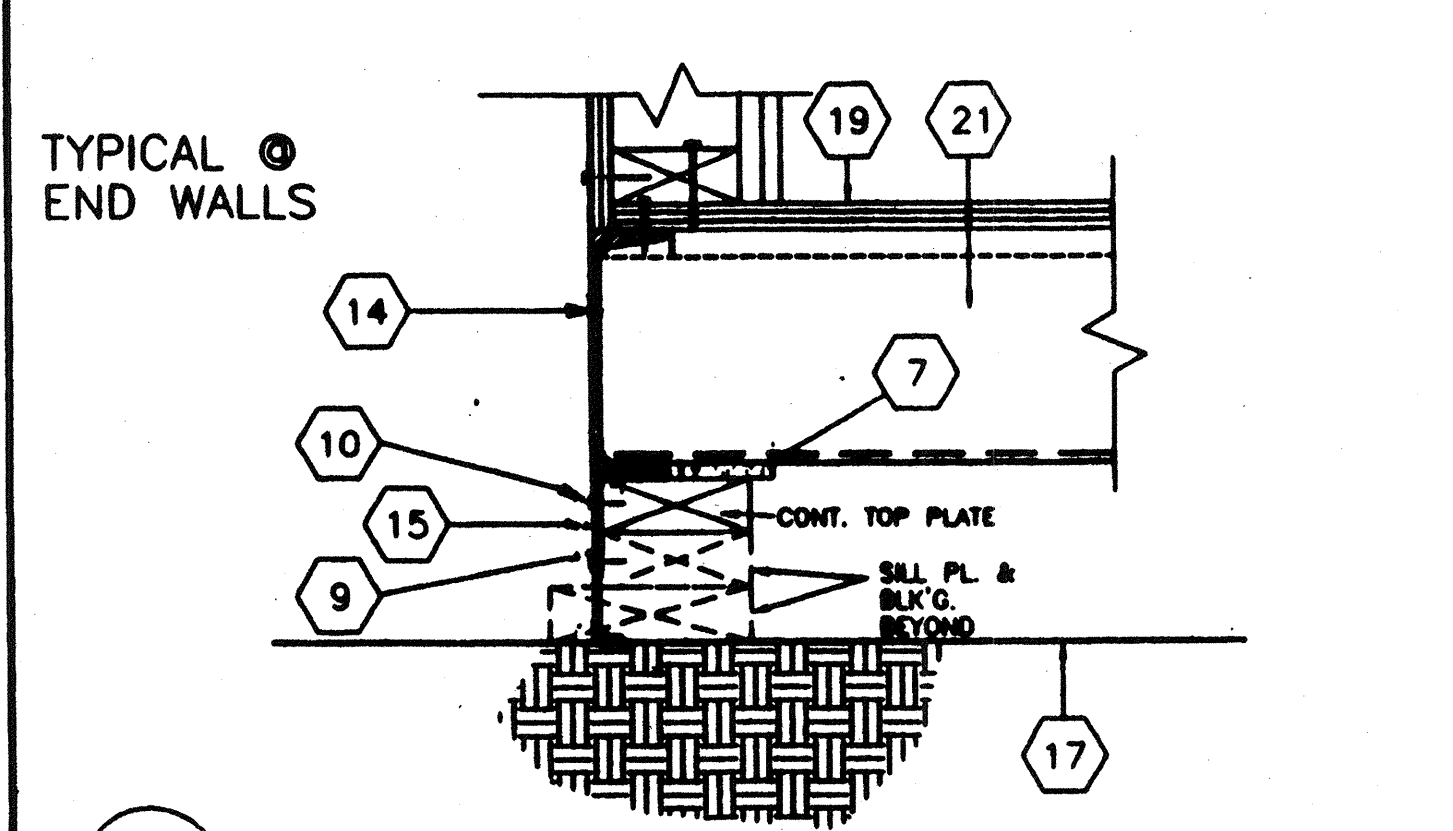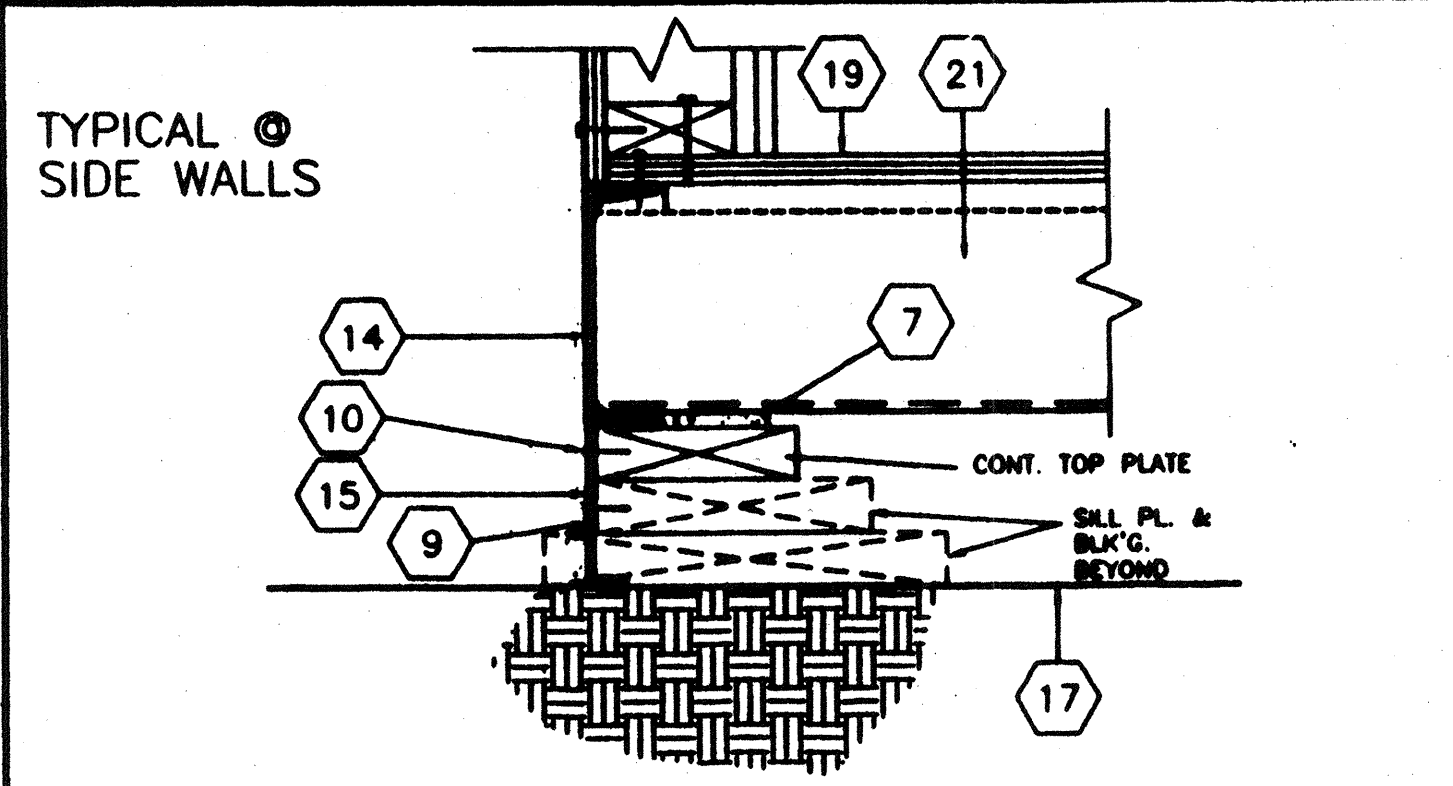

1 SCALE: NTS
FOUNDATION VENT

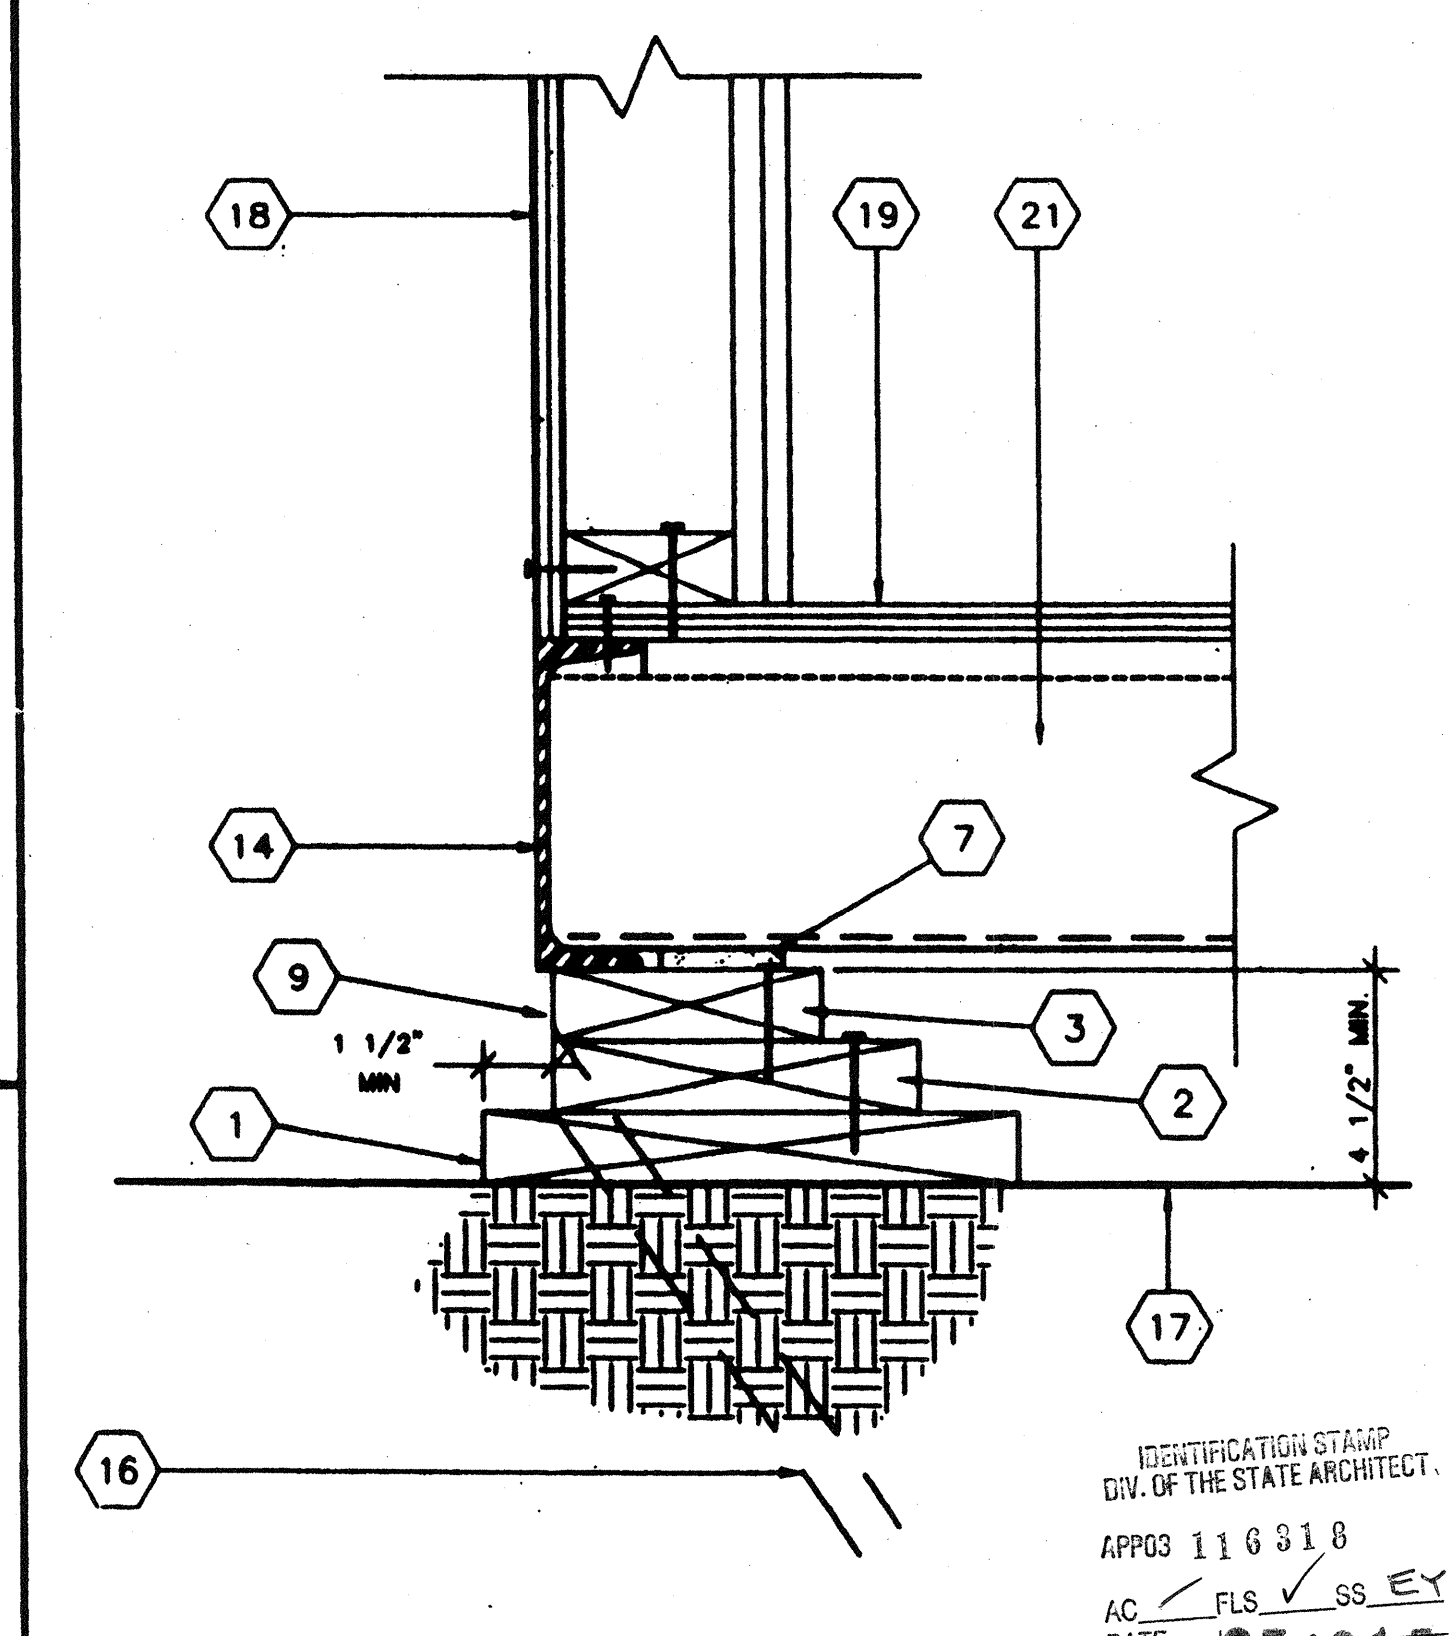

2 SCALE: 3"=1'-0"
FOUNDATION @ SIDE WALL

REVISIONS

KEY NOTES

- 2X12 SILL PLATE SEE FOUND. PLAN FOR LENGTH
- 2X8 BLOCKING W/16d MAX 5" O.C. TO SILL PLATE
- 2X6 TOP PLATE W/16d MAX 5" O.C. TO BLOCKING
- 2X4 TOP PLATE W/16d MAX 5" O.C. TO BLOCKING
- 2X4 BLOCKING W/16d MAX. 5" O.C. TO SILL PLATE
- 2X6 SILL PLATE SEE FOUND. PLAN FOR LENGTH
- 5/8"x2 1/2" SHIM (WHEN REQ.)
- INSERT REQ'D 2X4 BLK'NG OR PLYWD. SHIM W/16d 12" O.C. FACE NAIL
- OPTIONAL - MIN. 3/8" PLYWOOD SHIRTING W/ 10d MIN. 4" O.C. ENDWALLS & 6" O.C. SIDEWALLS E.N. & TYP. 12" O.C. FN. PLATE TO PLATE NAILING FOR THE FOUNDATION MEMBERS CAN BE DECREASED TO 12" O.C. AND FOUNDATION BLOCKING SHALL BE RECESSED SUCH THAT THE SKIRTING SHALL BE INSTALLED FLUSH WITH THE PERIMETER FLOOR CHANNEL.
- 10d GALV. NAIL MAX. 4" O.C.
- 2X12X2'-6" SILL PLATE SEE FOUND. PLAN FOR QUANTITY REQ'D
- 2 X 10 PLATES W/ 2-16D BOX 6" O.C.
- 2X10 BLK'NG FACE OR TOE NAIL 16d MAX 12" O.C. ADD BLKS. OR SHIMS AS REQ'D
- FLOOR FRAME BEAM SEE STRUCTURAL C7x9
- TYPICAL FOUNDATION VENT (SEE FOUNDATION PLAN FOR SIZES AND LOCATIONS).
- SILL RESTRAINT 1" PIPE SEE FOUND. FOR LOCATION
- FINISH GRADE
- EXTERIOR FINISH
- PLYWOOD SUBFLOOR
- MOD-LINE
- FLOOR-JOIST
- 4"x12"x10 GA. PLATE
- 6"x12"x10 GA. PLATE
- 1/4" S.T.S. TYP. 4-PLACES
- 1/4" X3" LG. LAG SCREW TYP. 4-PLACES
- 5/8" X4" LAGS (FOR LOCATION SEE PLAN)

FOUNDATION LUMBER TO BE PRE-CUT AT FACTORY. LUMBER GRADES & PRESSURE TREATING TO BE VERIFIED BY IN-PLANT INSPECTOR.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
APPG 116318
AC FLS SS EX
DATE 051215

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
04 100596
AC FLS SS EX
DATE AUG 10 1996

STKP-37

2765
2852
2854
2900

DRAWN BY RLI
DATE 8/96
CHECKED BY FH
DATE 8/96

F3.0