


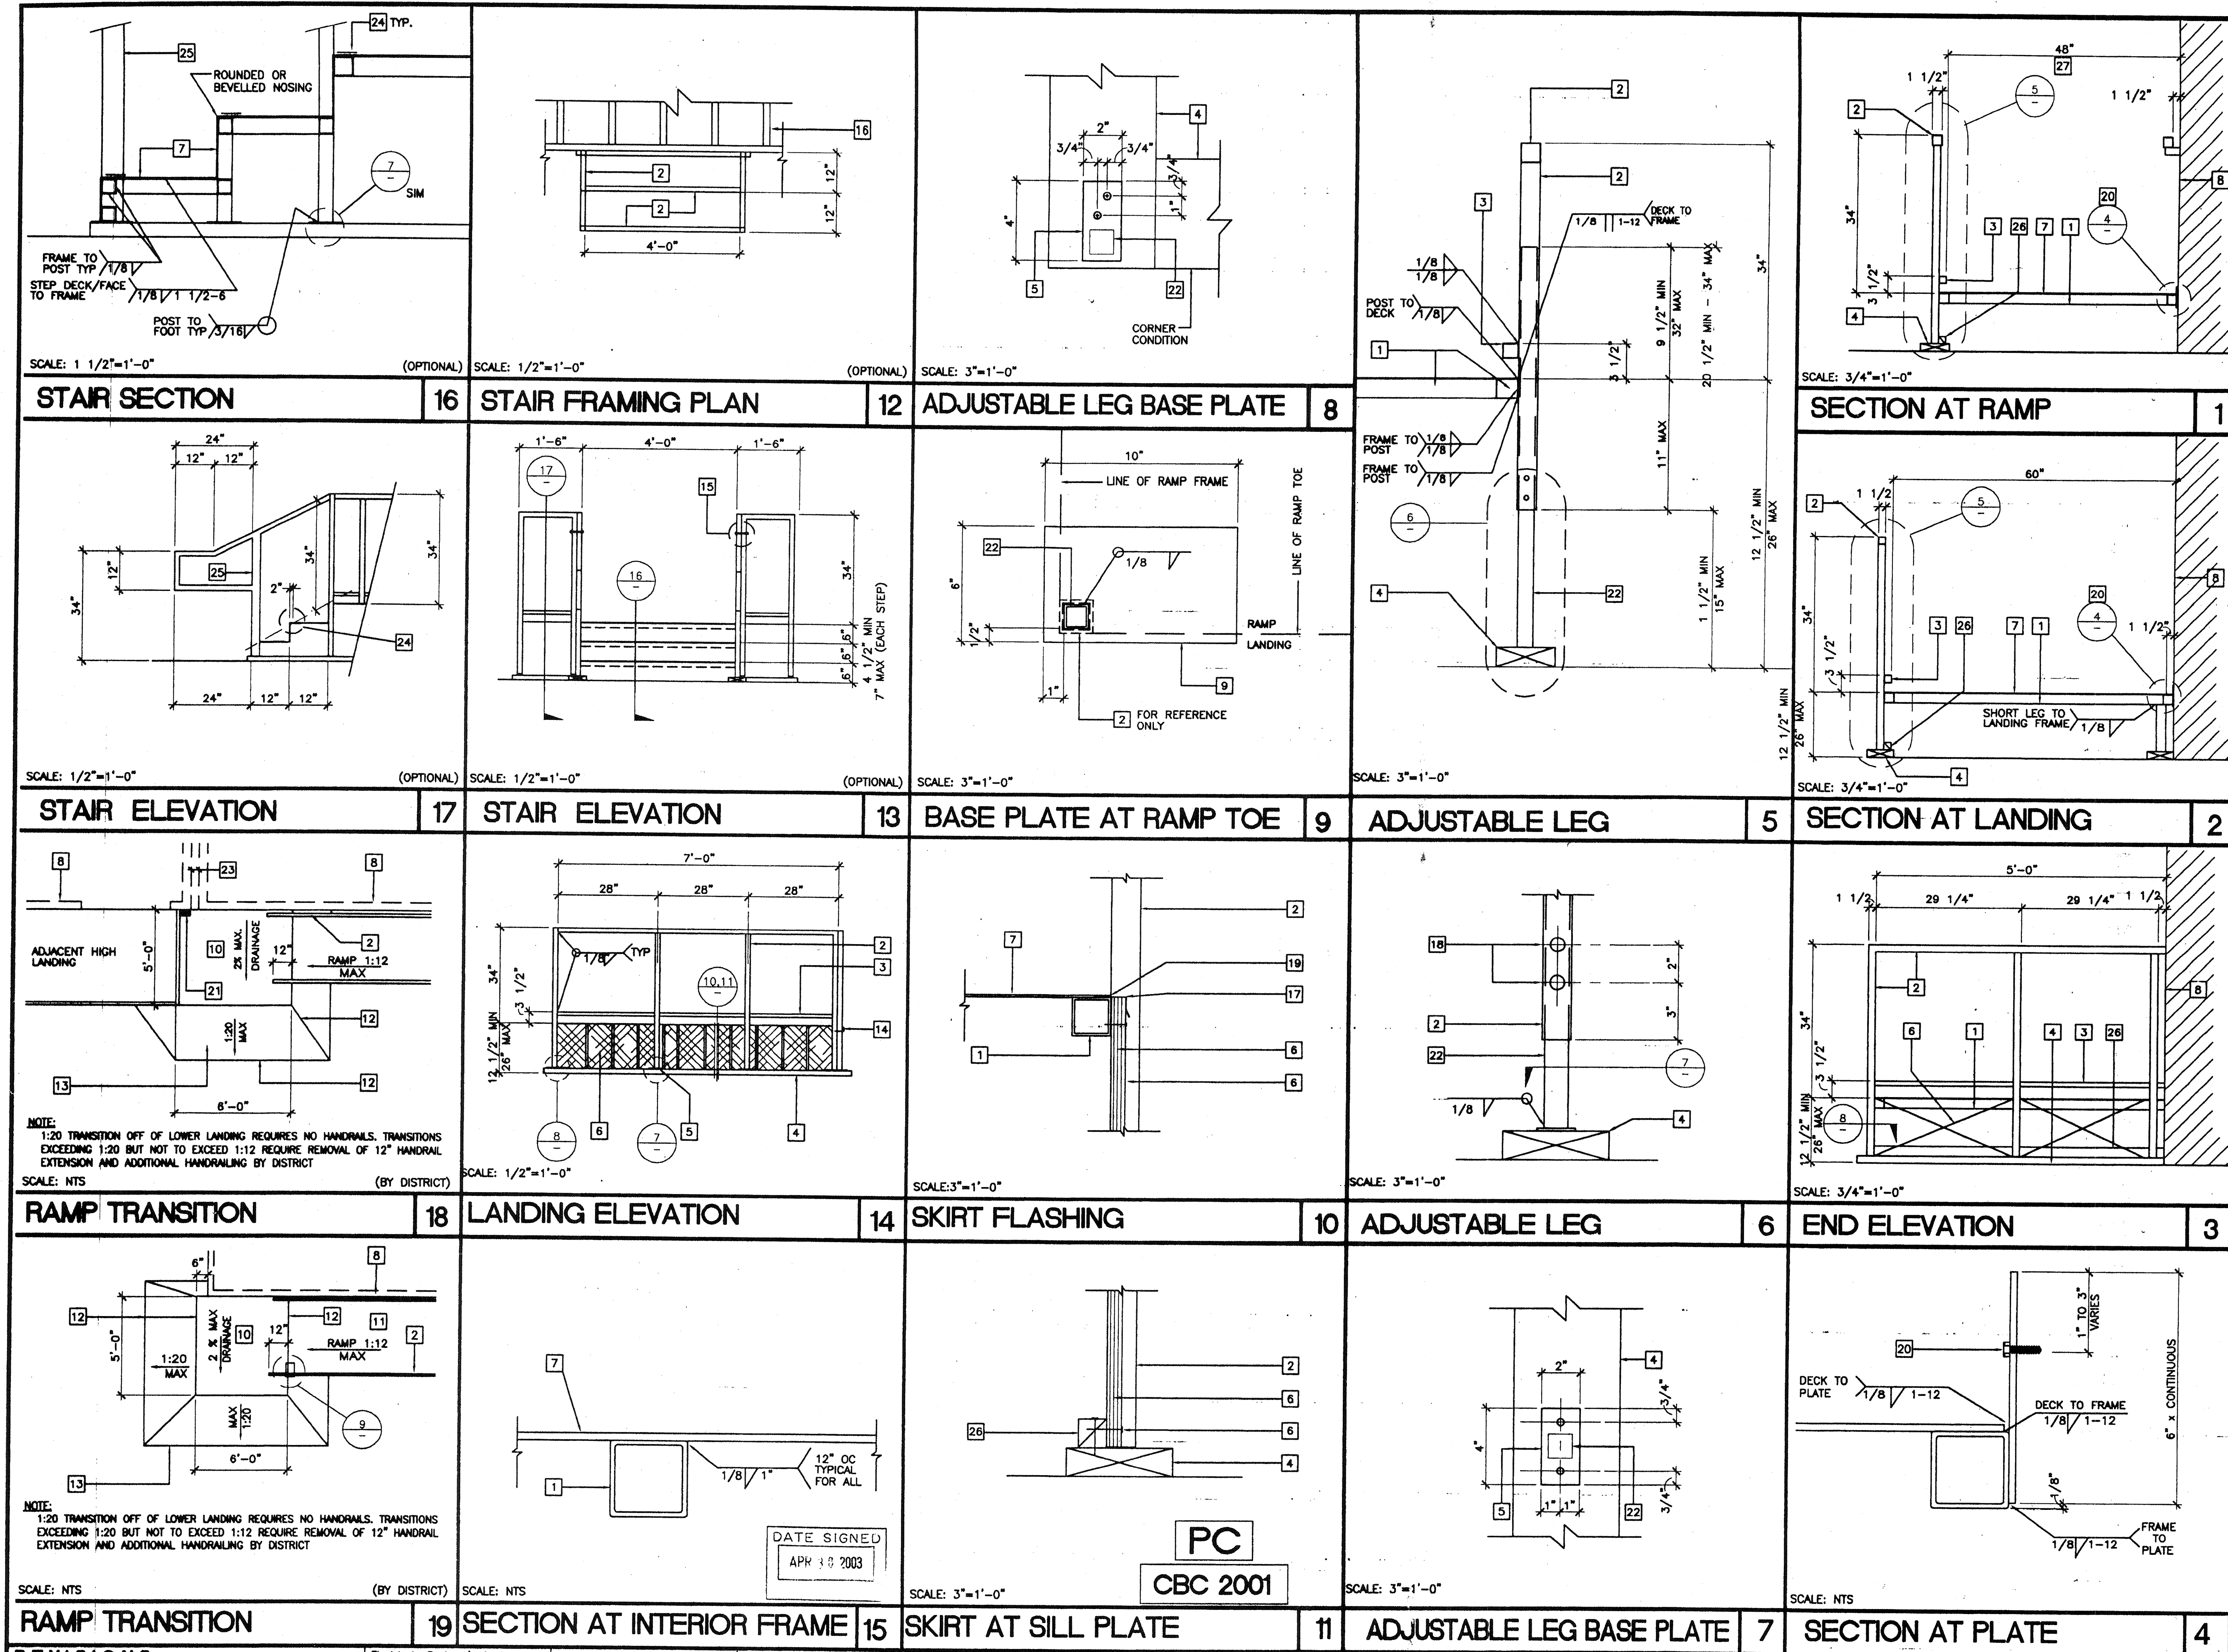

- ### KEY NOTES
- 1 TS 2"x2"x14 GA
 - 2 TS 1 1/2"x1 1/2"x14 GA (Fy = 39 KSI). EASED OR ROUNDED CORNERS.
 - 3 TS 1"x1"x16 GA WHEELCHAIR GUIDE
 - 4 2"x6" PRESSURE TREATED SILL PLATE
 - 5 2"x4"x12 GA BASE PLATE WITH 2-1/4"x1" LAGS
 - 6 SKIRTING: PLYWOOD TO MATCH BUILDING SIDING. BLOCK ALL EDGES. ATTACH WITH 8d AT 6" OC EDGES AND 12" OC FIELD. AT EDGE CONNECTION TO TS. USE #14x2" TEK SCREWS AT 6" OC
 - 7 12GA METAL DECK: NON-SLIP SURFACE. DESIGN COEFFICIENT OF FRICTION GREATER THAN 0.7 C.O.F. MAINTAINABLE FOR 1 YR. PROVIDE ROUNDED OR BEVELED EDGES ON STAIR NOSING
 - 8 EXISTING BUILDING.
 - 9 6"x10"x12 GA BASE PLATE AT RAMP TOE.
 - 10 LOWER LANDING BY DISTRICT
 - 11 RAMP BY MODTECH RAMP
 - 12 FLUSH TRANSITION
 - 13 PAVE BY DISTRICT
 - 14 3"x1"x3"-0"x10 GA BENT PLATE
 - 15 FASTEN POSTS WITH 3/8" DIA THRU BOLT, TYPICAL
 - 16 RAMP LANDING, TYPICAL
 - 17 26 GA FLASHING
 - 18 3/8" DIAx2" LONG MB WITH NUT & WASHERS
 - 19 CAULKING
 - 20 6"x10GA CONTINUOUS PLATE WITH #14x2" TEK SCREWS AT 9" OC INTO WOOD OR FOUNDATION BLOCKS OR #14x2" TEK SCREWS INTO METAL AT 9" OC
 - 21 PROVIDE DIVERSION FOR WATER FROM DOWNSPOUT FOR THIS CONDITION. BY DISTRICT
 - 22 TS 1 1/4"x1 1/4"x14 GA (Fy = 39 KSI)
 - 23 4" MINIMUM BUILDING SEPARATION
 - 24 2" SLIP RESISTANT WARNING STRIPES MAX 1" FROM EVERY STAIR NOSING. USE CONTRASTING COLOR.
 - 25 TS 2 1/2"x1 1/2"x8 GA ASTM A500 GRADE A
 - 26 2"x2" NAILER WITH 16d AT 12" OC
 - 27 RAMP WIDTH MINIMUM CLEAR DIMENSION IS 4'-0" IF AT LEAST TWO EXIT/DISCHARGE ARE REQUIRED OR 5'-0" IF ONLY ONE EXIT/DISCHARGE IS REQUIRED. SEE CBC1133B.5.2.2

REVISIONS

1		
2		
3		
4		
5		

Electrical Engineer's Seal
Mechanical Engineer's Seal
PC Professional of Record Seal
Architect's Seal

DATE SIGNED
APR 30 2003

PC
CBC 2001

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
PC-04
104801
DATE 6/12/03

MODTECH™
2830 BARRETT AVENUE
PERRIS, CALIF. 92571
PH (909) 943-4014
FAX (909) 940-0427

PROJECT NUMBER: 4012-125
© MODTECH, INC. 2002
CLASS LEASING INC STOCKPILE # 70
100-24 x 40 CLASSROOM BUILDINGS
4012-125 05-22-2003 80 MPH

DRAWN BY: STKP-70
DATE: 05-22-03
CHECKED BY:
DATE:
MODTECH Index No.
R1.02

FILE PATH: 2440-R1.02.DWG PROJECT NO. PC-04-104801