




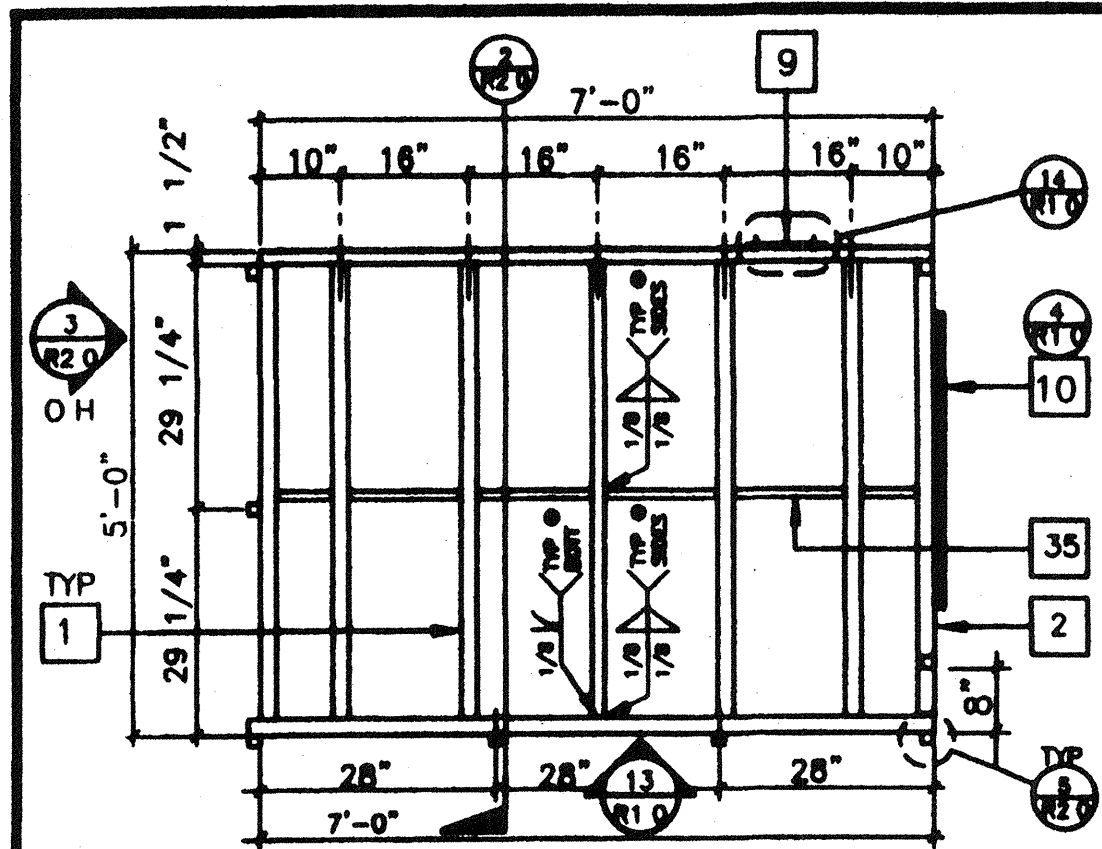


LANDING FRAME 12

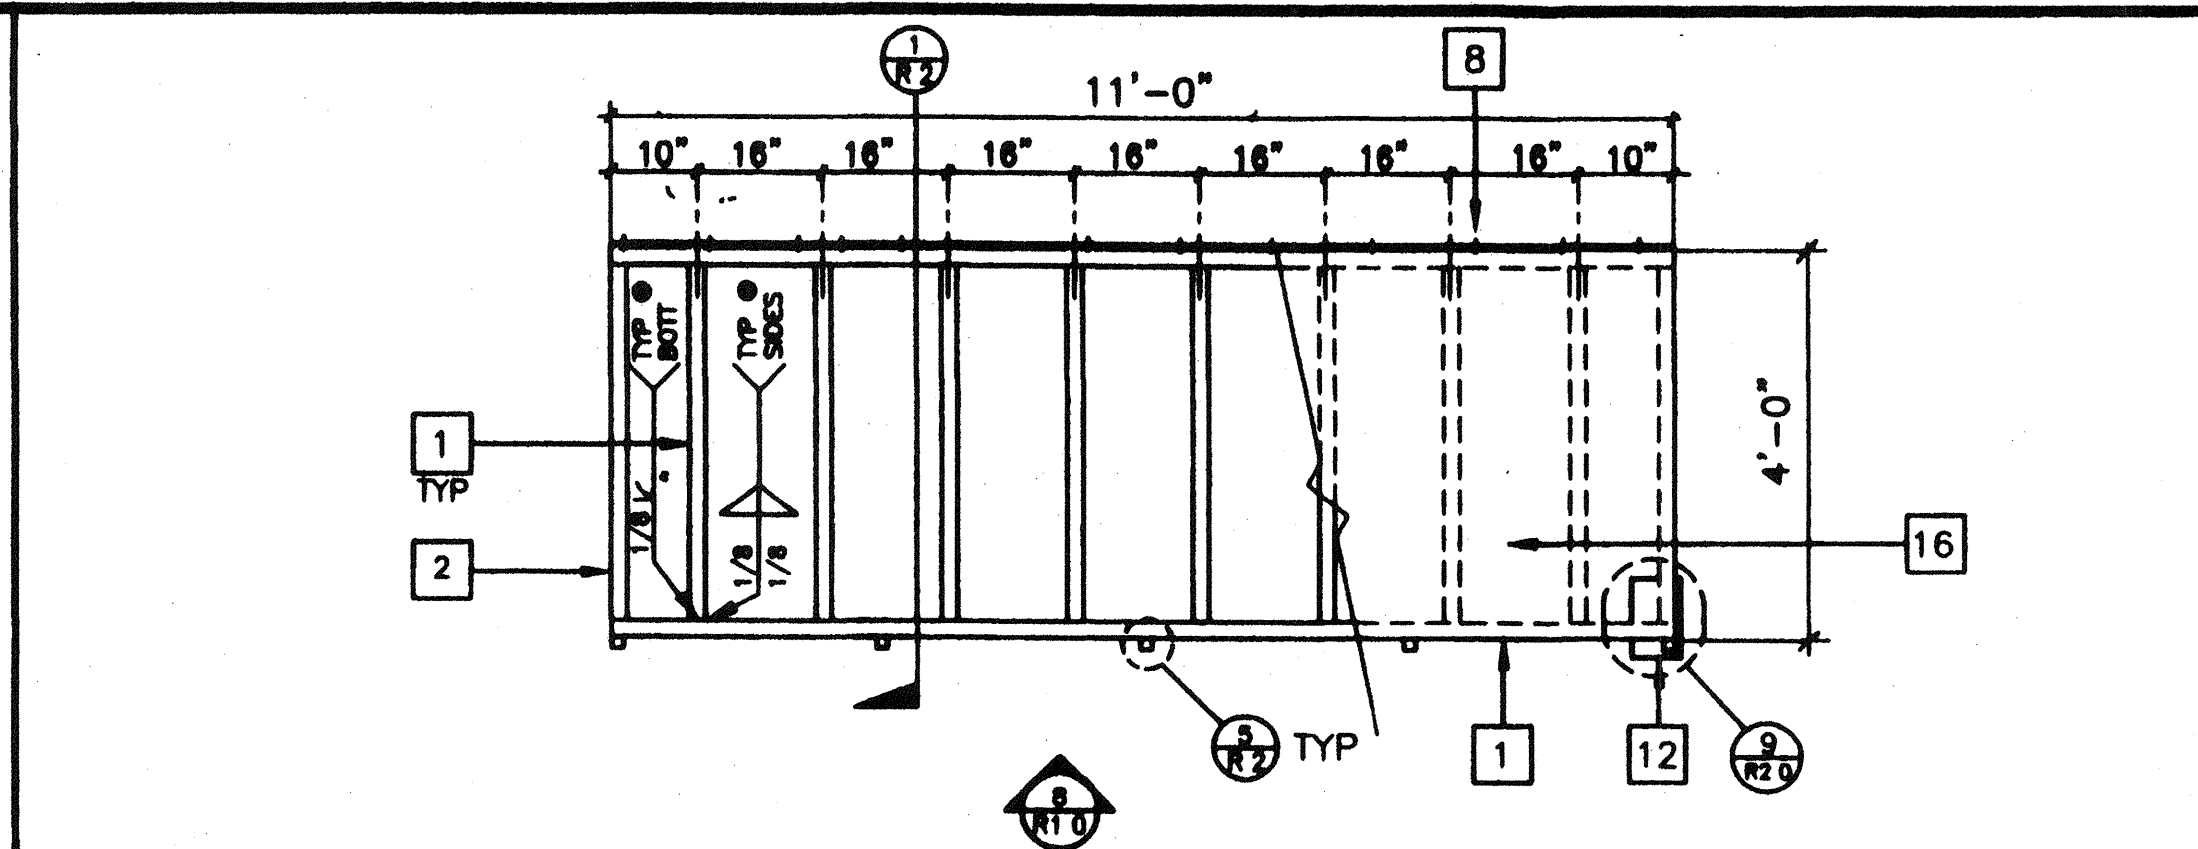


RAMP FRAME 7

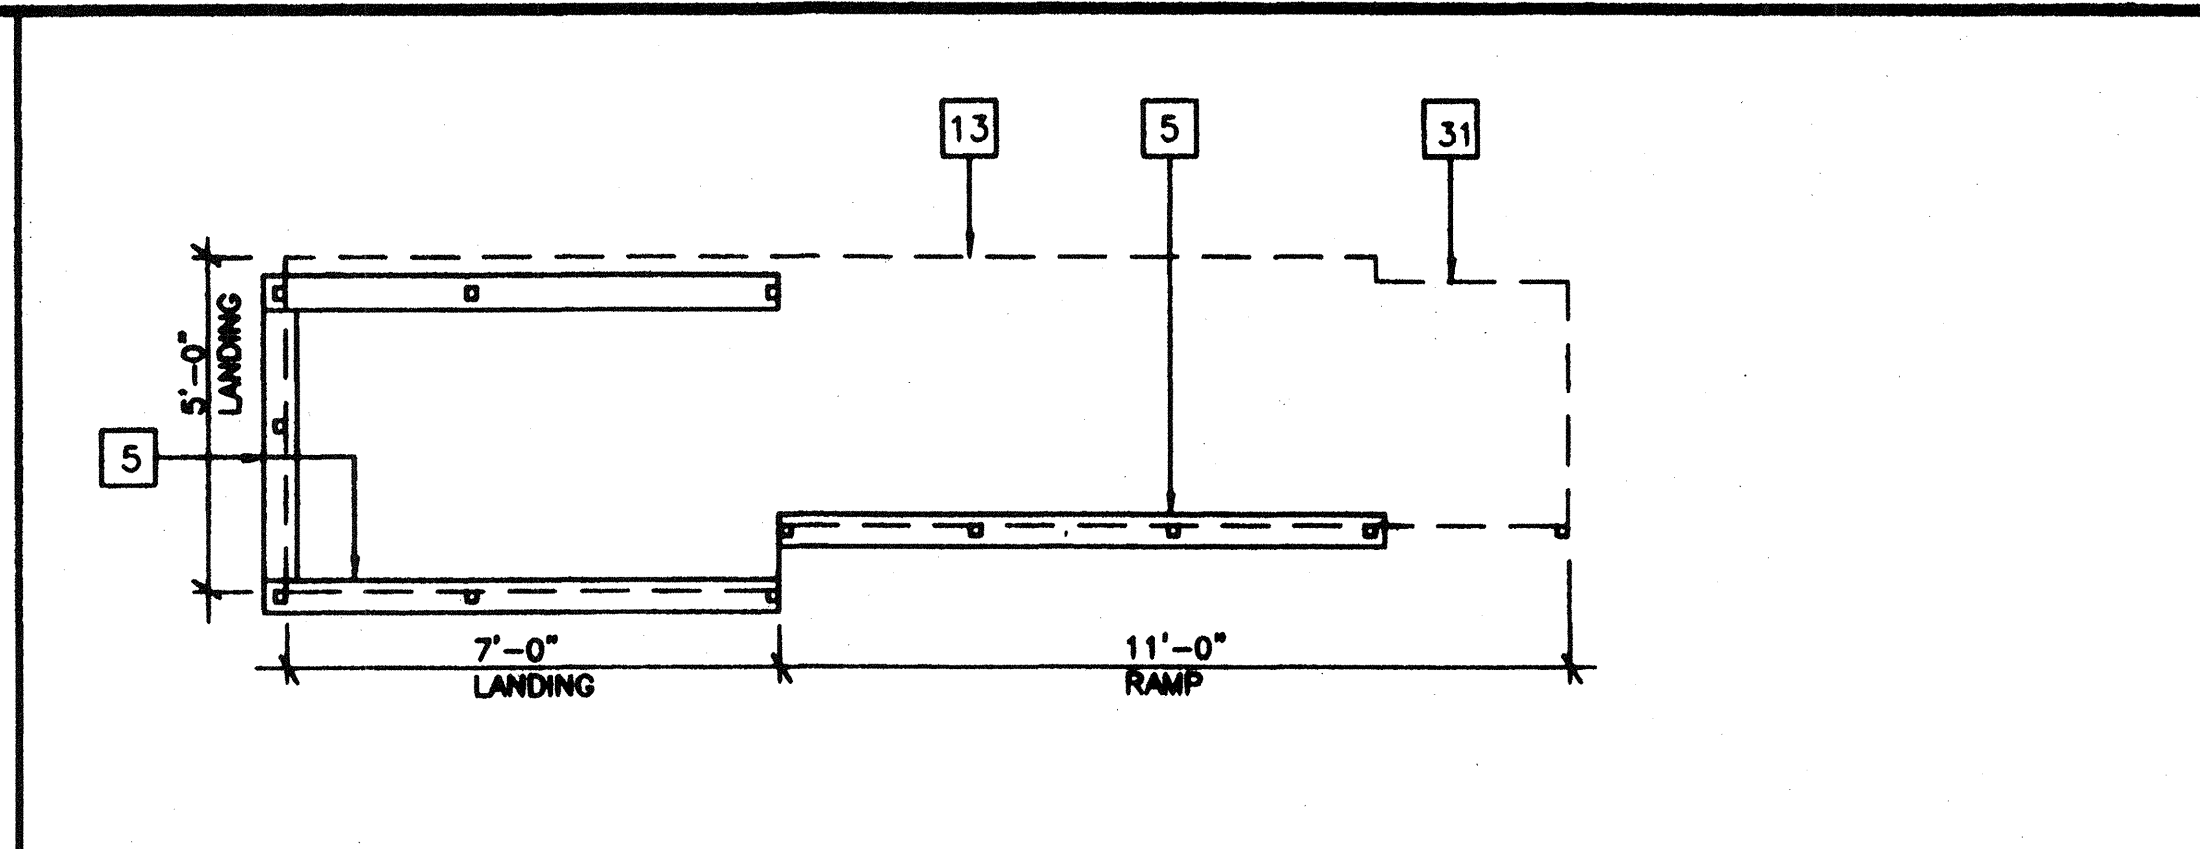


SILL PLAN FOR RAMP AND LANDING 3/8" 1

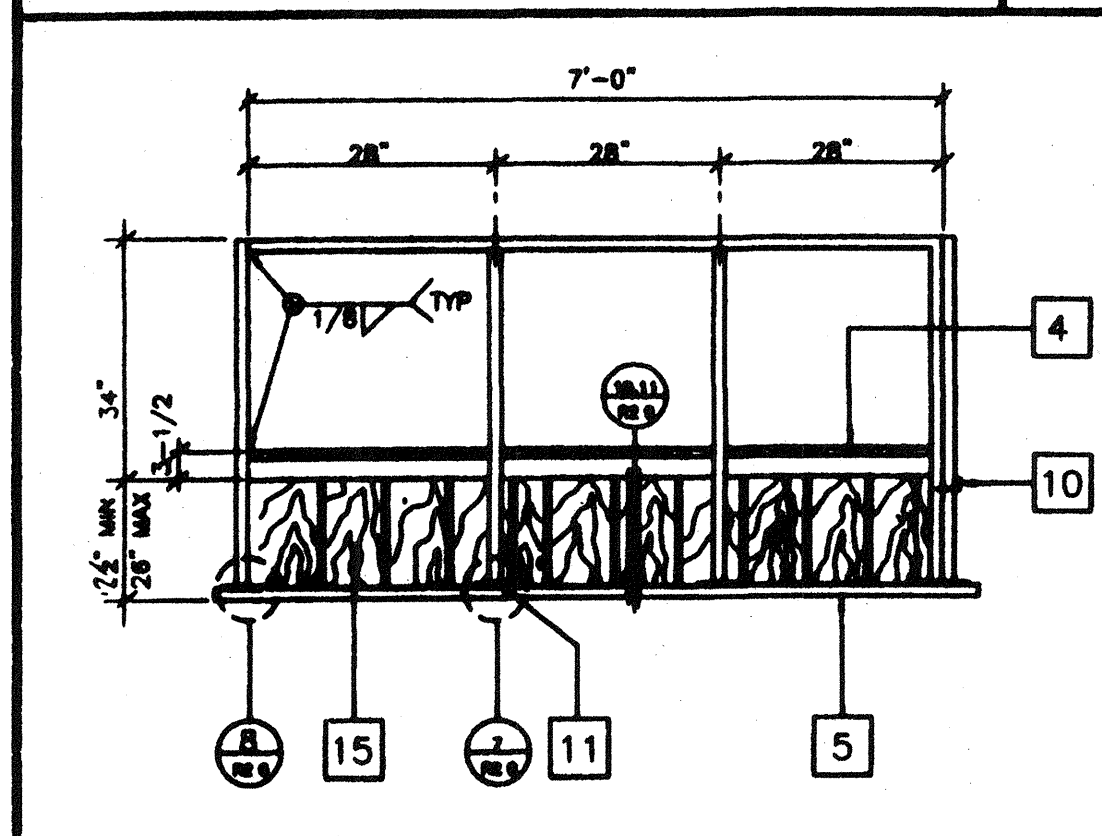


LANDING ELEVATION 13

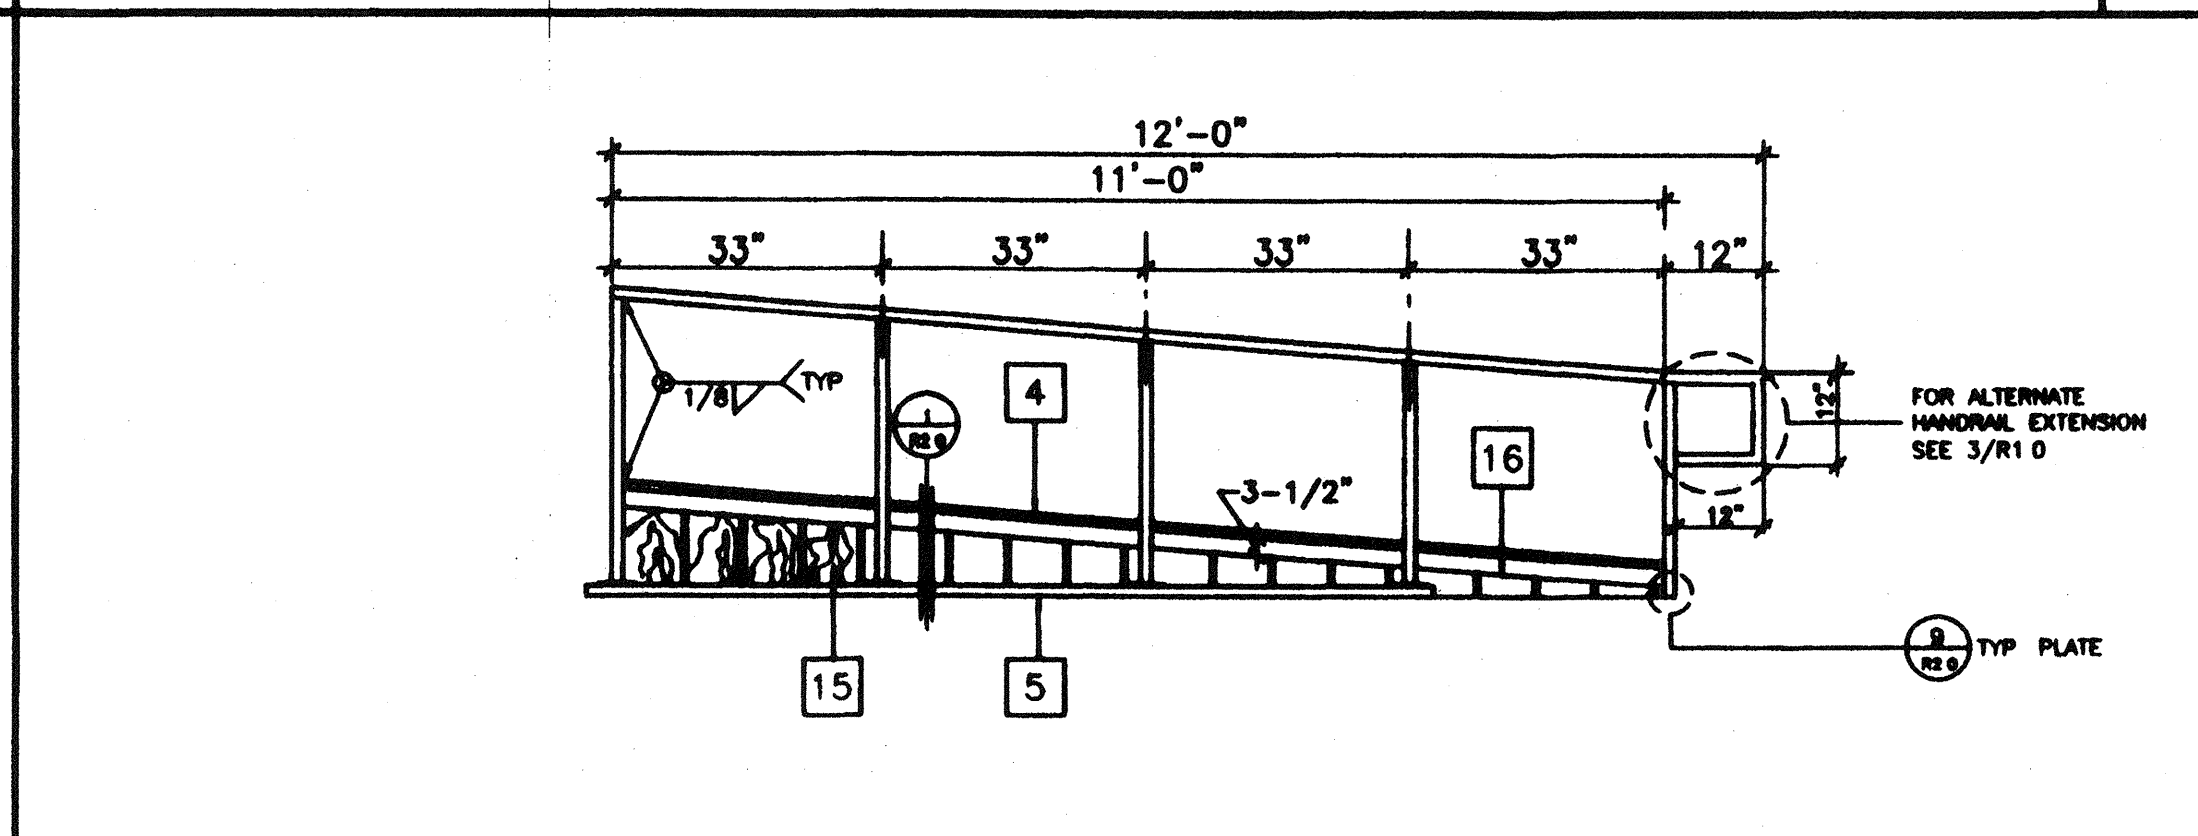


RAMP ELEVATION 8

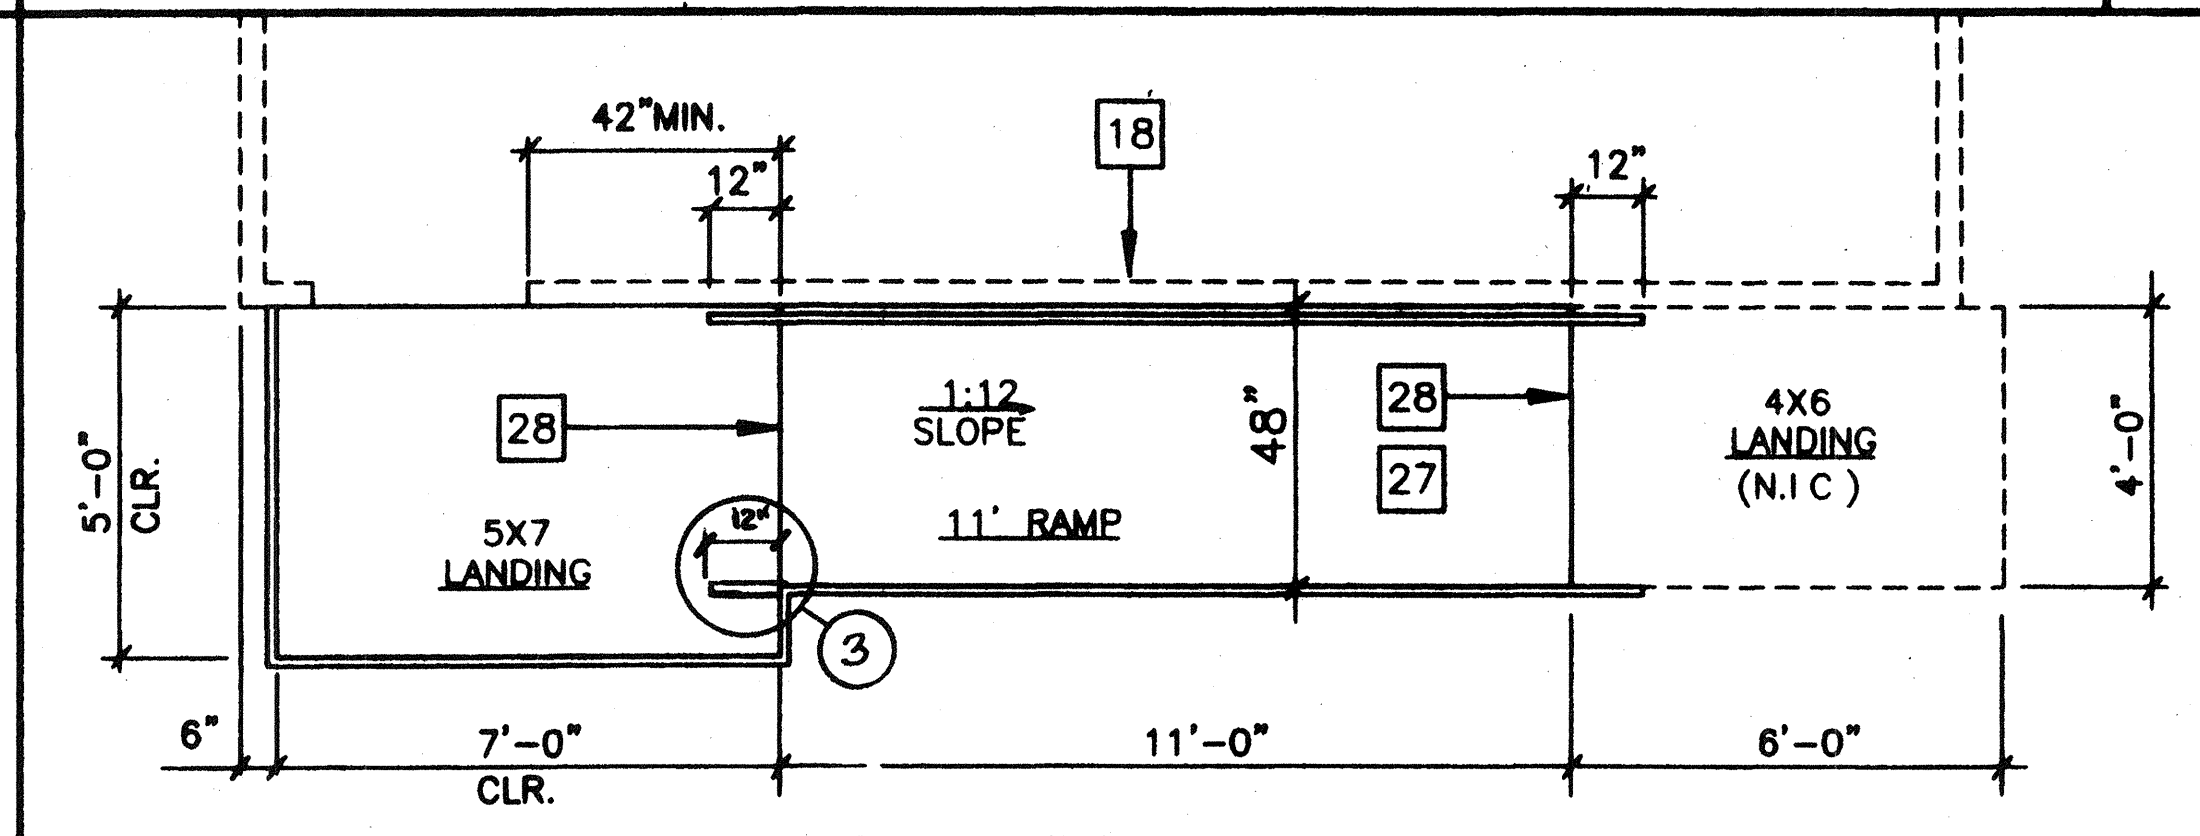


RAMP AND LANDING AT BUILDING 3/8" 2

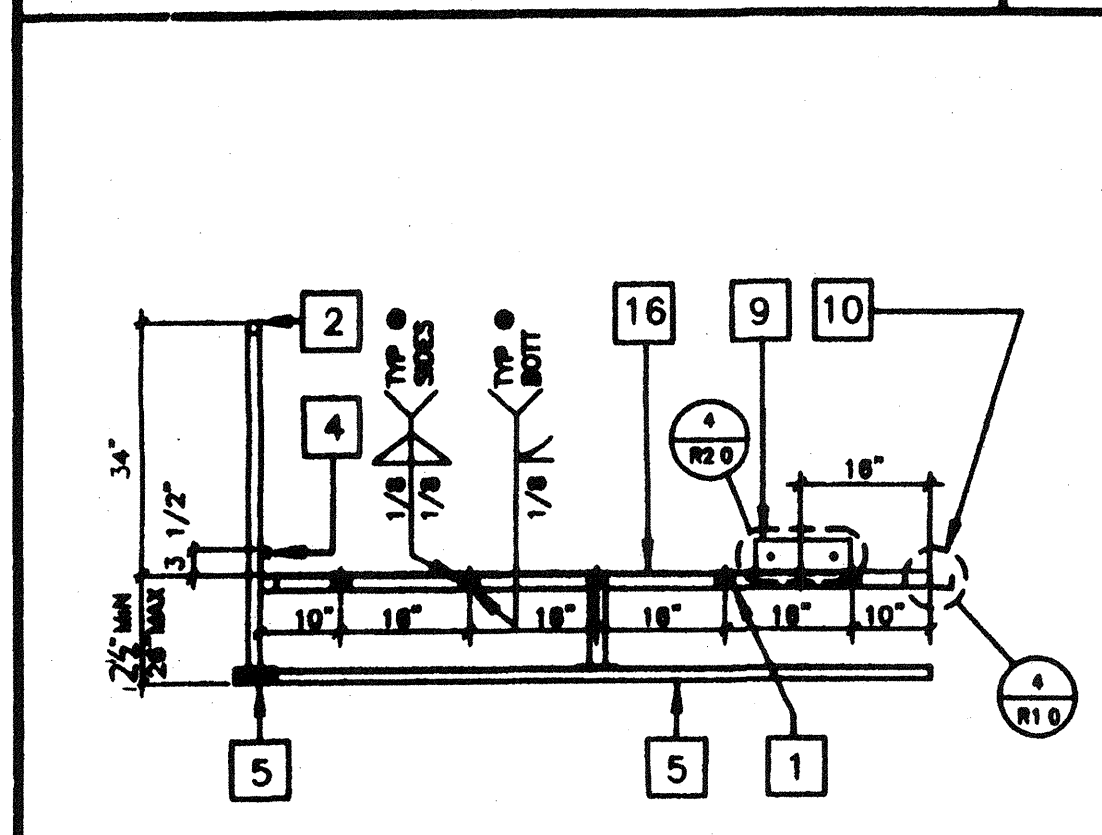


LONG. SECTION - LANDING 14

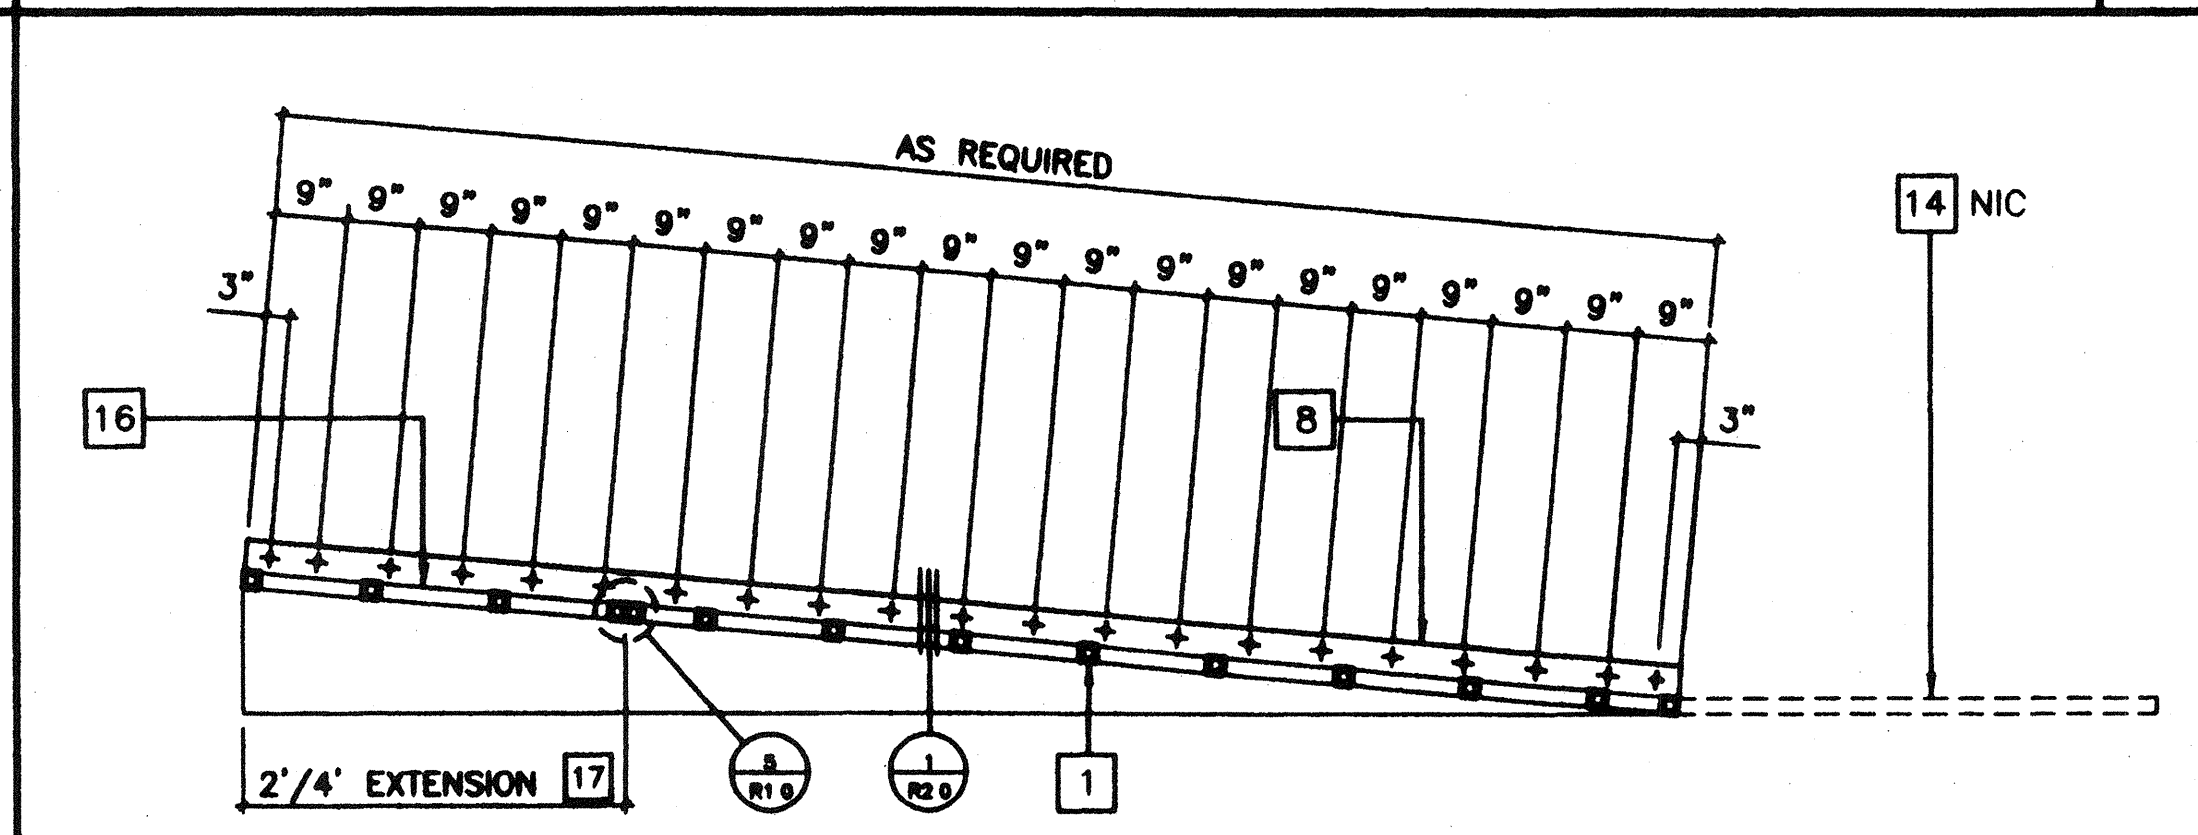


LONGITUDINAL SECTION - RAMP 9

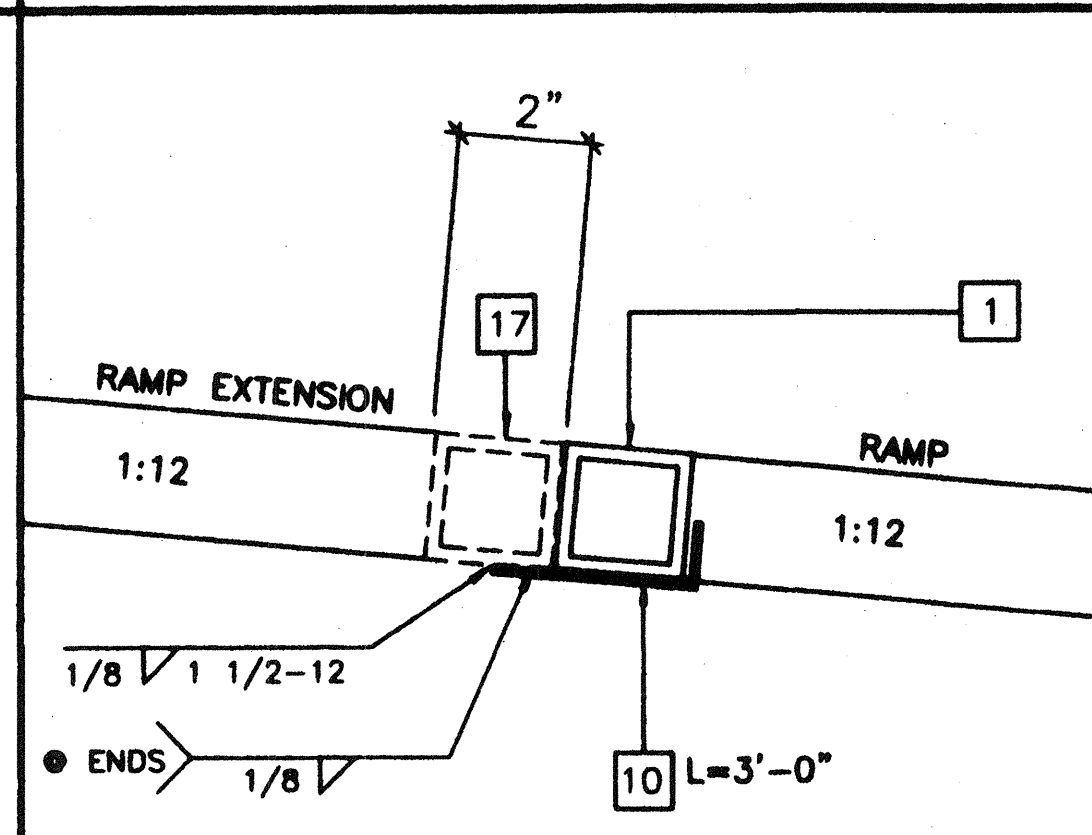

RAMP EXTENSION TO RAMP 5

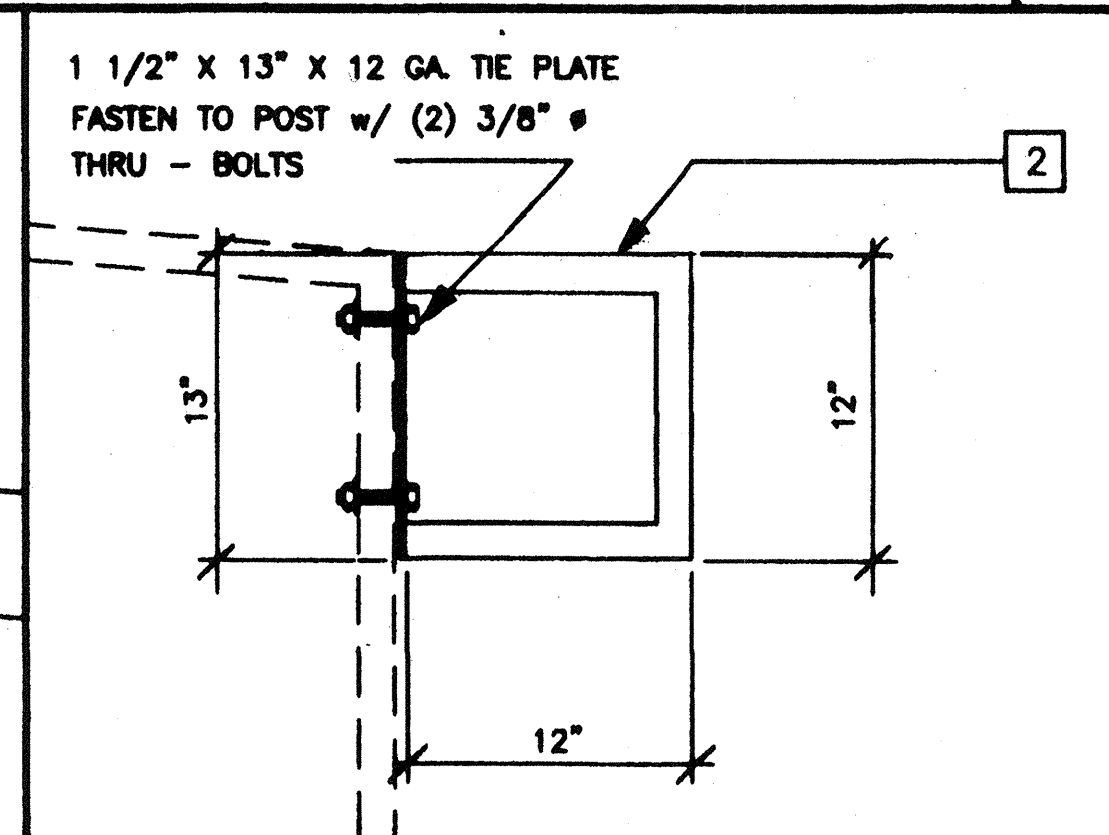

GUARD RAIL EXTENSION 3

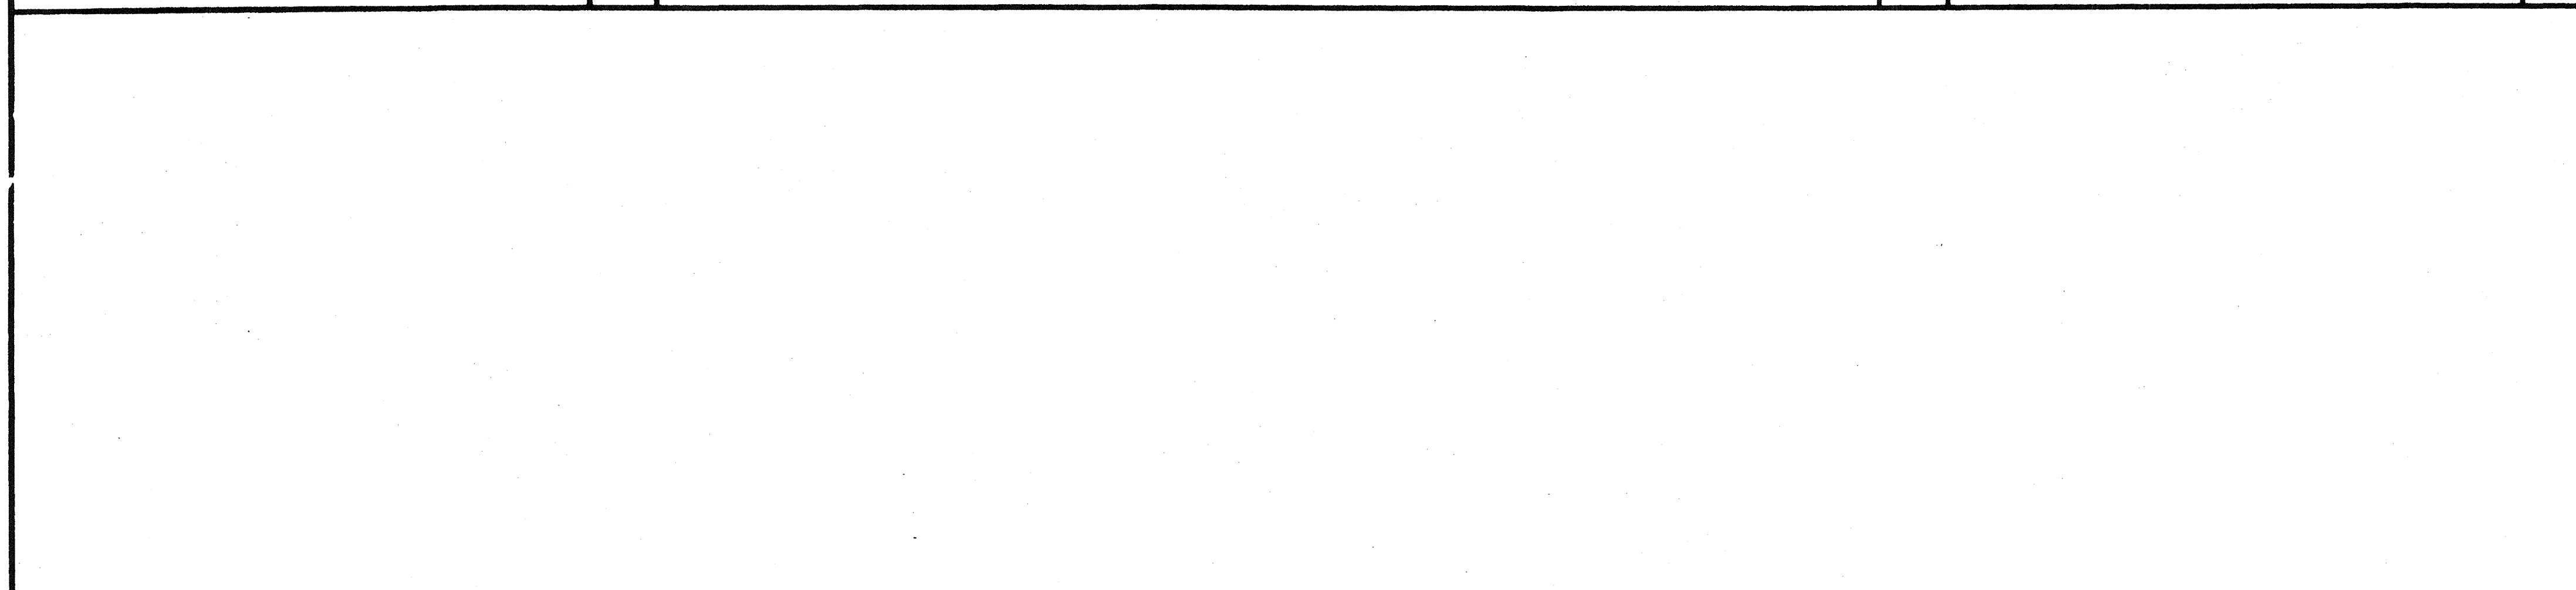

LANDING TO RAMP 4

- ### KEY NOTES
- TS 2" x 2" x 14ga
 - TS 1 1/2" x 1 1/2" x 14ga (Fy = 39KSI)
 - TS 1" x 1" x 16ga WHEELCHAIR GUIDE
 - 2 x 6 PT SILL PLATE
 - 6" x 10ga CONT. PLATE W/ 1/4" x 2" TEK SCREWS @ 9" OC INTO WOOD OR FOUND. BLOCKS OR #14 x 2" TEK SCREWS INTO STEEL @ 9" OC
 - 6" x 12" x 10ga PLATE W/ 2-1/4" x 3" LAGS TO STRUCTURAL FRAME OF BUILDING
 - 3" x 1" x 3'-0" x 10ga BENT PLATE
 - 2" x 4" x 12ga BASE PLATE W/ 2-1/4" x 1" LAGS
 - 6" x 10" x 12ga BASE PLATE @ RAMP TOE
 - LINE OF RAMP/LANDING ABOVE
 - LOWER LANDING BY DISTRICT
 - SKIRTING: PLYWOOD TO MATCH BUILDING SIDING. BLOCK ALL EDGES. ATTACH W/ 8d @ 6" OC EDGES AND 12" OC FIELD. AT EDGE CONNECTION TO T.S. USE #14 x 2" TEK SCREWS @ 6" OC
 - 12ga METAL DECK: NON-SLIP SURFACE. DESIGN COEFFICIENT OF FRICTION GREATER THAN 0.6. MAINTAINABLE FOR 1 YR.
 - RAMP EXTENSION FRAME.
 - EXISTING BUILDING.
 - RAMP BY MODTECH
 - FLUSH TRANSITION
 - NOTCH BOTTOM PLATE (MUD SILL) AS REQUIRED TO CLEAR RAMP TOE. MAX NOTCH 1 1/2" x 4'-0" LONG.
 - TS 1" x 1" x 16ga

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES

O4 100929

AC 11/8 FLS 88 37

DATE JAN 07 2000

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT

AP03 116318

AC 11/8 FLS 88 37

DATE 051215

- ### NOTES
- RAMPS: RAMPS SHALL NOT SLOPE MORE THAN 1" IN 12"
 - HANDRAILS: HANDRAILS AT BOTH SIDES OF RAMP AT 34" HT.
 - SURFACE: LANDING & RAMP TO HAVE NON SLIP SURFACE ANCOR GRIP II AS MANUFACTURED BY AMERICAN CHEMICAL COMPANY (OR EQUAL)
 - GROUNDING: PROVIDE GROUNDING OF RAMP TO BLDG FRAME W/ #6 CU TO BOTH GROUND LUGS.
 - ARCHITECT SITE / RAMP / LANDING PLANNING: DUE TO VARYING SITE CONDITIONS THE MAXIMUM HEIGHT OF FINISH FLOOR FROM GRADE IS 28". THEREFORE IT IS POSSIBLE THAT THE ACCESS RAMP ATTACHED TO THE BUILDING COULD BE 26'-0" AT A SLOPE OF 1:12 ARCHITECT MUST TAKE INTO ACCOUNT THAT THE RAMP SUPPLIED BY MODTECH INC. IS 11'-0" AT A SLOPE OF 1:12 THEREFORE THE ARCHITECT WILL HAVE TO DESIGN AND PROVIDE SUFFICIENT DETAILS OF RAMP EXTENSIONS AND BOTTOM LANDING DEPENDING ON PARTICULAR SITE CONDITIONS. IN NO WAY IS MODTECH INC. RESPONSIBLE FOR ANY RAMP EXTENSION EXCEEDING THE ORIGINAL PLAN AS SHOWN ON SHEET R-1.
 - ALL 1 1/4" AND 1 1/2" TUBE STEEL TO BE OF ASTM A500 GRADE A STEEL (Fy = 39 KSI)

REVISIONS

1		
2		
3		
4		
5		

Electrical Engineer's Seal

Mechanical Engineer's Seal

Structural Engineer's Seal

Architect's Seal

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES

PC 266

AC 11/8 FLS 88 37

DATE JAN 21 2000

REVISED

MODTECH INC.

2830 BARRETT AVENUE
PERRIS, CALIF. 92572

PH (909) 943-4014
FAX (909) 940-0427

Job Number: PC 266 2986

© MODTECH, INC. 1997

drawn by FVH

date 11/98

checked by 4012-088

date 05 JAN 99

project no. 2986

MODTECH Index No. R1.0

RAMP / LANDING

R1.0

2506, 2377, 3027, 3183