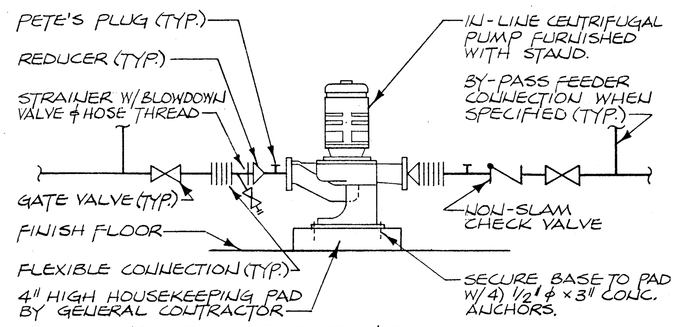

IN-LINE PUMP PIPING (WITH SUPPORT STAND) — E / MP-6

SCALE : NONE

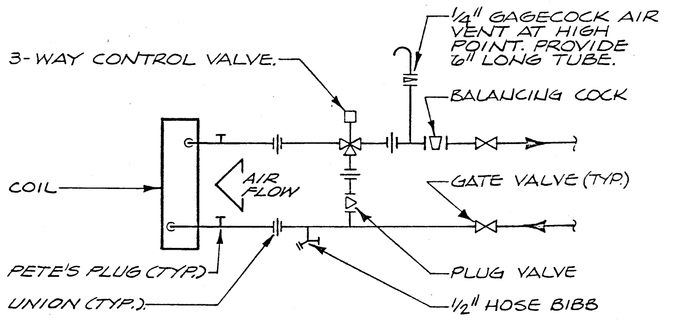

COIL PIPING DETAIL — F / MP-6

SCALE : NONE

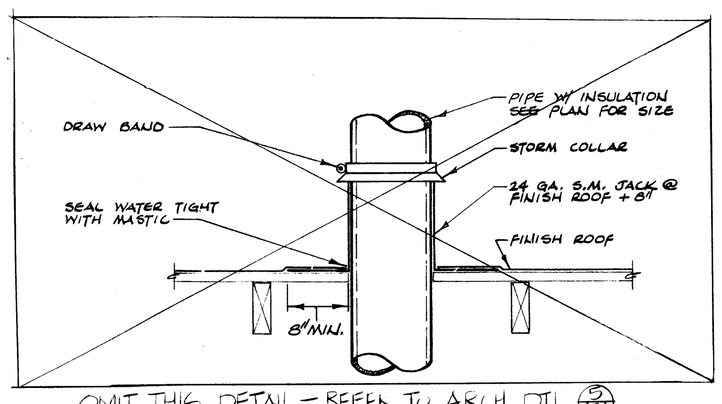

OMIT THIS DETAIL - REFER TO ARCH. DTL. 9/A4

PIPE THRU ROOF DETAIL — G / MP-6

SCALE : NONE

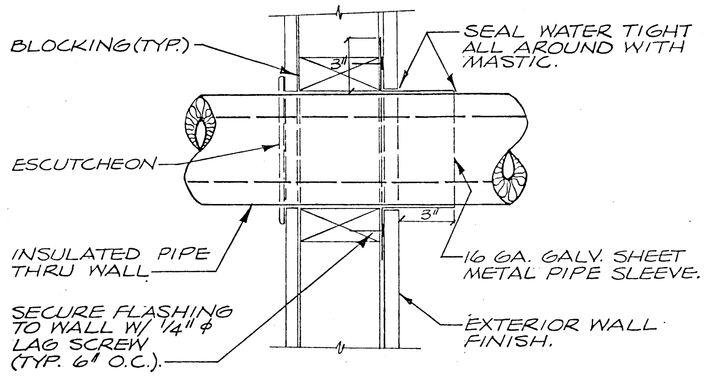

PIPE THRU WALL DETAIL — H / MP-6

SCALE : NONE

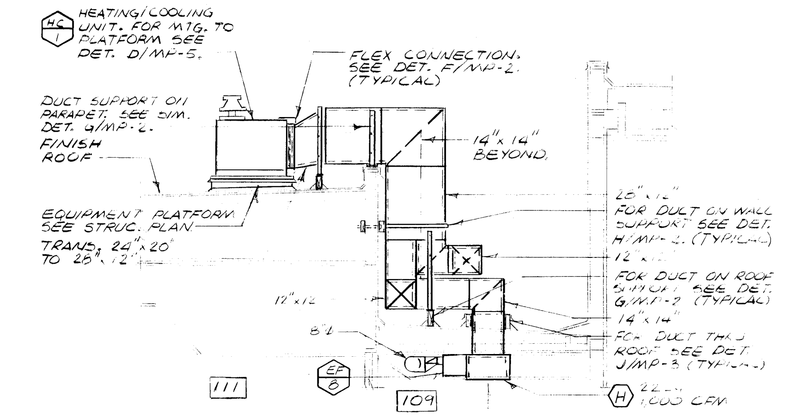

SECTION AT HC-1 — A / MP-6

SCALE : 1/4" = 1'-0"

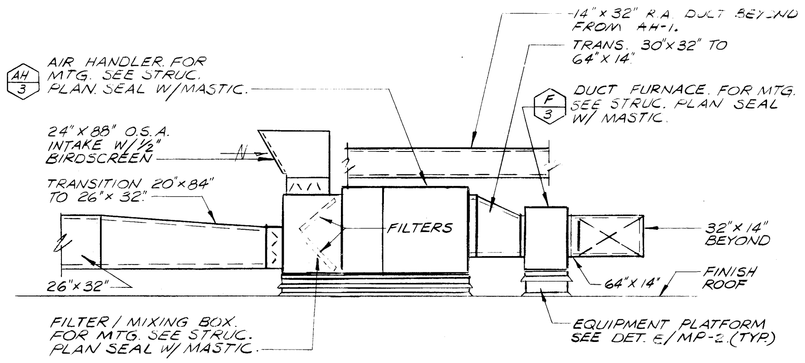

SECTION AT AH-3 — B / MP-6

SCALE : 1/4" = 1'-0"

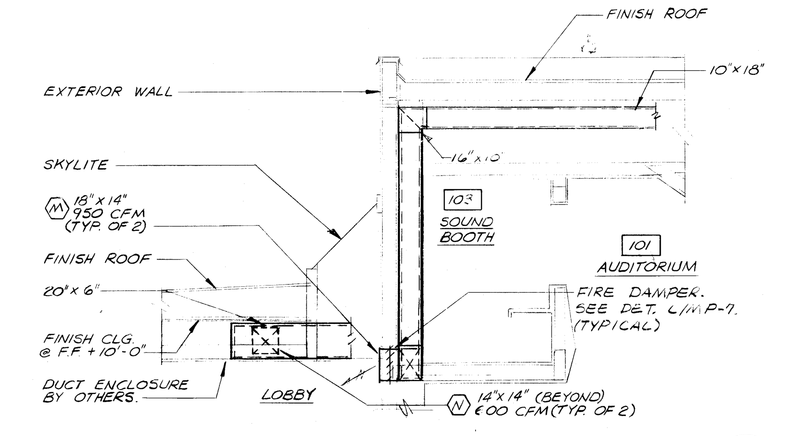

SECTION AT AH-1 — C / MP-6

SCALE : 1/4" = 1'-0" (AH-2 IS SIMILAR)

SECTION AT LOBBY — D / MP-6

SCALE : 1/4" = 1'-0" (FC-1 NOT SHOWN FOR CLARITY)

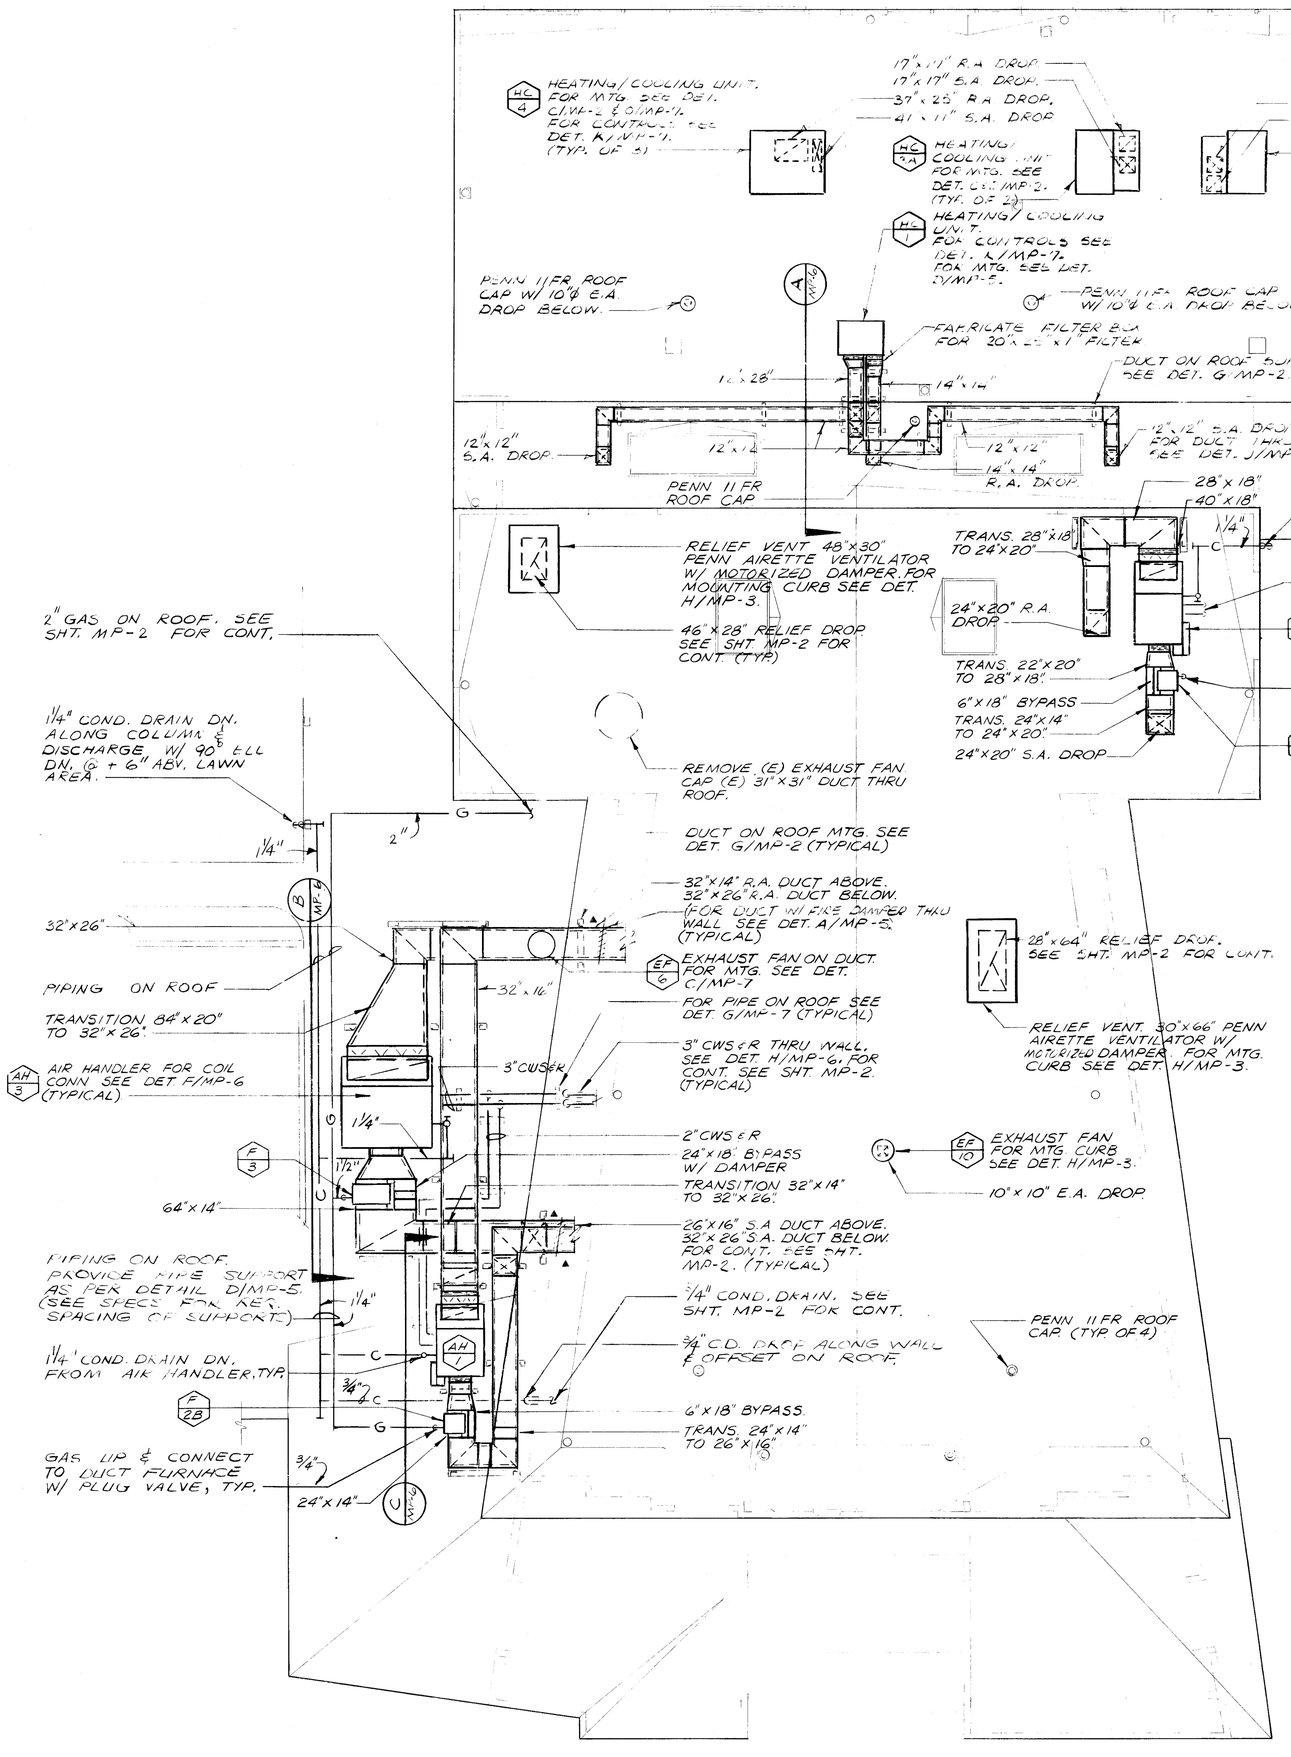

ALTERNATE 1 : ALL WORK ASSOCIATED WITH UNIT AH-1

BUILDING 1

AIR CONDITIONING ROOF PLAN

SCALE : 1/8" = 1'-0"

NOTES :

1. COORDINATE LOCATION OF HC-1, 3A, 3B, & 4 W/ ARCH & STRUC. PLANS.



bfg biggar frapwell ghezzi cartnal

approved

Donald R. Lawrence & Associates
CONSULTING MECHANICAL ENGINEERS
1300 W. Shaw Ave., Suite 2B Fresno, CA. 93711
(209) 226-8181 ME31064

C-1128
C-3269
C-3132
*C-6564

biggar frapwell ghezzi cartnal
architects planners
31 south real road box 9698
bakersfield california 93309
805 832 8122
© copyrighted 1980

AIR CONDITIONING ROOF PLAN BUILDING 1 & DETAILS

BLAIR LEARNING CENTER RECONSTRUCTION

900 belle terrace, bakersfield, california

job 88-102

date 3-OCT 1990

sheet MP-6