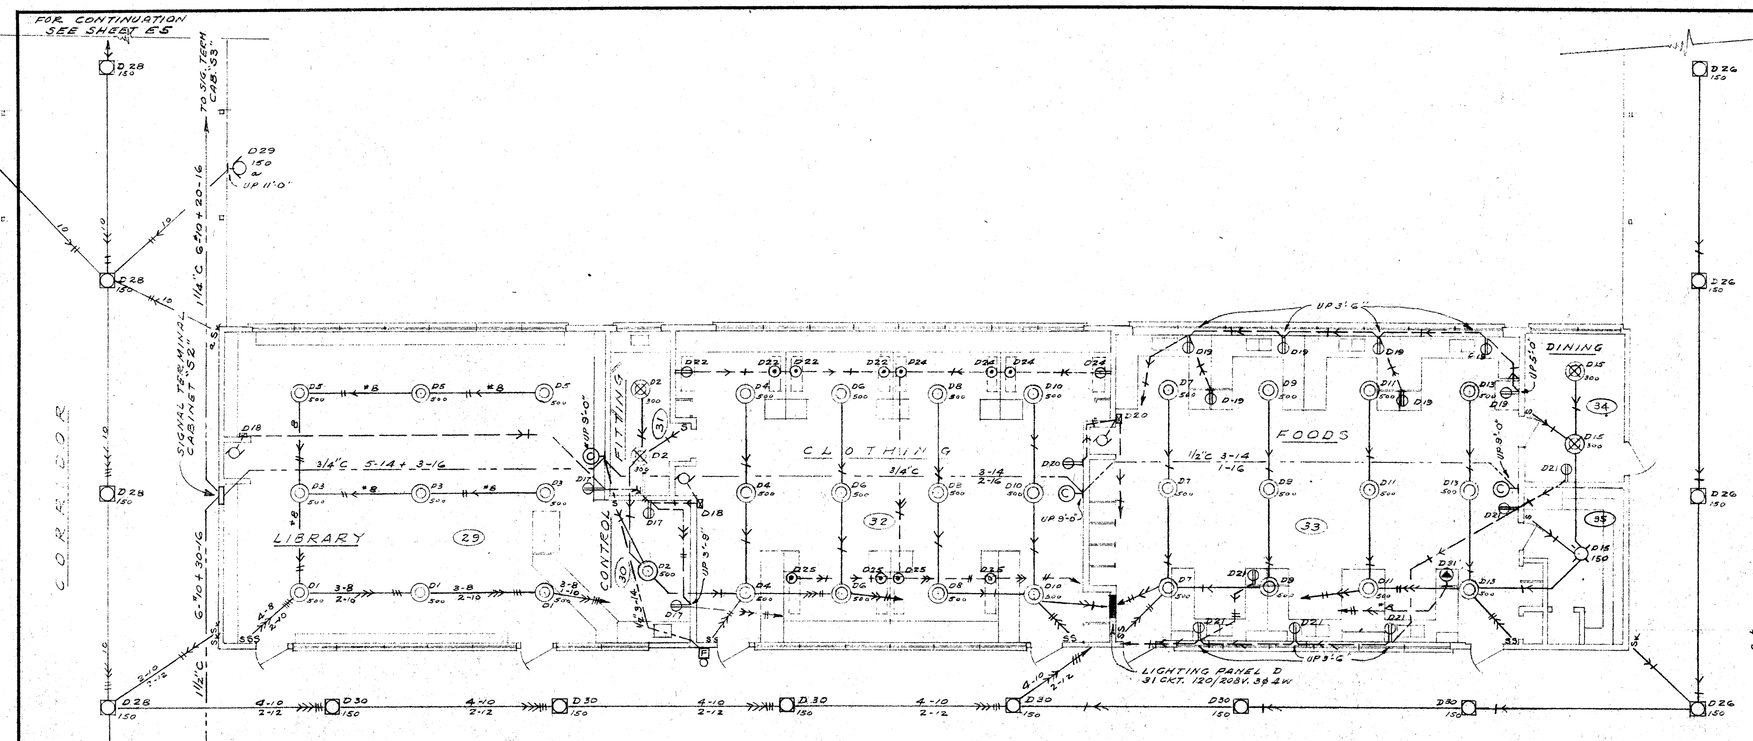

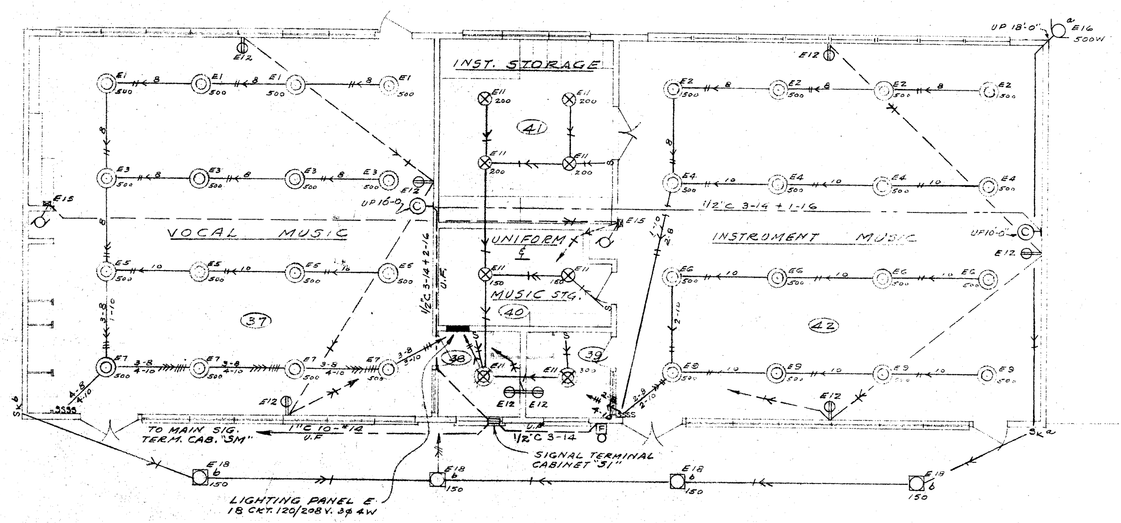

UNIT D
SCALE 1/8"-1'-0"

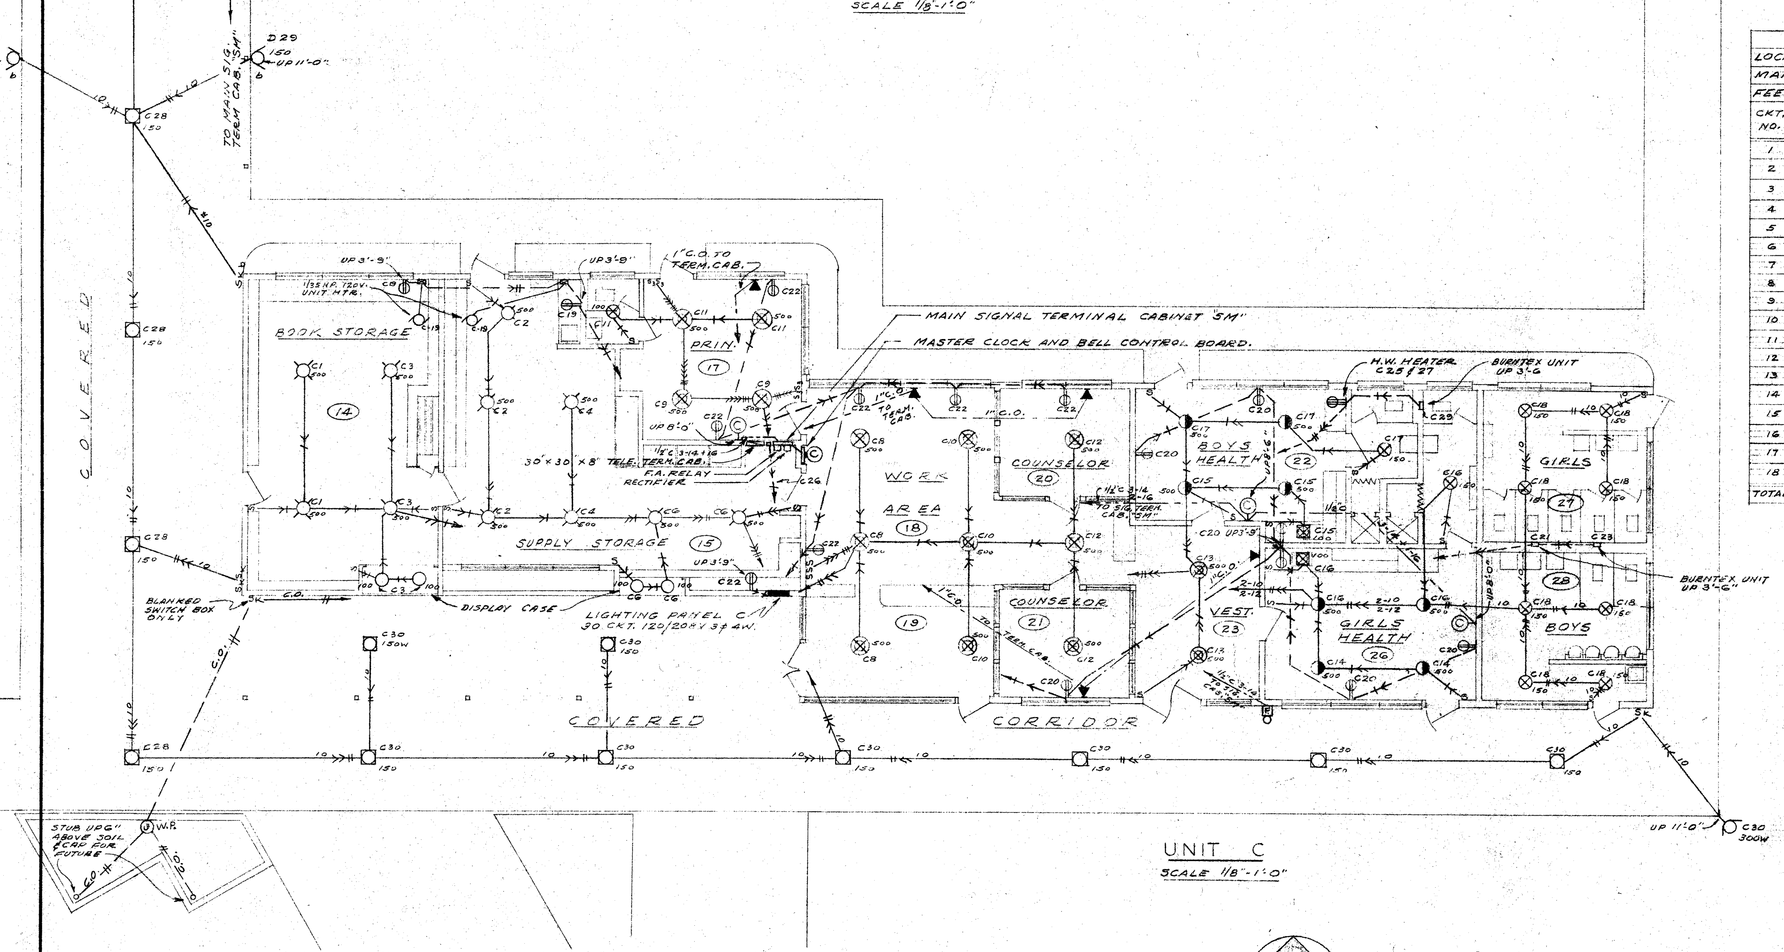

UNIT C
SCALE 1/8"-1'-0"

UNIT E
SCALE 1/8"-1'-0"

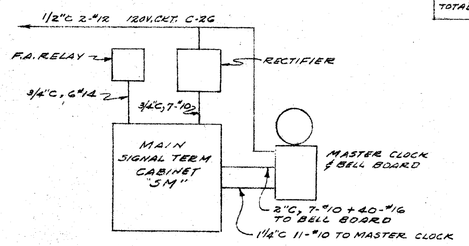

LIGHTING PANEL E

LOCATION: ROOM #38 — MOUNTING FLUSH
MAINS LUGS ONLY — AMPS. 74
FEED BOTTOM

CKT. NO.	BREAKERS P	AMP	OUTLETS LTG.	APP.	WATTAGE ϕA	ϕB	ϕC	LOCATION
1	1	20	4		2000			VOCAL MUSIC #37
2	1	20	4		2000			INSTR. " #42
3	1	20	4			2000		VOCAL " #37
4	1	20	4			2000		INSTR. " #42
5	1	20	4				2000	VOCAL " #37
6	1	20	4				2000	INSTR. " #42
7	1	20	4		2000			VOCAL " #37
8	1	20	SPARE		1200			
9	1	20	4			2000		INSTR. " #42
10	1	20	SPARE			1800		
11	1	20	8				1320	OFFICES / STORAGE RM 40+41
12	1	20	8				1440	BOOMS 37 / 42
13	1	20	SPARE		1080			
14	1	20	SPARE		1600			
15	1	20	2			1200		1/4HP HEATER, RMS. 37 / 42
16	1	15	1			600		FLOOD
17	1	20	SPARE				1000	
18	1	15	4				600	CORRIDOR
TOTAL					9080	8720	8760	26560

LIGHTING PANEL D

LOCATION ROOM #32 — MOUNTING FLUSH
MAINS LUGS ONLY — AMPS 126
FEED BOTTOM

CKT. NO.	BREAKERS P	AMP	OUTLETS LTG.	APP.	WATTAGE ϕA	ϕB	ϕC	LOCATION
1	1	15	3		1200			LIBRARY #29
2	1	15	3		1100			CONTROL FITTING RM.
3	1	15	3			1200		LIBRARY #29
4	1	15	3			1300		CLOTHING #32
5	1	15	3				1500	LIBRARY #29
6	1	15	3				1500	CLOTHING #32
7	1	15	3		1800			FOODS #33
8	1	15	3		1800			CLOTHING #32
9	1	15	3			1500		FOODS #33
10	1	15	3			1500		CLOTHING #32
11	1	15	3				1500	FOODS #33
12	1	15	SPARE				1000	
13	1	15	3		1500			FOODS #33
14	1	15	SPARE		1000			
15	1	15	3			750		DINING & STORAGE
16	1	15	SPARE			1000		
17	1	20	3				540	LIBRARY
18	1	20	2				1200	1/4HP. UNIT HTRS RMS. #29/32
19	1	20	7		1260			FOODS
20	1	20	2		780			1/4HP UNIT HTR #33 + RECPT
21	1	20	6			1080		FOODS
22	1	20	4			720		CLOTHING
23	1	20	SPARE				1000	
24	1	20	4				720	CLOTHING
25	1	20	4		720			CLOTHING
26	1	15	4		600			CORRIDOR
27	1	20	SPARE		1000			
28	1	15	4			600		CORRIDOR
29	1	20	6				900	FLOODS
30	1	15	6				900	CORRIDOR
31	3	35		1	4000	4000	4000	ELEC. RANGE
TOTAL					15620	15160	14760	45370

LIGHTING PANEL C

LOCATION CORRIDOR — MOUNTING FLUSH
MAINS LUGS ONLY — AMPS: 97
FEED BOTTOM

CKT. NO.	BREAKERS P	AMP	OUTLETS LTG.	APP.	WATTAGE ϕA	ϕB	ϕC	LOCATION
1	1	15	2		1000			BOOK STORAGE #14
2	1	15	3		1500			SUPPLY STORAGE #15
3	1	15	4			1200		BOOK STORAGE #14
4	1	15	2			1000		SUPPLY STORAGE #15
5	1	15	SPARE				1000	
6	1	15	4				1200	SUPPLY STORAGE #15
7	1	15	SPARE		1000			
8	1	15	3			1800		WORK AREA #18
9	1	15	2				1000	PRINCIPAL #17
10	1	15	3			1800		WORK AREA #18
11	1	15	3				1100	PRINCIPAL #17
12	1	15	3				1500	WORK AREA #18
13	1	15	2		1000			VESTIBULE #23
14	1	15	2		1000			GIRLS HEALTH #26
15	1	15	3				1100	BOYS HEALTH #22
16	1	15	4				1250	GIRLS HEALTH #26
17	1	15	3				1150	BOYS HEALTH #22
18	1	15	8				1800	BOYS & GIRLS TOILETS
19	1	20		4	720			USE HP UNIT HTRS RM #14 & 15
20	1	20		7	1260			RMS. #21-22 & 26
21	1	20		1			750	BURNTEX UNIT
22	1	20		7			1260	RMS. #17-18 & 20
23	1	20		1			750	BURNTEX UNIT
24	1	20	SPARE				1800	
25	1	20		1	2000			H.W. HEATER
26	1	20		1	1000			PROGRAM & F.D. RECT.
27	1	20		1		2000		H.W. HEATER
28	1	15	4			600		CORRIDOR
29	1	20		1			750	BURNTEX UNIT
30	1	15	9				1500	CORRIDOR
TOTAL					11980	11660	11150	34790

CHECK AND VERIFY ALL DIMENSIONS BEFORE PROCEEDING WITH THE WORK. REPORT ANY DISCREPANCIES TO ARCHITECT.

FLOOR PLANS UNITS C D & E ELECTRICAL

LESTER R. KELLY
MECHANICAL AND ELECTRICAL CONSULTING ENGINEER
443 SOUTH BEAUDRY AVENUE LOS ANGELES CALIF
DRAWN BY F.W.S. JOB NO. 256
CHECKED BY — DATE 3-1-51

COUNTY OF KERN
OFFICE OF SUPERINTENDENT OF SCHOOLS
JESSE D. STOCKTON — SUPERINTENDENT
APPROVED
DATE

STATE OF CALIFORNIA
DEPARTMENT OF PUBLIC WORKS
DIVISION OF ARCHITECTURE
STATE OF CALIFORNIA DEPARTMENT OF PUBLIC WORKS DIVISION OF ARCHITECTURE
APPLICATION NO. 8875 — APPROVED — BY SUPERVISING STRUCTURAL ENGINEER

BAKERSFIELD CITY SCHOOLS
1600 K ST. BAKERSFIELD, CALIFORNIA
BOARD OF EDUCATION
APPROVED — DATE 3/1/51

JUNIOR HIGH SCHOOL
BAKERSFIELD CITY SCHOOL DISTRICT
BELLE TERRACE & P STREETS
BAKERSFIELD CALIFORNIA
JOB NO. C-335

ERNEST L. McCOY · A·I·A · ARCHITECT
129 HAY BLDG. 1612 - 19th ST.
BAKERSFIELD — CALIFORNIA

DATE 3-1-51

DRAWN BY
E-3
OF SHTS.