
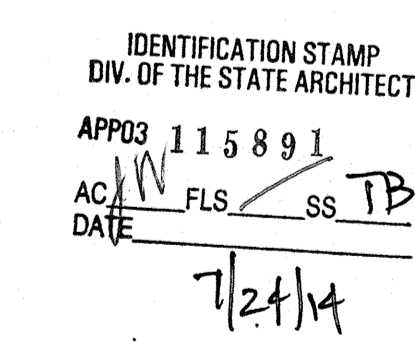
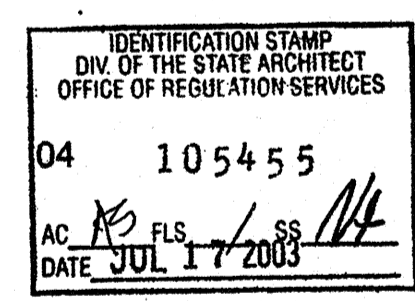


- ### KEY NOTES
- TS 2"x2"x14 GA
 - TS 1 1/2"x1 1/2"x14 GA (Fy = 39 KSI), ROUNDED OR BEVELED AT CORNERS.
 - TS 1"x1"x18 GA WHEELCHAIR GUIDE
 - 2"x6" PRESSURE TREATED SILL PLATE
 - 2"x4"x12 GA BASE PLATE WITH 2-1/4"x1" LAGS
 - SKIRTING: PLYWOOD TO MATCH BUILDING SIDING, BLOCK ALL EDGES, ATTACH WITH 8d AT 6" OC EDGES AND 12" OC FIELD, AT EDGE CONNECTION TO TS, USE #14x2" TEK SCREWS AT 6" OC
 - 12GA METAL DECK: NON-SLIP SURFACE, DESIGN COEFFICIENT OF FRICTION GREATER THAN 0.8, MAINTAINABLE FOR 1 YR, PROVIDE ROUNDED OR BEVELED EDGES ON STAIR NOSING.
 - EXISTING BUILDING.
 - 6"x10"x12 GA BASE PLATE AT RAMP TOE.
 - LOWER LANDING BY DISTRICT
 - RAMP BY MODTECH
 - FLUSH TRANSITION
 - PAVE BY DISTRICT
 - 3"x1"x3'-0"x10 GA BENT PLATE
 - FASTEN POSTS WITH 3/8" DIA THRU BOLT, TYPICAL
 - RAMP LANDING, TYPICAL
 - 26 GA FLASHING
 - 3/8" DIAx2" LONG MB WITH NUT & WASHERS
 - CAULKING
 - 6"x10GA CONTINUOUS PLATE WITH #14x2" TEK SCREWS AT 9" OC INTO WOOD OR FOUNDATION BLOCKS OR #14x2" TEK SCREWS INTO METAL AT 9" OC
 - PROVIDE DIVERSION FOR WATER FROM DOWNSPOUT FOR THIS CONDITION, BY DISTRICT
 - TS 1 1/4"x1 1/4"x14 GA (Fy = 39 KSI)
 - 4" MINIMUM BUILDING SEPARATION
 - 2" SLIP RESISTANT WARNING STRIPES MAX 1" FROM EVERY STAIR NOSING AND TOP LANDING, USE CONTRASTING COLOR.
 - TS 2 1/2"x1 1/2"x8 GA, ASTM A500 GRADE A
 - 2"x2" NAILER WITH 16d AT 12" OC
 - RAMP WIDTH MINIMUM CLEAR DIMENSION IS 5'-0"

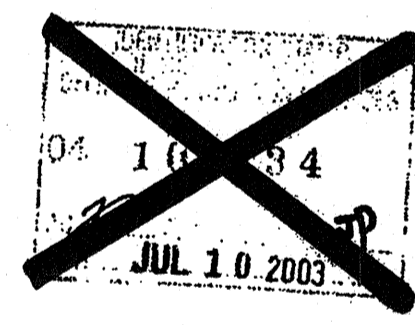

NO.	DATE	DESCRIPTION

Electrical Engineer's Seal
Mechanical Engineer's Seal
PC Professional of Record Seal
Architect's Seal

PC
CBC 2001
IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
PC-04
104796
AC FLS/SS
DATE 7/21/03

MODTECHTM
2830 BARRETT AVENUE FAX (909) 943-4014
PERRIS, CALIF. 92572 FAX (909) 940-0427

PROJECT NUMBER: 4736
WILLIAM SCOTTSMAN
© MODTECH, INC. 2002
ALL RIGHTS RESERVED
DRAWN BY: GL
DATE: 07/07/03
CHECKED BY:
DATE:
MODTECH Index No.

R1.02

PROJECT NO. 4736