


NOTE: ALL FIXTURES SHALL HAVE SHUT-OFF VALVES


TYPE 1/2" COPPER  
MAX. DEV. LENGTH = 40 FT.  
PRESSURE RANGE = 40 TO 60 PSI

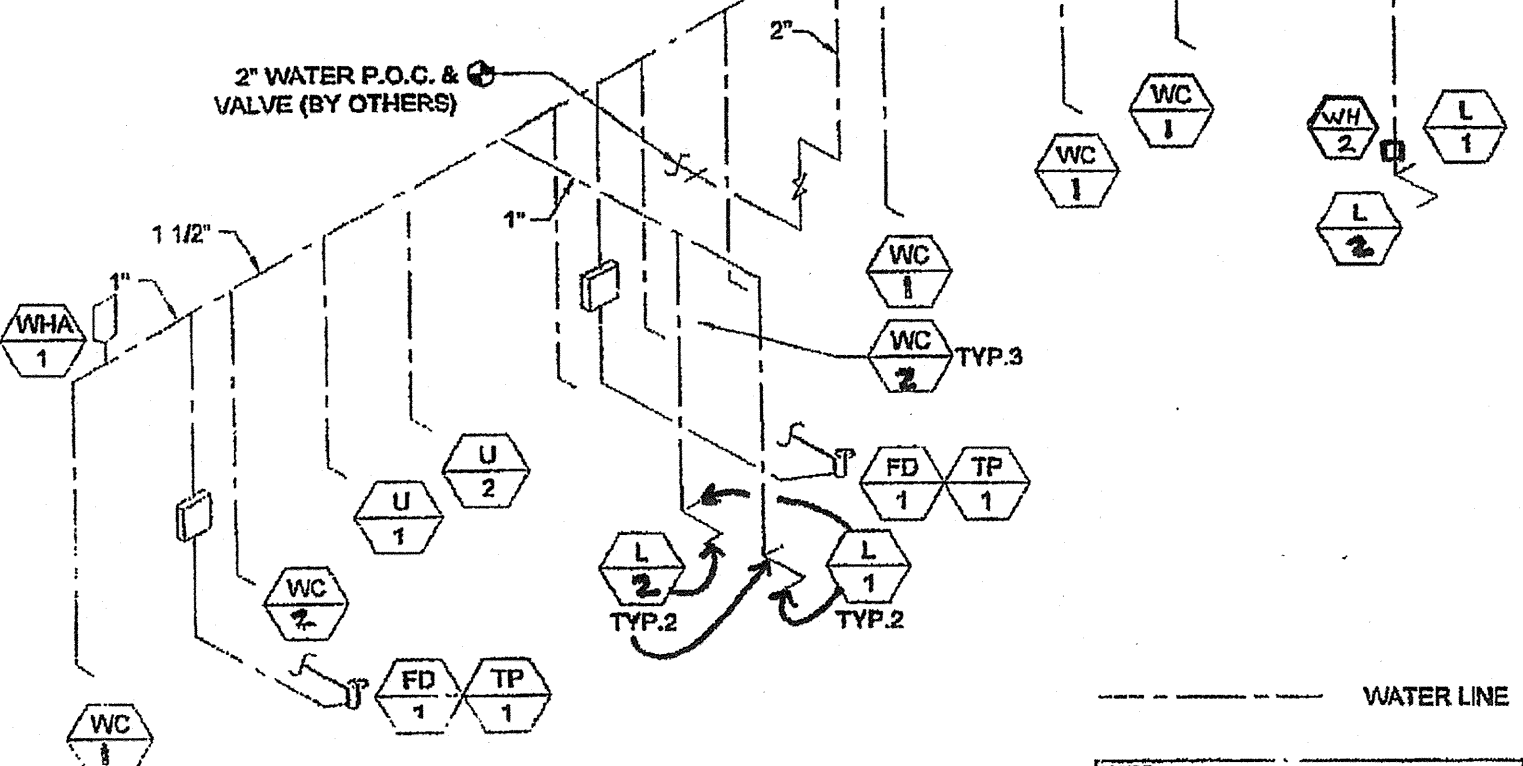

MODEL C-2  
SUPPLY ISOMETRIC - FLOOR AND WALL MOUNT

SCALE: N.T.S. 8


NOTE:  
HOT WATER LINE INSULATION TO BE INSTALLED AT FIRST F FROM THE WATER HEATER ON NON-RECIRCULATING SYSTEMS  
ALL HOT WATER LINES TO BE INSULATED WHEN RECIRCULATING SYSTEMS ARE USED.

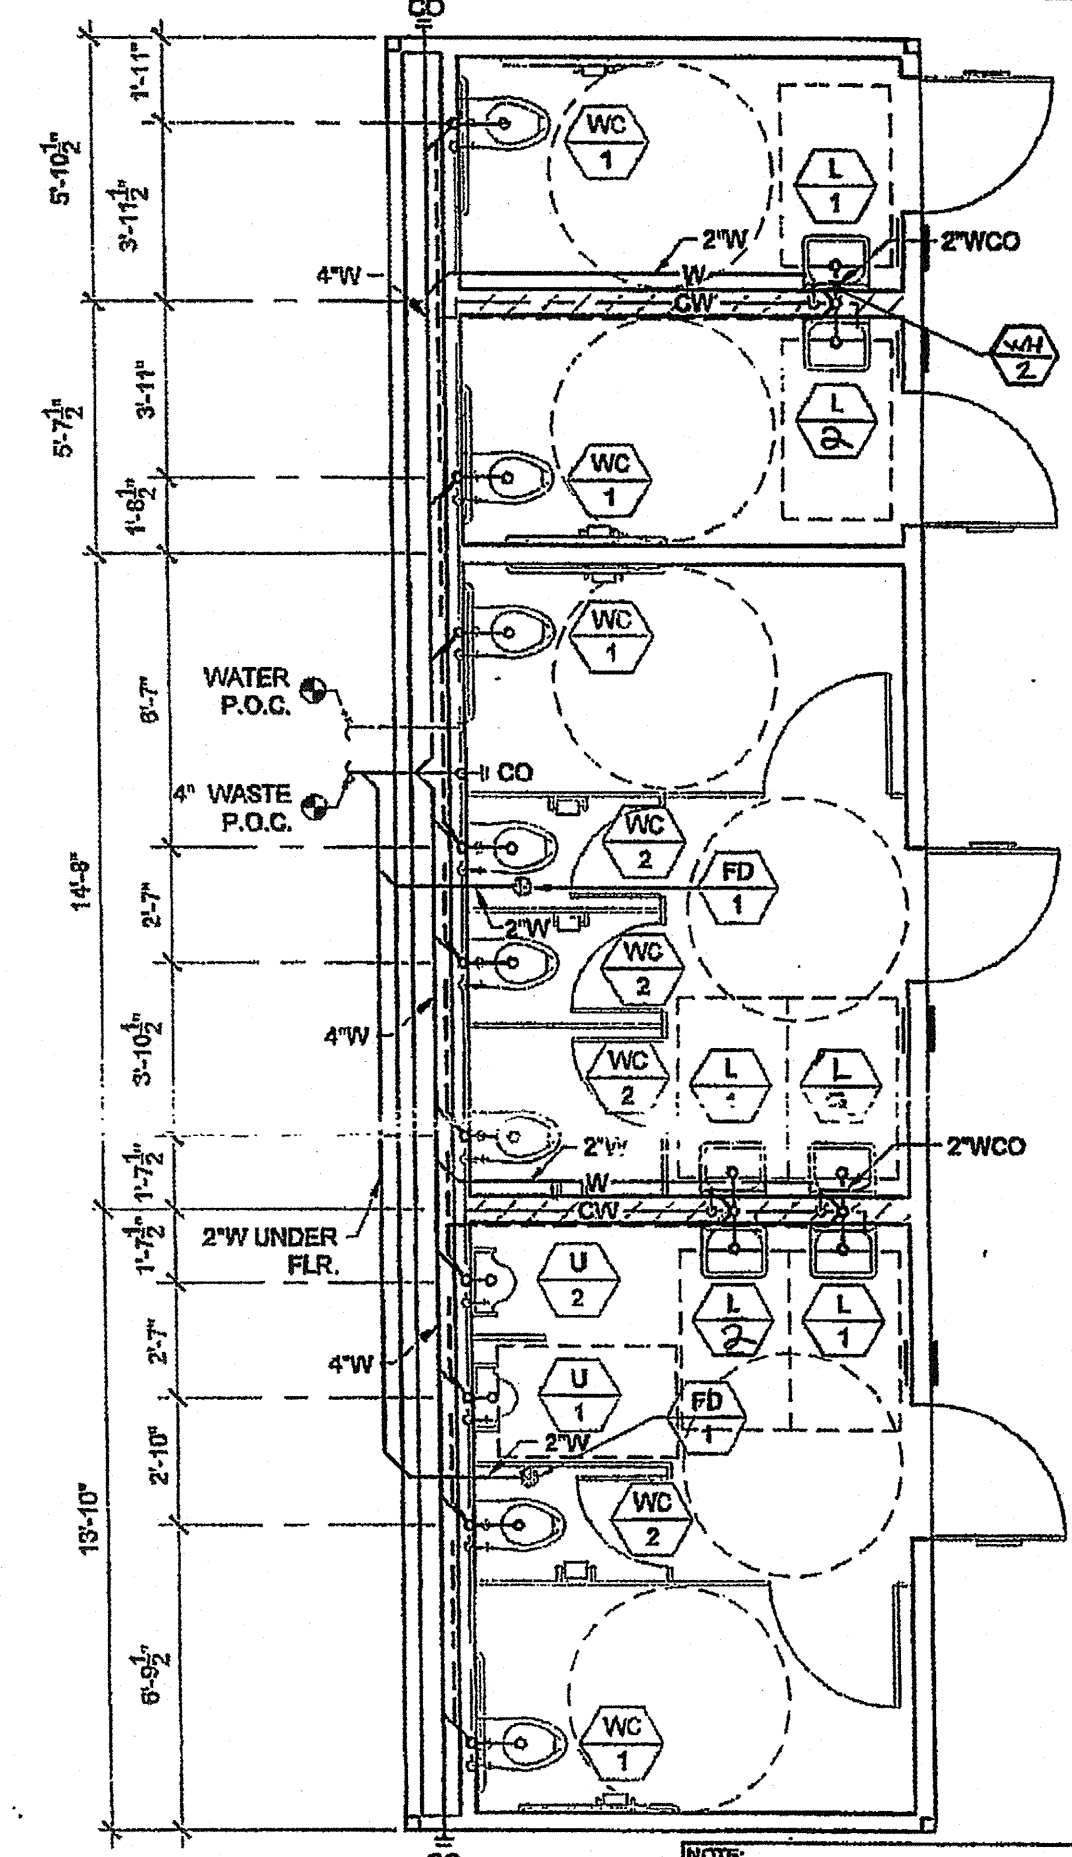

WALL MOUNT - MODEL C-2  
PLUMBING PLAN

SCALE: 1/4" = 1'-0" 6


NOTE:  
HOT WATER LINE INSULATION TO BE INSTALLED AT FIRST F FROM THE WATER HEATER ON NON-RECIRCULATING SYSTEMS  
ALL HOT WATER LINES TO BE INSULATED WHEN RECIRCULATING SYSTEMS ARE USED.

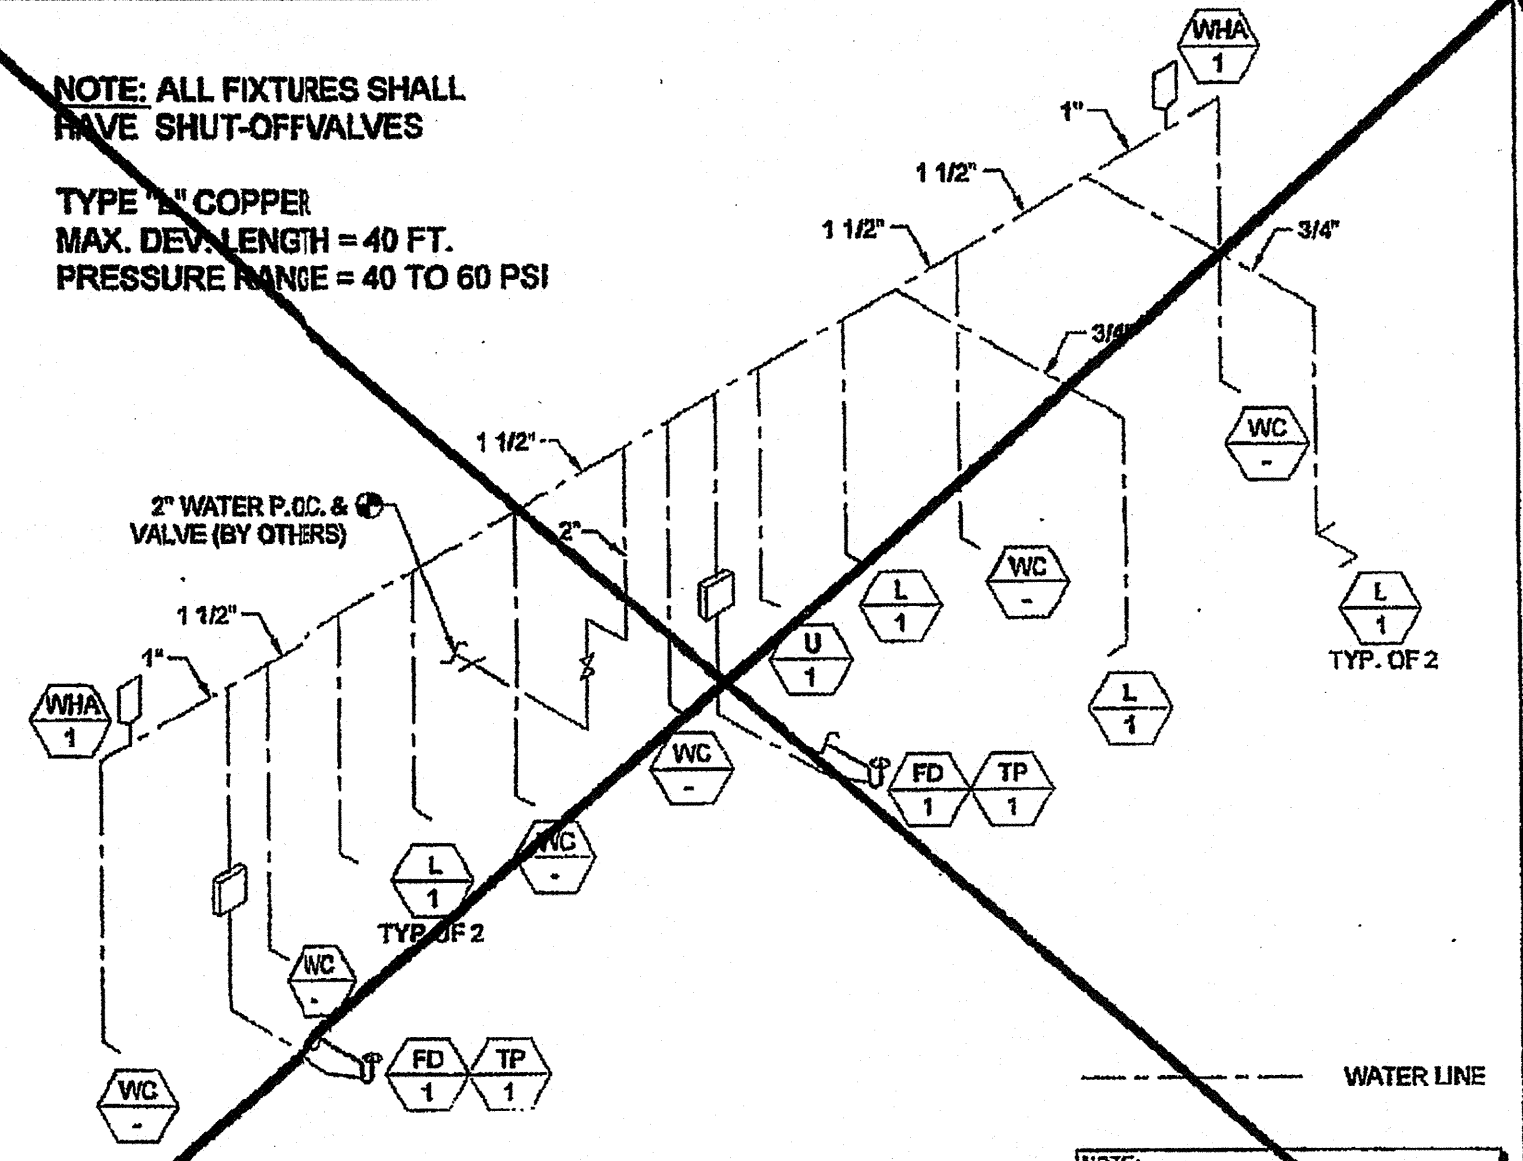

MODEL C-1  
SUPPLY ISOMETRIC - FLOOR AND WALL MOUNT

SCALE: N.T.S. 3


NOTE:  
HOT WATER LINE INSULATION TO BE INSTALLED AT FIRST F FROM THE WATER HEATER ON NON-RECIRCULATING SYSTEMS  
ALL HOT WATER LINES TO BE INSULATED WHEN RECIRCULATING SYSTEMS ARE USED.

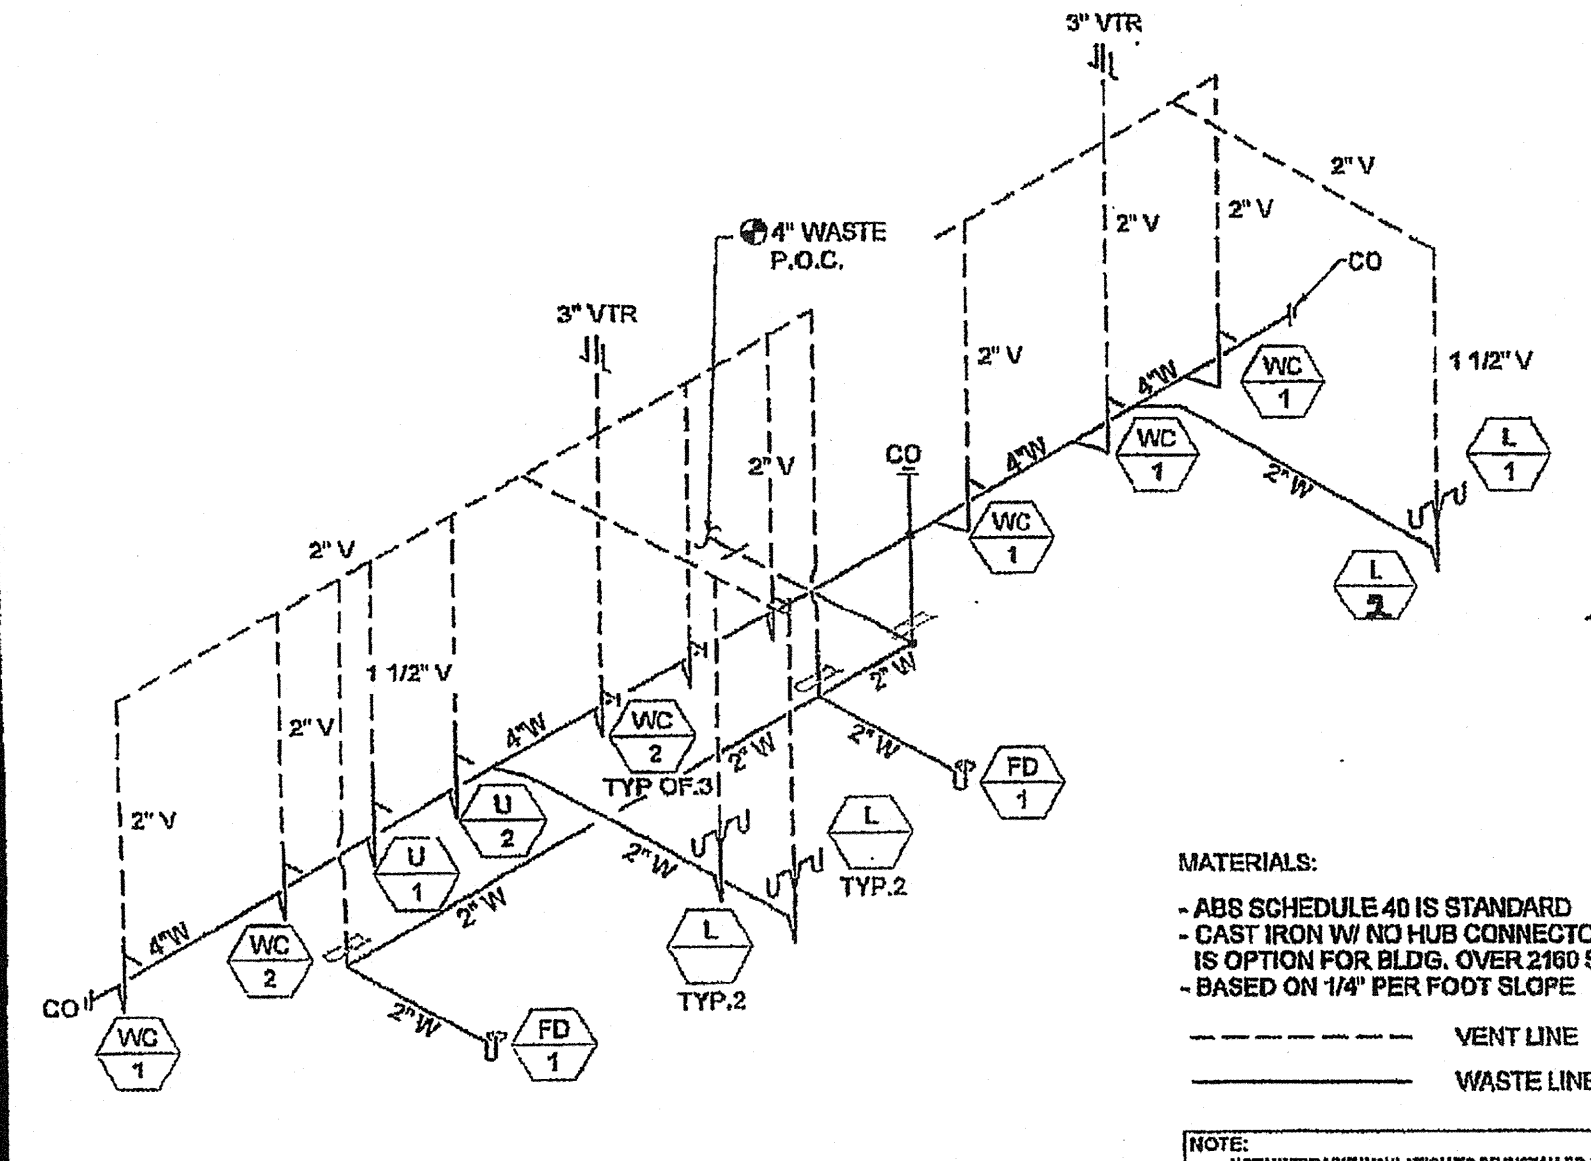

MODEL C-2  
WASTE AND VENTING ISOMETRIC - WALL MOUNT

SCALE: N.T.S. 9


MATERIALS:  
- ABS SCHEDULE 40 IS STANDARD  
- CAST IRON W/ NO HUB CONNECTOR IS OPTION FOR BLDG. OVER 2160 SF.  
- BASED ON 1/4" PER FOOT SLOPE

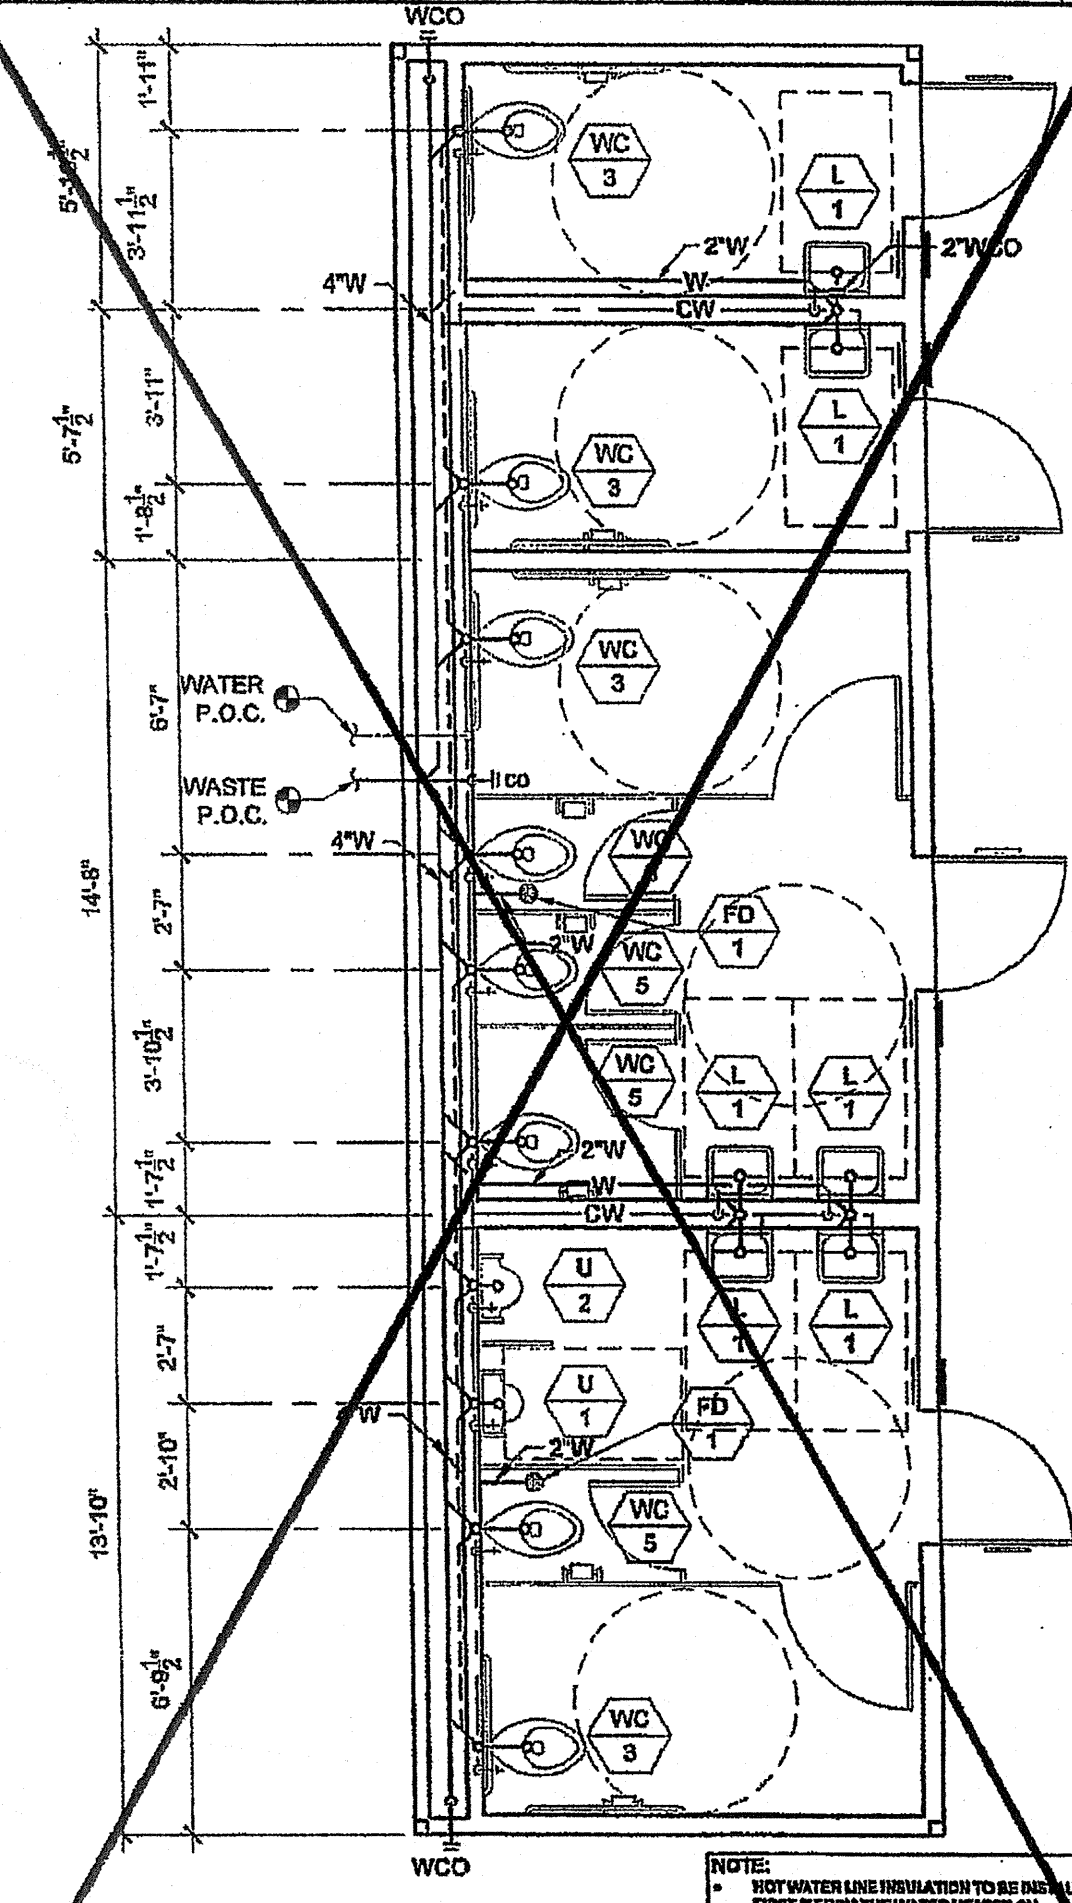

FLOOR MOUNT - MODEL C-2  
PLUMBING PLAN

SCALE: 1/4" = 1'-0" 7


NOTE:  
HOT WATER LINE INSULATION TO BE INSTALLED AT FIRST F FROM THE WATER HEATER ON NON-RECIRCULATING SYSTEMS  
ALL HOT WATER LINES TO BE INSULATED WHEN RECIRCULATING SYSTEMS ARE USED.

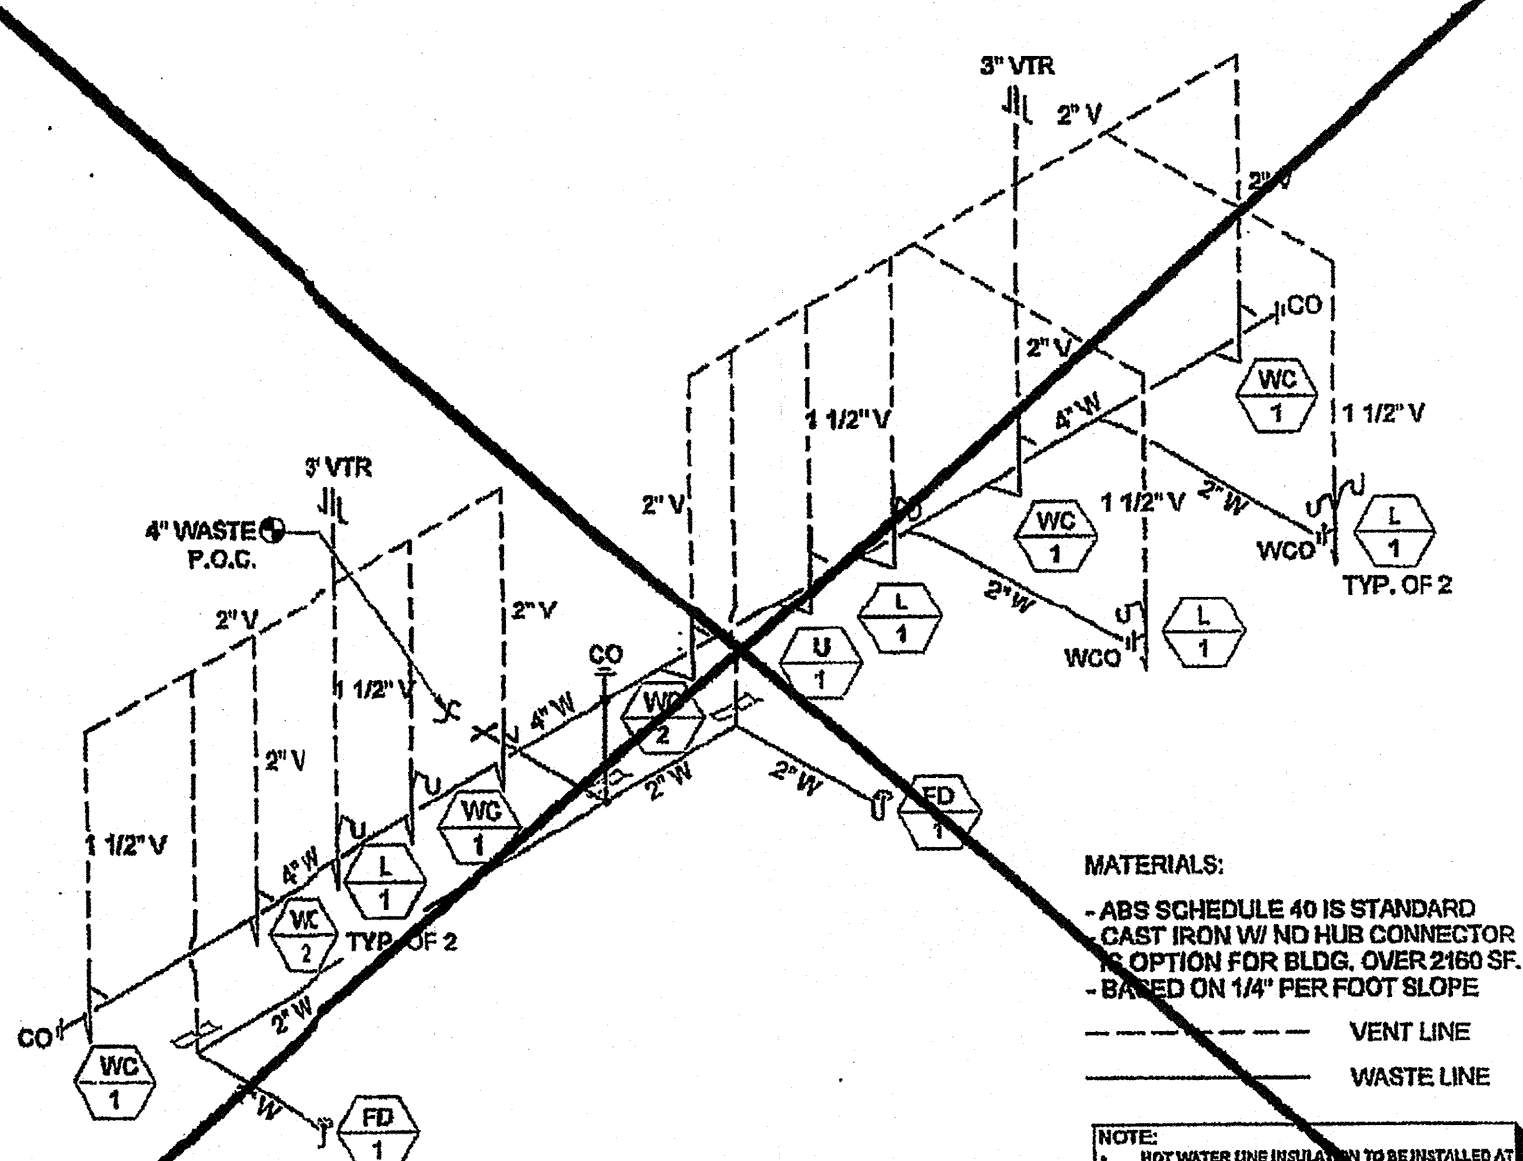

MODEL C-1  
WASTE AND VENTING ISOMETRIC - WALL MOUNT

SCALE: N.T.S. 5


MATERIALS:  
- ABS SCHEDULE 40 IS STANDARD  
- CAST IRON W/ NO HUB CONNECTOR IS OPTION FOR BLDG. OVER 2160 SF.  
- BASED ON 1/4" PER FOOT SLOPE

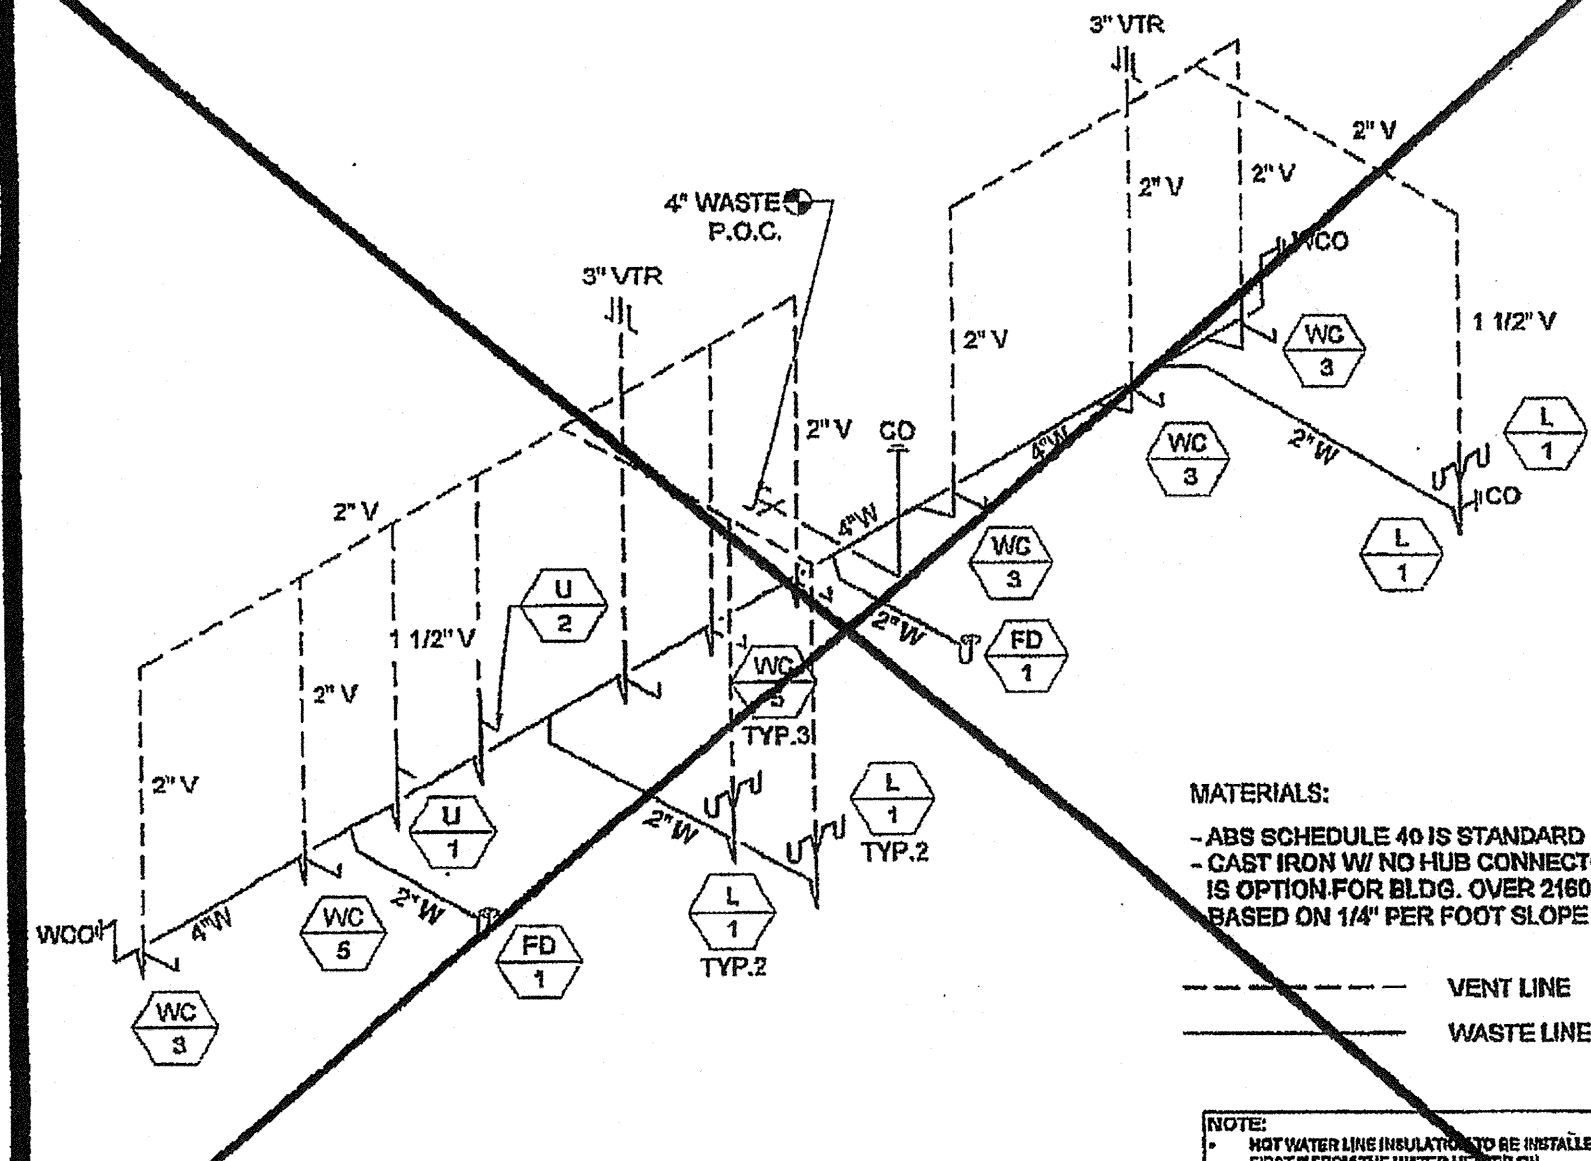

MODEL C-2  
WASTE AND VENTING ISOMETRIC - FLOOR MOUNT

SCALE: N.T.S. 10


MATERIALS:  
- ABS SCHEDULE 40 IS STANDARD  
- CAST IRON W/ NO HUB CONNECTOR IS OPTION FOR BLDG. OVER 2160 SF.  
- BASED ON 1/4" PER FOOT SLOPE

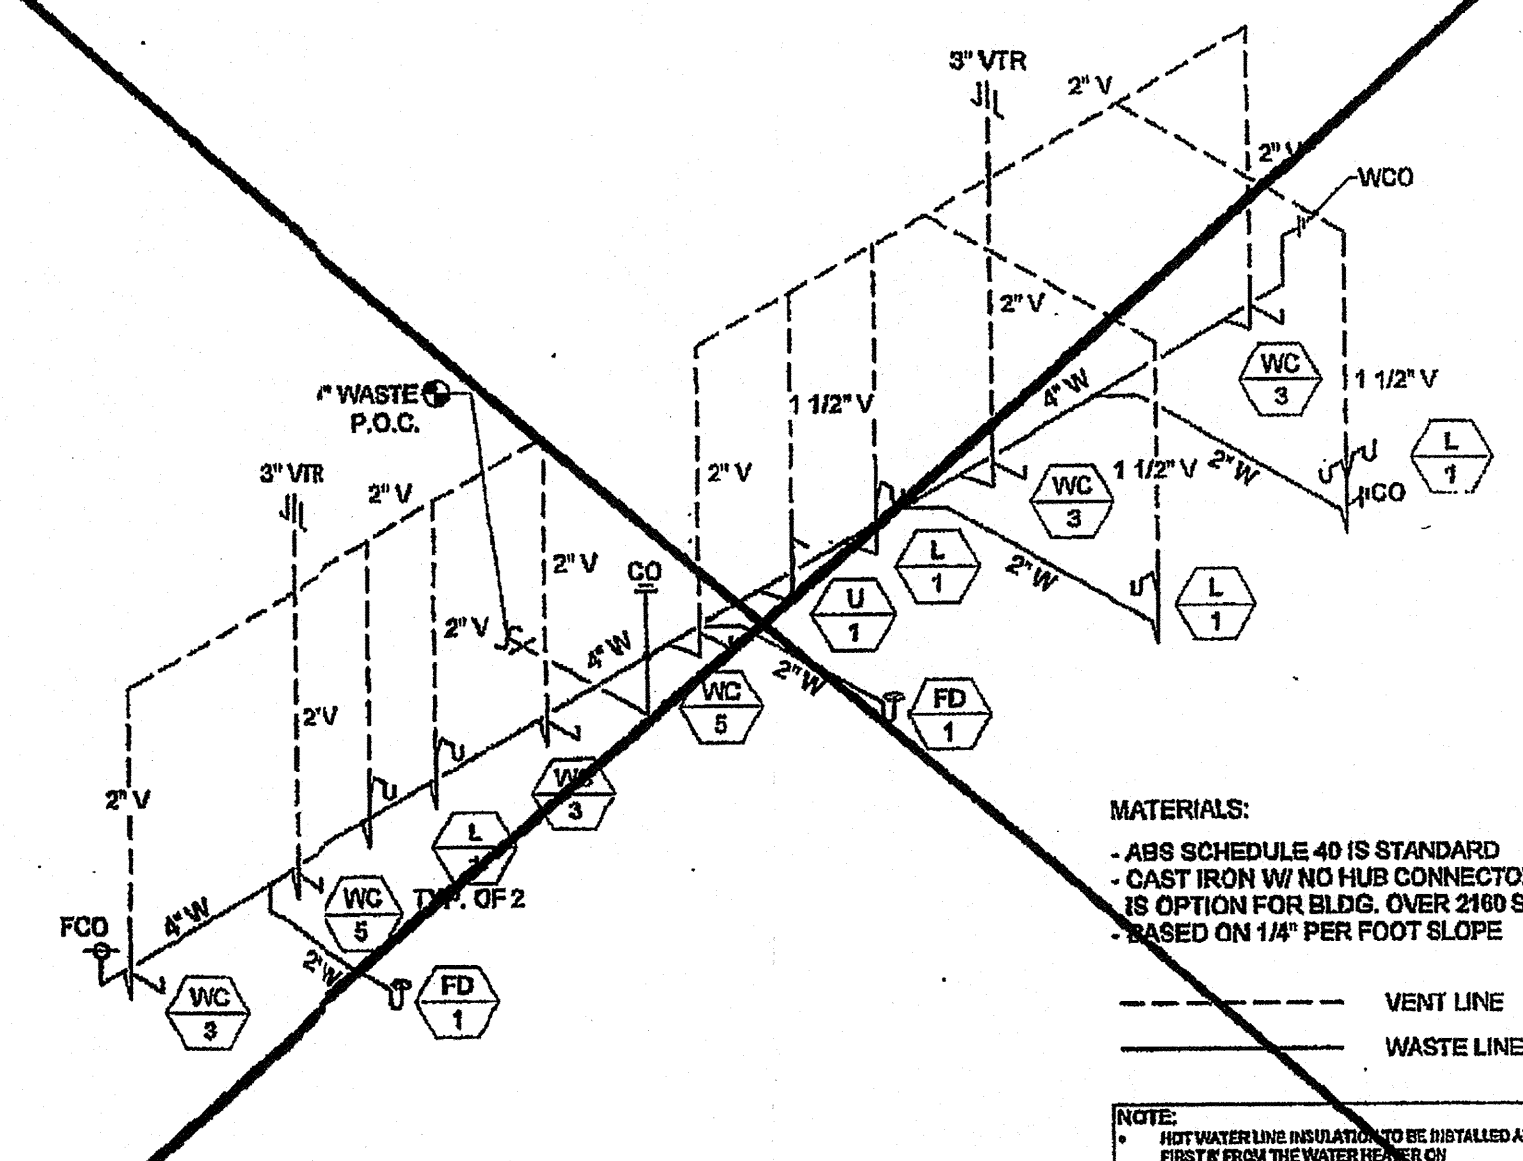

MODEL C-1  
WASTE AND VENTING ISOMETRIC - FLOOR MOUNT

SCALE: N.T.S. 5


NOTE:  
HOT WATER LINE INSULATION TO BE INSTALLED AT FIRST F FROM THE WATER HEATER ON NON-RECIRCULATING SYSTEMS  
ALL HOT WATER LINES TO BE INSULATED WHEN RECIRCULATING SYSTEMS ARE USED.

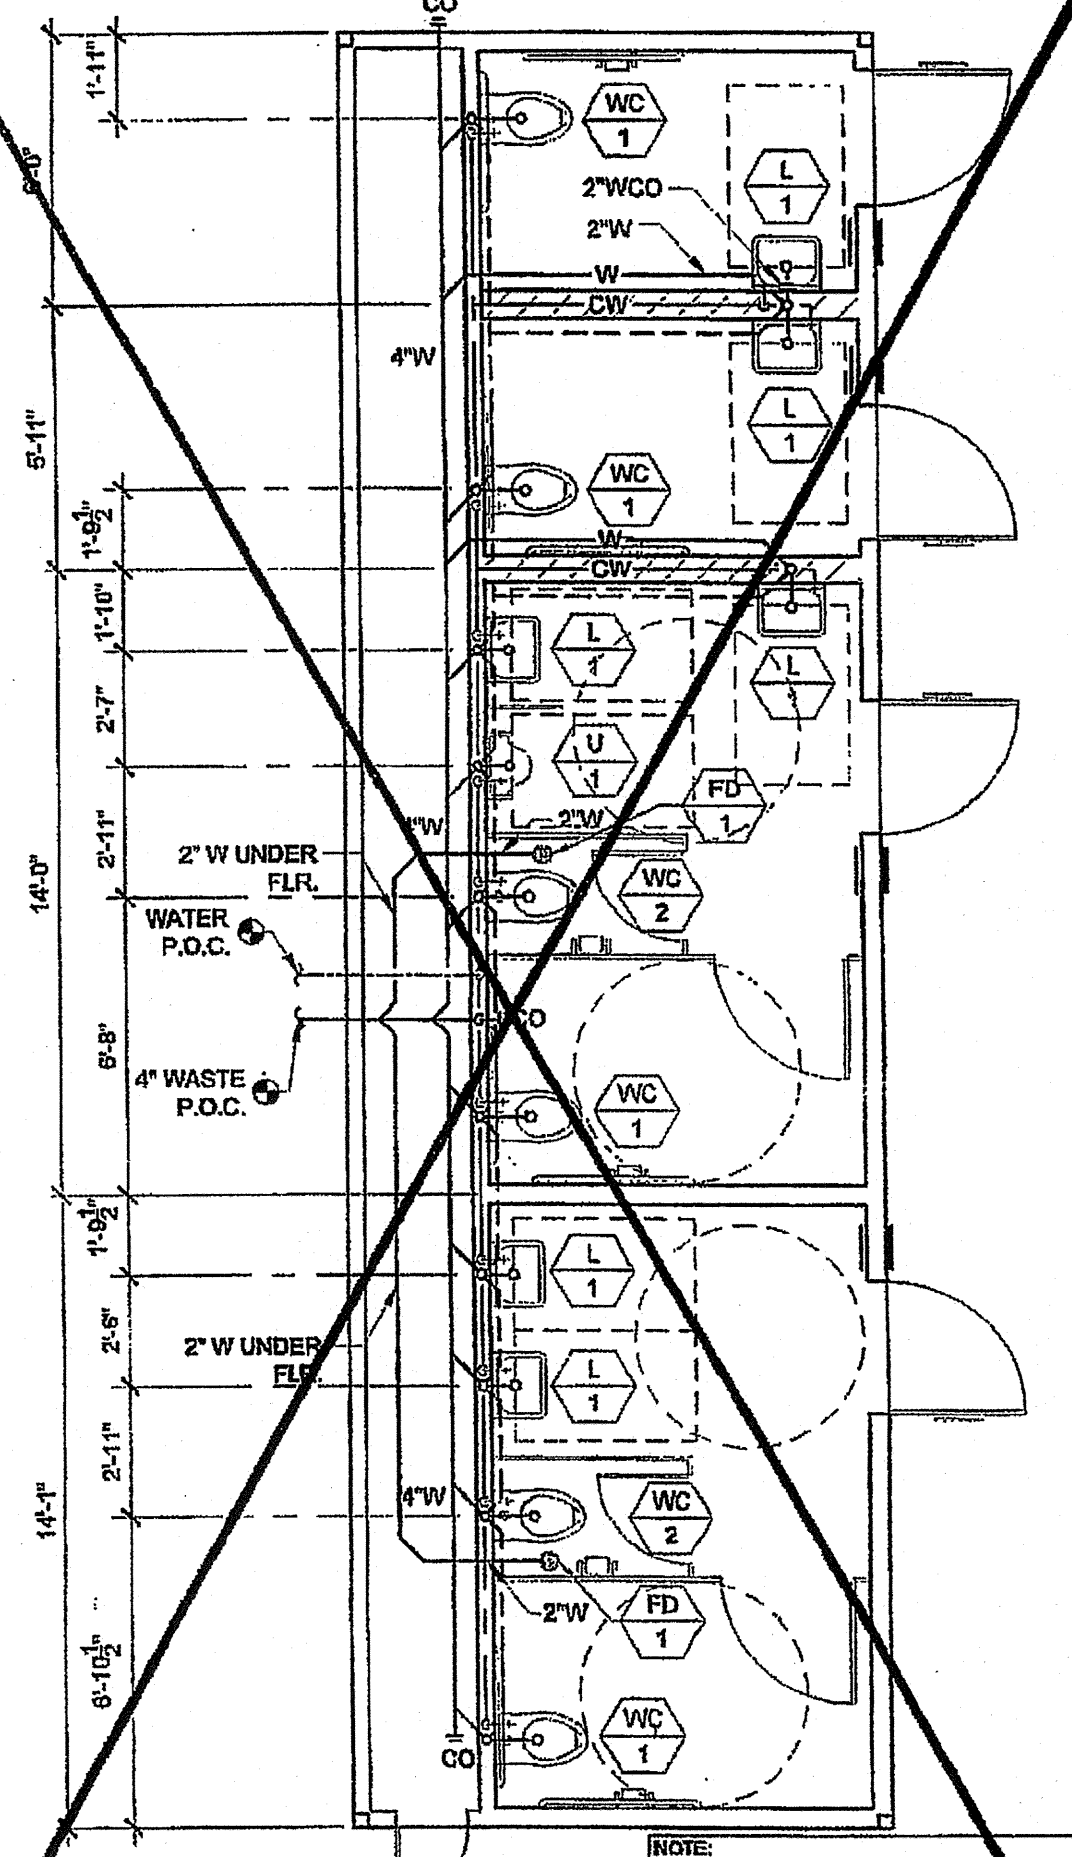

WALL MOUNT - MODEL C-1  
PLUMBING PLAN

SCALE: 1/4" = 1'-0" 1

NOTE:  
HOT WATER LINE INSULATION TO BE INSTALLED AT FIRST F FROM THE WATER HEATER ON NON-RECIRCULATING SYSTEMS  
ALL HOT WATER LINES TO BE INSULATED WHEN RECIRCULATING SYSTEMS ARE USED.

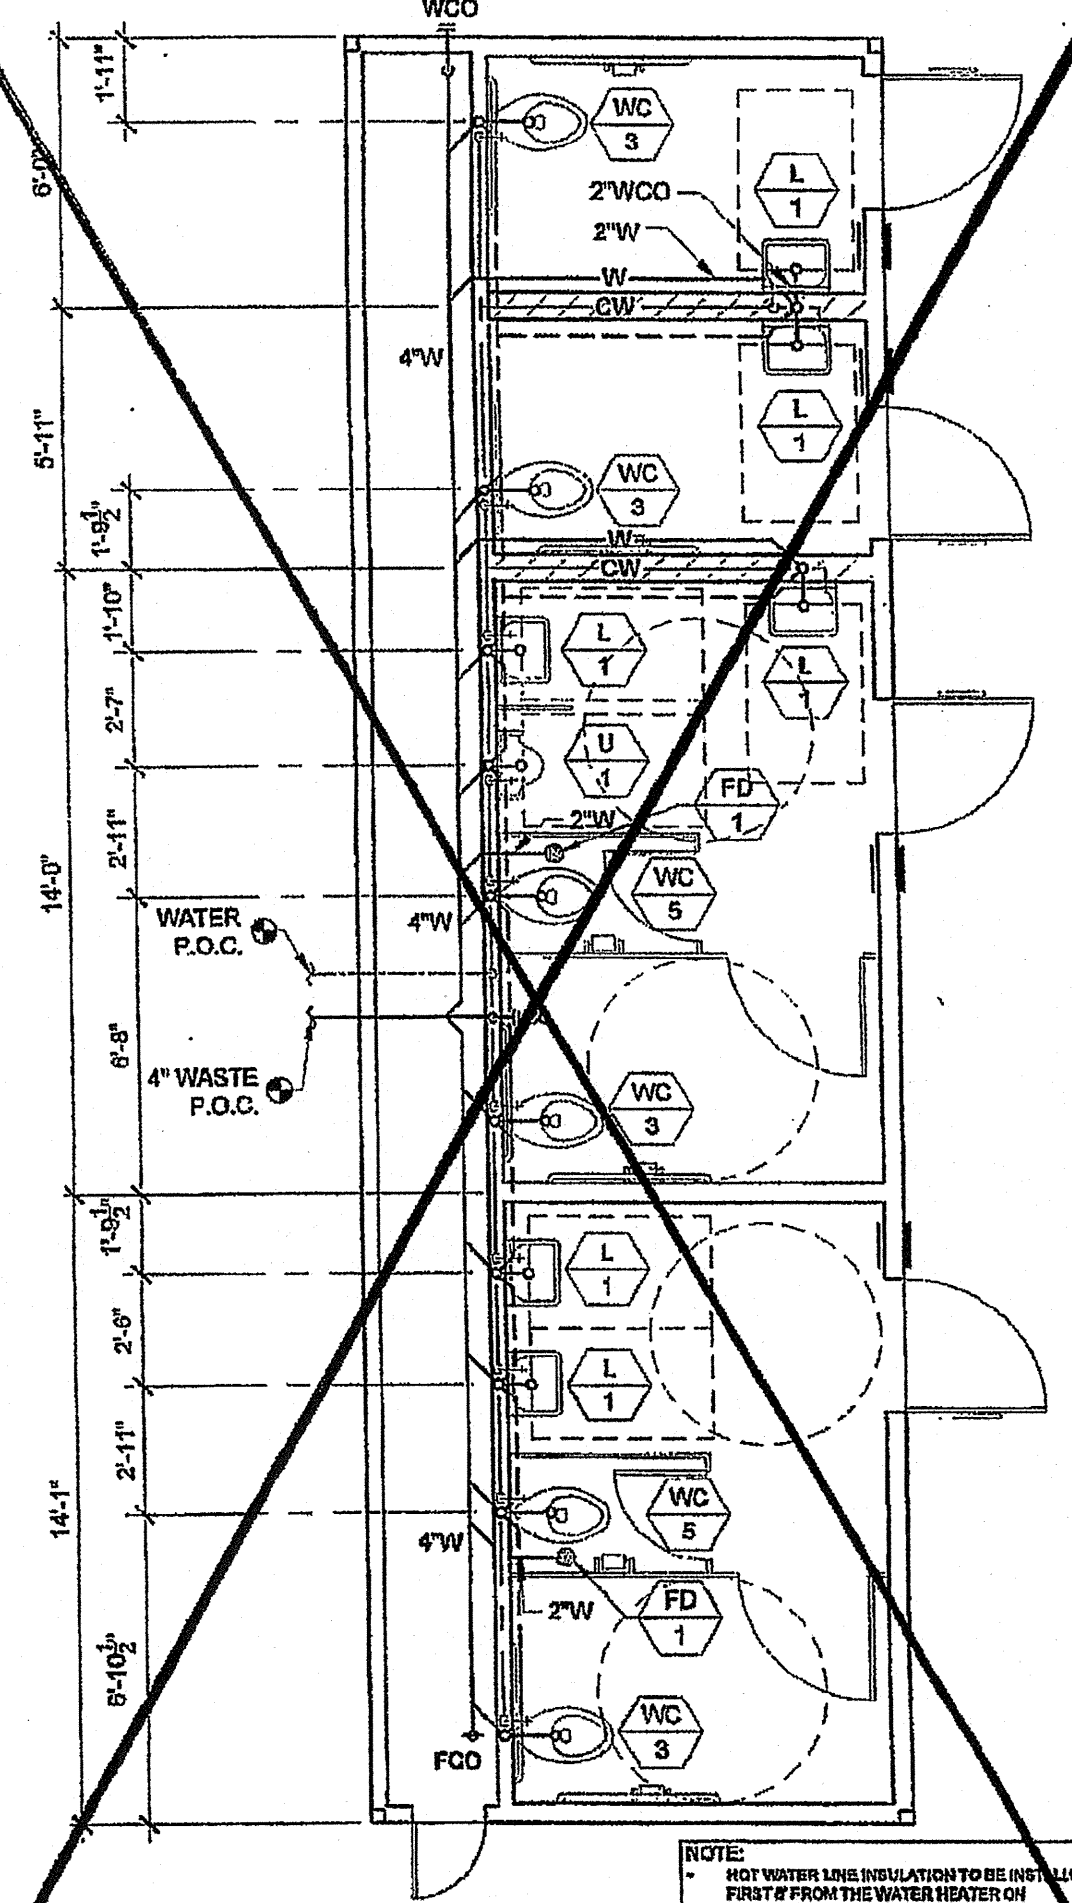

FLOOR MOUNT - MODEL C-1  
PLUMBING PLAN

SCALE: 1/4" = 1'-0" 2

NOTE:  
HOT WATER LINE INSULATION TO BE INSTALLED AT FIRST F FROM THE WATER HEATER ON NON-RECIRCULATING SYSTEMS  
ALL HOT WATER LINES TO BE INSULATED WHEN RECIRCULATING SYSTEMS ARE USED.

THESE DRAWINGS AND ALL MATERIAL CONTAINED HEREIN ARE THE PROPERTY OF SILVERCREEK INDUSTRIES, INC (SCI INC) AND SHALL NOT BE REPRODUCED, COPIED OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY AND SHALL NOT BE USED IN WHOLE OR IN PART TO ASSIST IN THE MAKING OF OR FOR THE PURPOSE OF FURNISHING ANY INFORMATION FOR THE MAKING OF DRAWINGS, PRINTS, APPARATUS OR PARTS THEREOF WITHOUT THE FULL KNOWLEDGE AND WRITTEN CONSENT OF SCI INC. ALL PATENTABLE MATERIAL CONTAINED HEREIN AND ORIGINATING WITH SCI INC SHALL BE THE PROPERTY OF SCI INC



SILVER CREEK INDUSTRIES, INC.



195 EAST MORGAN PERRIS, CALIFORNIA 92571  
PHONE: 951-943-5393 FAX: 951-943-2211


PROJECT NAME:  
**Class Leasing**

SHEET TITLE:  
**PLUMBING PLAN AND ISOMETRICS MODEL G-4 OR C-2 "ADULT"**

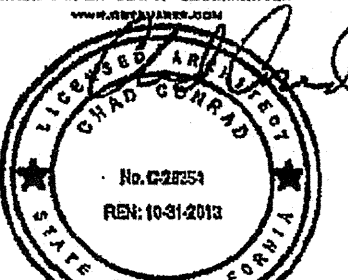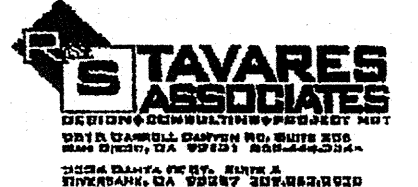

12/28/2011

ARCHITECT OF RECORD  
SUBMISSION DATE:  
IDENTIFICATION STAMP  
DIV. OF THE STATE ARCHITECT  
APPROX 115891  
AC FLS SS  
DATE 7/24/11

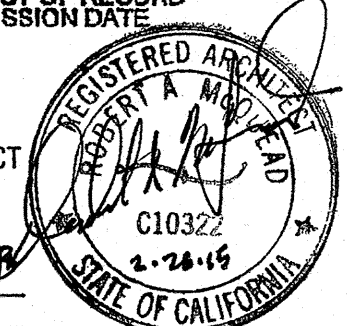

PROJECT SPECIFIC STATE AGENCY APPROVAL  
IDENTIFICATION STAMP  
DIV. OF THE STATE ARCHITECT  
OFFICE OF REGULATION SERVICES  
04 113309  
AC FLS SS DW  
DATE DEC 19 2011

ORIGINAL PC STATE AGENCY APPROVAL  
IDENTIFICATION STAMP  
DIV. OF THE STATE ARCHITECT  
OFFICE OF REGULATION SERVICES  
PC 04-112137  
AC FLS SS DW  
DATE DEC 27 2011

NO.	REVISIONS

SILVER CREEK INDUSTRIES  
12' x 40' PC  
PROJECT NO:  
DRAWN BY:  
SCALE: AS NOTED  
DATE: 6-17-11  
P.C. SHEET NUMBER

**P-1.03A**