


Electrical Engineer & Seal


Mechanical Engineer & Seal

Engineer & Seal

Architect Seal

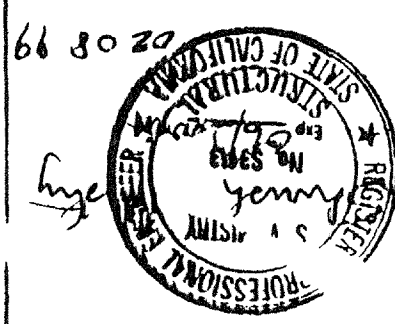

Division of the State Architect
REVISED
 IDENTIFICATION STAMP
 DIV. OF REGULATION SERVICES
 OFFICE OF THE STATE ARCHITECT
PC-270
 DATE: FEB 19 1999

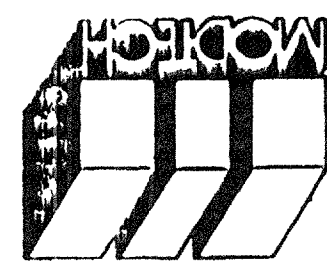

MODTECH INC.
 2830 BARRETT AVENUE
 PERRIS, CALIF. 92572
 PH (909) 943-4014
 FAX (909) 940-0427

REFLECTED CEILING PLAN

PROJECT MJB © MODTECH INC 1999

DRAWN BY MVR
 DATE: 2-2-99
 CHECKED BY SCS
 PROJECT NO.
 MODTECH Index No.


A7.0

PROJECT NO. PC-270

FILE PATH

REFLECTED CEILING PLAN (24'X40')

SCALE 1/4" = 1'

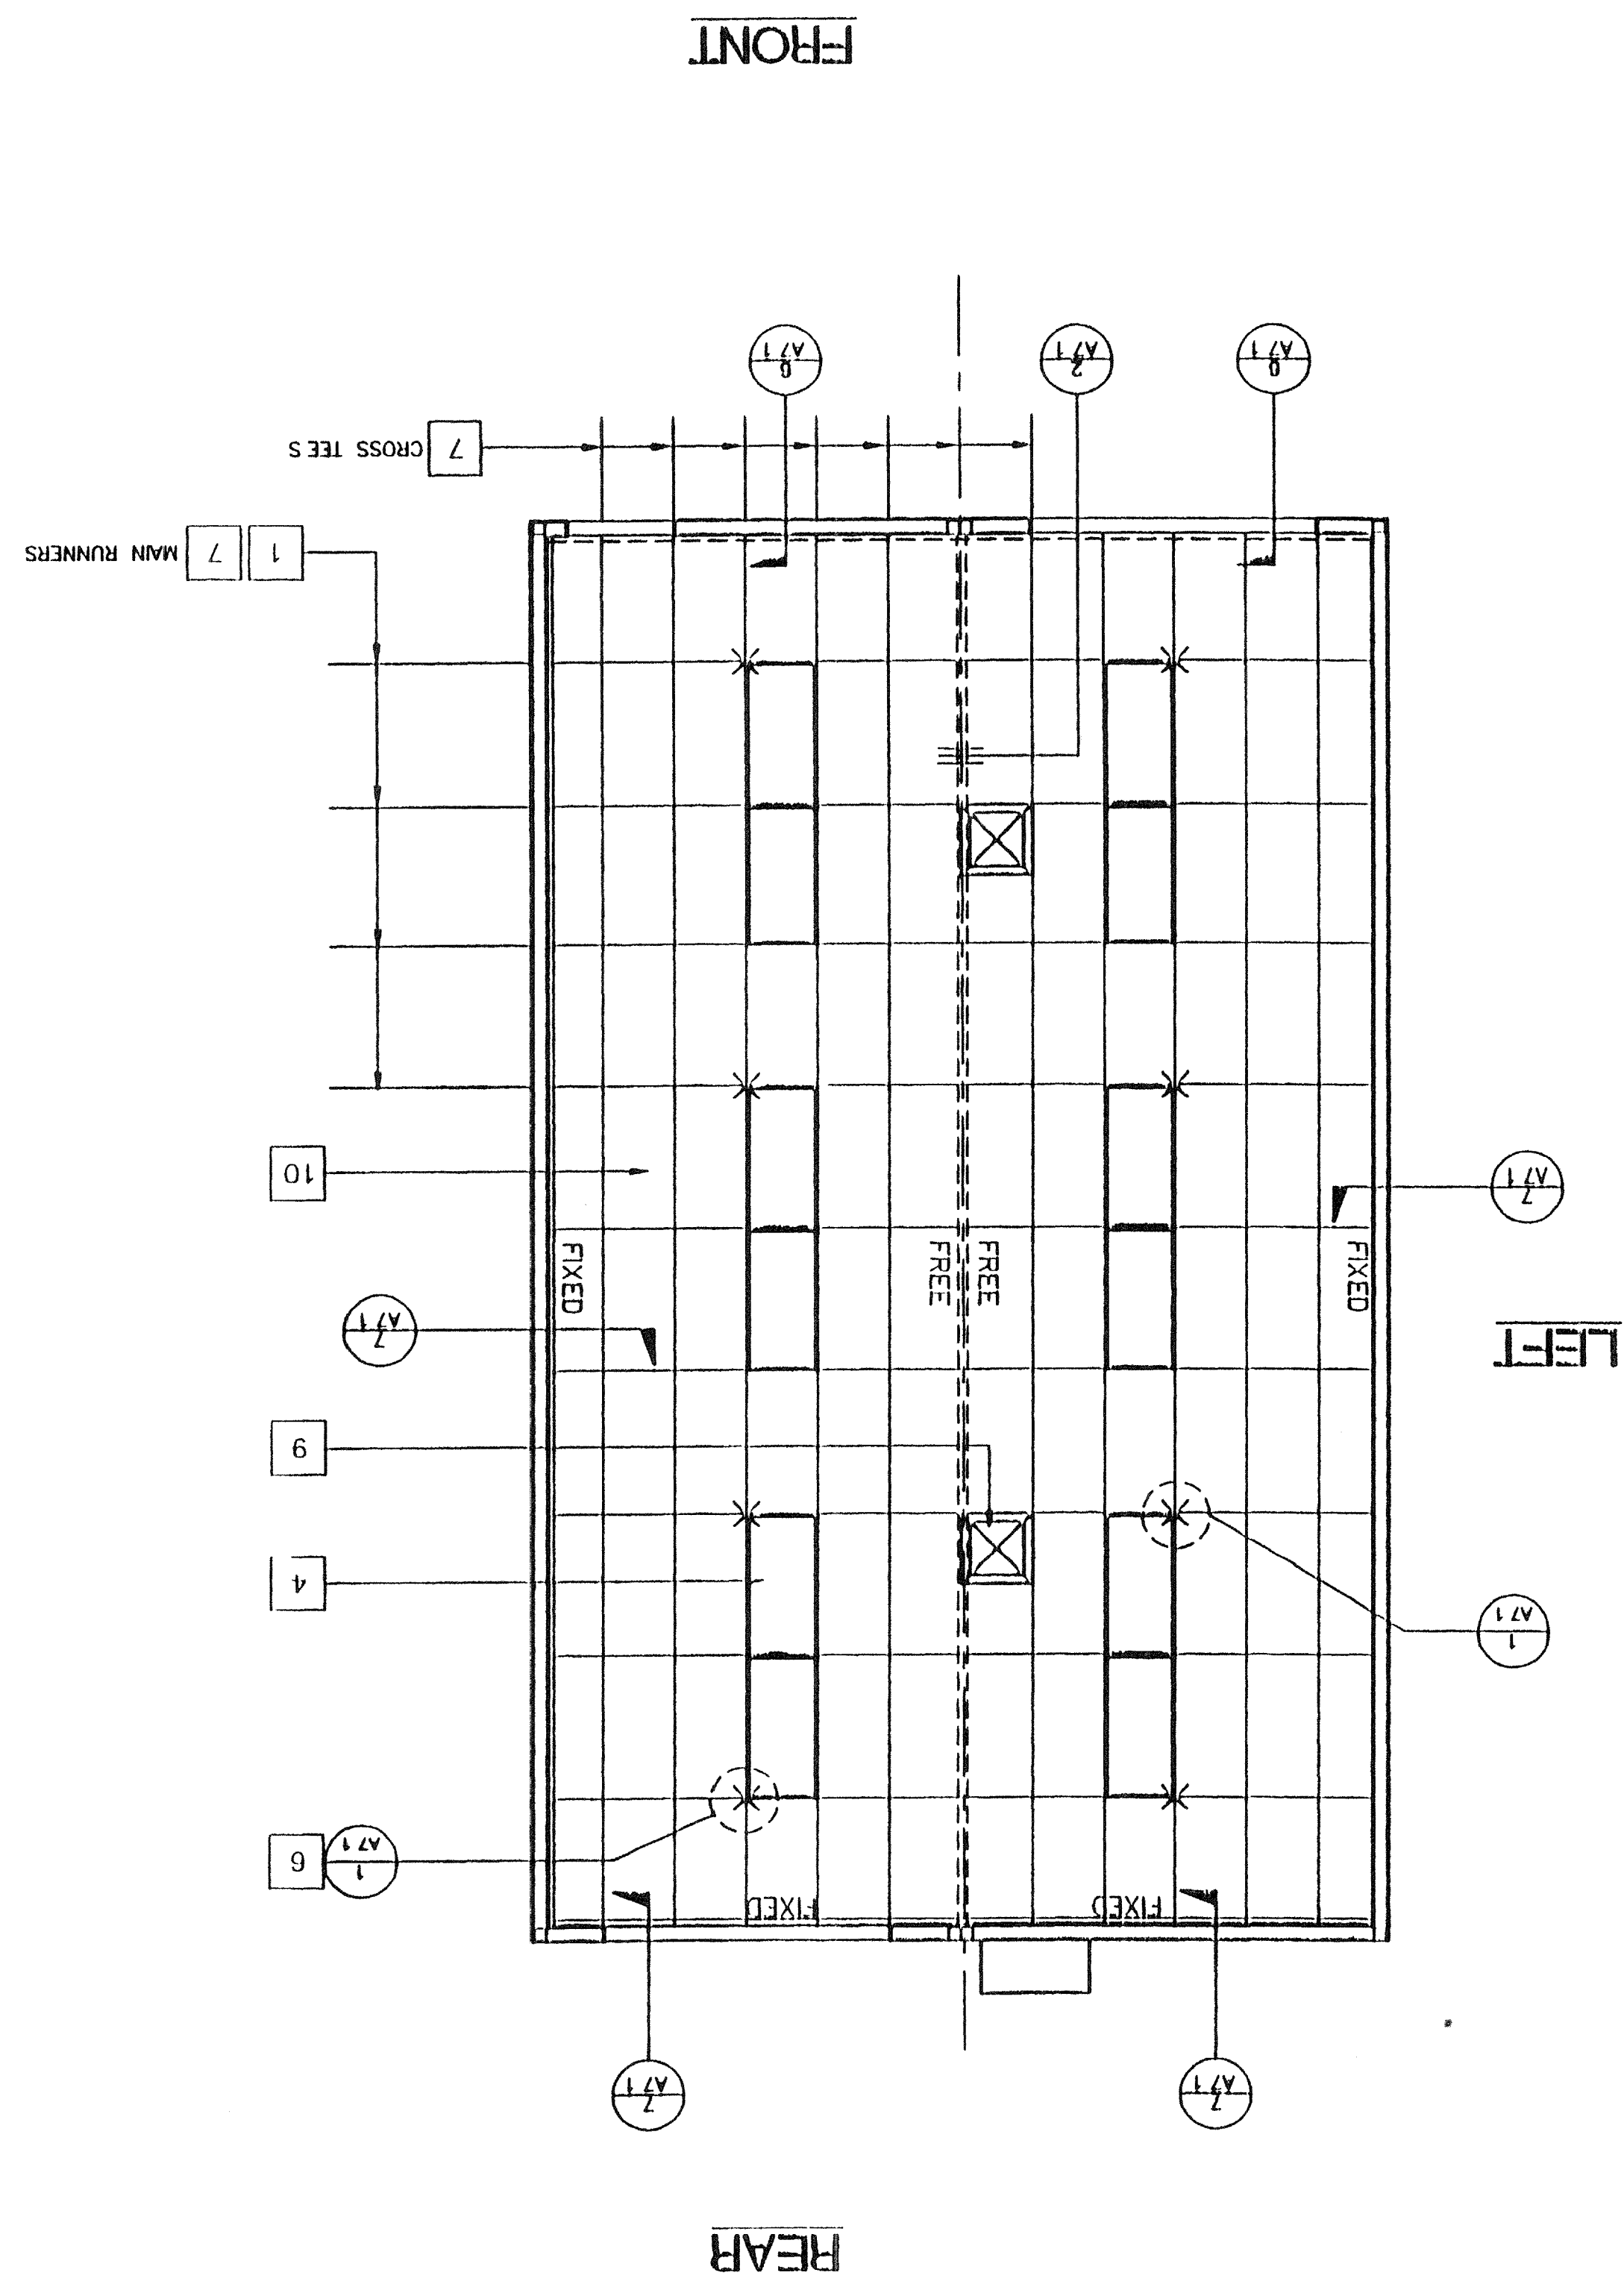

LEGEND

- 1 & 1 BAR CEILING
- 2 X 4 ELEG. FIXTURE RECESSED
- SUPPLY AIR DIFFUSER
- RETURN AIR DIFFUSER
- SPLV WIRE 4 WAY
- INDICATES FIXED SIDE (SEE DETAIL 7/A7.1)
- INDICATES FREE SIDE (SEE DETAIL 6/A7.1)

KEY NOTES

- 1 MAIN RUNNERS @ 4'-0" W/12GA HANGER WIRE, @ END OF EACH RUNNER
- 2 HANGER WIRE SHALL BE ATTACHED WITHIN 8" OF WALL OR SOFTEN
- 3 VERTICAL WIRES MORE THAN 1-IN-6 OUT OF PLUMB SHALL HAVE COUNTERBRACING WIRES
- 4 PROVIDE 2-12GA SLACK WIRES TO HOUSING OF ALL LIGHT FIXTURES AT DIAGONAL CORNERS. WIRES SHALL BE ATTACHED TO STRUCTURE OF RECESSED ATTACH FIXTURE TO GRID W/1-#8 METAL SCREW AT EACH CORNER
- 5 RUNNERS MAY BE ATTACHED TO WALLS OR MOLD AT 2-ADJACENT WALLS OTHER WALLS NO ATTACHMENT CLEARANCE OF 1/2" BETWEEN END OF RUNNERS AND FACE OF WALL
- 6 CEILING ARTAS SHALL HAVE 2/4-WAY SPLAYS PER DETAIL 1 ON SHEET A7.1 IN LOCATIONS INDICATED ON DRAWINGS. WIRES TAUT BUT NOT TO DISTORT GRID
- 7 **T-BAR PART NUMBERS**

AMSTRONG	PA-041	RUNNER MAIN	7301D	4 CROSS TEE	7343	2' CROSS TEE	7328	WALL ANGL	7800D
----------	--------	-------------	-------	-------------	------	--------------	------	-----------	-------

- 8 DUCTWORK SHALL BE RIGIDLY ATTACHED TO BUILDING AND SHALL NOT BE CLOSER THAN 6" TO HANGER WIRES
- 9 REGISTERS SHALL BE POSITIVELY ATTACHED W/4-10X SHEET METAL SCREWS (1-1" AT EACH CORNER)
- 10 CEILING PANELS 2910

REVISED
 RPP
 JUL 1999
 MAY 20 1999