

STRUCTURAL DESIGN VALUES

All values reported are unfactored and strength level, unless noted otherwise

Gravity Design Data		Value
Dead Loads:		
Electronic Sign		800 lbs.
Wind Design Data		Value
Design Wind Speed (3-sec gust), V_{ULT}		115 mph
Design Wind Speed (3-sec gust), V_{ASD}		85 mph
Risk Category		III
Exposure Category		C
Applicable Internal Pressure Coefficient		± 0.18
Design Wind Pressure(s)		$q_s = 24.8$ psf
Design Wind Force		$F = 1,730$ lbs.
Earthquake Design Data		Value
Risk Category		III
Importance Factor, I_e		1.25
Mapped Spectral Response Accelerations		$S_m = 1.089$ g $S_s = 0.404$ g
Site Class		D
Spectral Response Coefficients		$S_{ap} = 0.773$ g $S_{wp} = 0.430$ g
Seismic Design Category		D
Analysis Procedure Used	Equivalent Lateral Force Procedure (ASCE 7, 12.8)	
Nonbuilding Structure, not Similar to Building System	Signs and Billboards, Chapter 15 ASCE 7-10	
Response Modification Factor		$R = 3$
Seismic Response Coefficient		$C_s = 0.323$
Design Base Shear		$V = 570$ lbs.
Geotechnical Design Data		Value
Geotechnical Report prepared by: 2016 California Building Code, Chapter 18A		
Allowable Soil Bearing Pressure (DL + LL)		1500 psf
Design Passive Pressure, Unconstrained, P_p		100 pcf
Design Skin Friction, f_s		100 psf

SPECIAL INSPECTION

GENERAL NOTES

- All Special Inspection shall be provided in accordance with CBC Section 1704A and 1705A.
- Where Special Inspection is required, all inspection or testing shall be provided by an "approved agency" in accordance with CBC Section 1702A.1, 1703A.1 and 1704A.1.
- Special Inspectors shall keep records of inspections. The Special Inspector shall furnish inspection reports to the Authority Having Jurisdiction, and to the Architect or Engineer of Record. Reports shall indicate that work inspected was done in conformance to approved construction documents. Discrepancies shall be brought to the immediate attention of the contractor for correction. If the discrepancies are not corrected, the discrepancies shall be brought to the attention of the Authority Having Jurisdiction and to the Architect or Engineer of Record prior to the completion of that phase of work. A final report documenting required Special Inspections and correction of any discrepancies noted in the inspections shall be submitted at a point in time agreed upon by the permit applicant and the Authority Having Jurisdiction prior to the start of work.
- Special Inspectors shall be approved by local Authority Having Jurisdiction in accordance with CBC Section 1704A.2.1.
- Local Authority Having Jurisdictions may require Special Inspection for "Special Cases" in accordance with CBC Section 1705A.1.1
- Contractor's responsibility: Each contractor responsible for the construction of a Main Lateral-Force-Resisting System, listed in the Statement of Special Inspection shall submit a written statement of responsibility to the Authority Having Jurisdiction and the owner prior to the commencement of work on the system or component. The contractor's statement of responsibility shall contain the following:
 - Acknowledgement of awareness of the special requirements contained in the statement of special inspections;
 - Acknowledgement that control will be exercised to obtain conformance with the construction documents approved by the Authority Having Jurisdiction;
 - Procedures for exercised control within the contractor's organization, the method and frequency of reporting and the distribution of the reports; and
 - Identification and qualifications of the person(s) exercising such control and their position(s) in the organization.
- Refer to Special Inspection requirements by other disciplines not included herein.

CONCRETE CONSTRUCTION^{AO}

Verification and Inspection	Continuous	Periodic
1. Inspection of reinforcing steel including prestressing tendons, and placement. ²		✓
2. Inspection of reinforcing steel welding in accordance with Table 1705.2.2, Item 5b. ^d		✓
3. Inspection of anchors cast in concrete. ^e		✓
4. Inspection of anchors post installed in hardened concrete members. ^{2,4,6}		✓
5. Verifying use of required design mix. ⁸		✓
6. At the time fresh concrete is sampled to fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete. ^h	✓	
7. Inspection of concrete and shotcrete placement for proper application techniques. ¹	✓	
8. Inspection for maintenance of specified curing temperature and techniques. ¹		✓
9. Inspection of prestressed concrete. ² a. Application of prestressing forces b. Grouting of bonded prestressing tendons in the Seismic Force-Resisting System	✓	
10. Erection of precast concrete members. ¹		✓
11. Verification of in-situ concrete strength, prior to stressing of tendons in post-tensioned concrete and prior to removal of shores and forms from beams and structural slabs. ⁶		✓
12. Inspect formwork for shape, location and dimensions of the concrete member being formed. ¹		✓

Notes: Concrete Construction

- Where applicable, see also CBC Section 1705A.12, Special Inspections for seismic resistance
- Specific requirements for Special Inspection shall be included in the research report for the anchor issued by an approved source in accordance with ACI 318-14 Section 17.8.2 or other requirements. Where specific requirements are not provided, Special Inspection requirements shall be specified by the Registered Design Professional and shall be approved by the Building Official prior to the commencement of the work.
- ACI 318: Ch. 20, 25.2, 25.3, 26.5-1-26.5.3, CBC: 1908A.4
- AWS D1.4, ACI 318: 26.5.4
- ACI 318: 17.8.2
- ACI 318: 17.8.2.4, 17.8.2
- ACI 318: Ch. 19, 26.4.3, 26.4.4, CBC: 1904A.1, 1904A.2
- ASTM C172, ASTM C31, ACI 318: 26.4.5, 26.12, CBC: 1908A.10, 1908A.2, 1908A.3
- ACI 318: 26.4.5, CBC: 1908A.6, 1908A.7, 1908A.8
- ACI 318: 26.4.7-26.4.9, CBC: 1908A.9
- ACI 318: 26.9.2.1, 26.9.2.3
- ACI 318: Ch. 26.8
- ACI 318: 26.10.2
- ACI 318: 26.10.1 (b)
- CBC Section 1705A.3 and Table 1705A.3
- See Special Cases Special Inspection for more requirements

STEEL CONSTRUCTION^{BO}

Verification and Inspection	Continuous	Periodic
Required verification and inspection of steel construction		
1. Material verification of structural steel, cold-formed steel deck, high-strength bolts, nuts and washers:		
a. For structural steel, identification markings to conform to AISI 360, or ASTM Standards Specified in approved Construction Documents. Manufacturer's certificate of compliance required.		✓
2. Material verification of structural steel or cold-form steel deck:		
a. Identification markings to conform to ASTM standards specified in the approved construction documents.		✓
b. Manufacturer's certified test reports.		✓
3. Inspection of high-strength bolting:		
a. Snug-tight joints		✓
b. Pretensioned and slip-critical joints using turn-of-nut with matchmarking, twist off bolt or direct tension indicator methods of installation		✓
c. Pretensioned and slip-critical joints using turn-of-nut without matchmarking or calibrated wrench methods of installation	✓	
4. Material verification of weld filler materials:		
a. Identification markings to conform to AWS specification in the approved Construction Documents		✓
b. Manufacturer's certificate of compliance required		✓
5. Inspection of welding:		
a. Structural steel and cold formed steel deck:		
1) Complete and partial joint penetration groove welds	✓	
2) Multi-pass fillet welds	✓	
3) Single-pass fillet welds > 3/16"	✓	
4) Plug and slot welds	✓	
5) Single-pass fillet welds < 3/16"		✓
6) Floor and roof deck welds ^c		✓
b. Reinforcing steel: ^d		
1) Verification of weldability of reinforcing steel other than ASTM A706.		✓
2) Reinforcing steel resisting flexural and axial forces in intermediate and special moment frames, and boundary elements of special structural walls of concrete and shear reinforcement.	✓	
3) Shear reinforcement	✓	
4) Other reinforcing steel		✓
6. Inspection of steel frame joint details for compliance:		
a. Details such as bracing and stiffening		✓
b. Member locations		✓
c. Application of joint details at each connection		✓
Inspection tasks prior to welding		
1. Welding procedure specifications (WSPs) available	✓	
2. Manufacturer certifications for welding consumables available	✓	
3. Material identification (type/grade)		✓
4. Welder identification system ^g		✓
5. Fit-up of groove welds (including joint geometry) Joint preparation, dimensions, cleanliness, tacking, backing type and fit		✓
6. Configuration and finish of access holes		✓
7. Fit-up of fillet welds Dimensions, cleanliness, tacking		✓
8. Check welding equipment		
Inspection tasks during welding		
1. Use of qualified welders		✓
2. Control and handling of welding consumables Packaging, exposure control		✓
3. No welding over cracked tack welds		✓
4. Environmental conditions Wind speed within limits, precipitation and temperature		✓

STEEL CONSTRUCTION, CONTINUED

Verification and Inspection	Continuous	Periodic
Inspection tasks during welding (Continued)		
5. WPS followed Settings on welding equipment, travel speed, selected welding materials, shielding gas type/flow rate, preheat applied, interpass temperature maintained min./max., proper position (F, V, H, OH)		✓
6. Welding techniques Interpass and final cleaning, each pass within profile limitations		✓
Inspection tasks after welding		
1. Welds cleaned		✓
2. Size, length and location of welds	✓	
3. Welds meet visual acceptance criteria Crack prohibition, weld/base-metal fusion, crater cross section, weld profiles, weld size, undercut, porosity	✓	
4. Arc strikes	✓	
5. K-Area ⁷	✓	
6. Backing removed and weld tabs removed (if required)	✓	
7. Repair activities	✓	
8. Document acceptance or rejection of welded joint or member	✓	
Inspection tasks prior to bolting ⁸		
1. Manufacturer's certifications available for fastener materials	✓	
2. Fasteners marked in accordance with ASTM requirements		✓
3. Proper fasteners selected for the joint detail (grade, type, bolt length if threads are to be excluded from shear plane)		✓
4. Proper bolting procedure selected for joint detail		✓
5. Connecting elements, including the appropriate faying surface condition and hole preparation, if specified, meet applicable requirements		✓
6. Pre-installation certification testing by installation personnel observed and documented for fastener assemblies and methods used		✓
7. Proper storage provided for bolts, nuts, washer and other fastener components		✓
Inspection tasks during bolting		
1. Fastener assemblies, of suitable condition, placed in all holes and washers (if required) are positioned as required		✓
2. Joint brought to the snug-tight condition prior to the pretensioning operation		✓
3. Fastener component not turned by the wrench prevented from rotating		✓
4. Fasteners are pretensioned in accordance with the RCSC specification, progressing systematically from the most rigid point toward the free edges, see Minimum Bolt Pretension table below		✓
Inspection tasks after bolting		
1. Document acceptance or rejection of bolted connections	✓	
Notes: Steel Construction		
a. CBC Section 1705A.2 and Table 1705A.2.2		
b. CBC Section 1707A.11.1		
c. AWS D1.3		
d. AWS D1.4, ACI 318: Section 3.5.2		
e. The fabricator or erector, as applicable, shall maintain a system by which a welder who has welded a joint or member can be identified. Stamps, if used, shall be the low-stress type.		
f. When welding of doubler plates, continuity plates or stiffeners has been performed in the k-area, visually inspect the web k-area for cracks within 3 inches of the weld		
g. All methods of installation for high strength bolts shall require verification of pre-tension by a Skidmore-Welch calibrator for each batch or source of bolts used (see minimum pre-tension chart below).		

CAST-IN-PLACE DEEP FOUNDATIONS⁹


Verification and Inspection	Continuous	Periodic
1. Inspect drilling operations and maintain complete and accurate records for each element.	✓	
2. Verify placement locations and plumbness, confirm element diameters, bell diameters (if applicable), lengths, embedment into bedrock (if applicable) and adequate end bearing strata capacity. Record concrete or grout volumes.	✓	
3. For concrete elements, perform additional inspections and see Concrete Construction chart, this sheet, in accordance with CBC Section 1705A.3.		

Notes: Cast-in-place Deep Foundations
a. CBC Section 1705A.8 and Table 1705A.8

PRIME CONSULTANT

ARCHITECTURE PLANNING

IBI San Luis Obispo
4119 Broad Street, Suite 210
San Luis Obispo, CA 93401
805.546.0433 fax: 805.546.0504

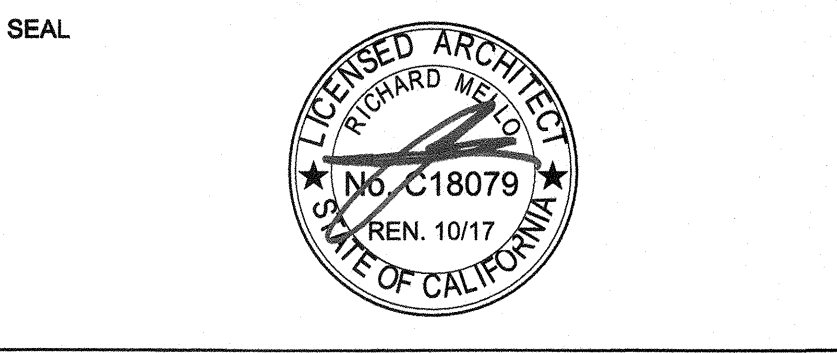

COPYRIGHT:
Any reproduction or distribution for any purpose other than authorized by IBI Group is forbidden.

COPYRIGHT 2017 IBI GROUP

REVISIONS

NO.	DATE	APPRD.	DESCRIPTION

CONSULTANT

SSG SMITH STRUCTURAL GROUP, LLP
811 E. Capitol Way, Suite 200 | 805-433-2110
San Luis Obispo, CA 93401 | smithstructural.com

REGISTERED PROFESSIONAL ENGINEER
MICHAEL E. PARSONS
No. 5405
STATE OF CALIFORNIA

DATE SIGNED:
10.25.17

THESE DRAWINGS, NOTES AND DETAILS ARE INSTRUMENTS OF SERVICE AND ARE THE PROPERTY OF SMITH STRUCTURAL GROUP, LLP. ALL DRAWINGS INFORMATION, OPERATIONS, IDEAS, DESIGNS AND ARRANGEMENTS REPRESENTED WITHIN THESE DOCUMENTS SHALL REMAIN THE PROPERTY OF THE ENGINEER. NO PART THEREOF SHALL BE COPIED, DISCLOSED TO OTHERS OR USED IN CONNECTION WITH ANY WORK OR PROJECT OTHER THAN THE SPECIFIC PROJECT FOR WHICH THEY HAVE BEEN PREPARED AND DEVELOPED WITHOUT THE EXPRESSED WRITTEN CONSENT OF THE ENGINEER. COPYRIGHT 2017.

AGENCY INFORMATION:

AGENCY TRACKING NO. 63321-271
FILE NO. 16-6

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES

03-118198
AC FLS SS CL
DATE OCT 25 2017

BAKERSFIELD CITY SCHOOL DISTRICT

ROOSEVELT E.S. - MARQUEE SIGN
2324 VERDE ST., BAKERSFIELD, CA 93304

OPSC or OSHPD PROJ. NO:

PROJECT NO:	17146.000
DRAWN BY:	SEA
CHKD BY:	JMM
ISSUE DATE:	10/25/2017

SHEET TITLE

STRUCTURAL NOTES

SHEET NUMBER

S1101

CONSTRUCTION DOCUMENTS